



# Kendoon to Tongland 132kV Reinforcement Project

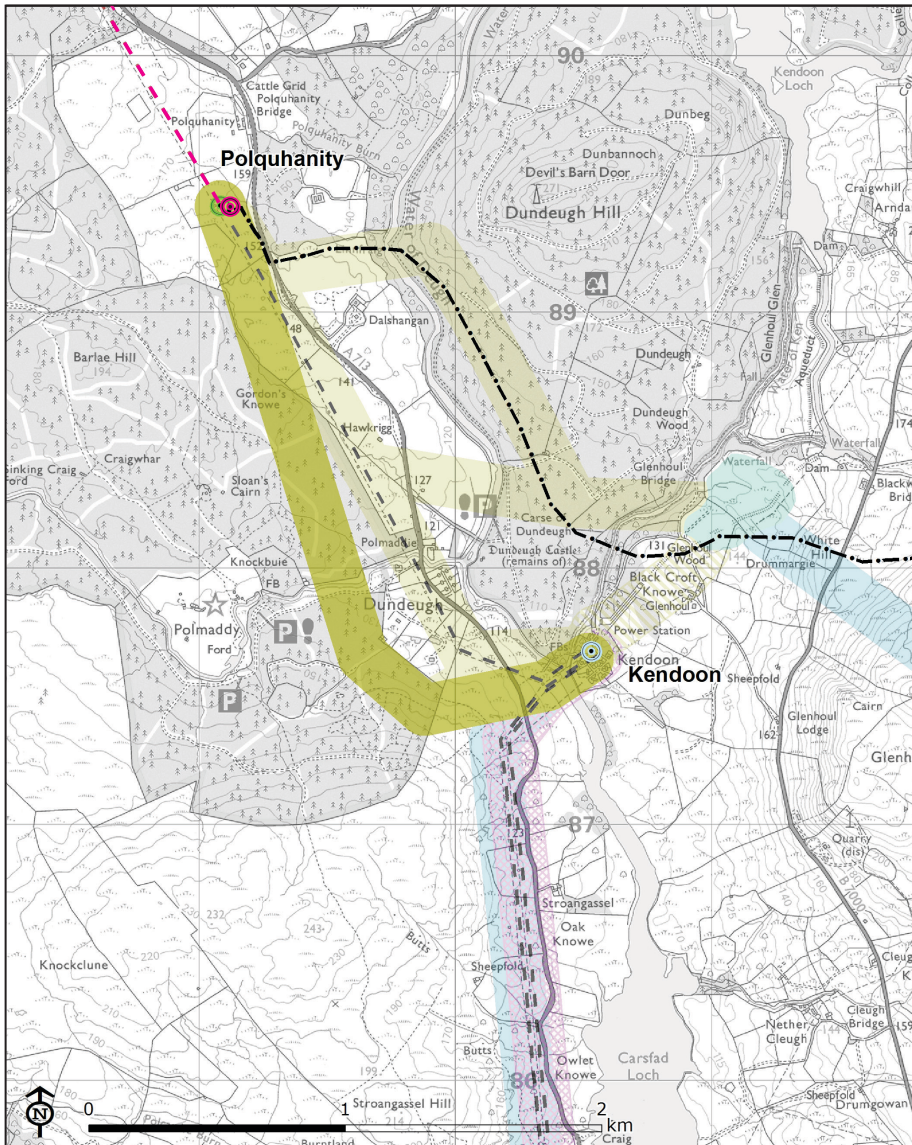

©Crown copyright 2016 OS 100057979

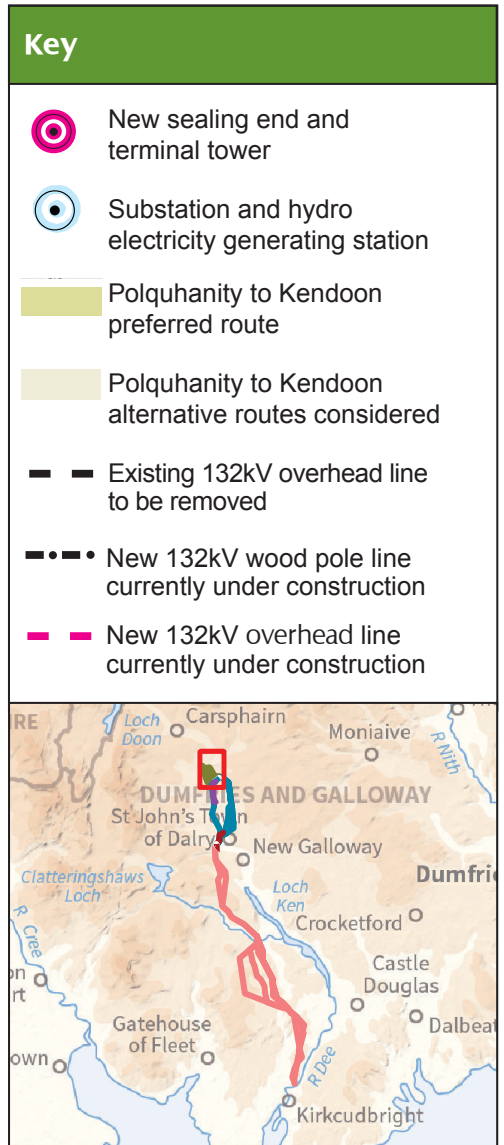

## Zone A: Polquhany to Kendoon

In this zone, the line starts at the point where another overhead line ends. It finishes at the existing Kendoon substation.

At the moment, the 132kV overhead line in this area is a mixture of single and double circuits supported on PL1 steel towers with a standard height of 20m. It will be replaced by a new double circuit 132kV overhead line supported on L7 steel towers with a standard height of 27m.

The substation at Kendoon may also need a small boundary extension to accommodate new connection works.

We identified six route options in Zone A. Our preferred one is the one furthest west. It heads south-east from Polquhany into coniferous forestry at the eastern edge of the Galloway Forest Park. It emerges from forestry south-west of Dundee Hill before turning east, north-east over the A713 and the Water of Ken to Kendoon substation.

[You can see this information in more detail in our Routing and Consultation document, elsewhere on this website.](#)