


11 The Preferred Route

Preferred Route

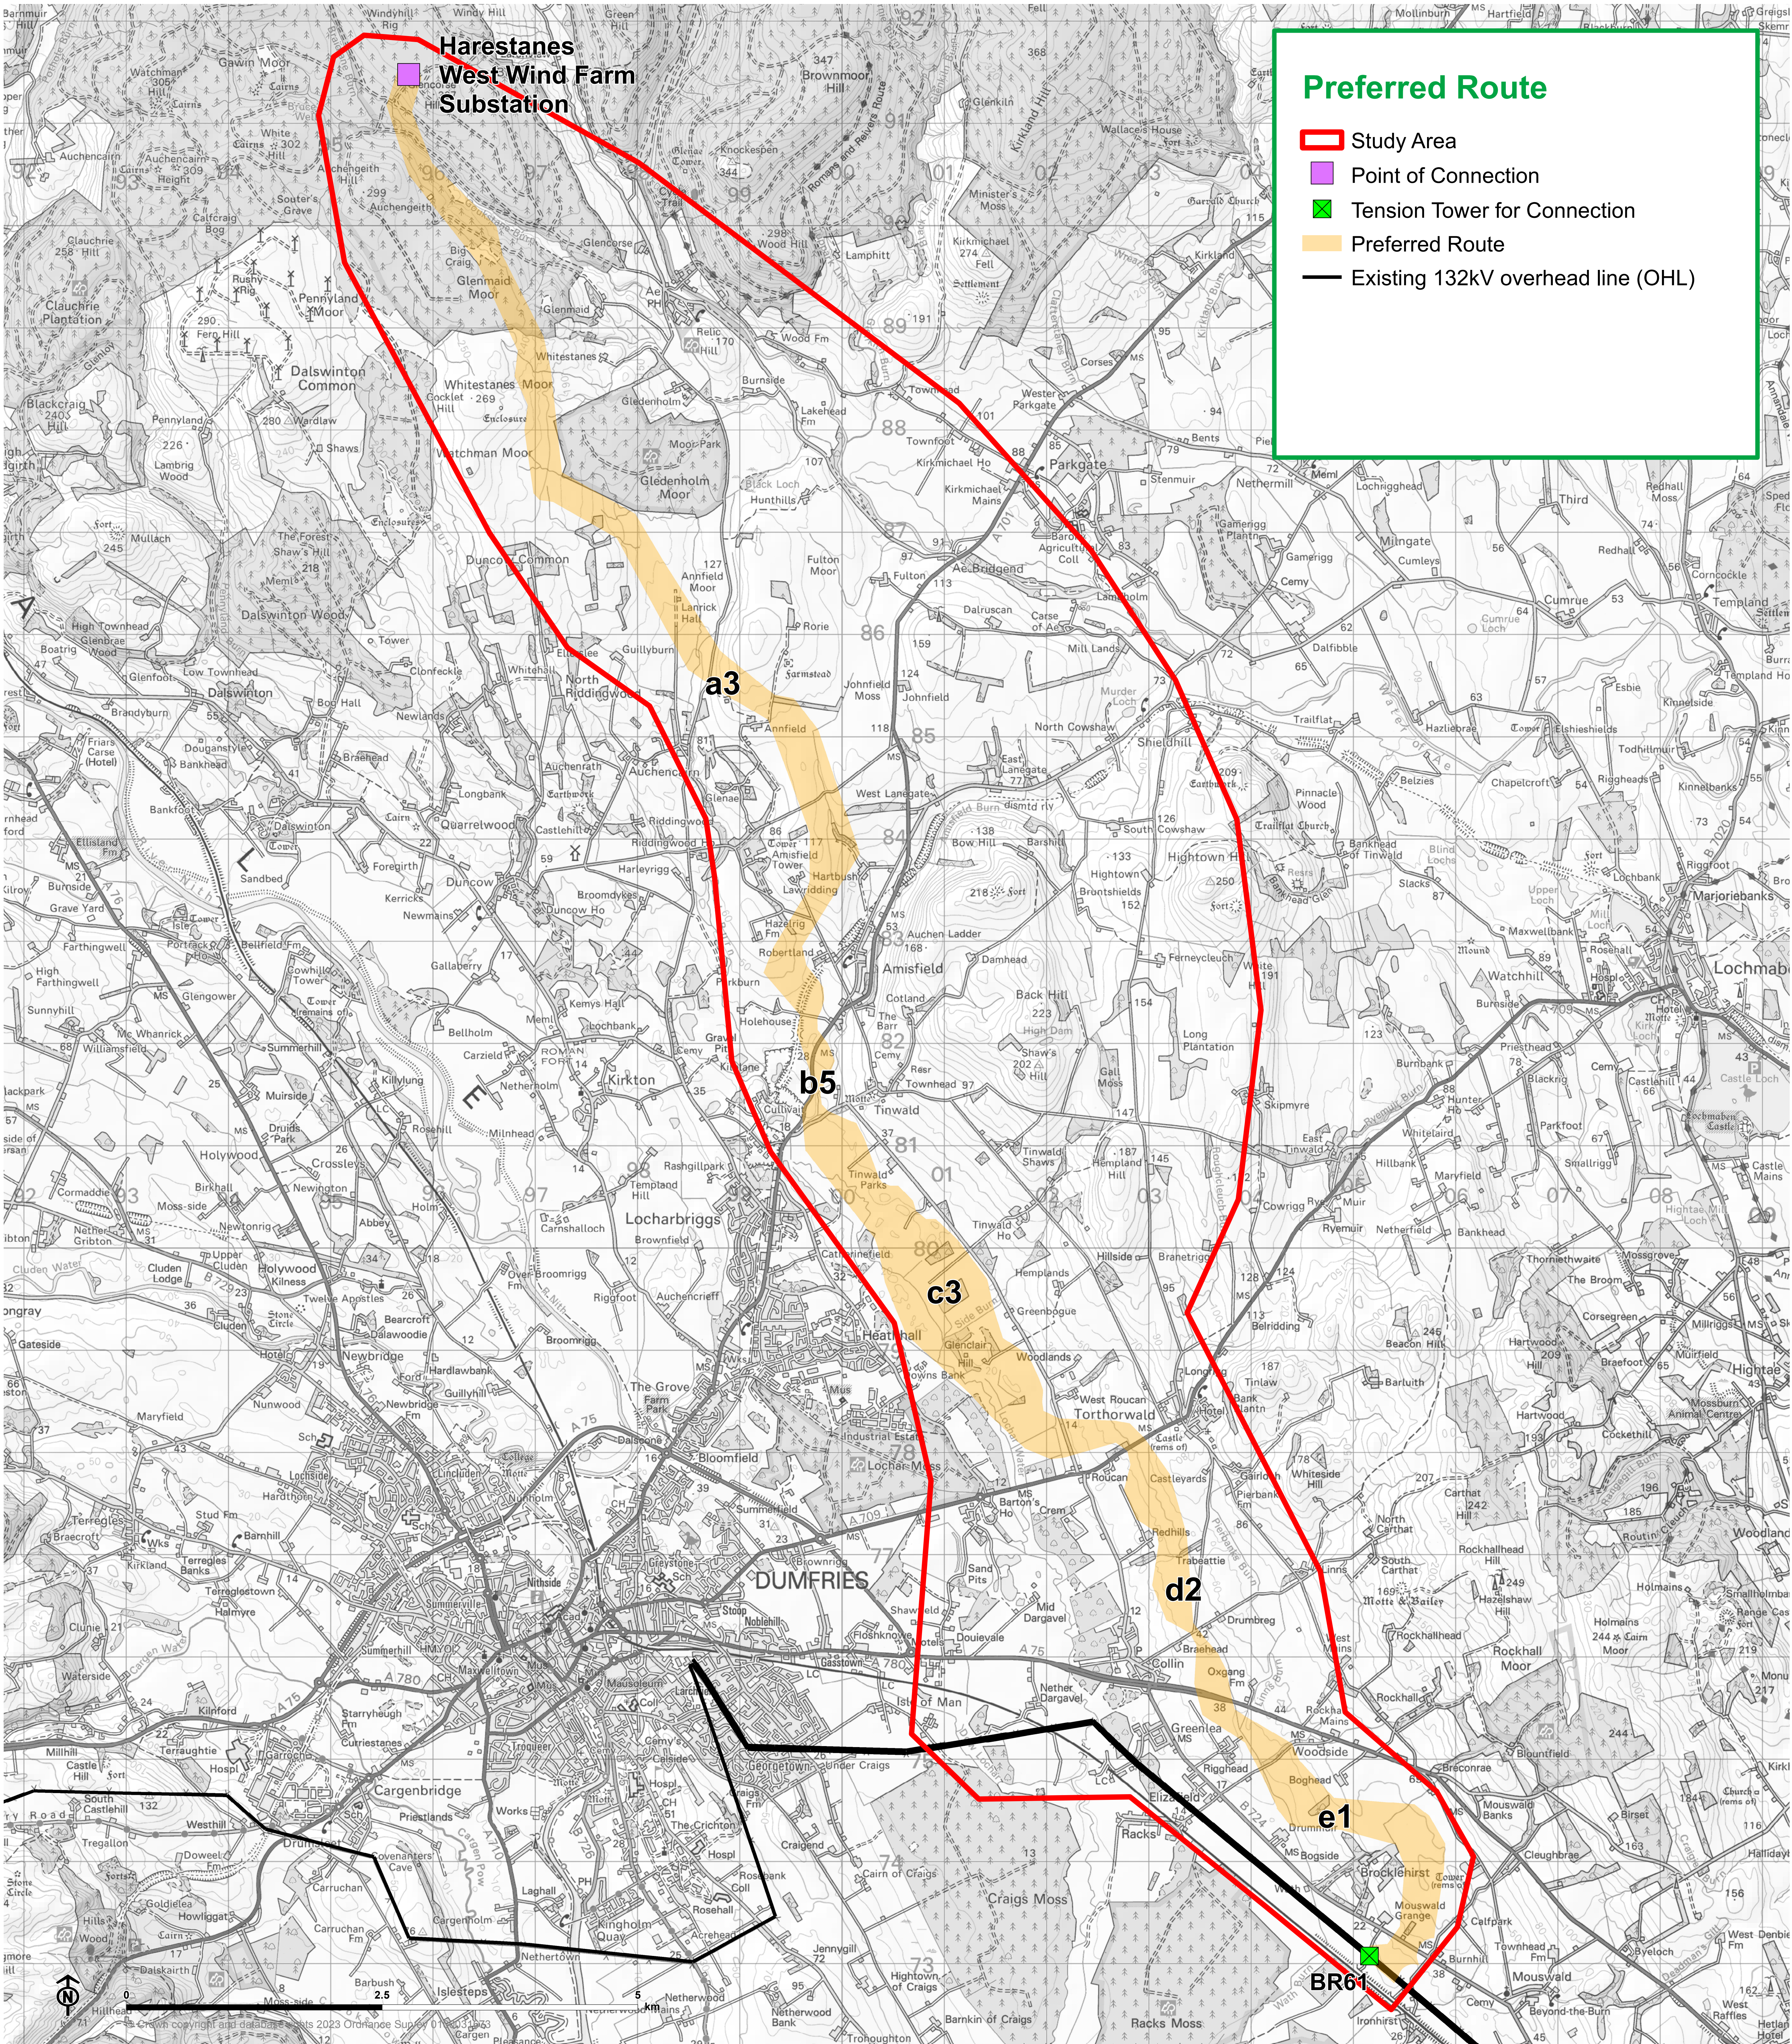

The detailed location of the new wood poles within the route corridor has still to be developed through a detailed design/technical review process which will be informed by the findings of this public consultation.

Harestanes West Wind Farm 132kV Overhead Line Grid Connection

www.spenenergynetworks.co.uk