

2.2

Annex


SP Energy Networks 2015–2023 Business Plan

Health index graphs


SP Energy Networks

June 2013


11kv Primary CB's

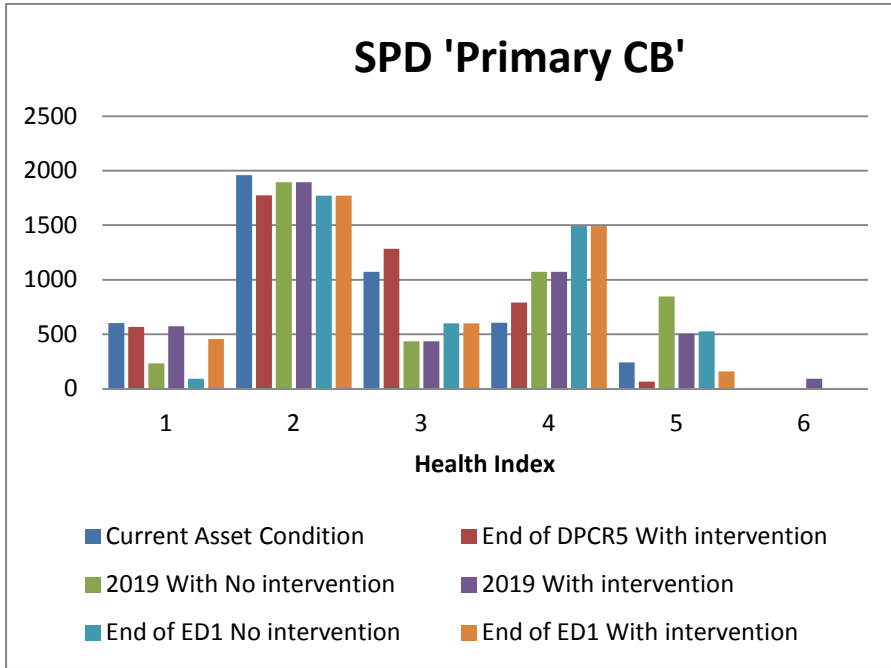


11kv Primary CB's

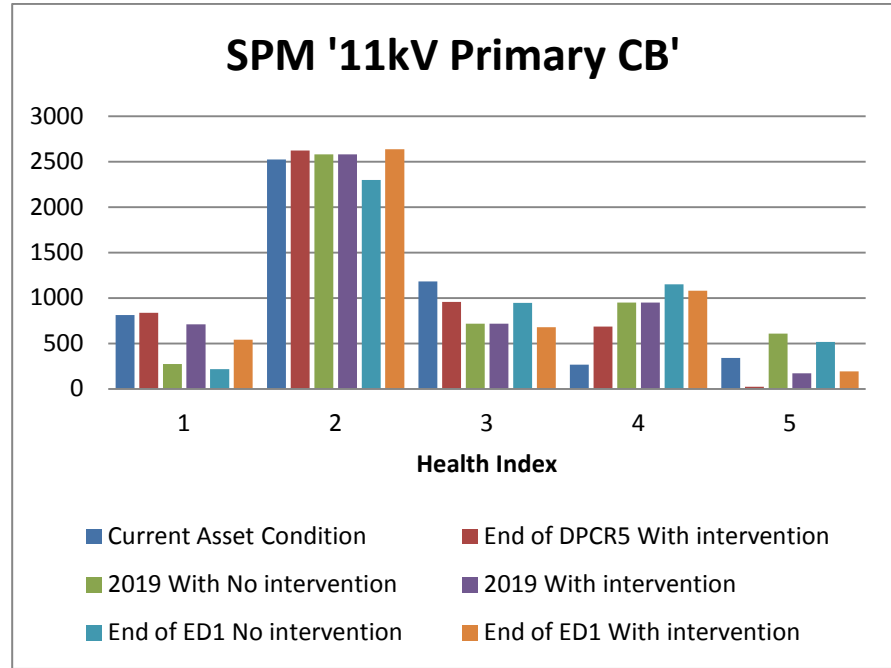


11kv Secondary CB's

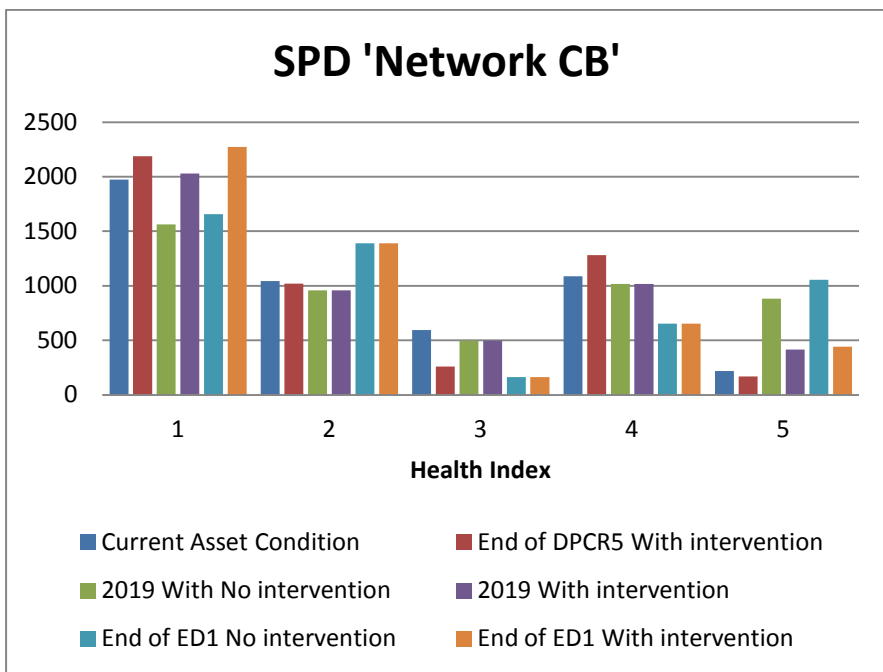


11kv Secondary CB's

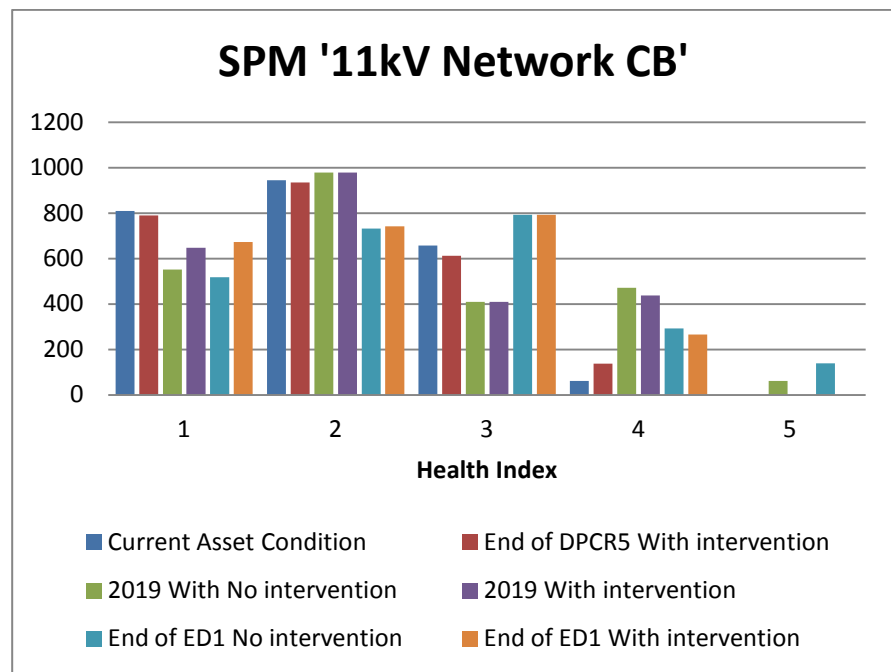


33kv Transformers

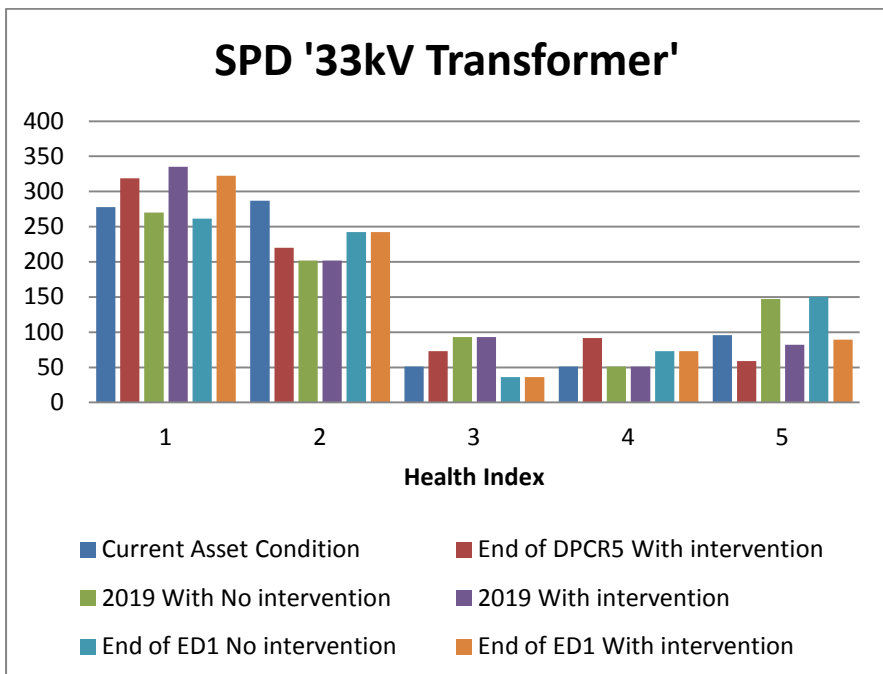


33kv Transformers

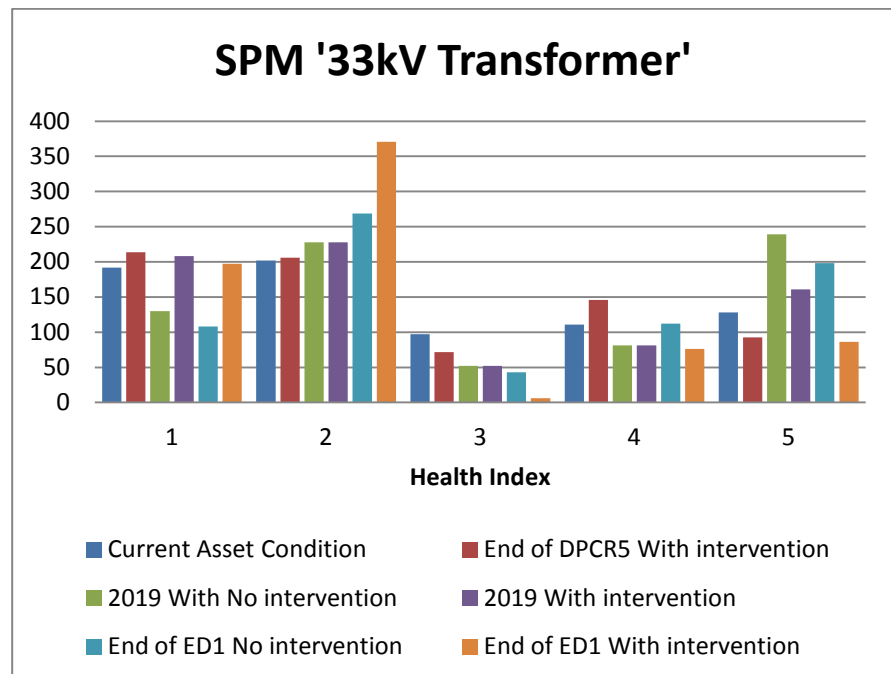


33kV Wood Poles

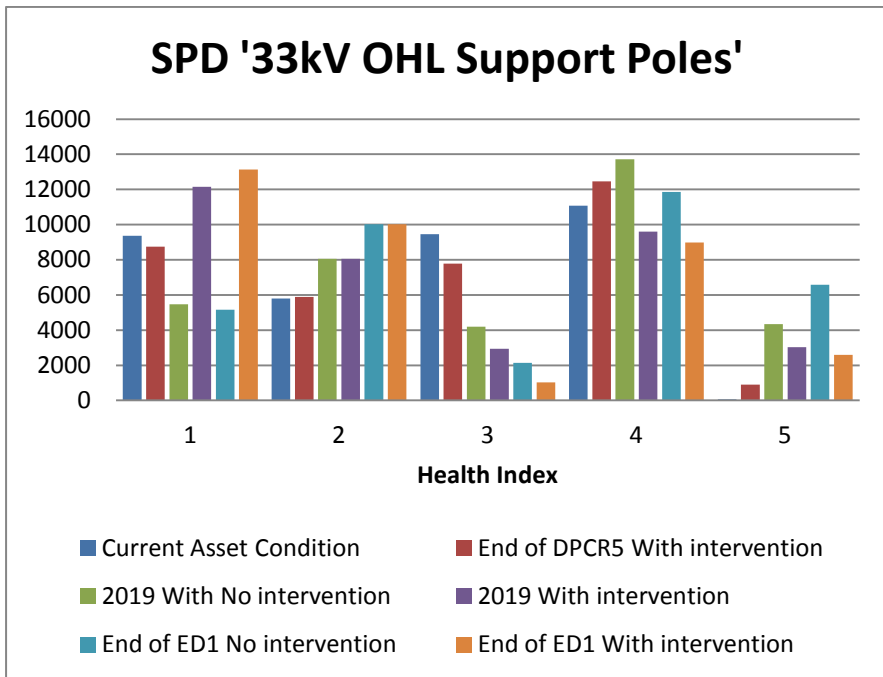


33kV Wood Poles

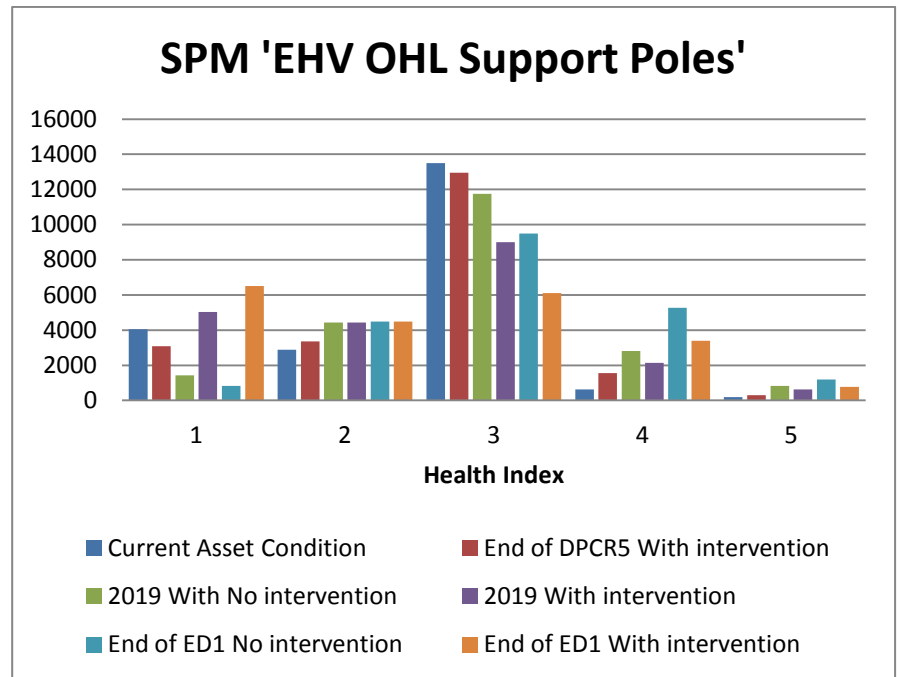


11kV Wood Poles

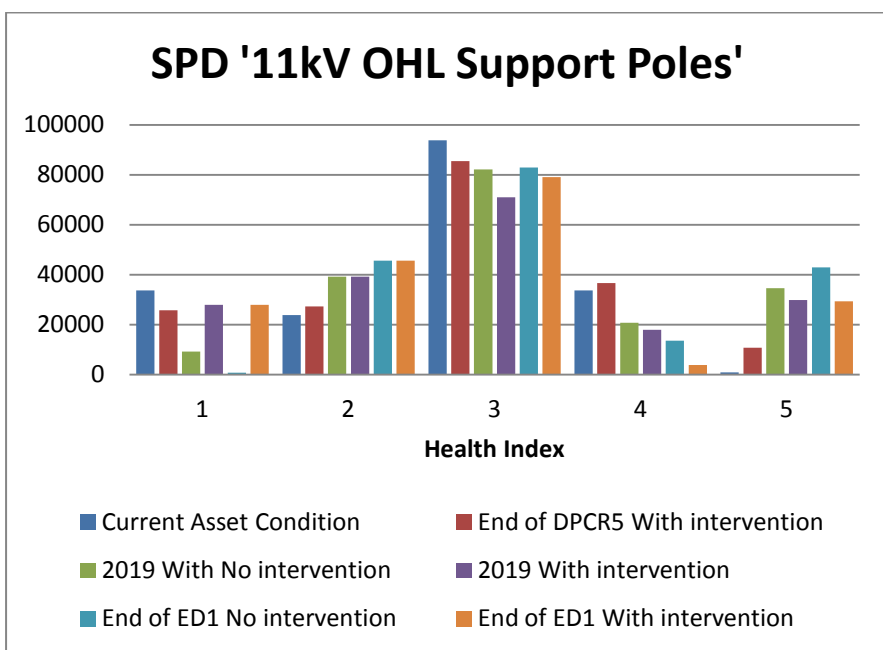


11kV Wood Poles

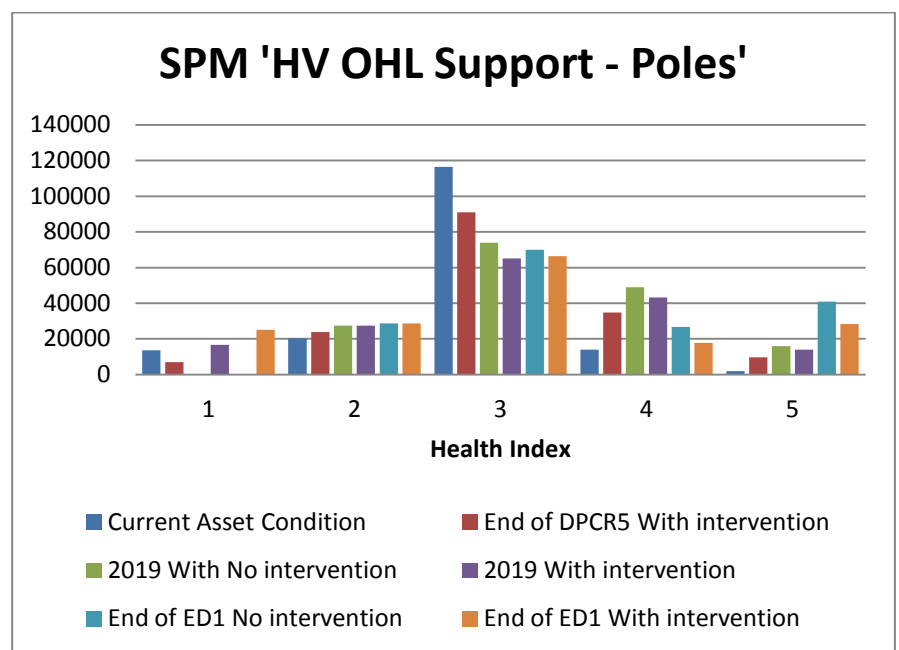


11kV RMU

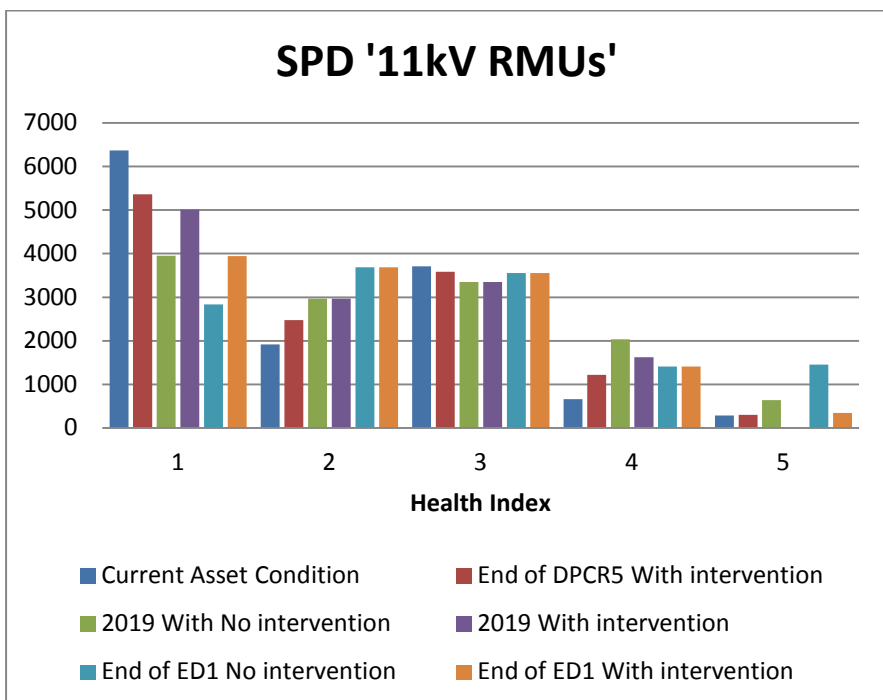


11V RMU

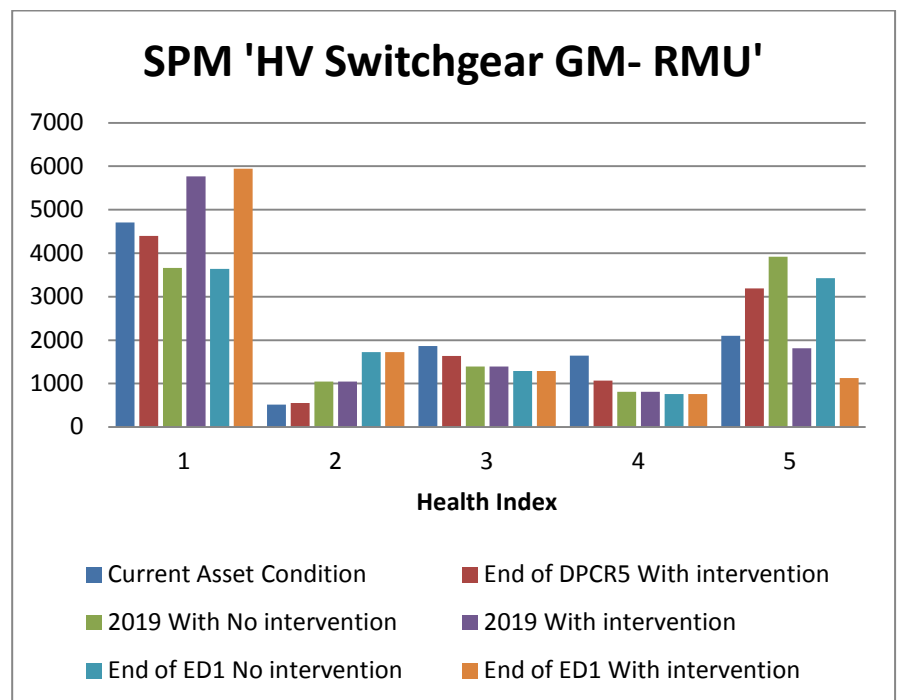


11kV Transformers

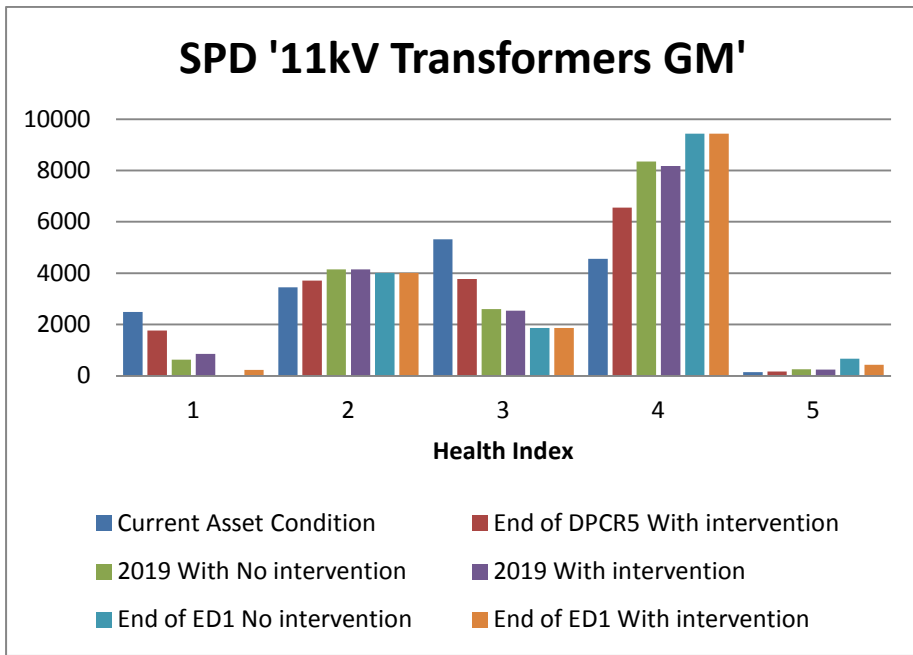


11kV Transformers

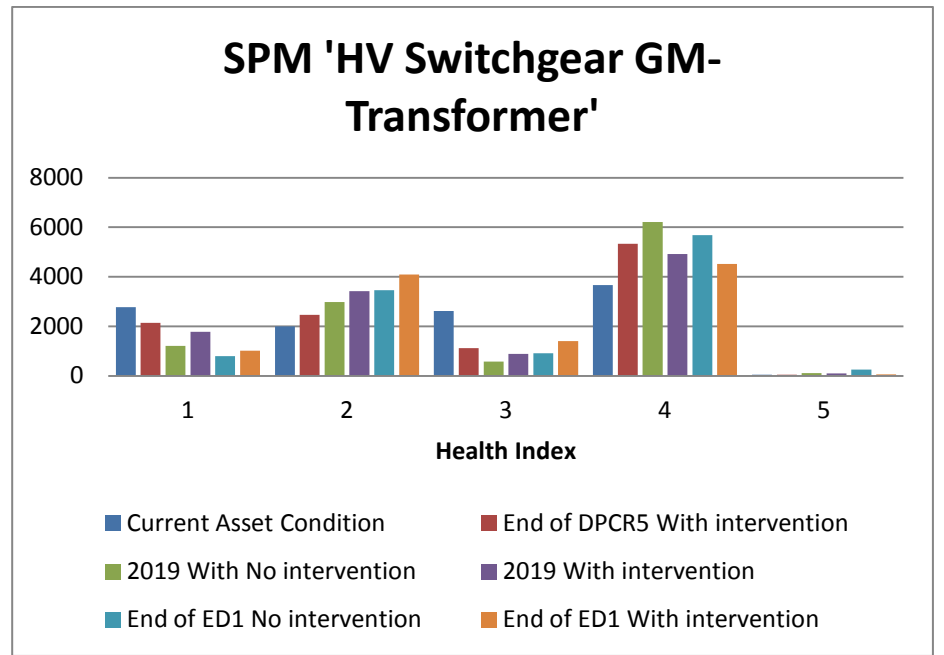


33kV Circuit Breakers

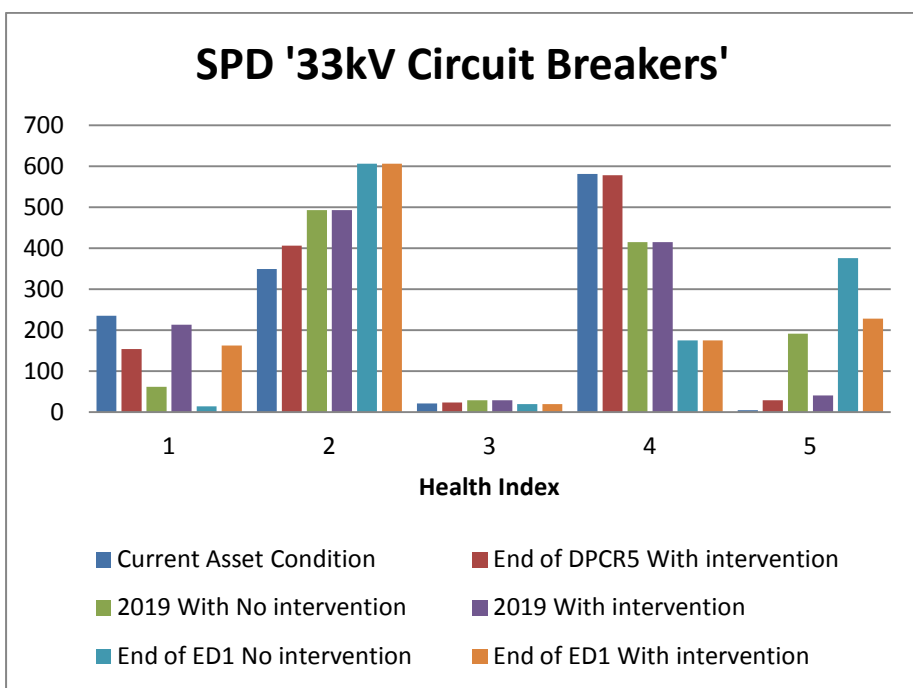

33kV Circuit Breakers

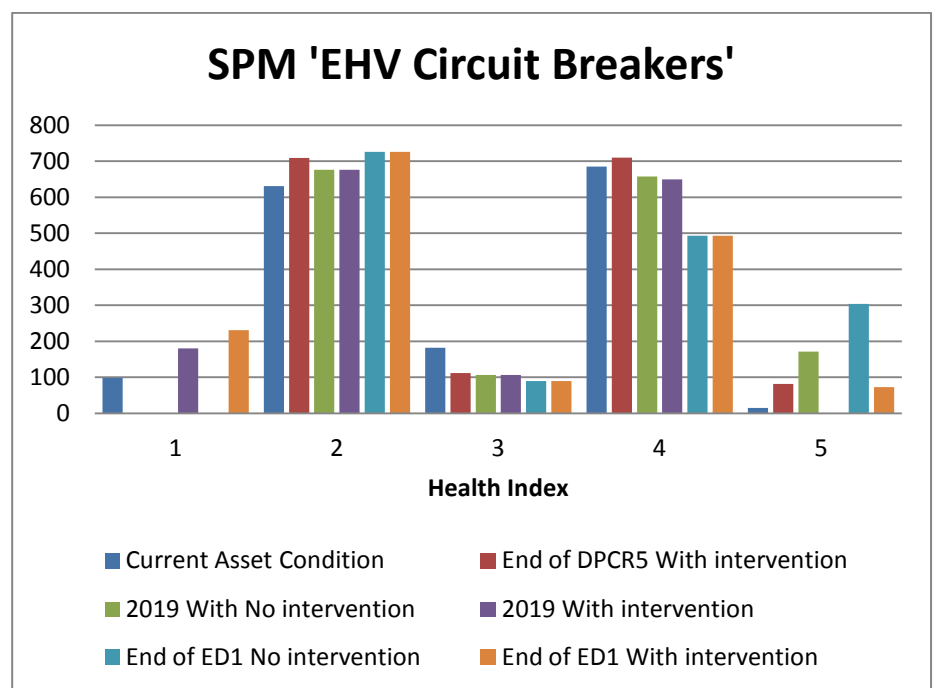

132kV Circuit Breakers

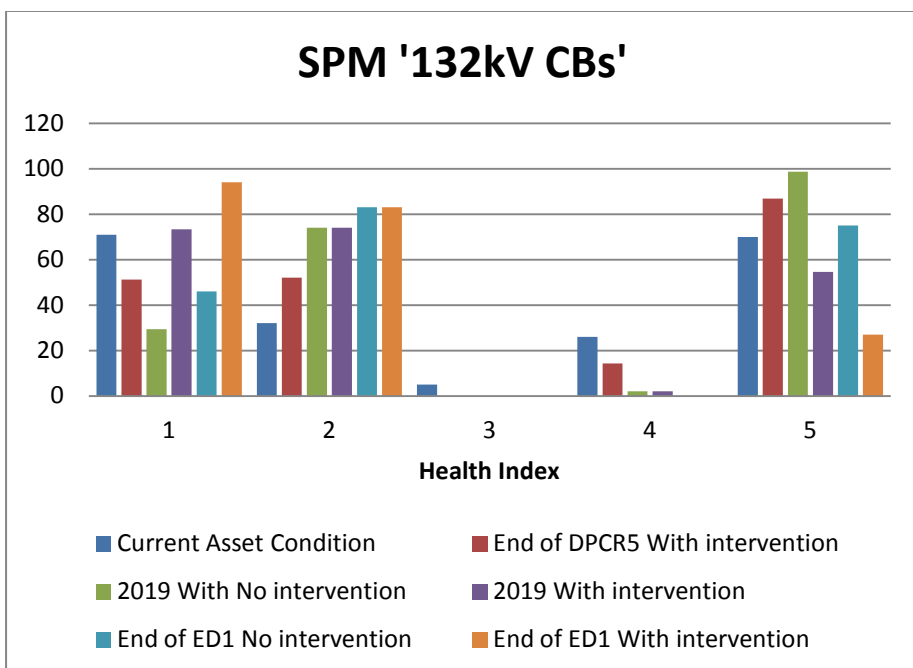

132kV Transformers

