


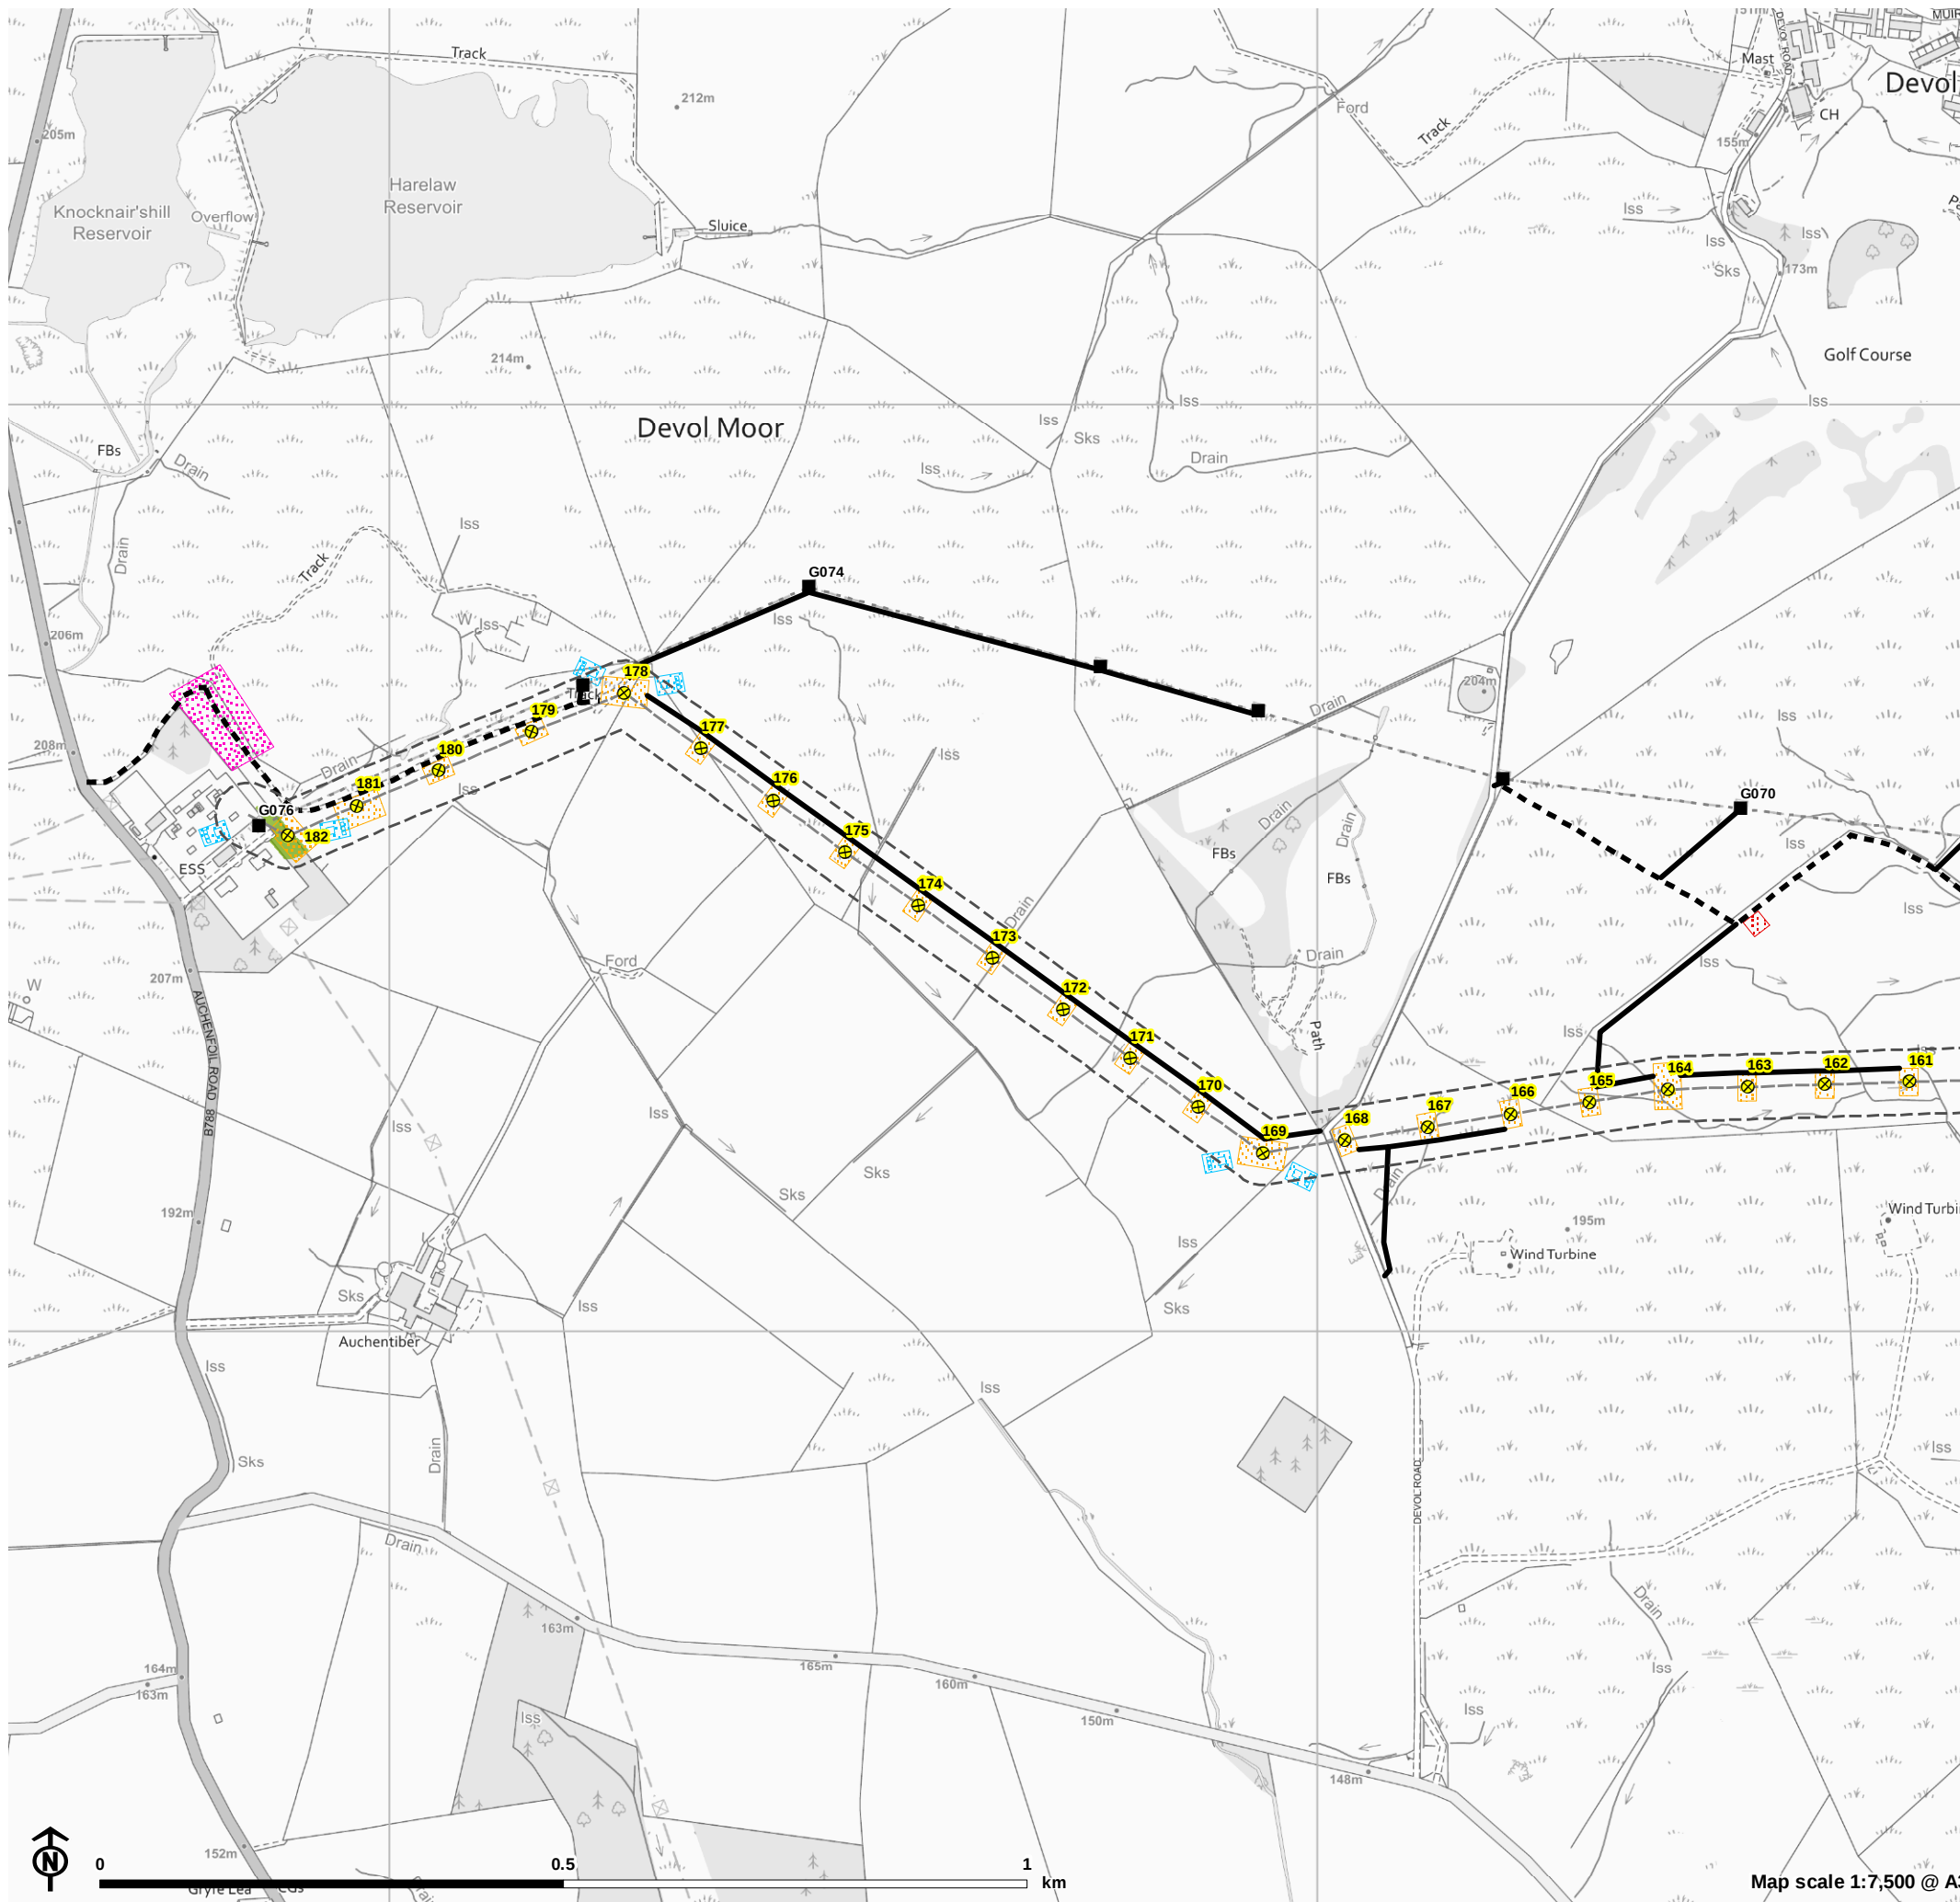

Erskine to Devol Moor
for SPEN



Figure 2a: Section 37 Site Plan

- New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- Existing 132kV OHL route
- New Access
- Existing Access
- Construction Compound
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave

Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725


This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.

Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay

A member of the staff of the Scottish Ministers

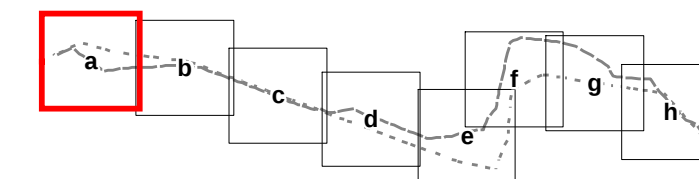

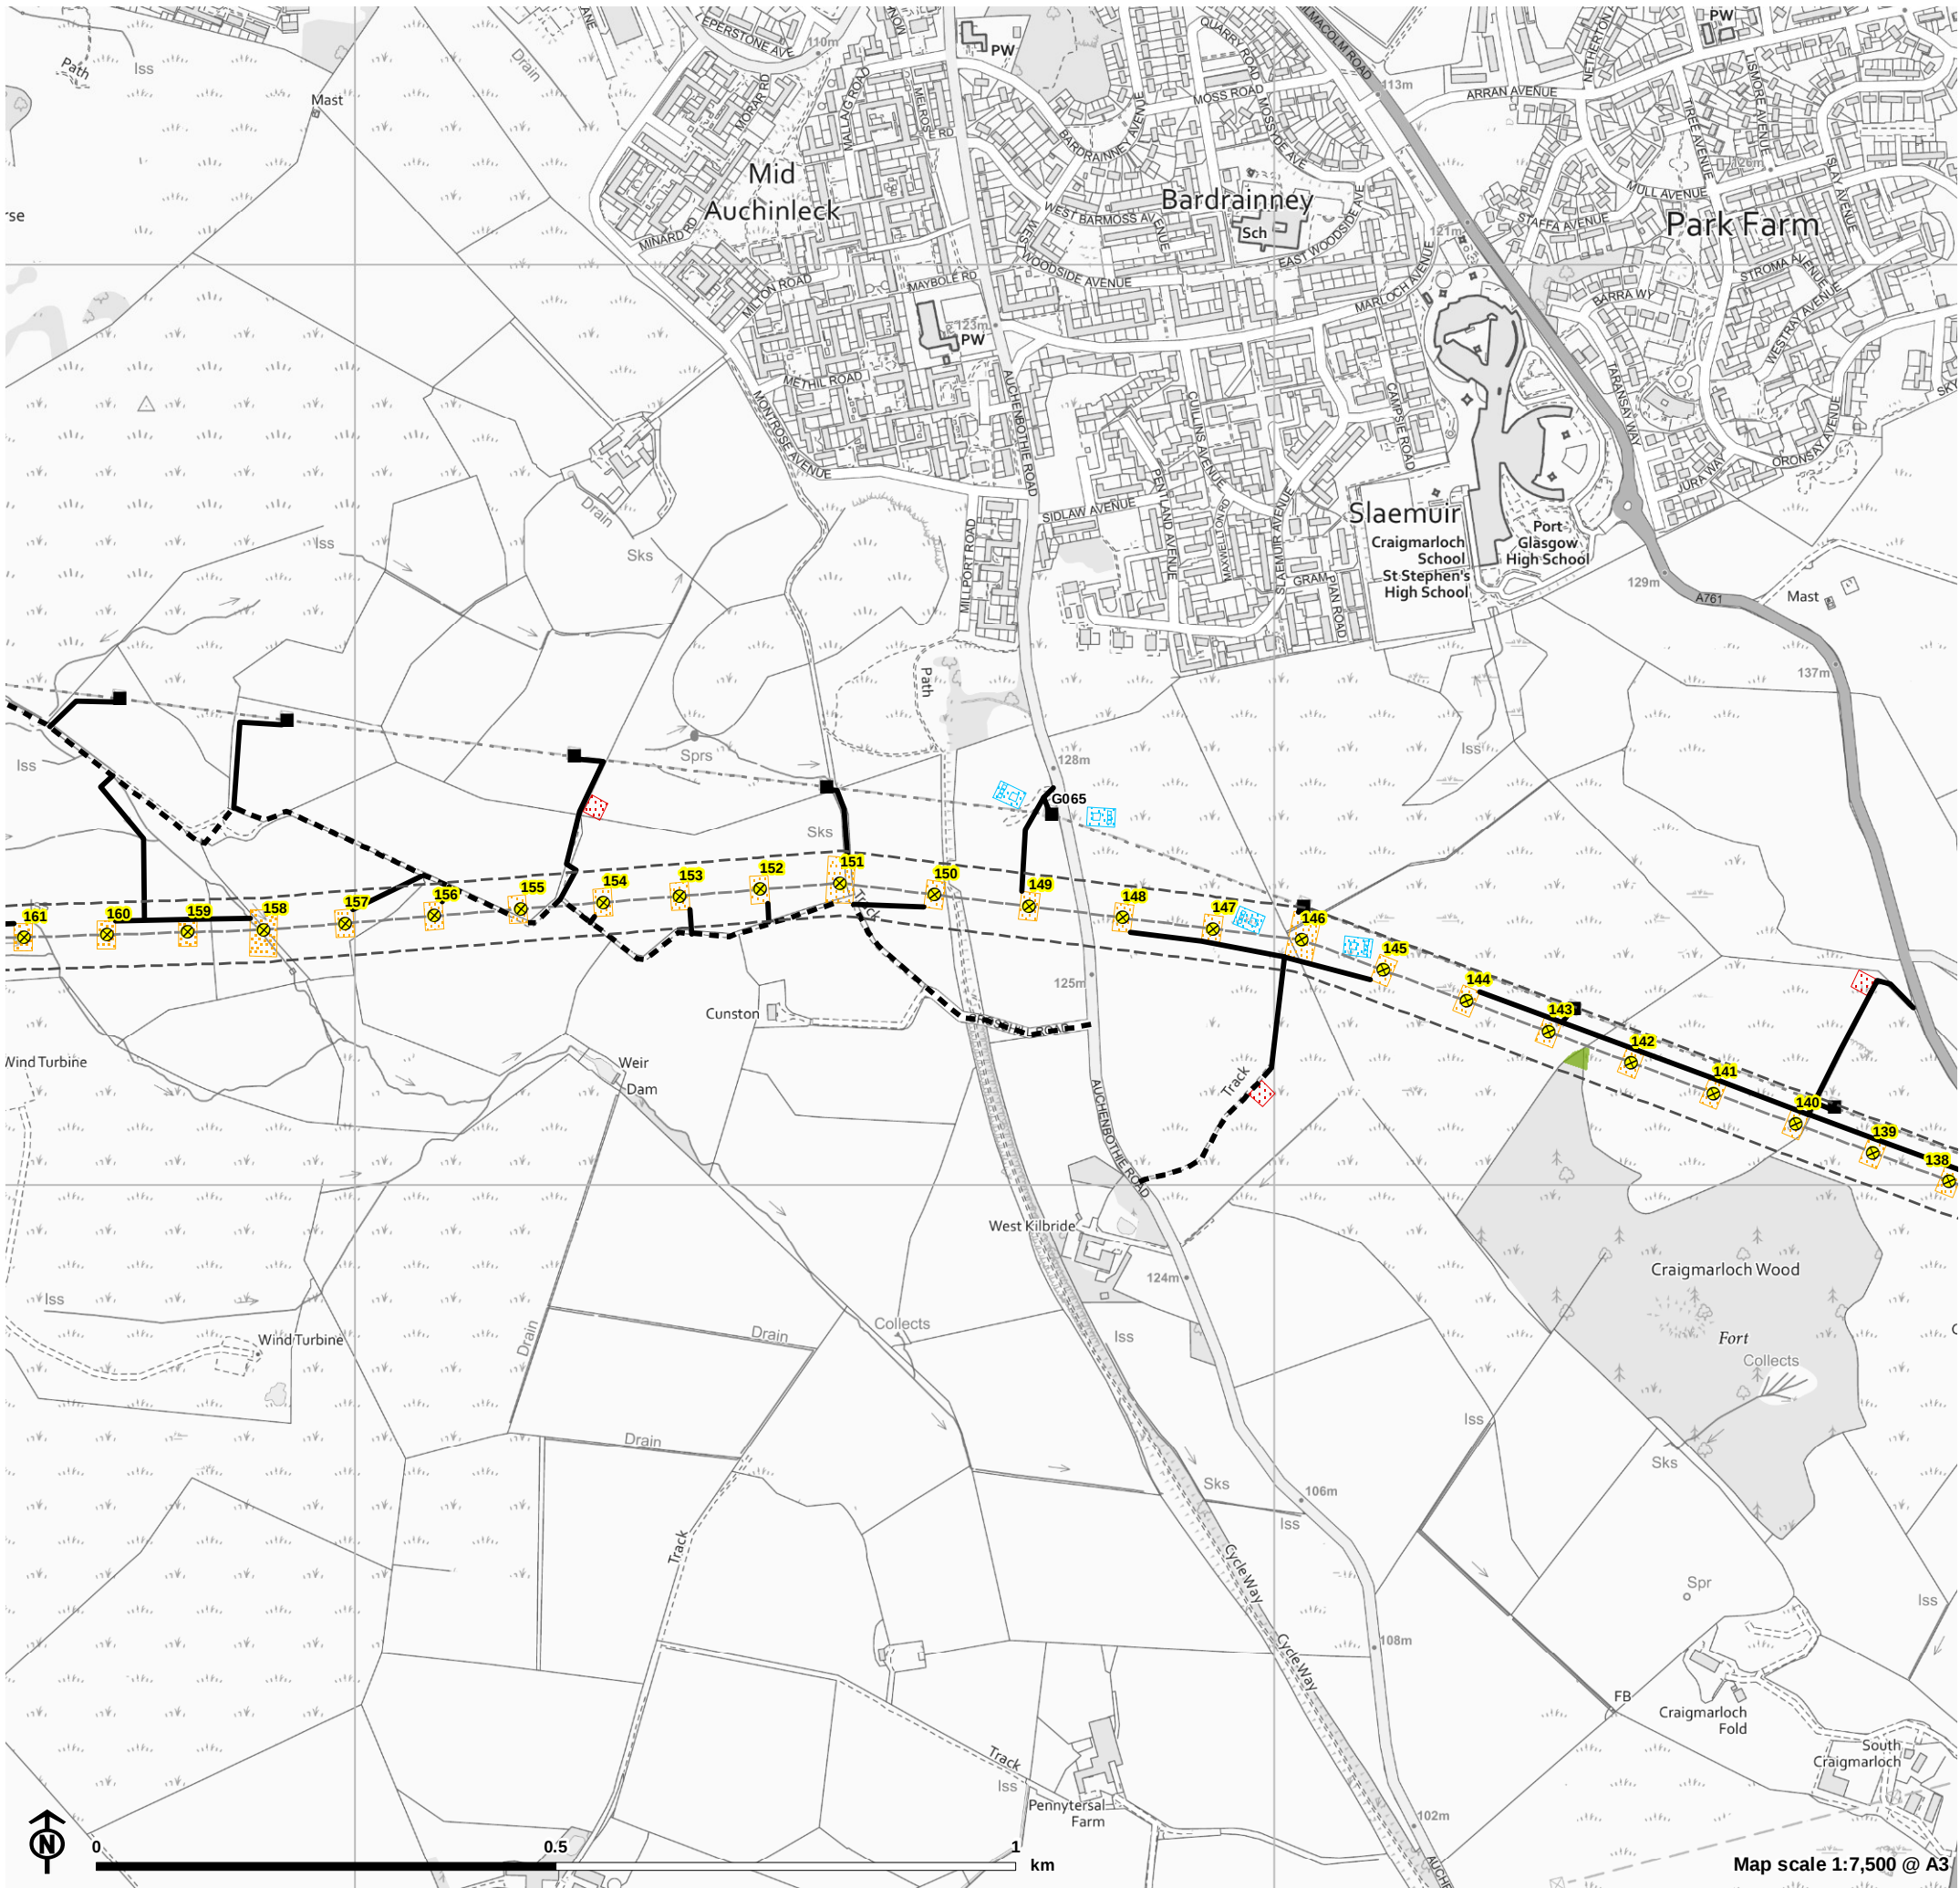



Figure 2b: Section 37 Site Plan

- New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- Existing 132kV OHL route
- New Access
- Existing Access
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance
 - Felling in 70m Wayleave

Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725

This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.
Date: 22 June 2023

Pp – *Shafharia Khataza*
For Ruth Findlay
A member of the staff of the Scottish Ministers

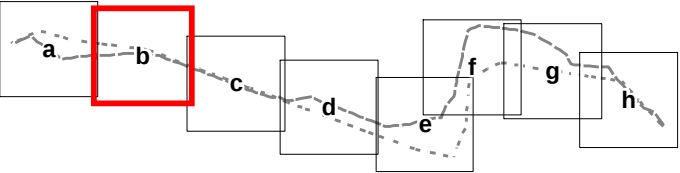



Erskine to Devol Moor
for SPEN



Figure 2c: Section 37 Site Plan

- ⊗ New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- - - Existing 132kV OHL route
- New Access
- - - Existing Access
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave
- Felling for Windthrow

Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725


This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.

Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay

A member of the staff of the Scottish Ministers

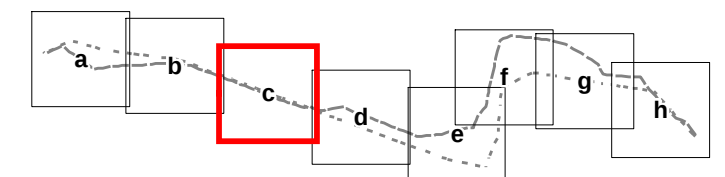

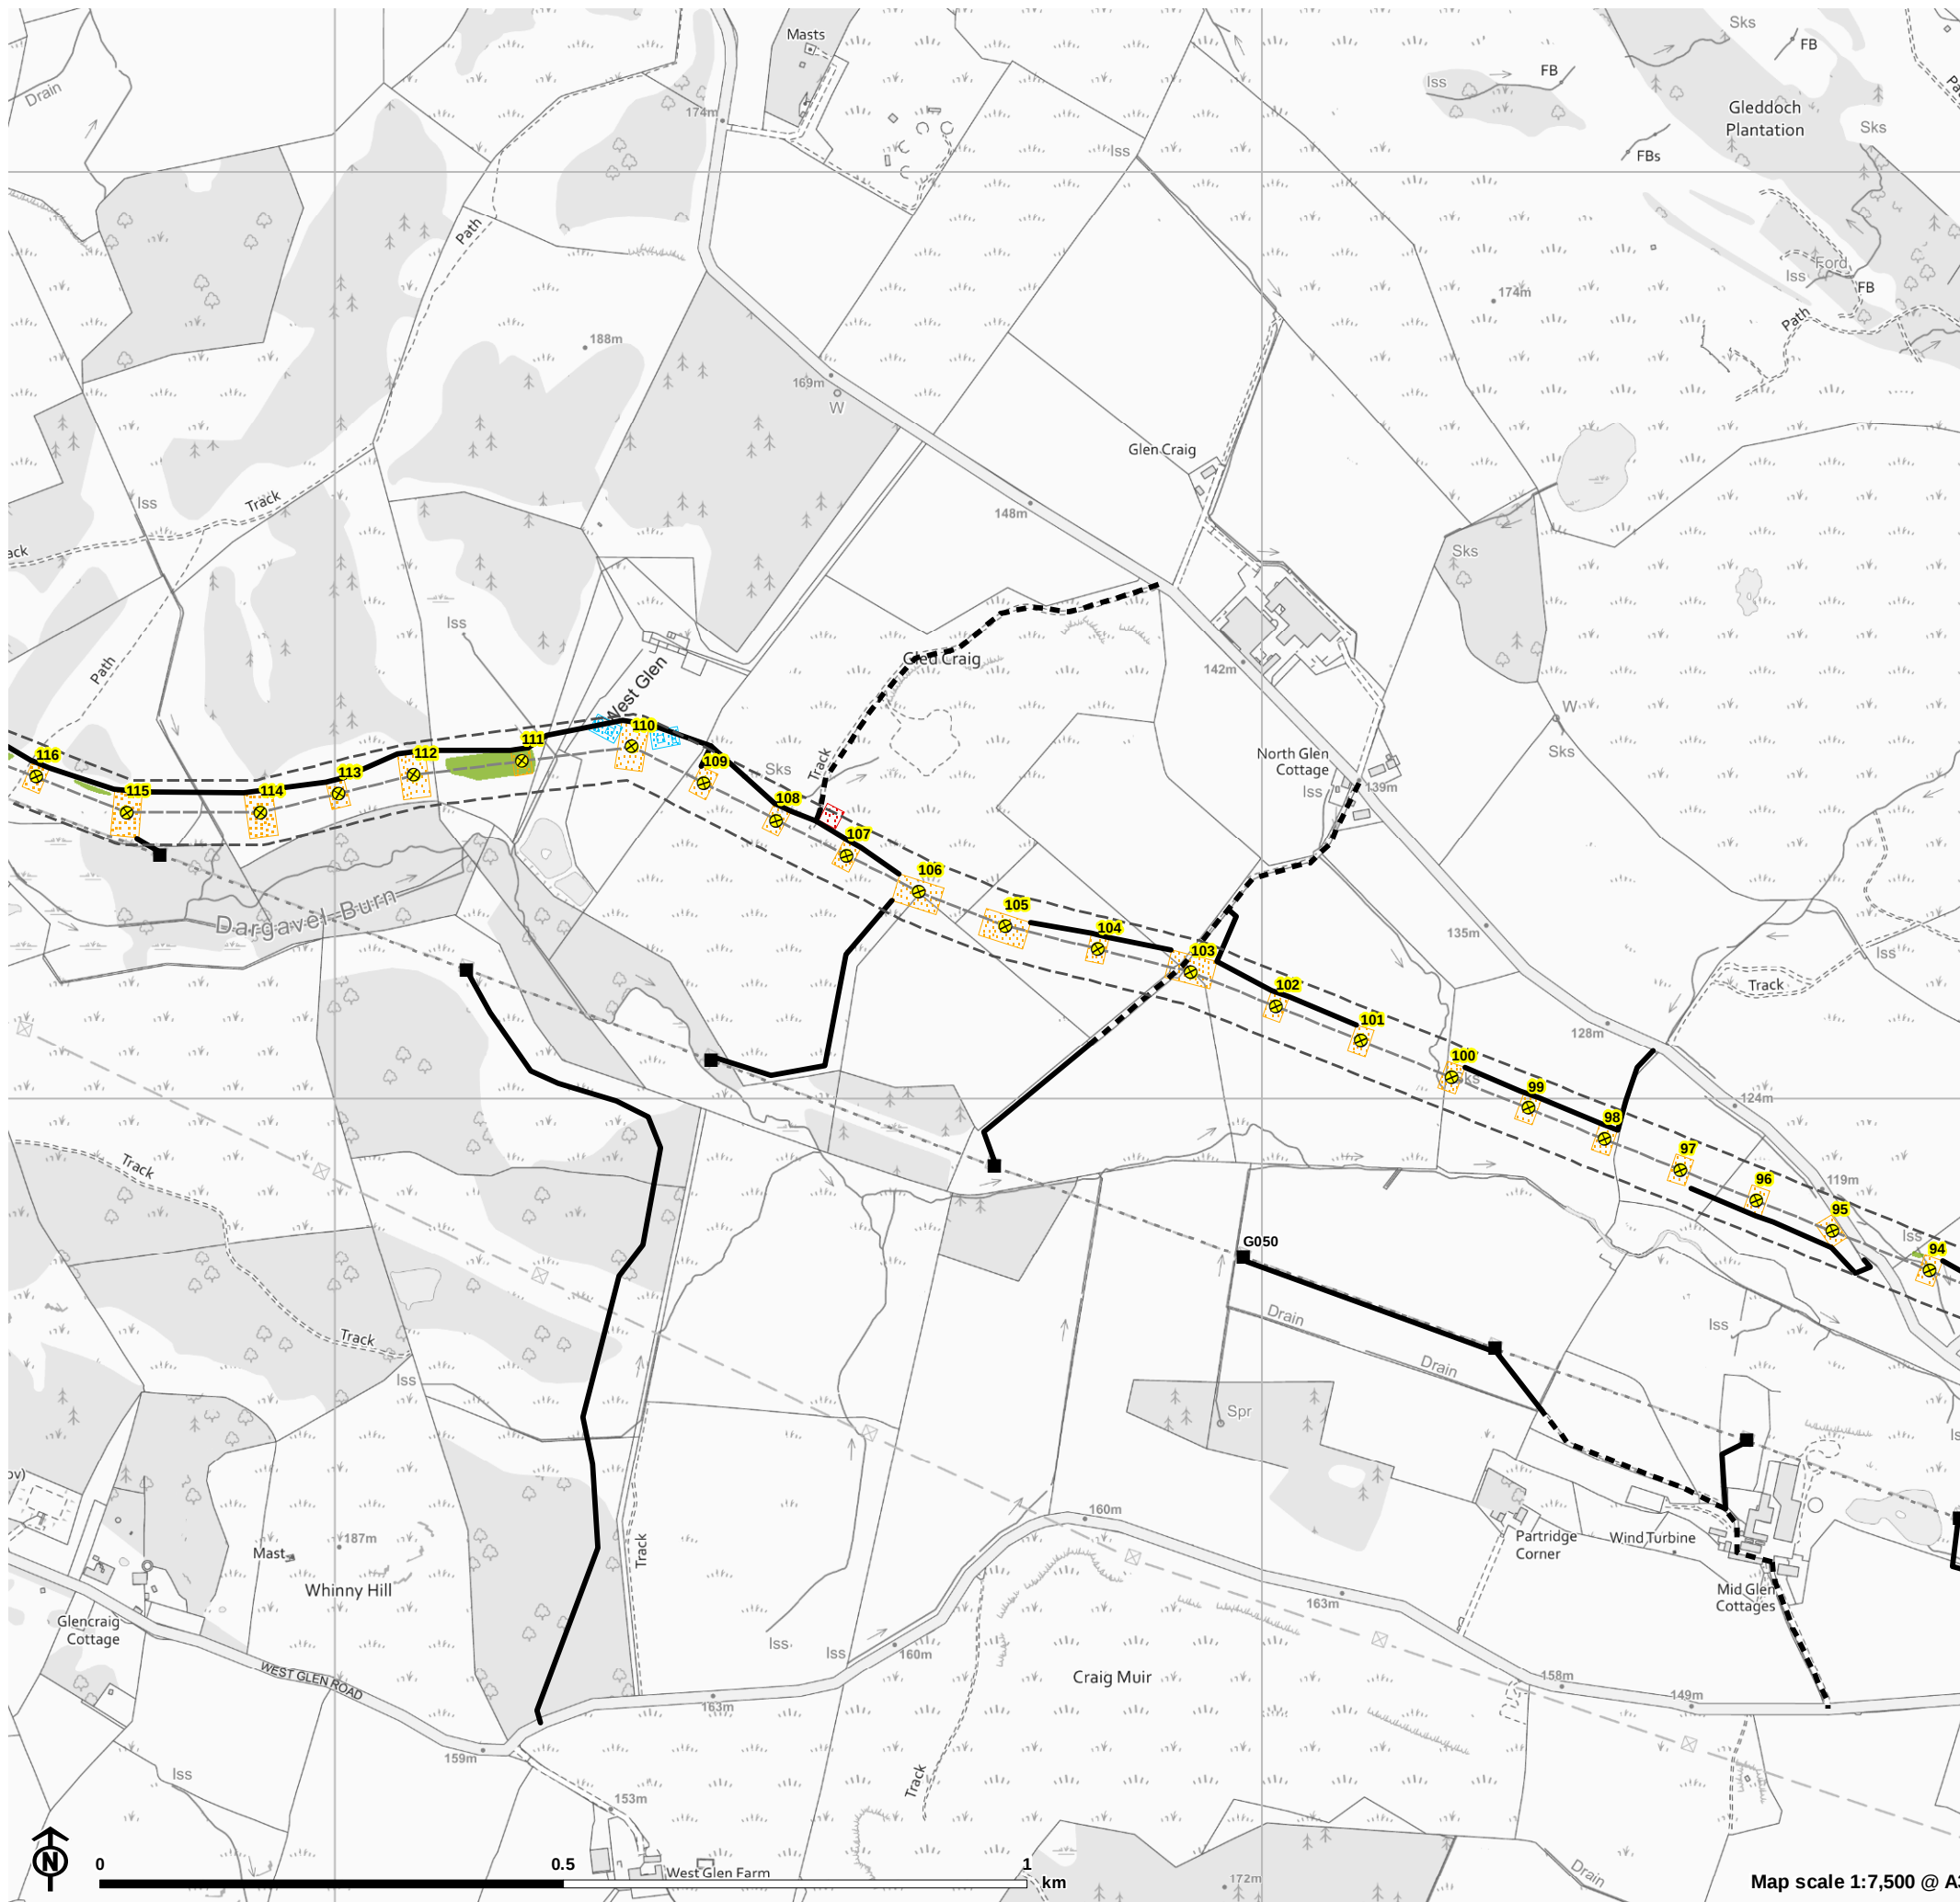


Figure 2d: Section 37 Site Plan

- New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- Existing 132kV OHL route
- New Access
- Existing Access
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave

Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725


This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.


Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay

A member of the staff of the Scottish Ministers

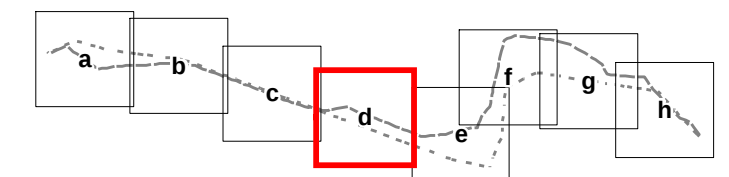

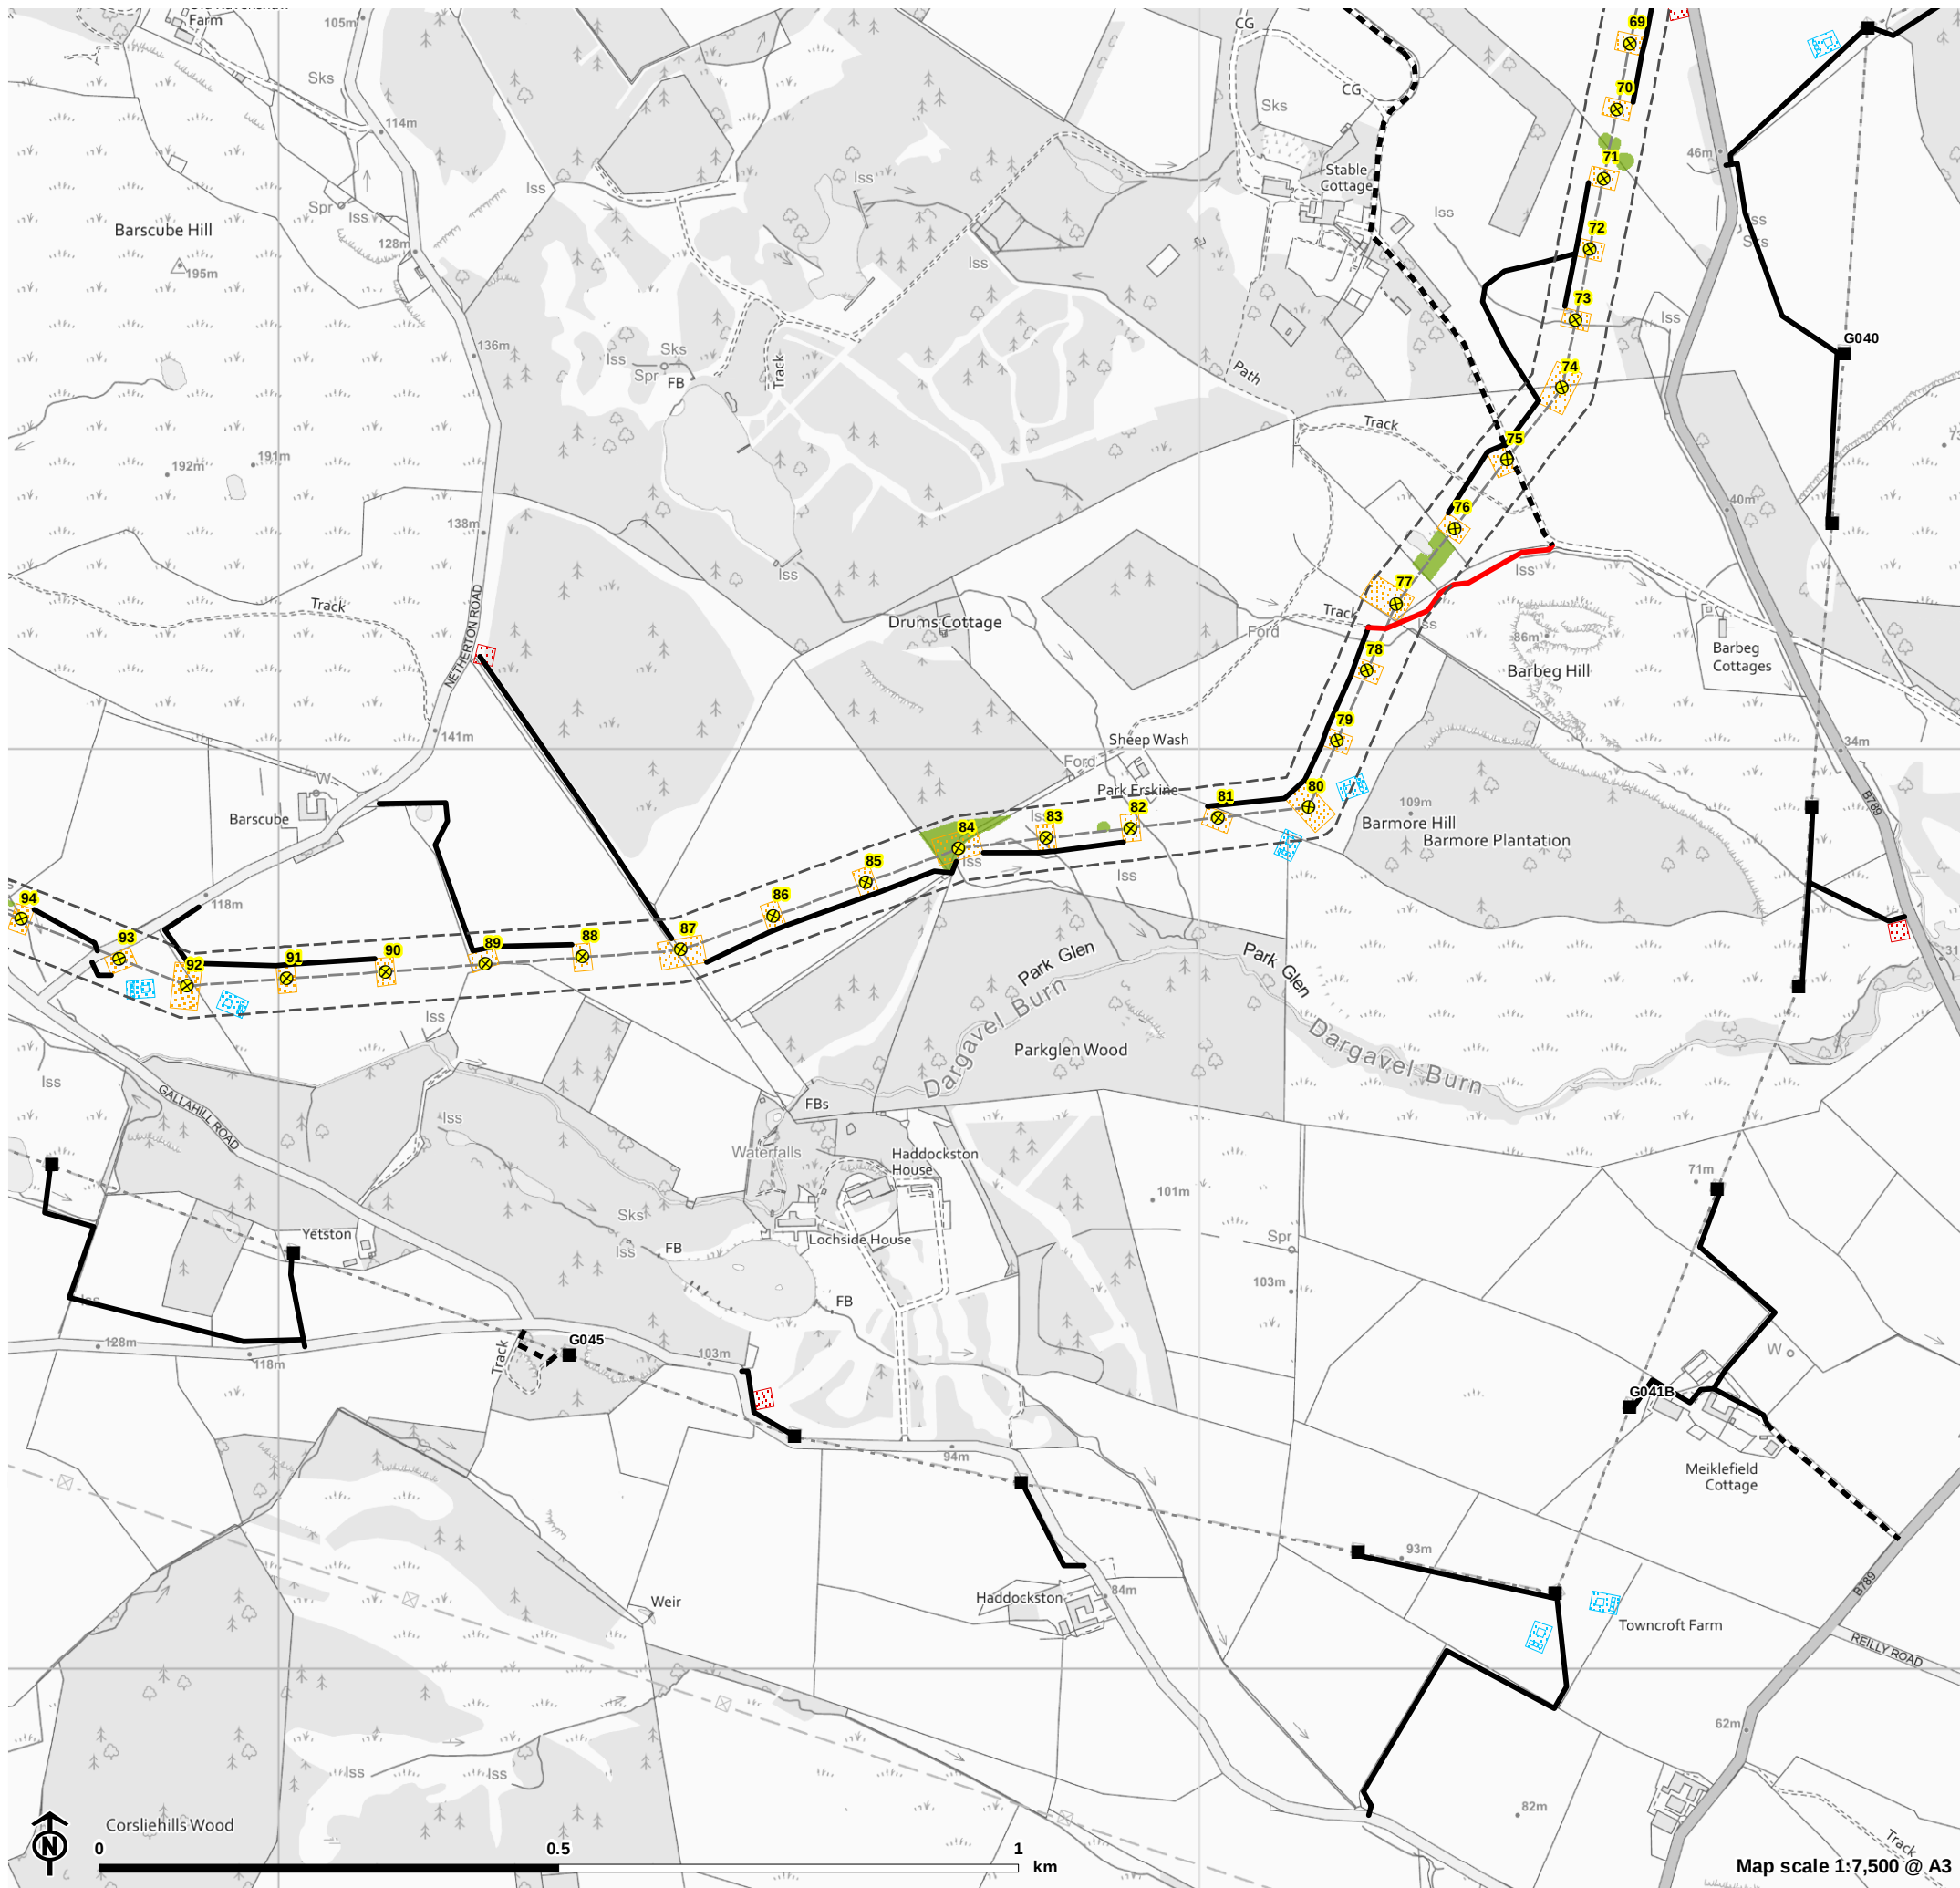

Erskine to Devol Moor
for SPEN



Figure 2e: Section 37 Site Plan

- ⊗ New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- - - Existing 132kV OHL route
- New Access
- New Access (Stone)
- - - Existing Access
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave


Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725


This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.

Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay
A member of the staff of the Scottish Ministers

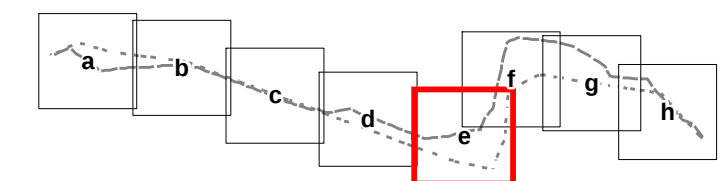

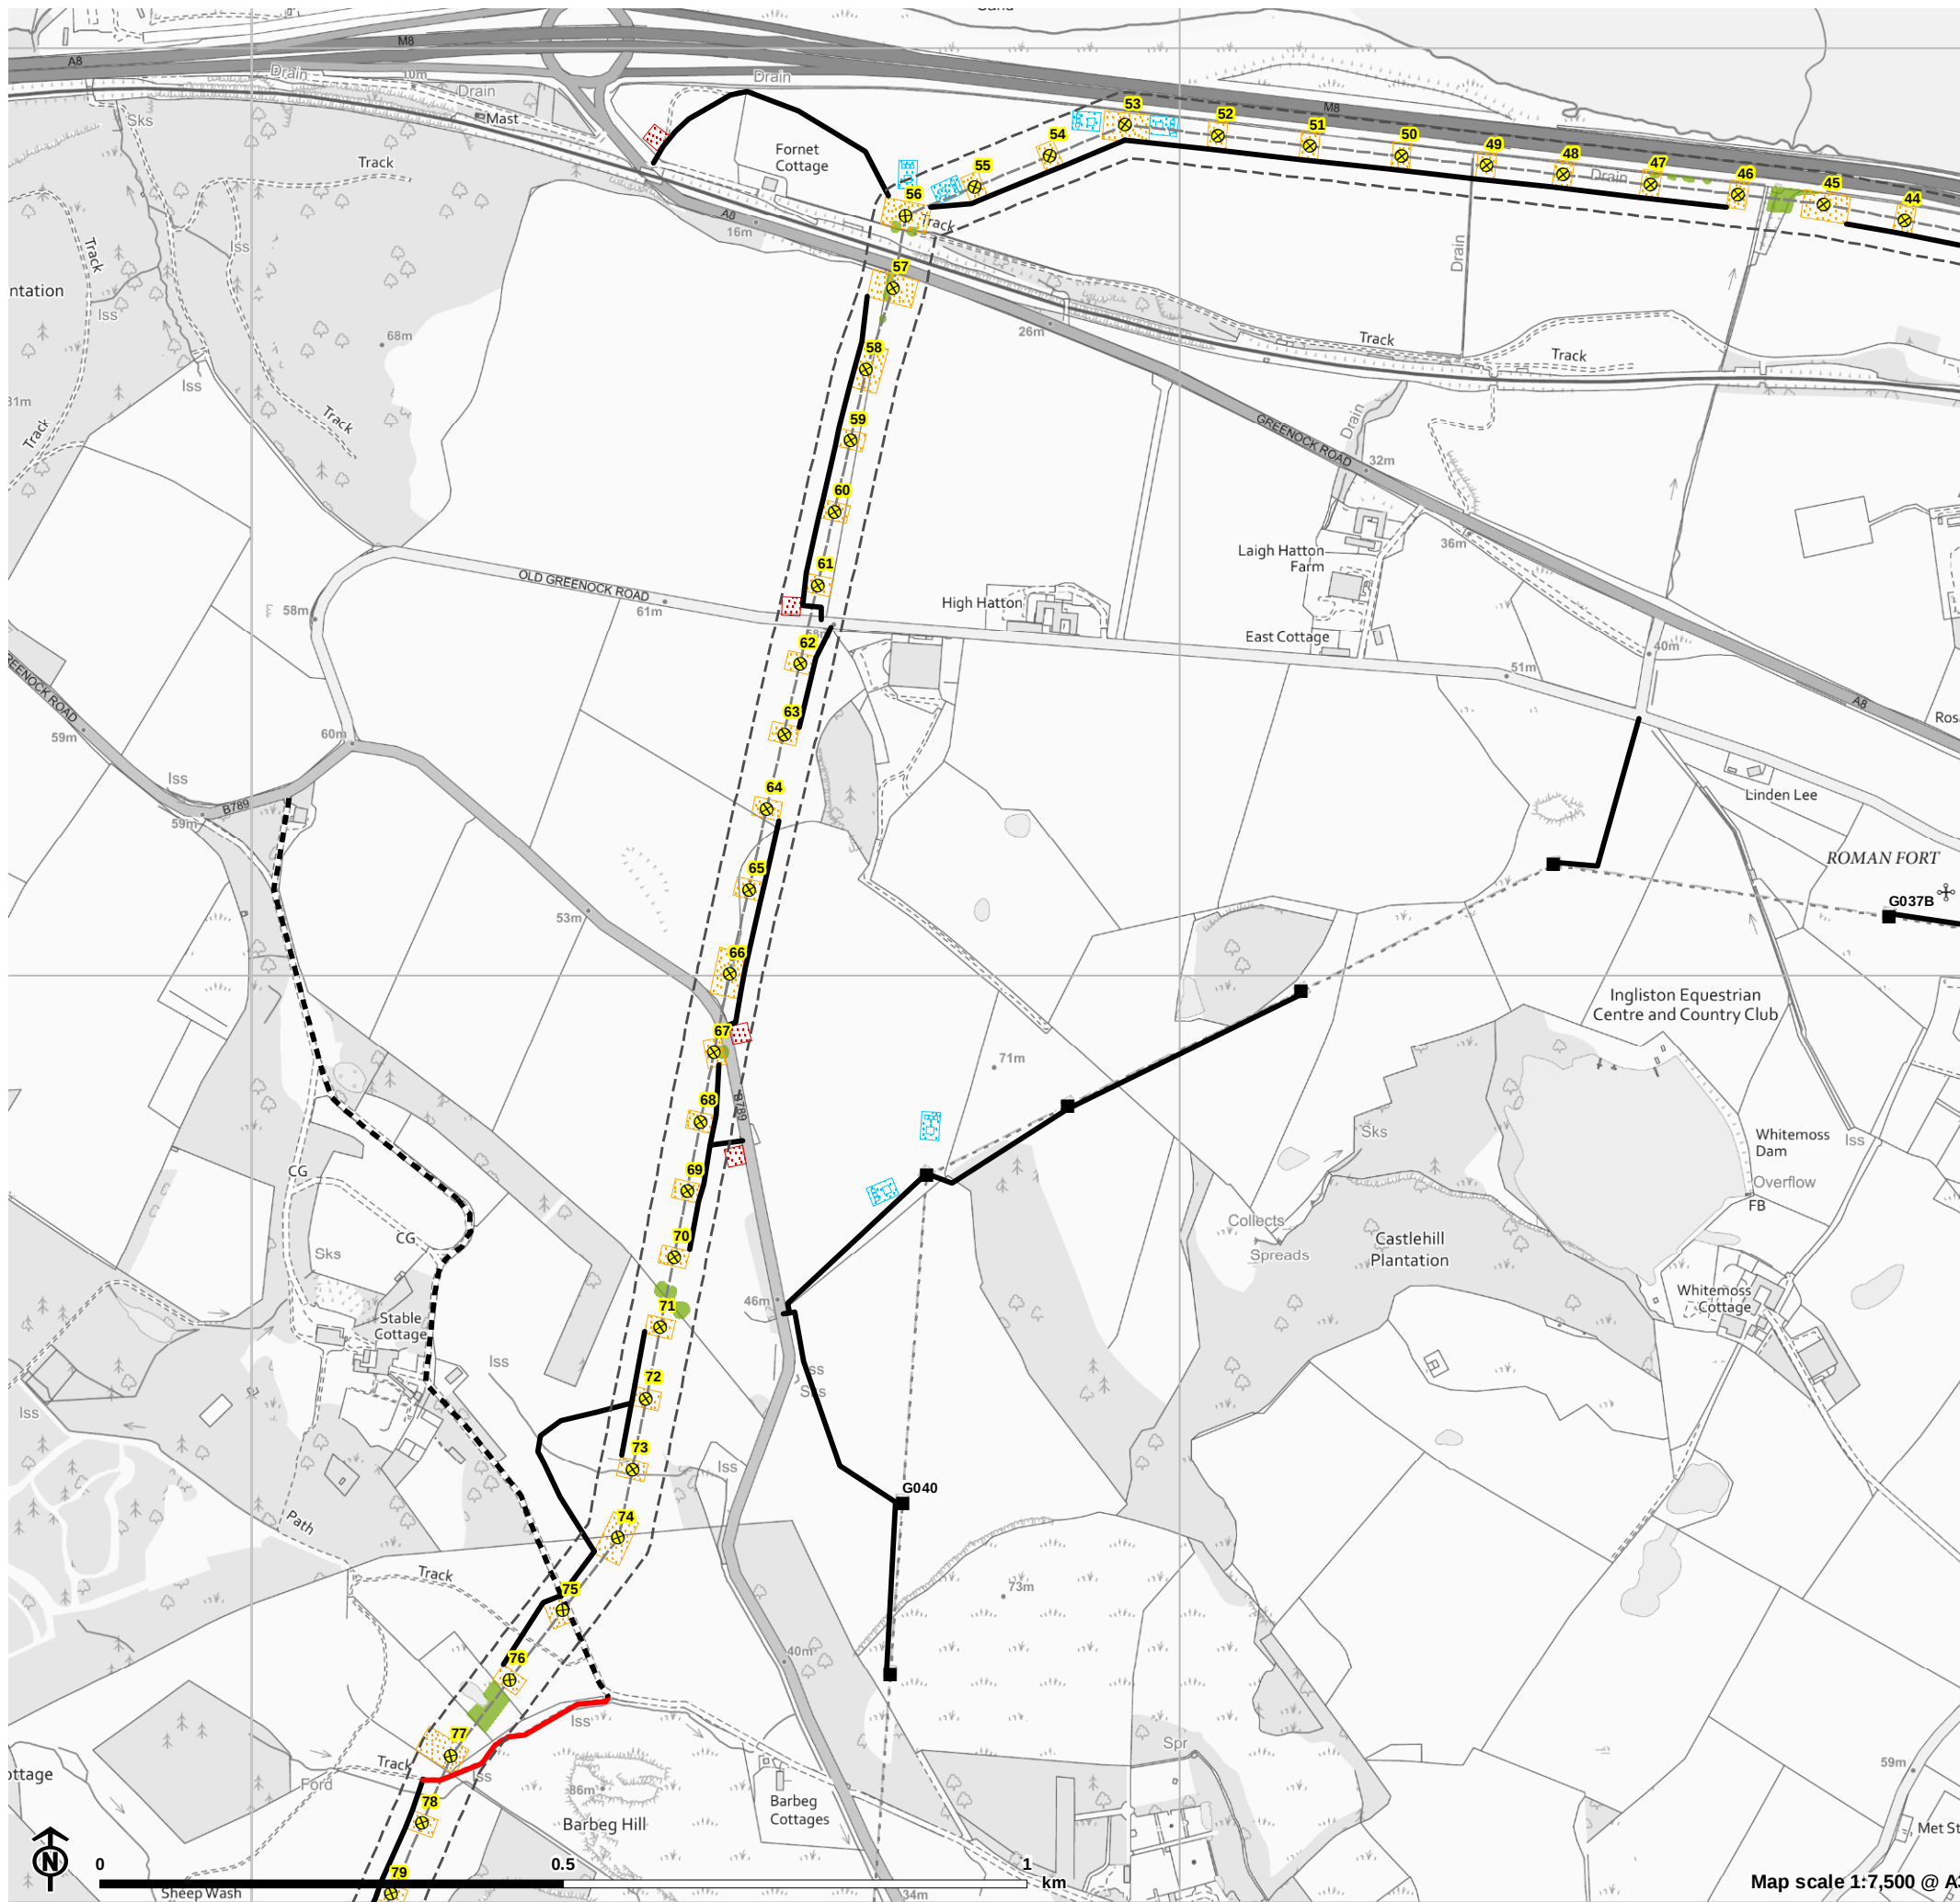

Erskine to Devol Moor
for SPEN



Figure 2f: Section 37 Site Plan

- ⊗ New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- - - Existing 132kV OHL route
- New Access
- New Access (Stone)
- - - Existing Access
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave


Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725

This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.

Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay
A member of the staff of the Scottish Ministers

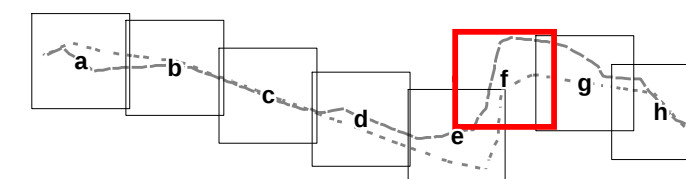

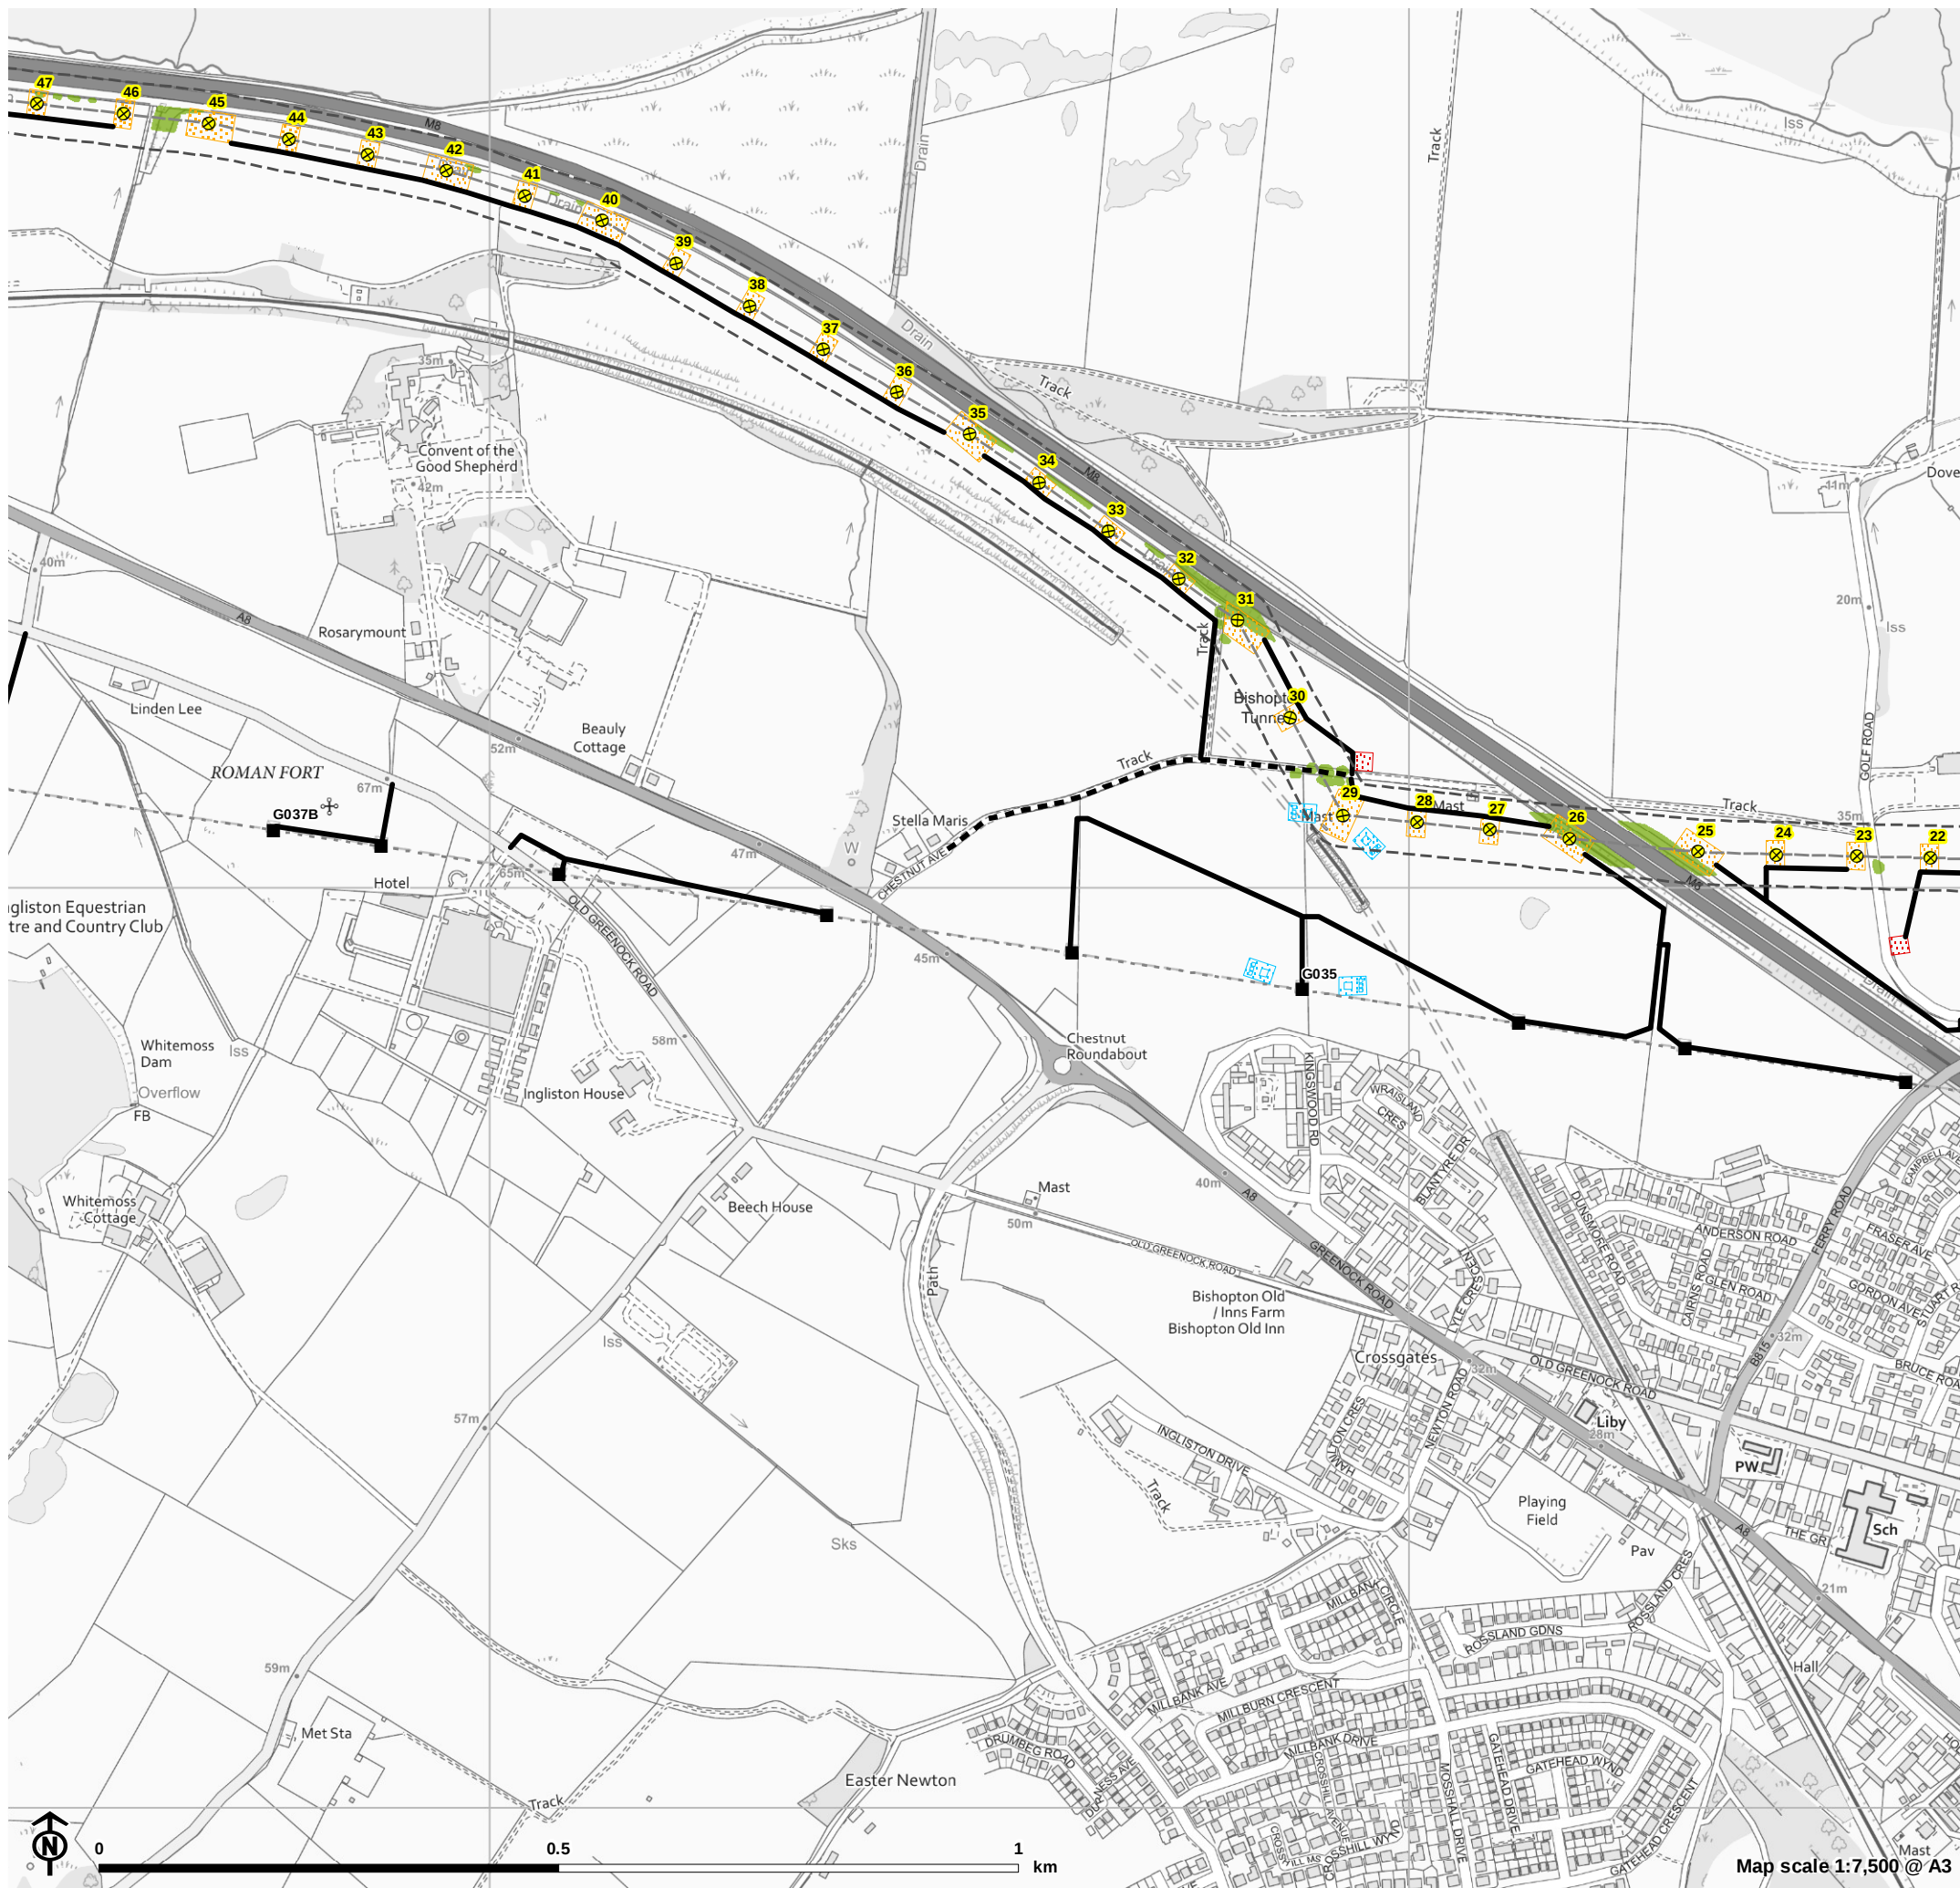


Figure 2g: Section 37 Site Plan

- ⊗ New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- ... Existing 132kV OHL route
- New Access
- - - Existing Access
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave


Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725


This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.

Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay
A member of the staff of the Scottish Ministers

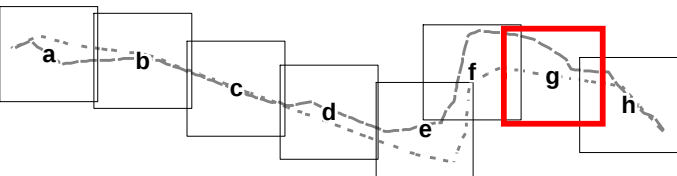

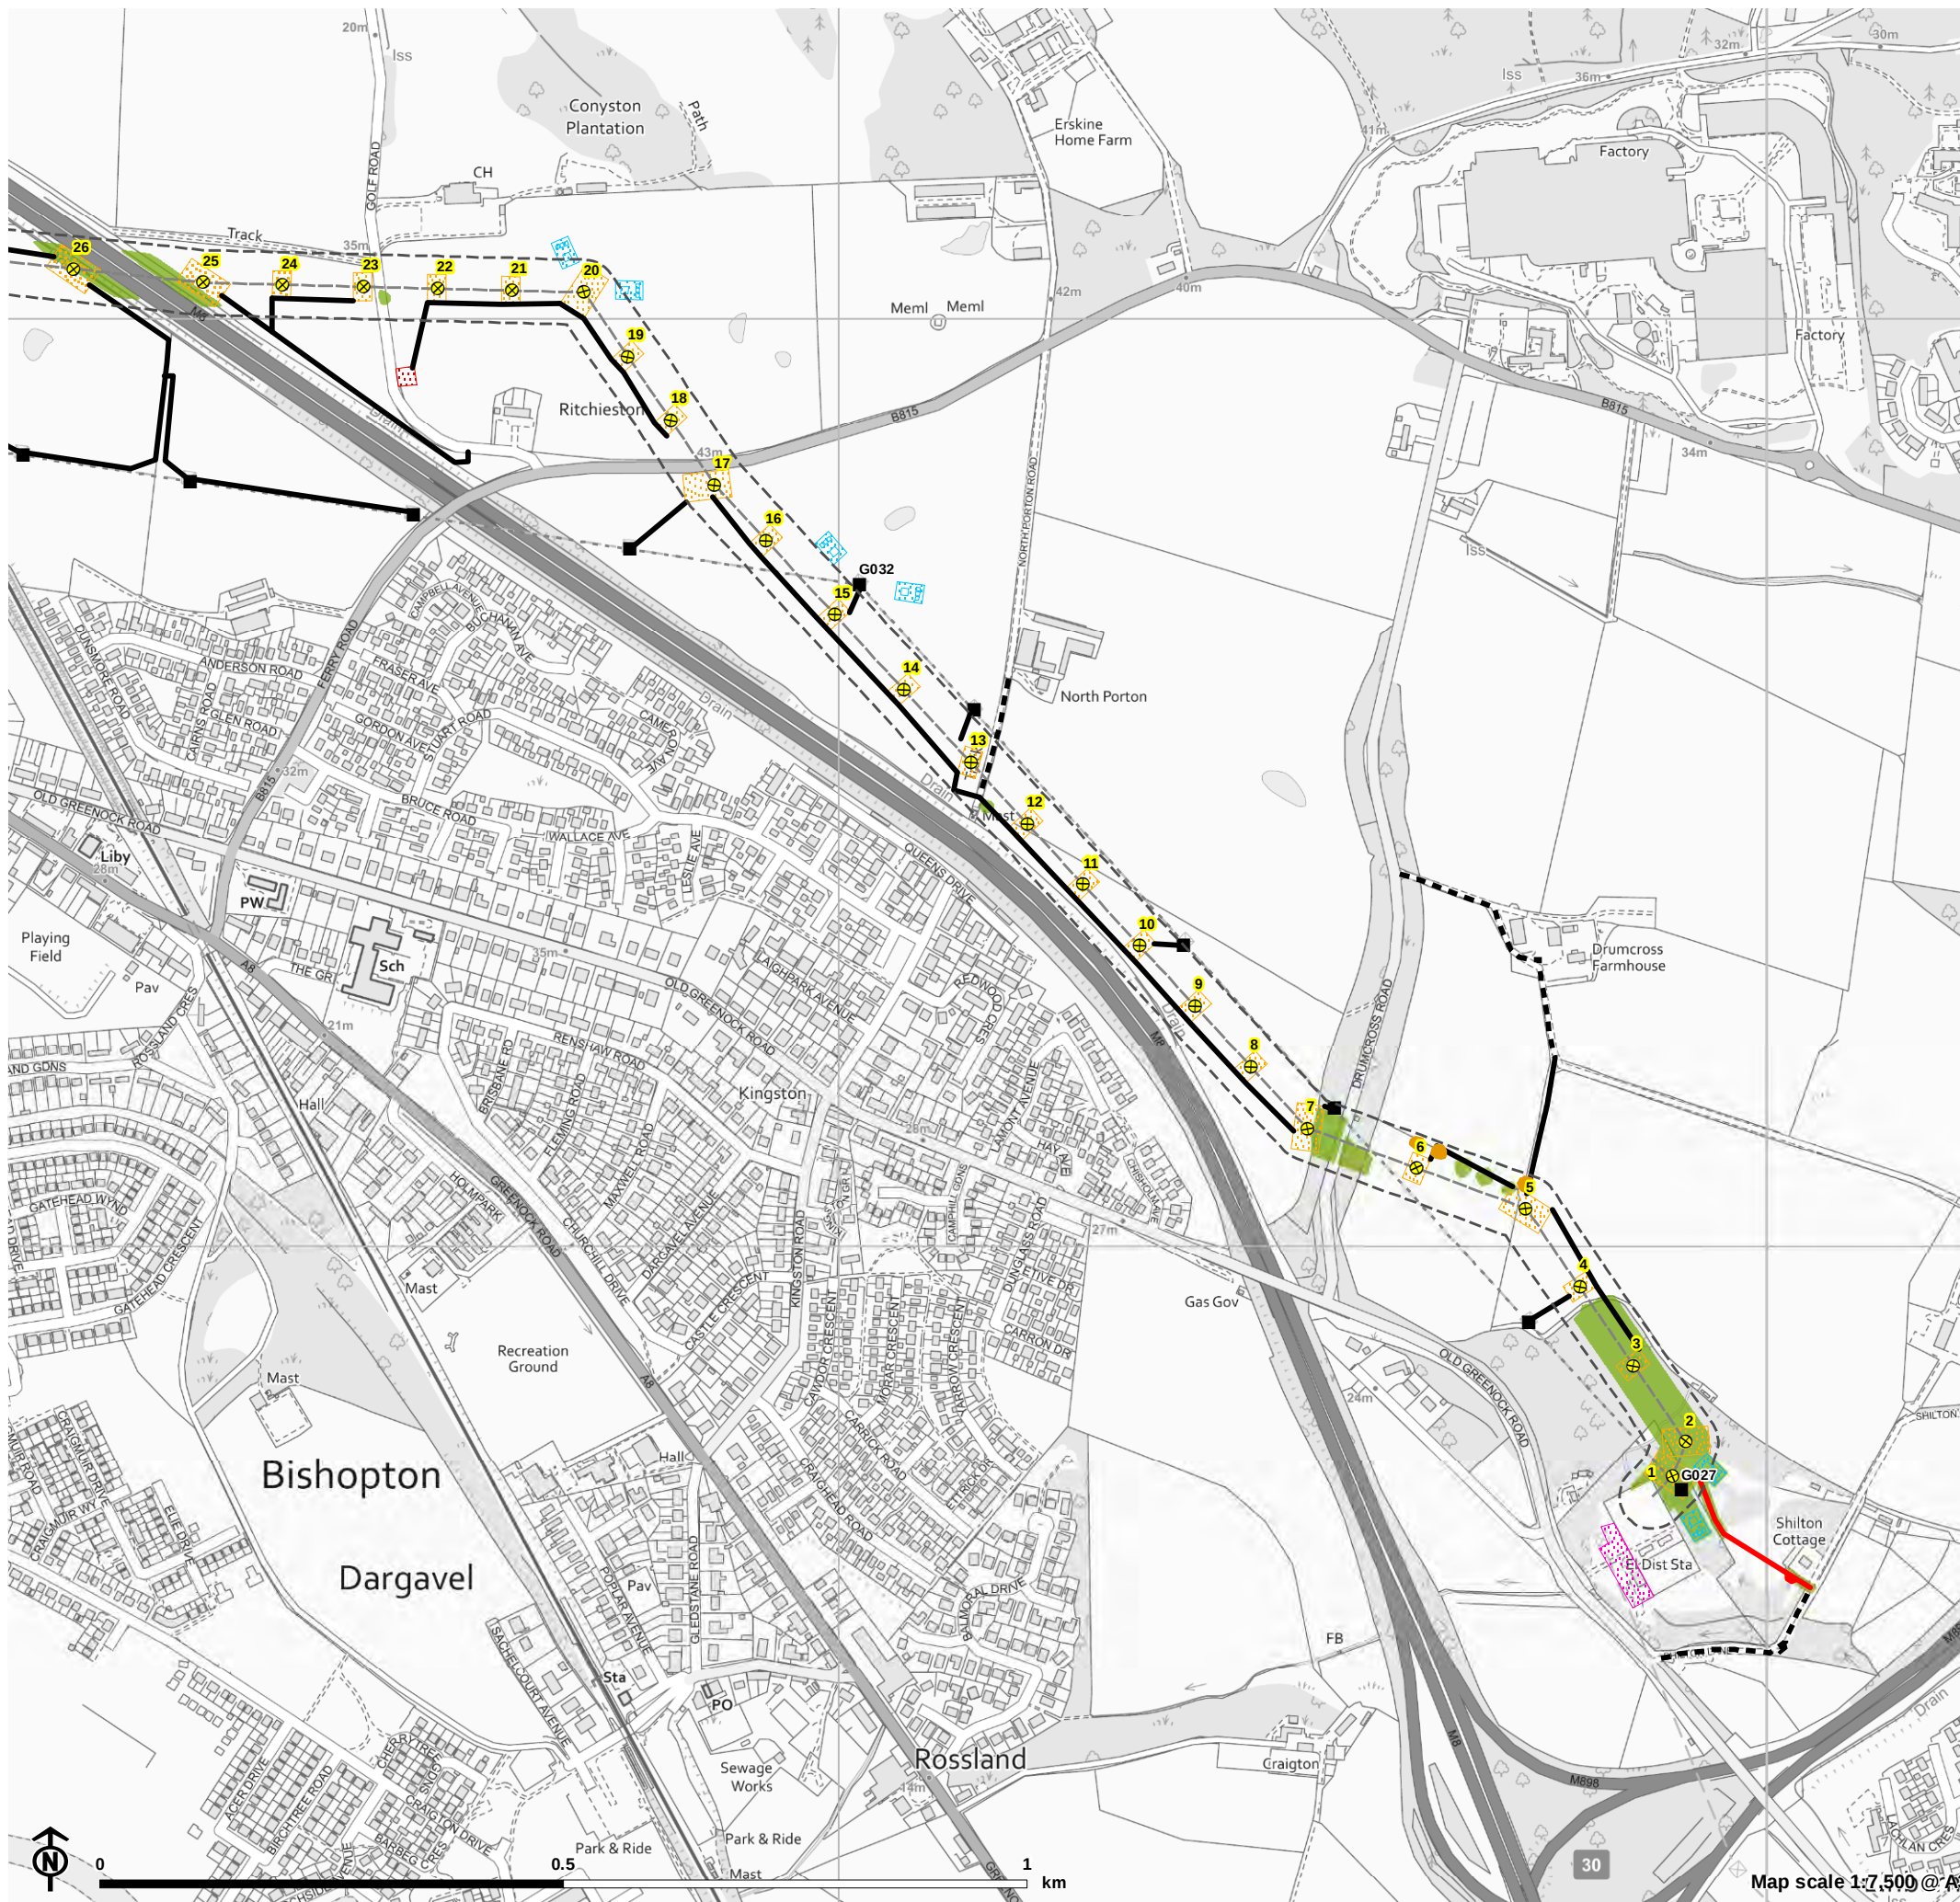

Erskine to Devol Moor
for SPEN



Figure 2h: Section 37 Site Plan

- ⊗ New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)
- New 132kV OHL route
- - - Existing 132kV OHL route
- New Access
- New Access (Stone)
- - - Existing Access
- Construction Compound
- Working Area
- Proposed Stone Laydown Area
- Pulling Position
- 70m Wayleave of proposed new OHL route
- Tree clearance**
- Felling in 70m Wayleave
- Crowning

Pole 1 grid reference: NS449708
Pole 182 grid reference: NS309725

This is the maps referred to in the consent by the Scottish Ministers in terms of Section 37 of the Electricity Act 1989 for consent to install and keep a 132 kV overhead line between Erskine Substation and Devol Moor Substation, in Inverclyde and Renfrewshire Planning Authority area.
Date: 22 June 2023

Pp – *Shafharia Khataza*

For Ruth Findlay

A member of the staff of the Scottish Ministers

