



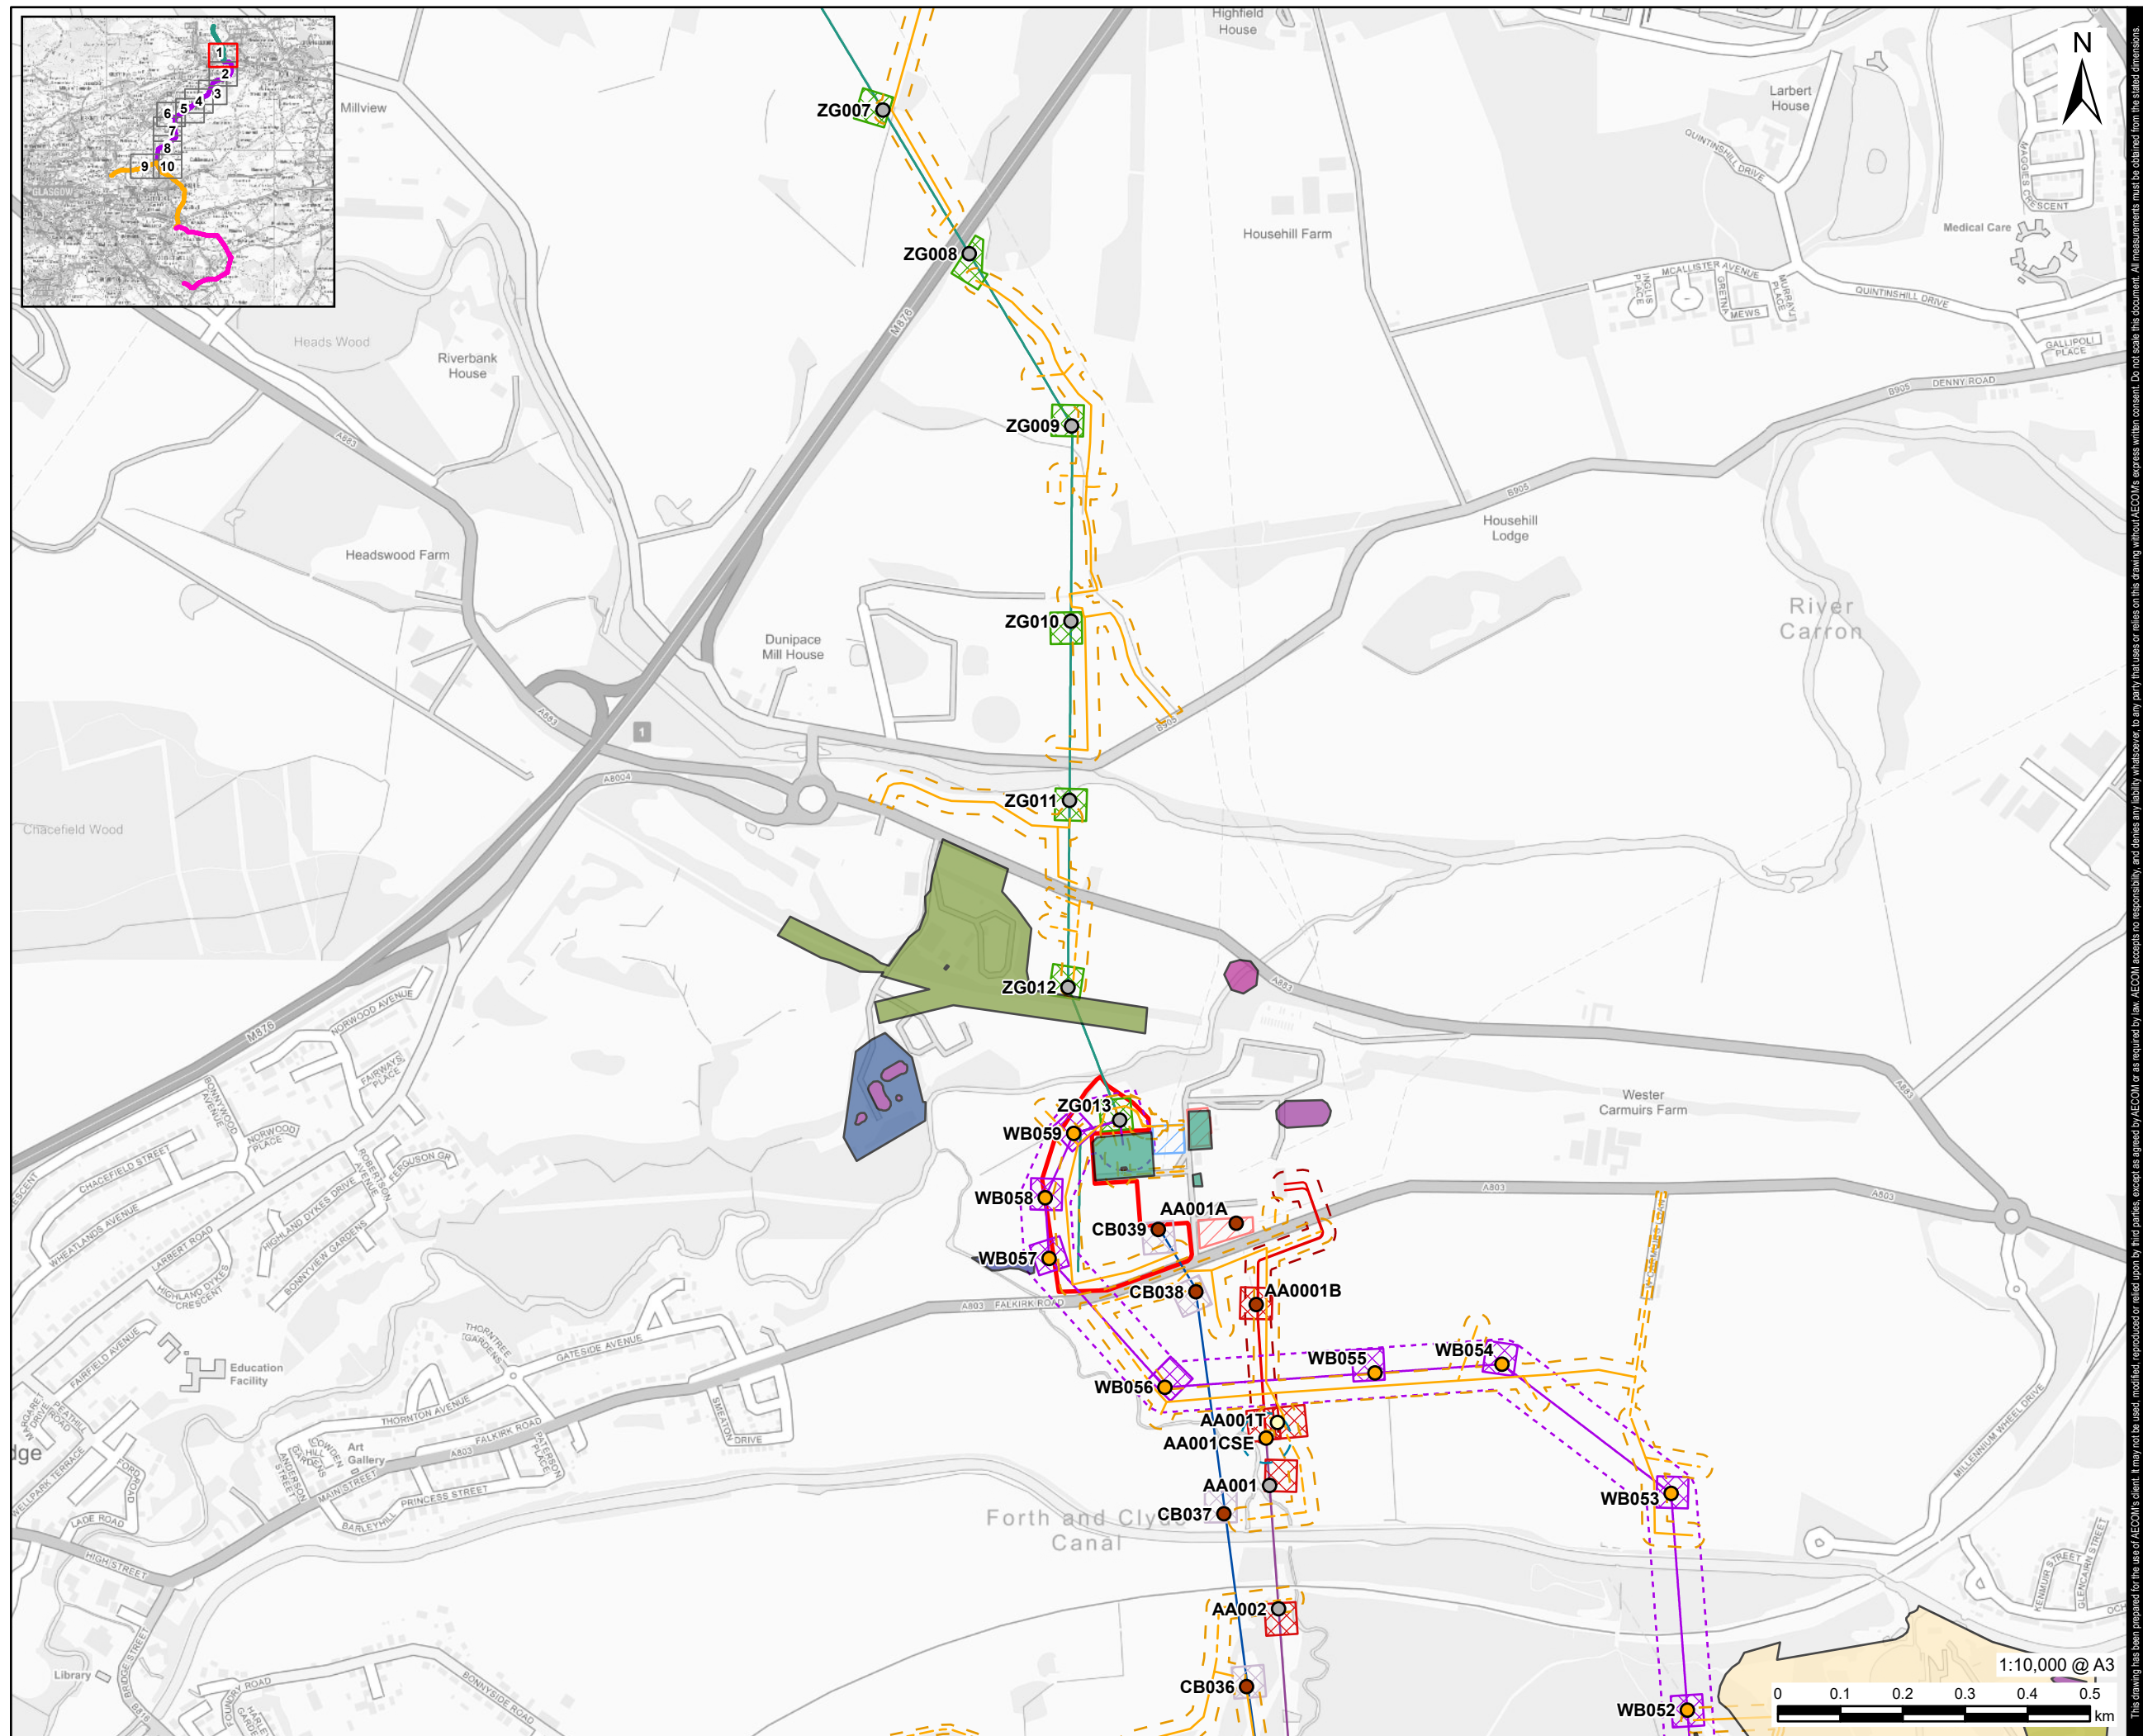

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any ability whatsoever, in any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

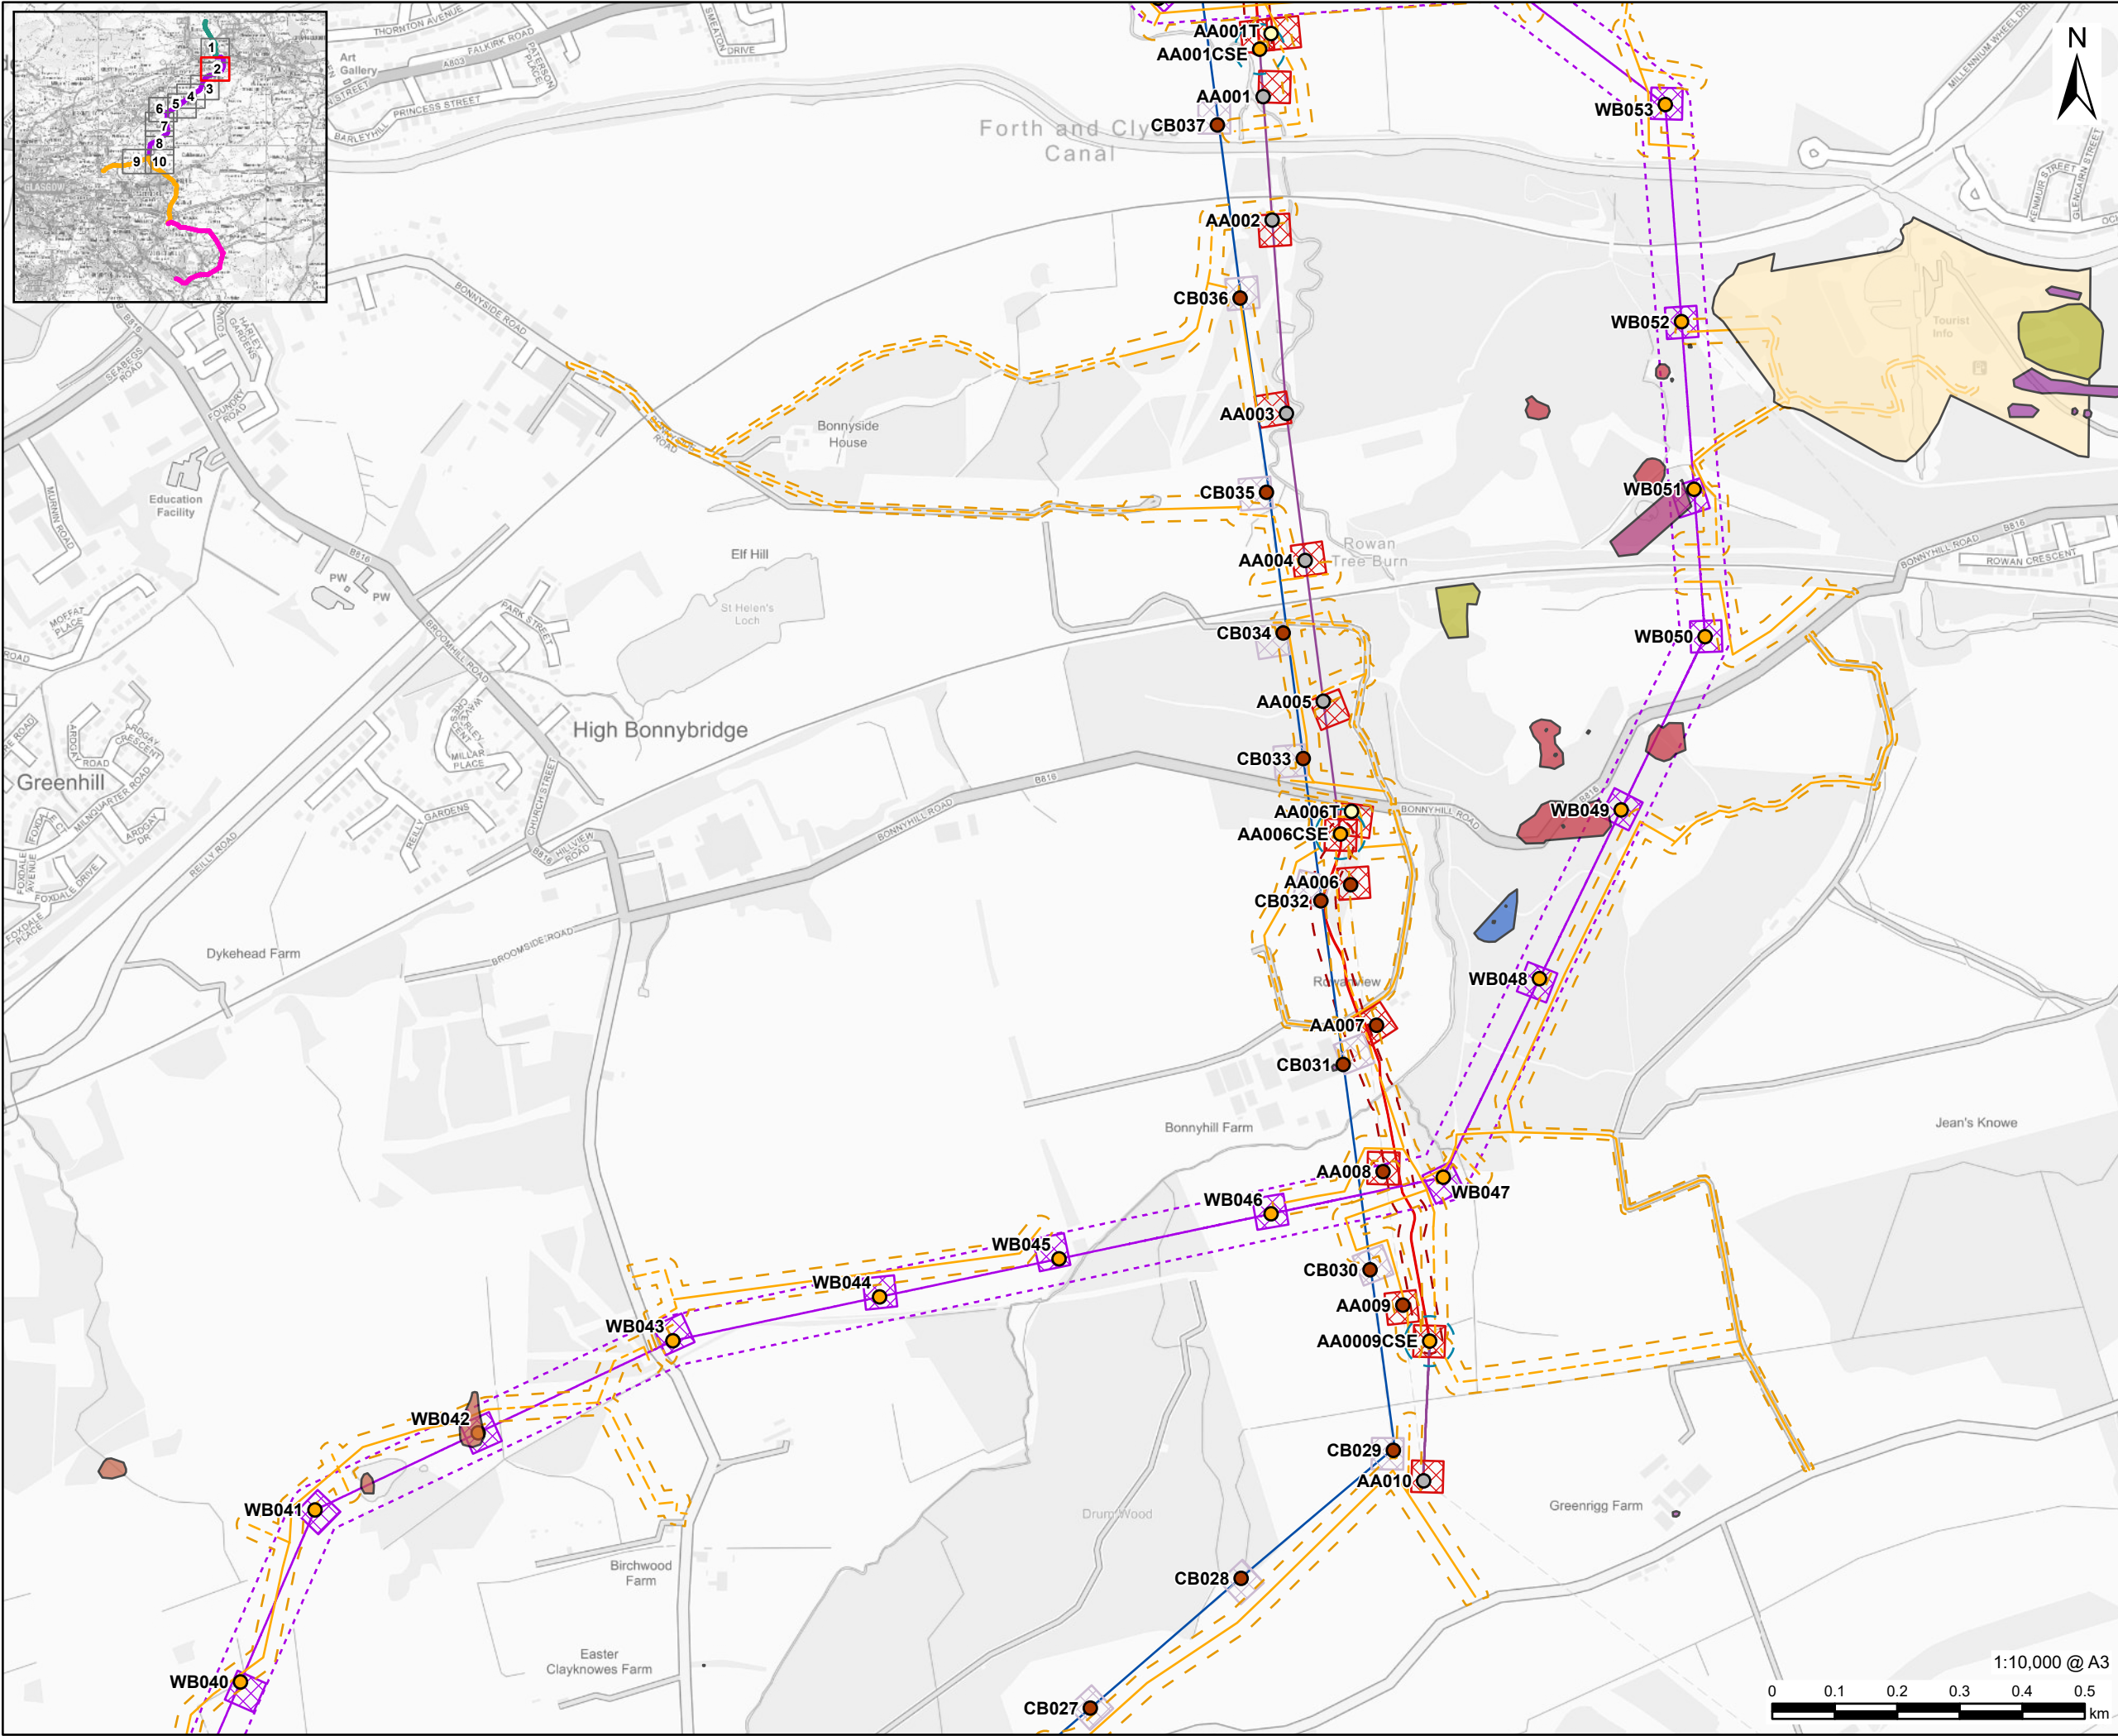

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Tower to be Removed
- New Build Tower Compound
- CB Tower Compound
- AA Tower Compound
- New Build Overhead Line
- CB Route Removal
- AA Alignment
- AA Route Undergrounding
- New Build Overhead Line Limit of Deviation
- AA Route Undergrounding Limit of Deviation
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Potential Sources of Contamination
 - Chemical / Engineering Works
 - Engineering Works
 - Ironstone Pit
 - Ironstone Shaft
 - Opencast
 - Pond
 - Shaft
 - Tank

NOTES

Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Potential Sources of Contamination

FIGURE NUMBER

Figure 10.5 (Sheet 2 of 10)

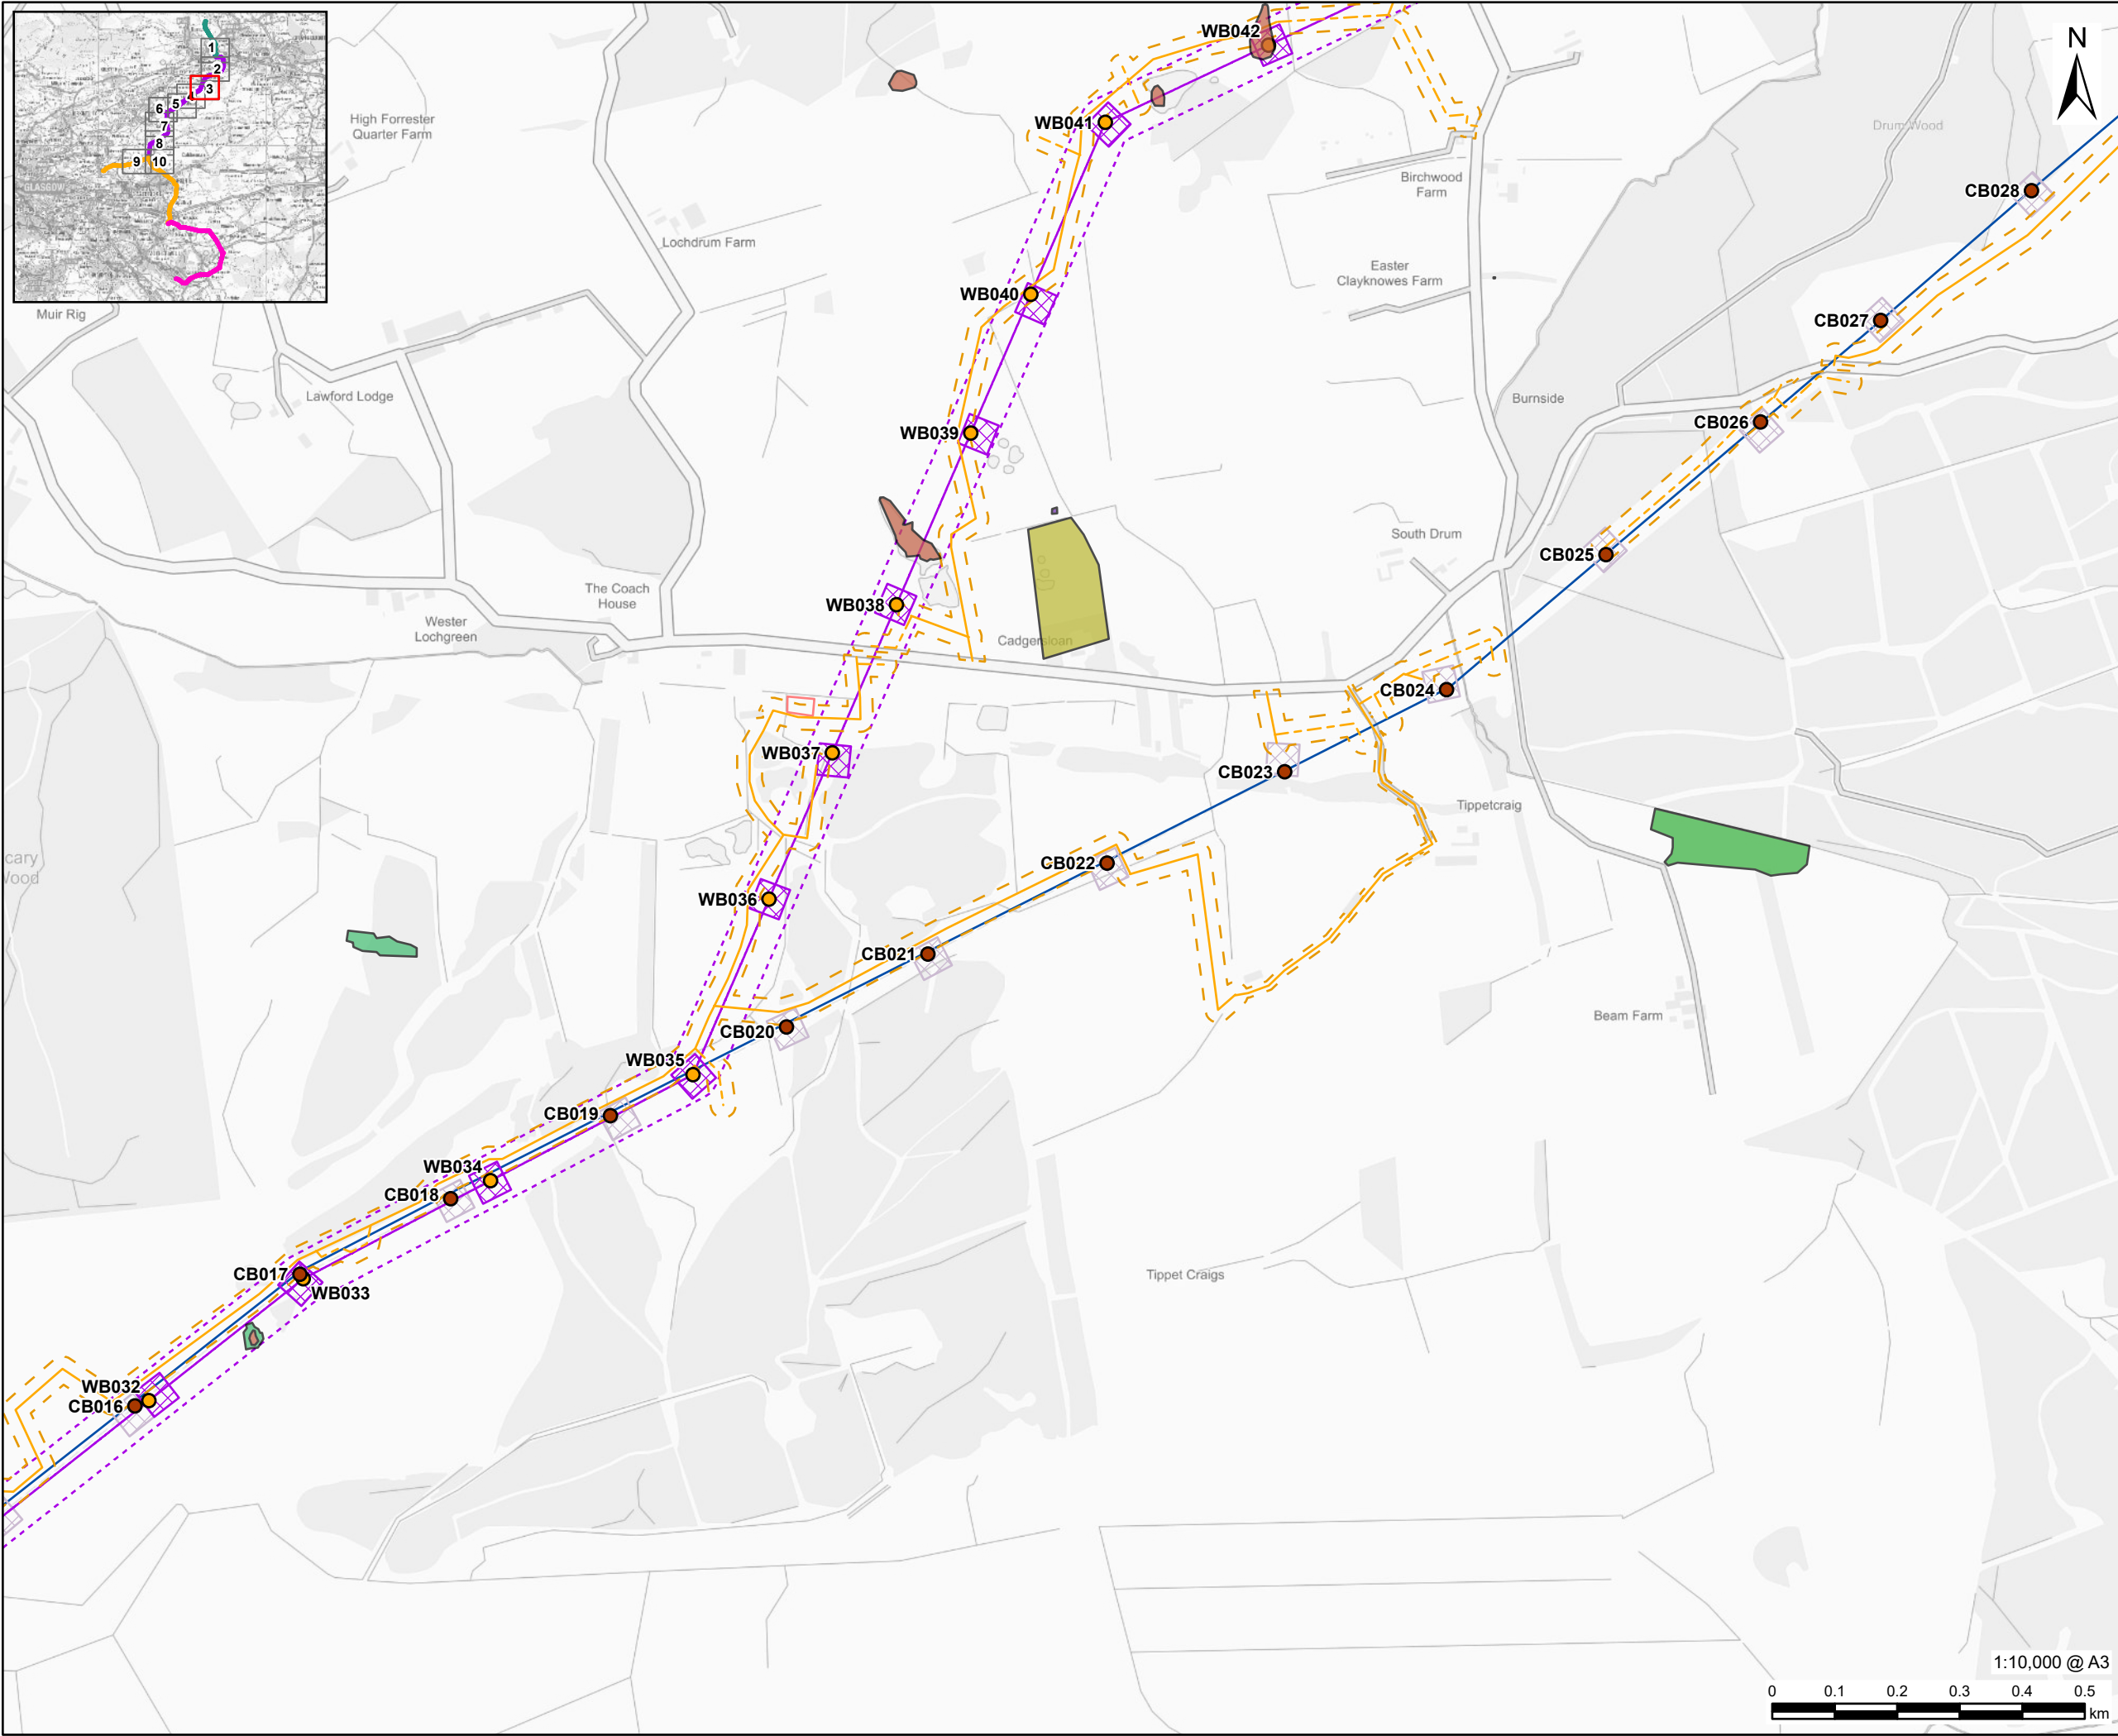

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Tower to be Removed
- New Build Tower Compound
- CB Tower Compound
- New Build Overhead Line
- CB Route Removal
- New Build Overhead Line Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Overhead Line Site Compound
- Potential Sources of Contamination
 - Active or Recent Landfill
 - Engineering Works
 - Pond
 - Quarry
 - Shaft

NOTES

Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Potential Sources of Contamination

FIGURE NUMBER

Figure 10.5 (Sheet 3 of 10)

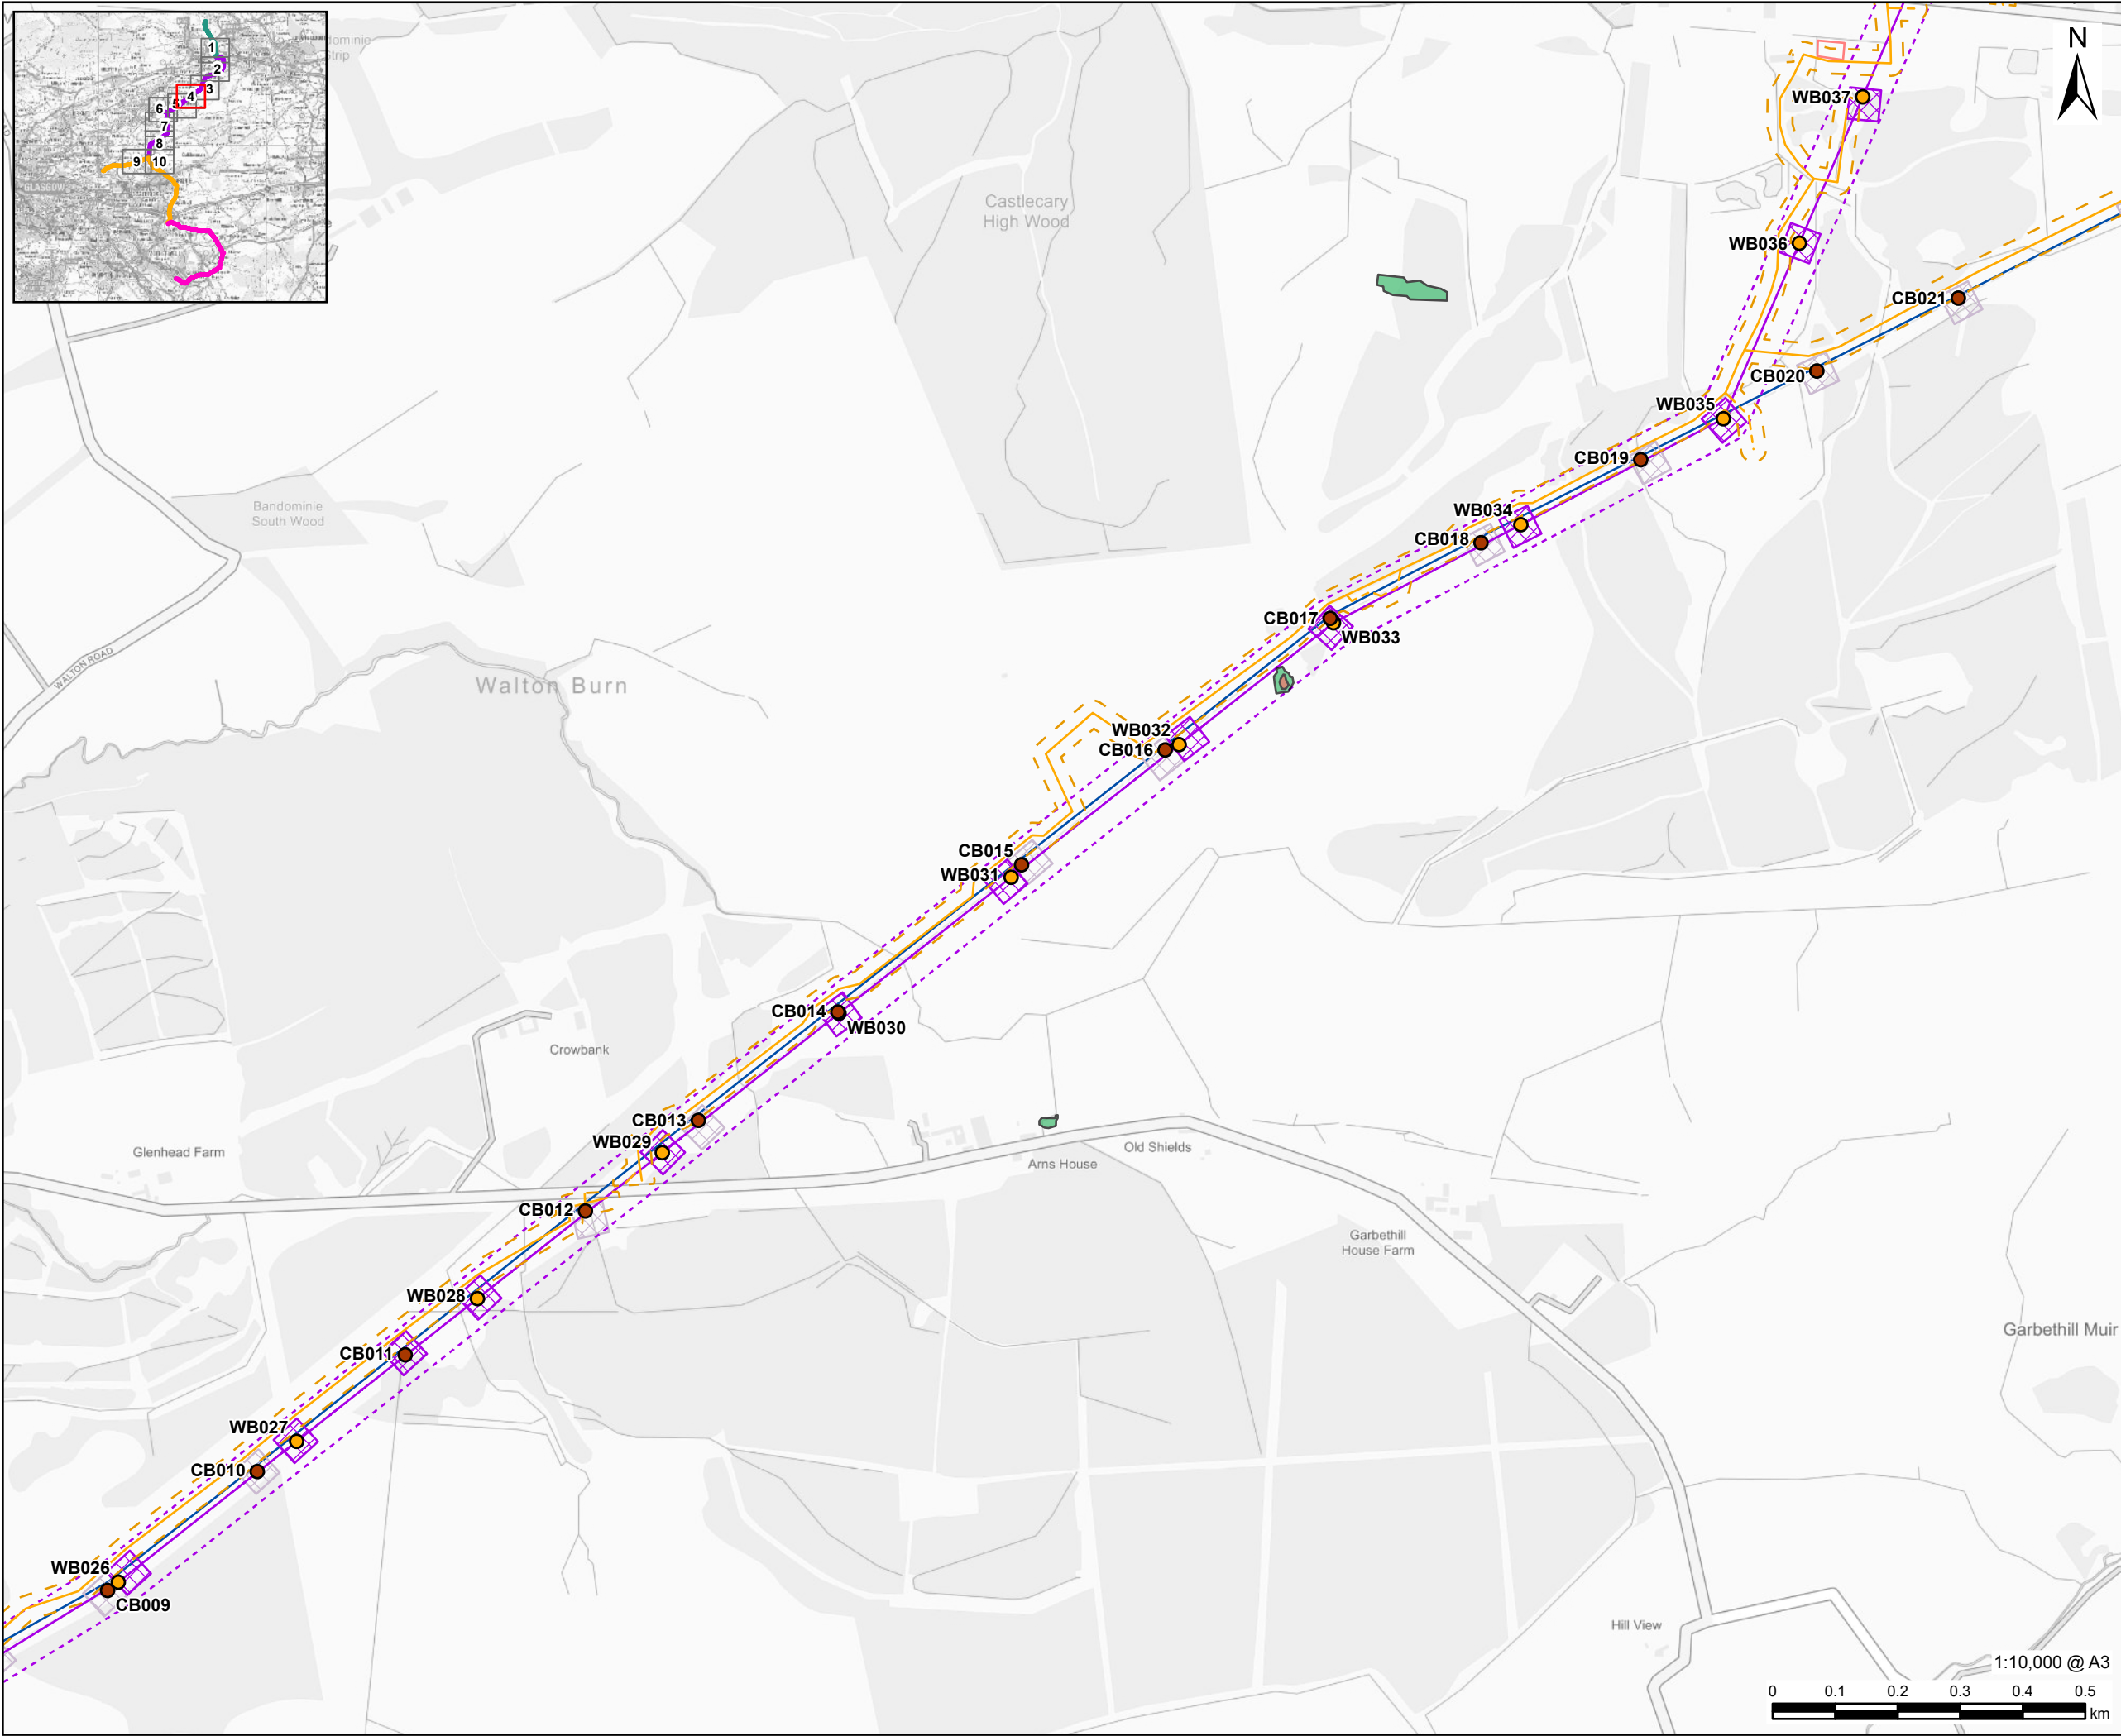

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Tower to be Removed
- New Build Tower Compound
- CB Tower Compound
- New Build Overhead Line
- CB Route Removal
- New Build Overhead Line Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Overhead Line Site Compound
- Potential Sources of Contamination
 - Engineering Works
 - Pond
 - Quarry

NOTES

Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Potential Sources of Contamination

FIGURE NUMBER

Figure 10.5 (Sheet 4 of 10)

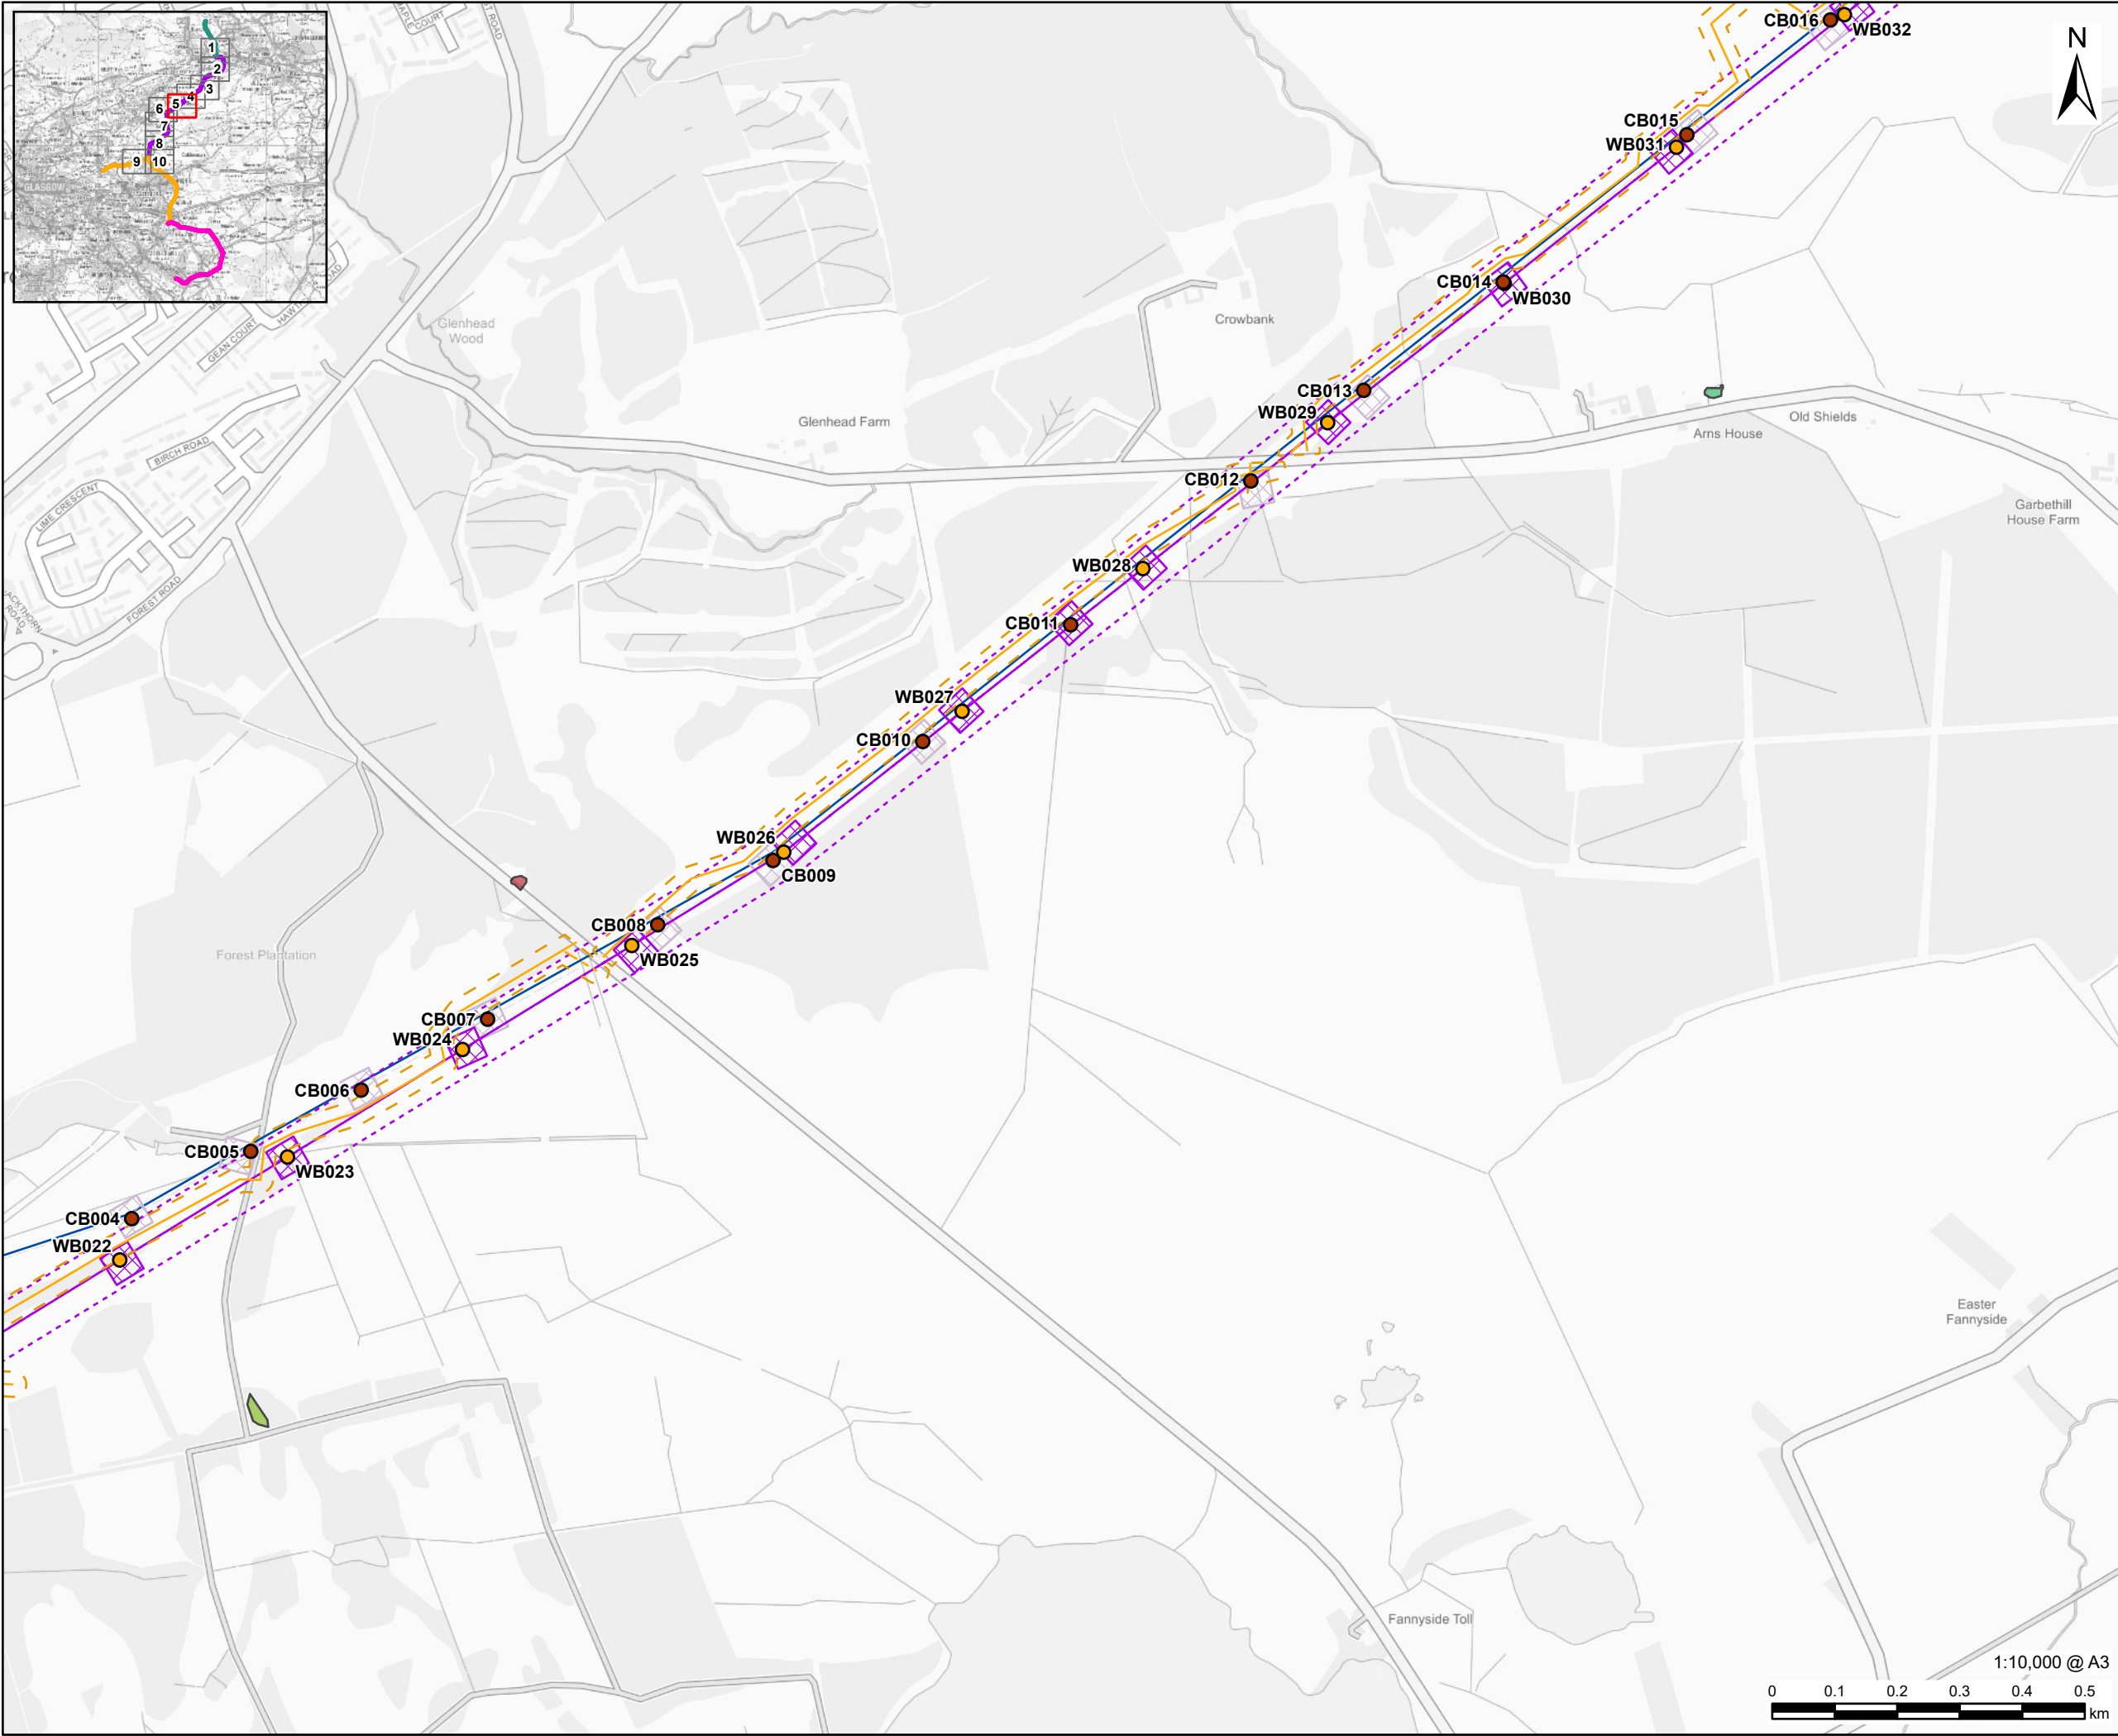

AECOM

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- New Tower
 - Tower to be Removed
 - New Build Tower Compound
 - CB Tower Compound
 - New Build Overhead Line
 - CB Route Removal
 - New Build Overhead Line Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Potential Sources of Contamination
 - Ironstone Pit
 - Limekiln
 - Quarry

NOTES
Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025


ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Potential Sources of Contamination

FIGURE NUMBER
Figure 10.5 (Sheet 5 of 10)

1:10,000 @ A3
0 0.1 0.2 0.3 0.4 0.5 km

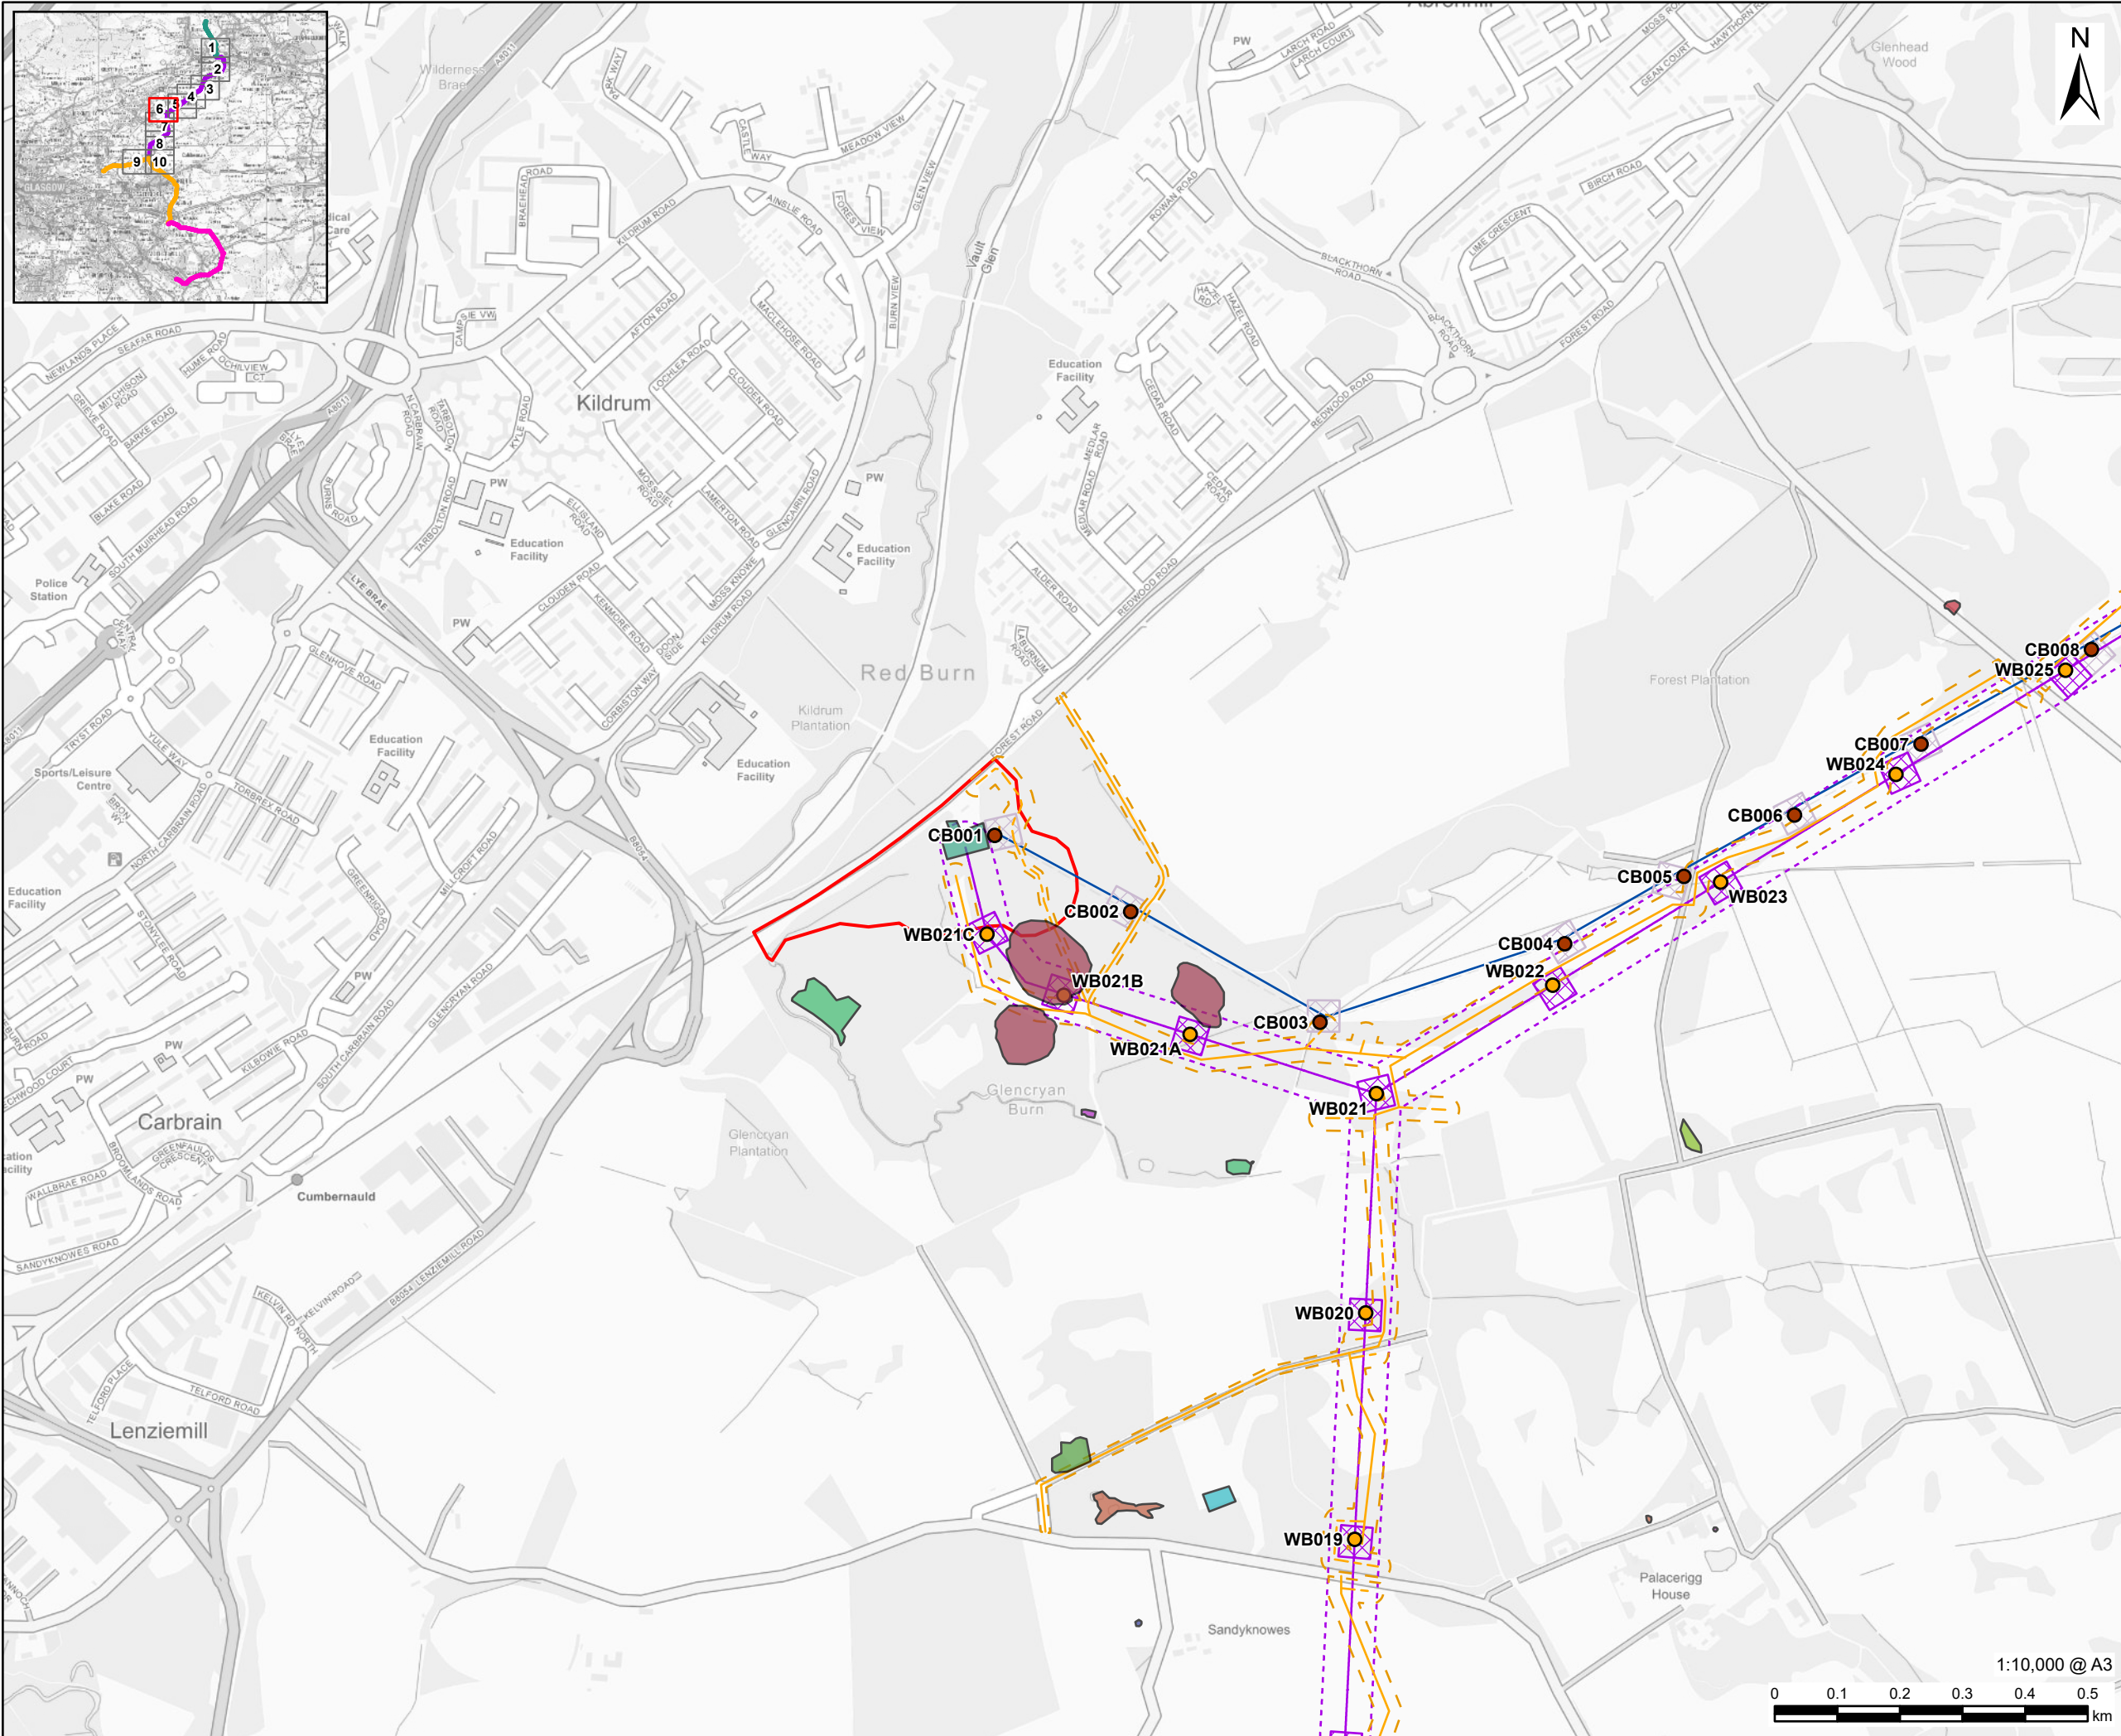

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Tower to be Removed
- Cumbernauld Substation Site Boundary
- New Build Tower Compound
- CB Tower Compound
- New Build Overhead Line
- CB Route Removal
- New Build Overhead Line Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation

Potential Sources of Contamination

- Electrical Substation
- Filtering Beds
- Ironstone Pit
- Limekiln
- Orchard
- Pond
- Quarry
- Refuse Tip
- Sand Pit
- Shaft
- Spoil Heap
- Tank

NOTES

Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Potential Sources of Contamination

FIGURE NUMBER

Figure 10.5 (Sheet 6 of 10)

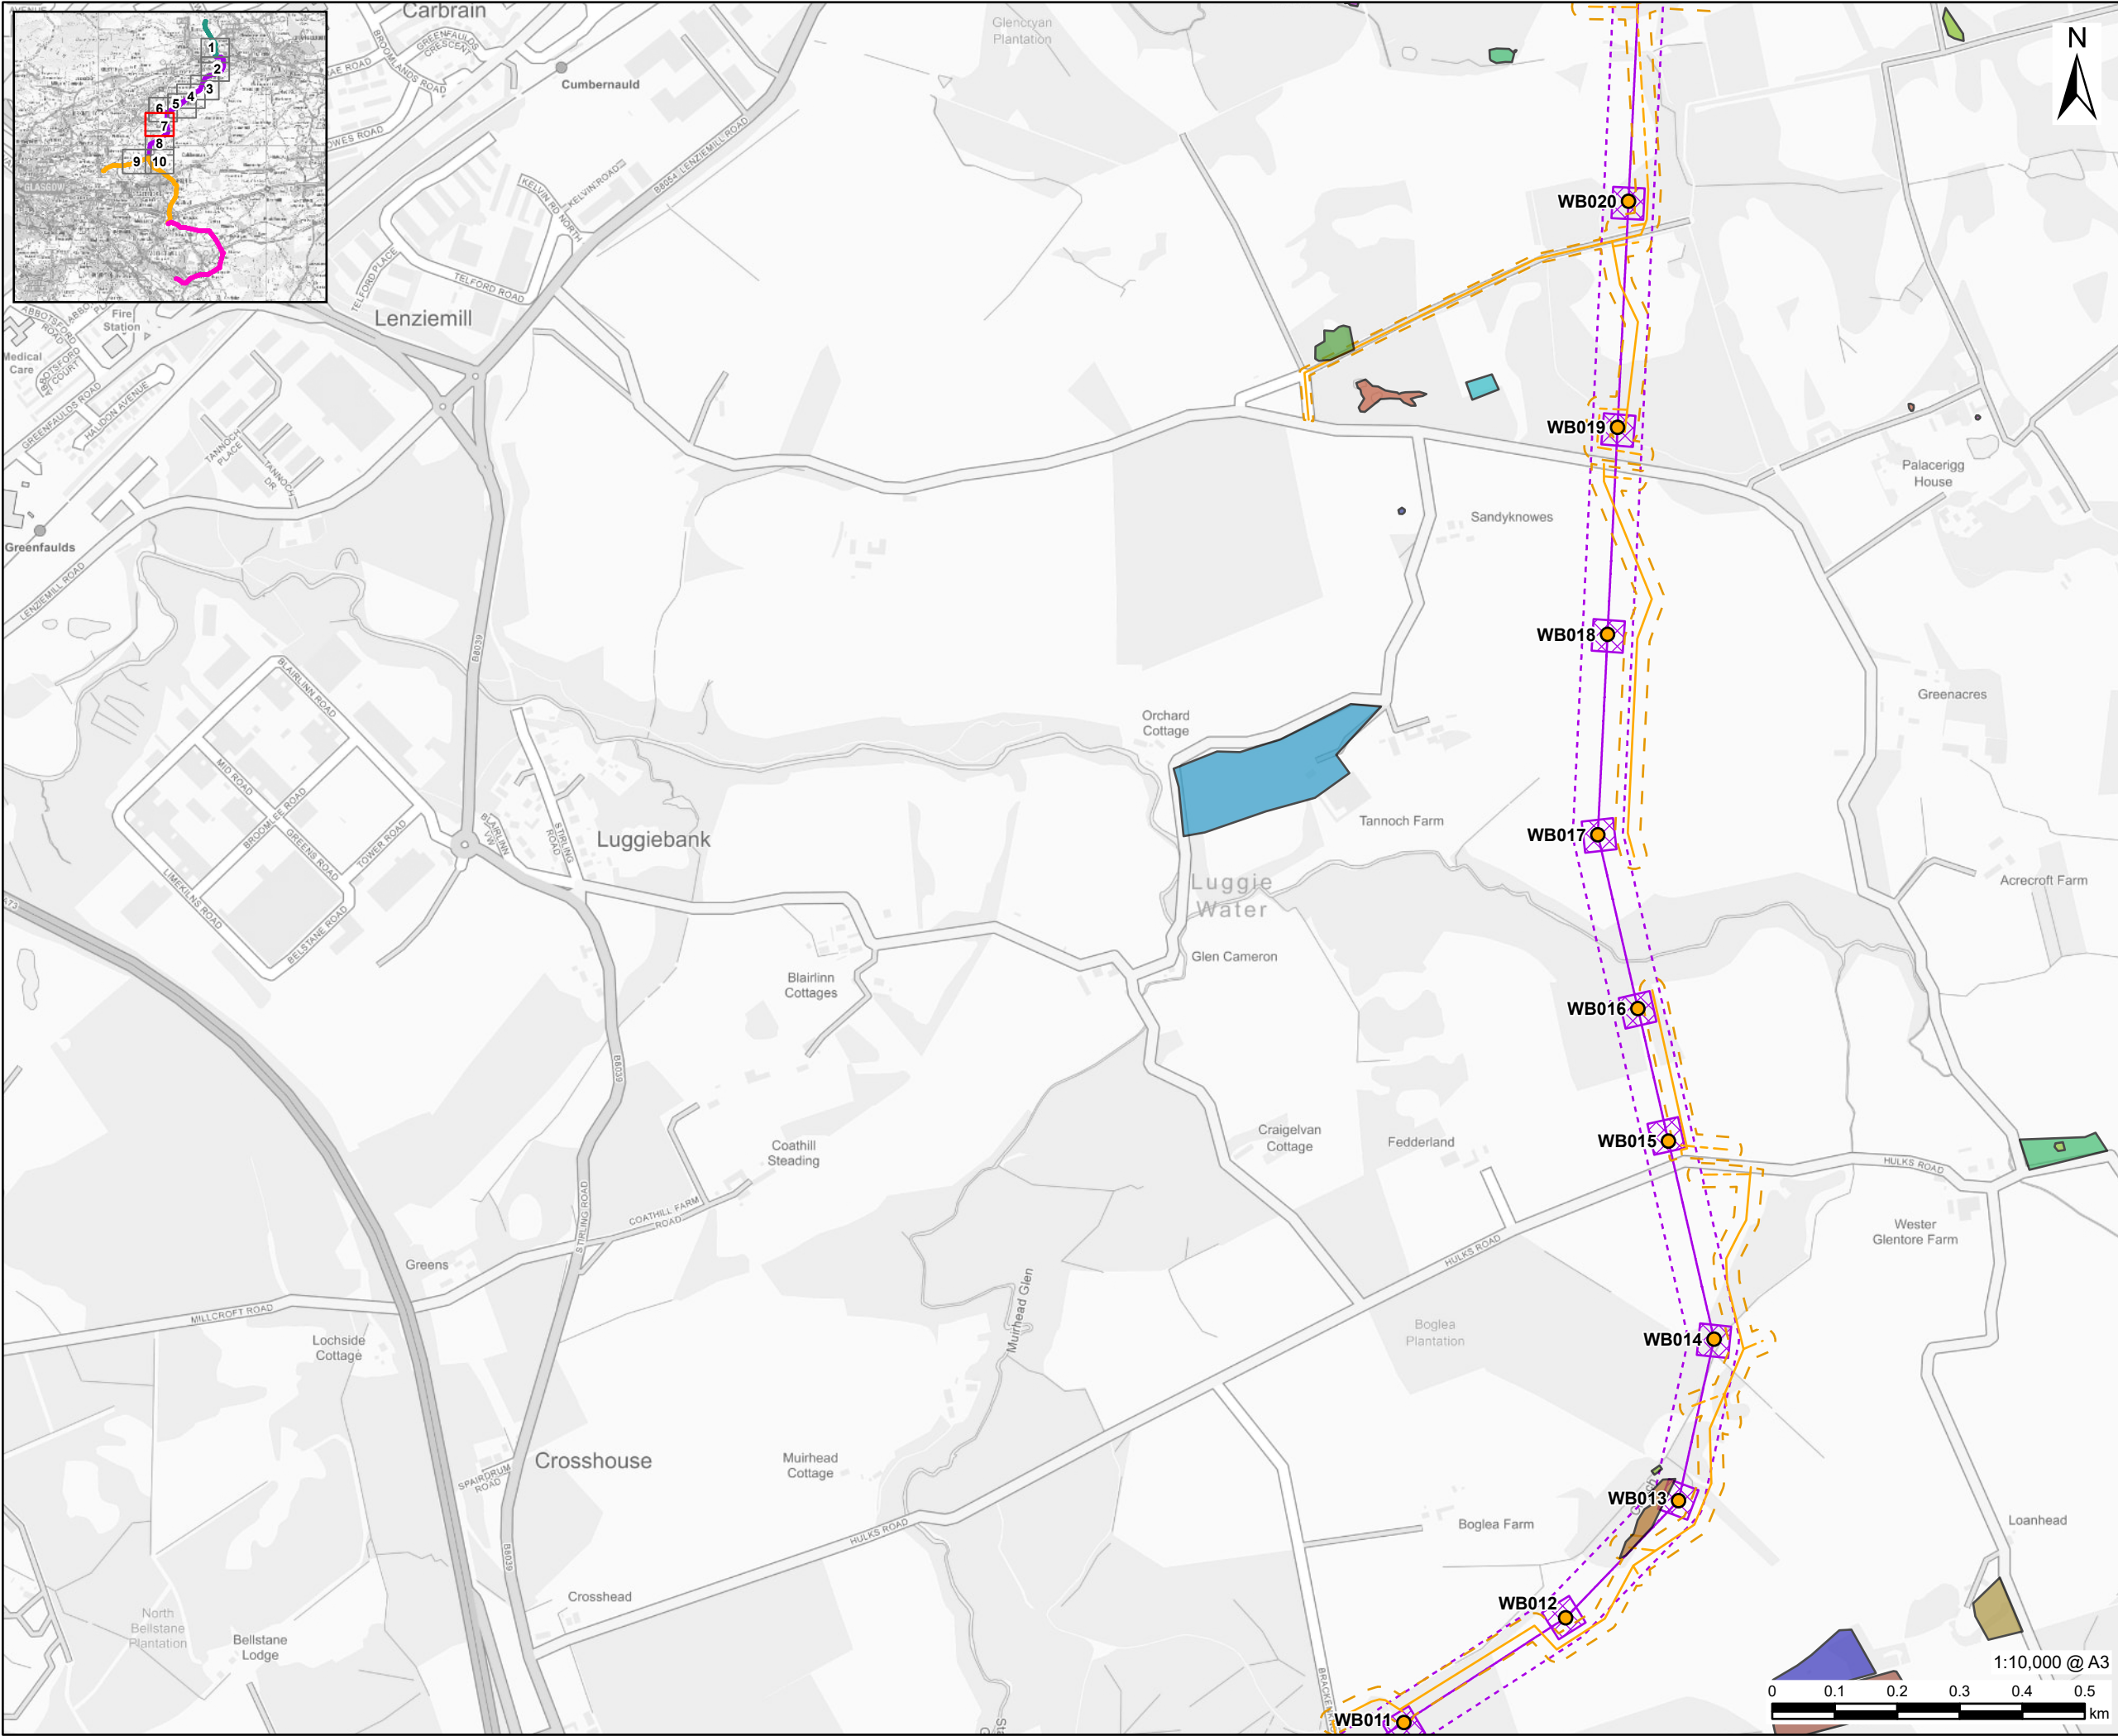

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- New Tower
 - New Build Tower Compound
 - New Build Overhead Line
 - New Build Overhead Line Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Potential Sources of Contamination
- Chemical Works
 - Coal Mine
 - Colliery
 - Filtering Beds
 - Limekiln
 - Orchard
 - Pond
 - Quarry
 - Refuse Tip / Colliery
 - Sand Pit
 - Shaft
 - Slag Heap
 - Spoil Heap
 - Tank


NOTES
Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Potential Sources of Contamination

FIGURE NUMBER
Figure 10.5 (Sheet 7 of 10)

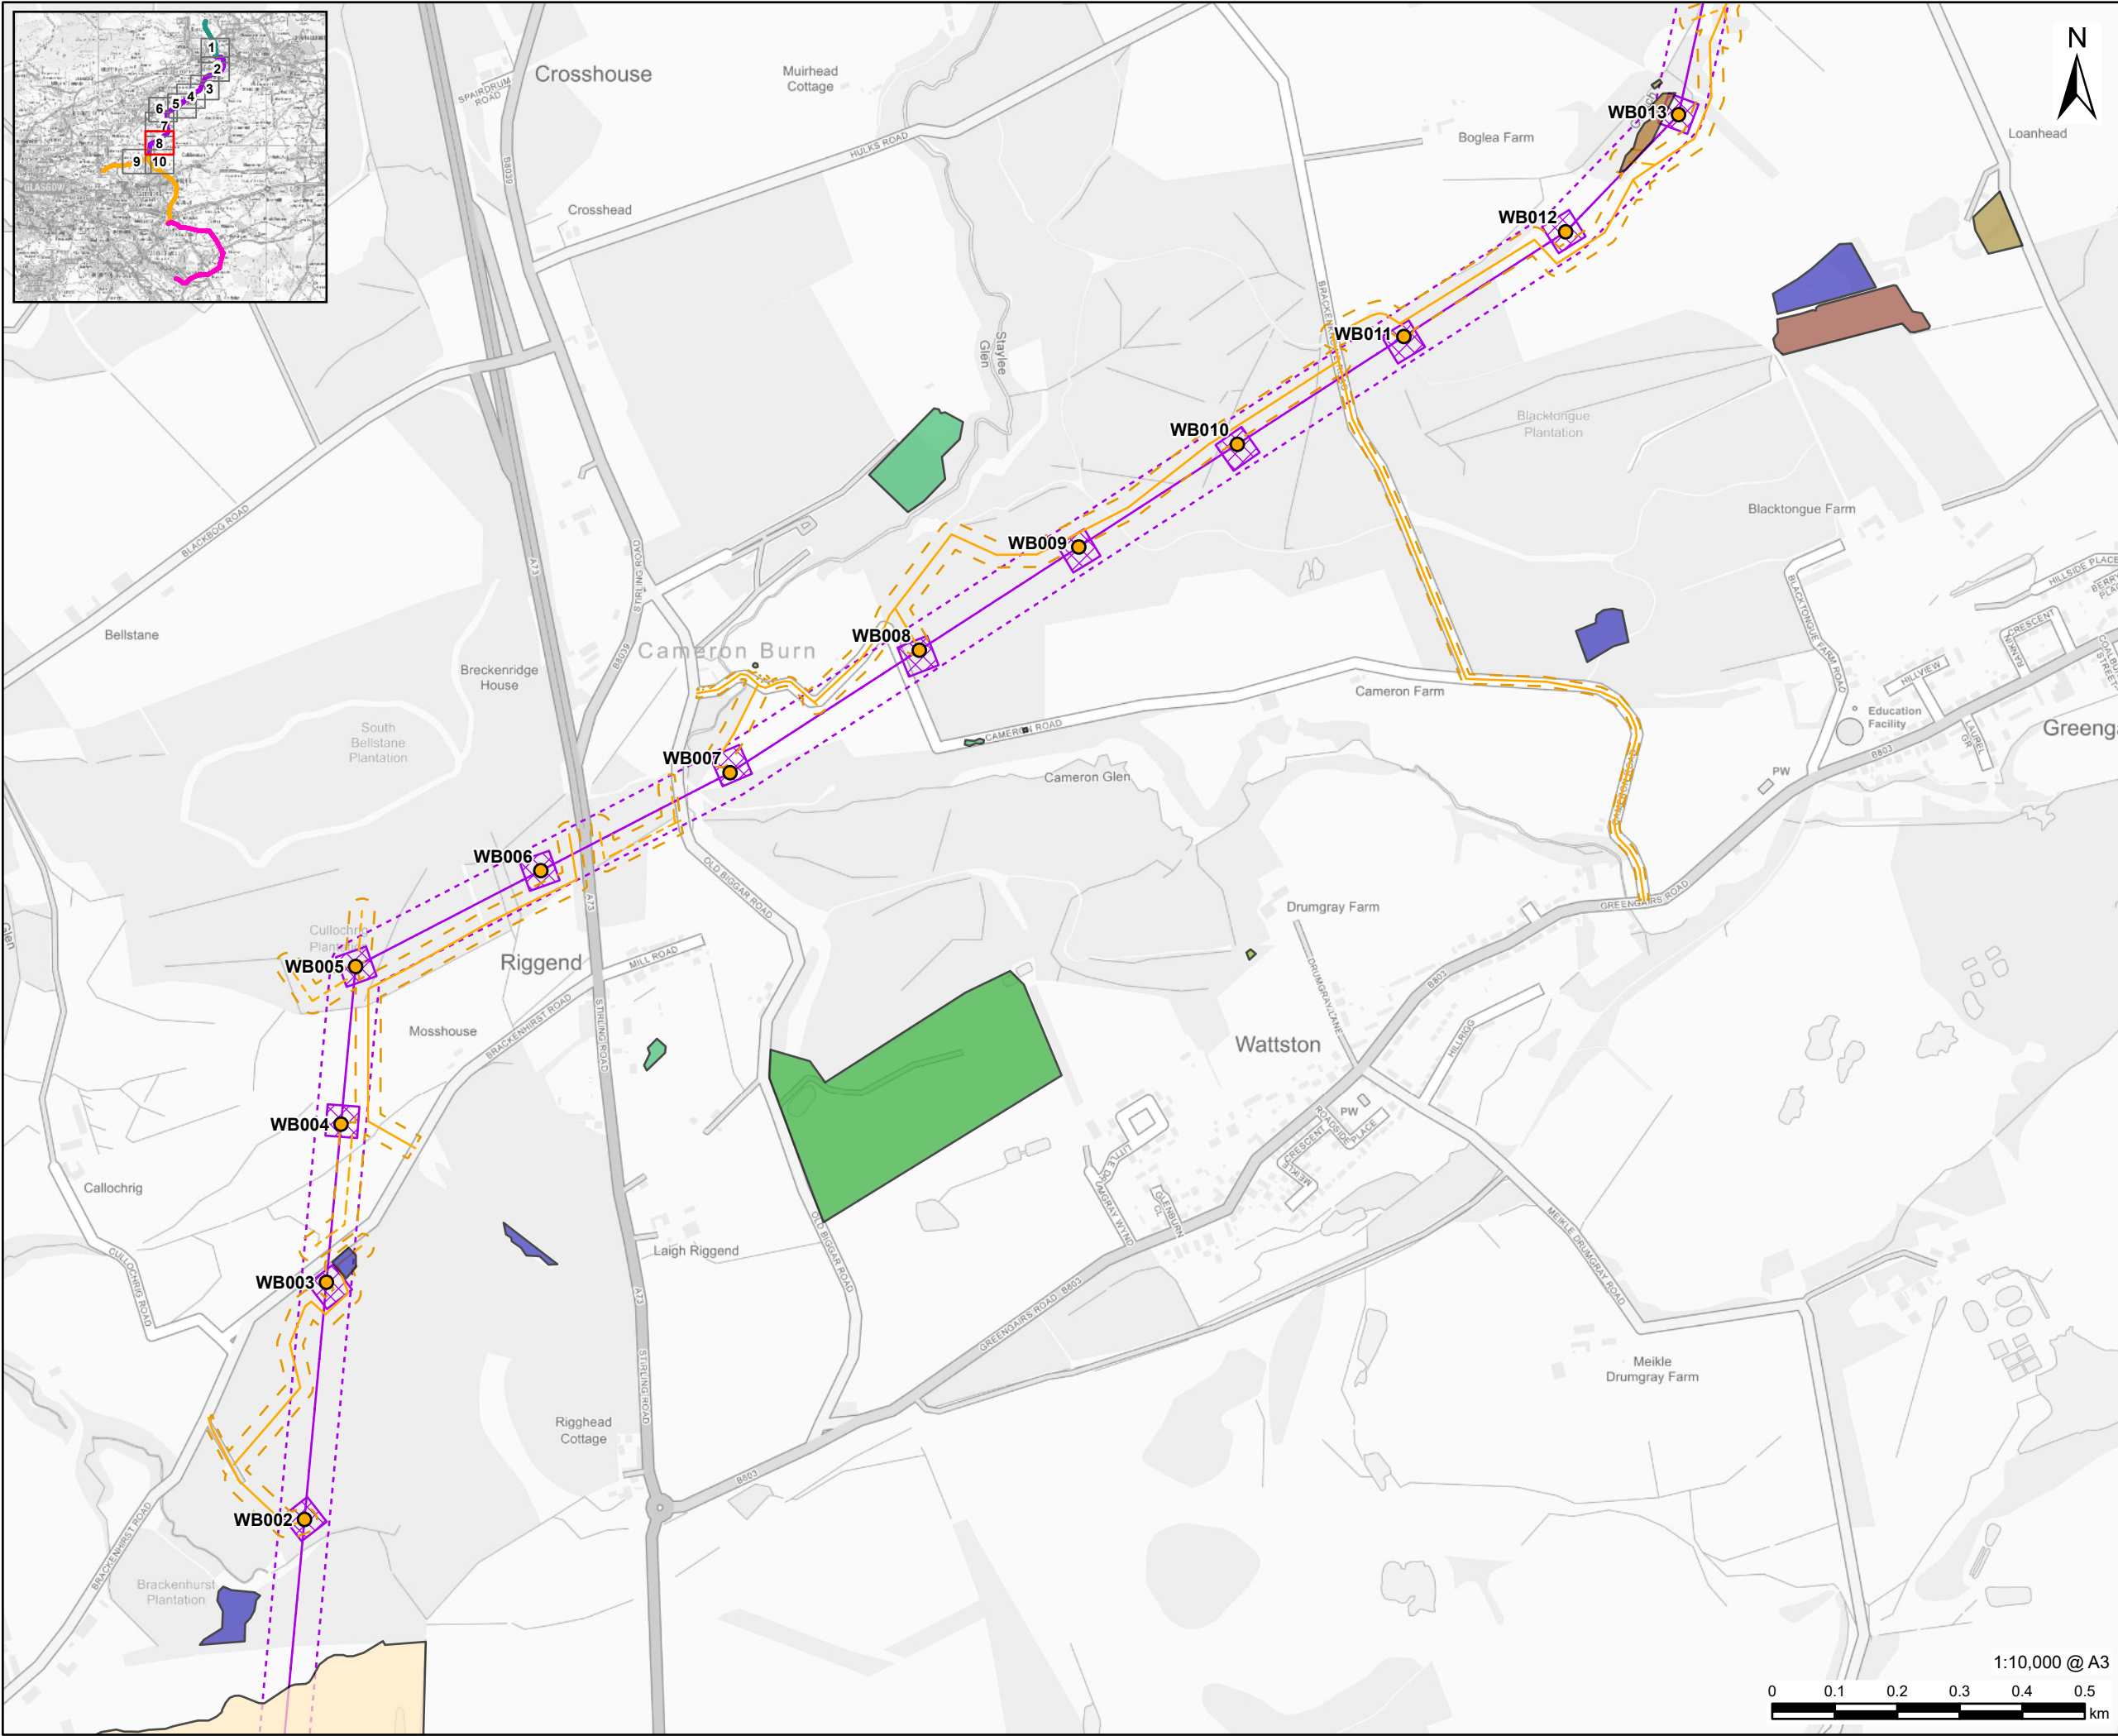

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- New Build Tower Compound
- New Build Overhead Line
- New Build Overhead Line Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation

Potential Sources of Contamination

- Active or Recent Landfill
- Coal Mine
- Colliery
- Limekiln
- Opencast
- Quarry
- Refuse Tip / Colliery
- Slag Heap

NOTES

Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE


Potential Sources of Contamination

FIGURE NUMBER

Figure 10.5 (Sheet 8 of 10)

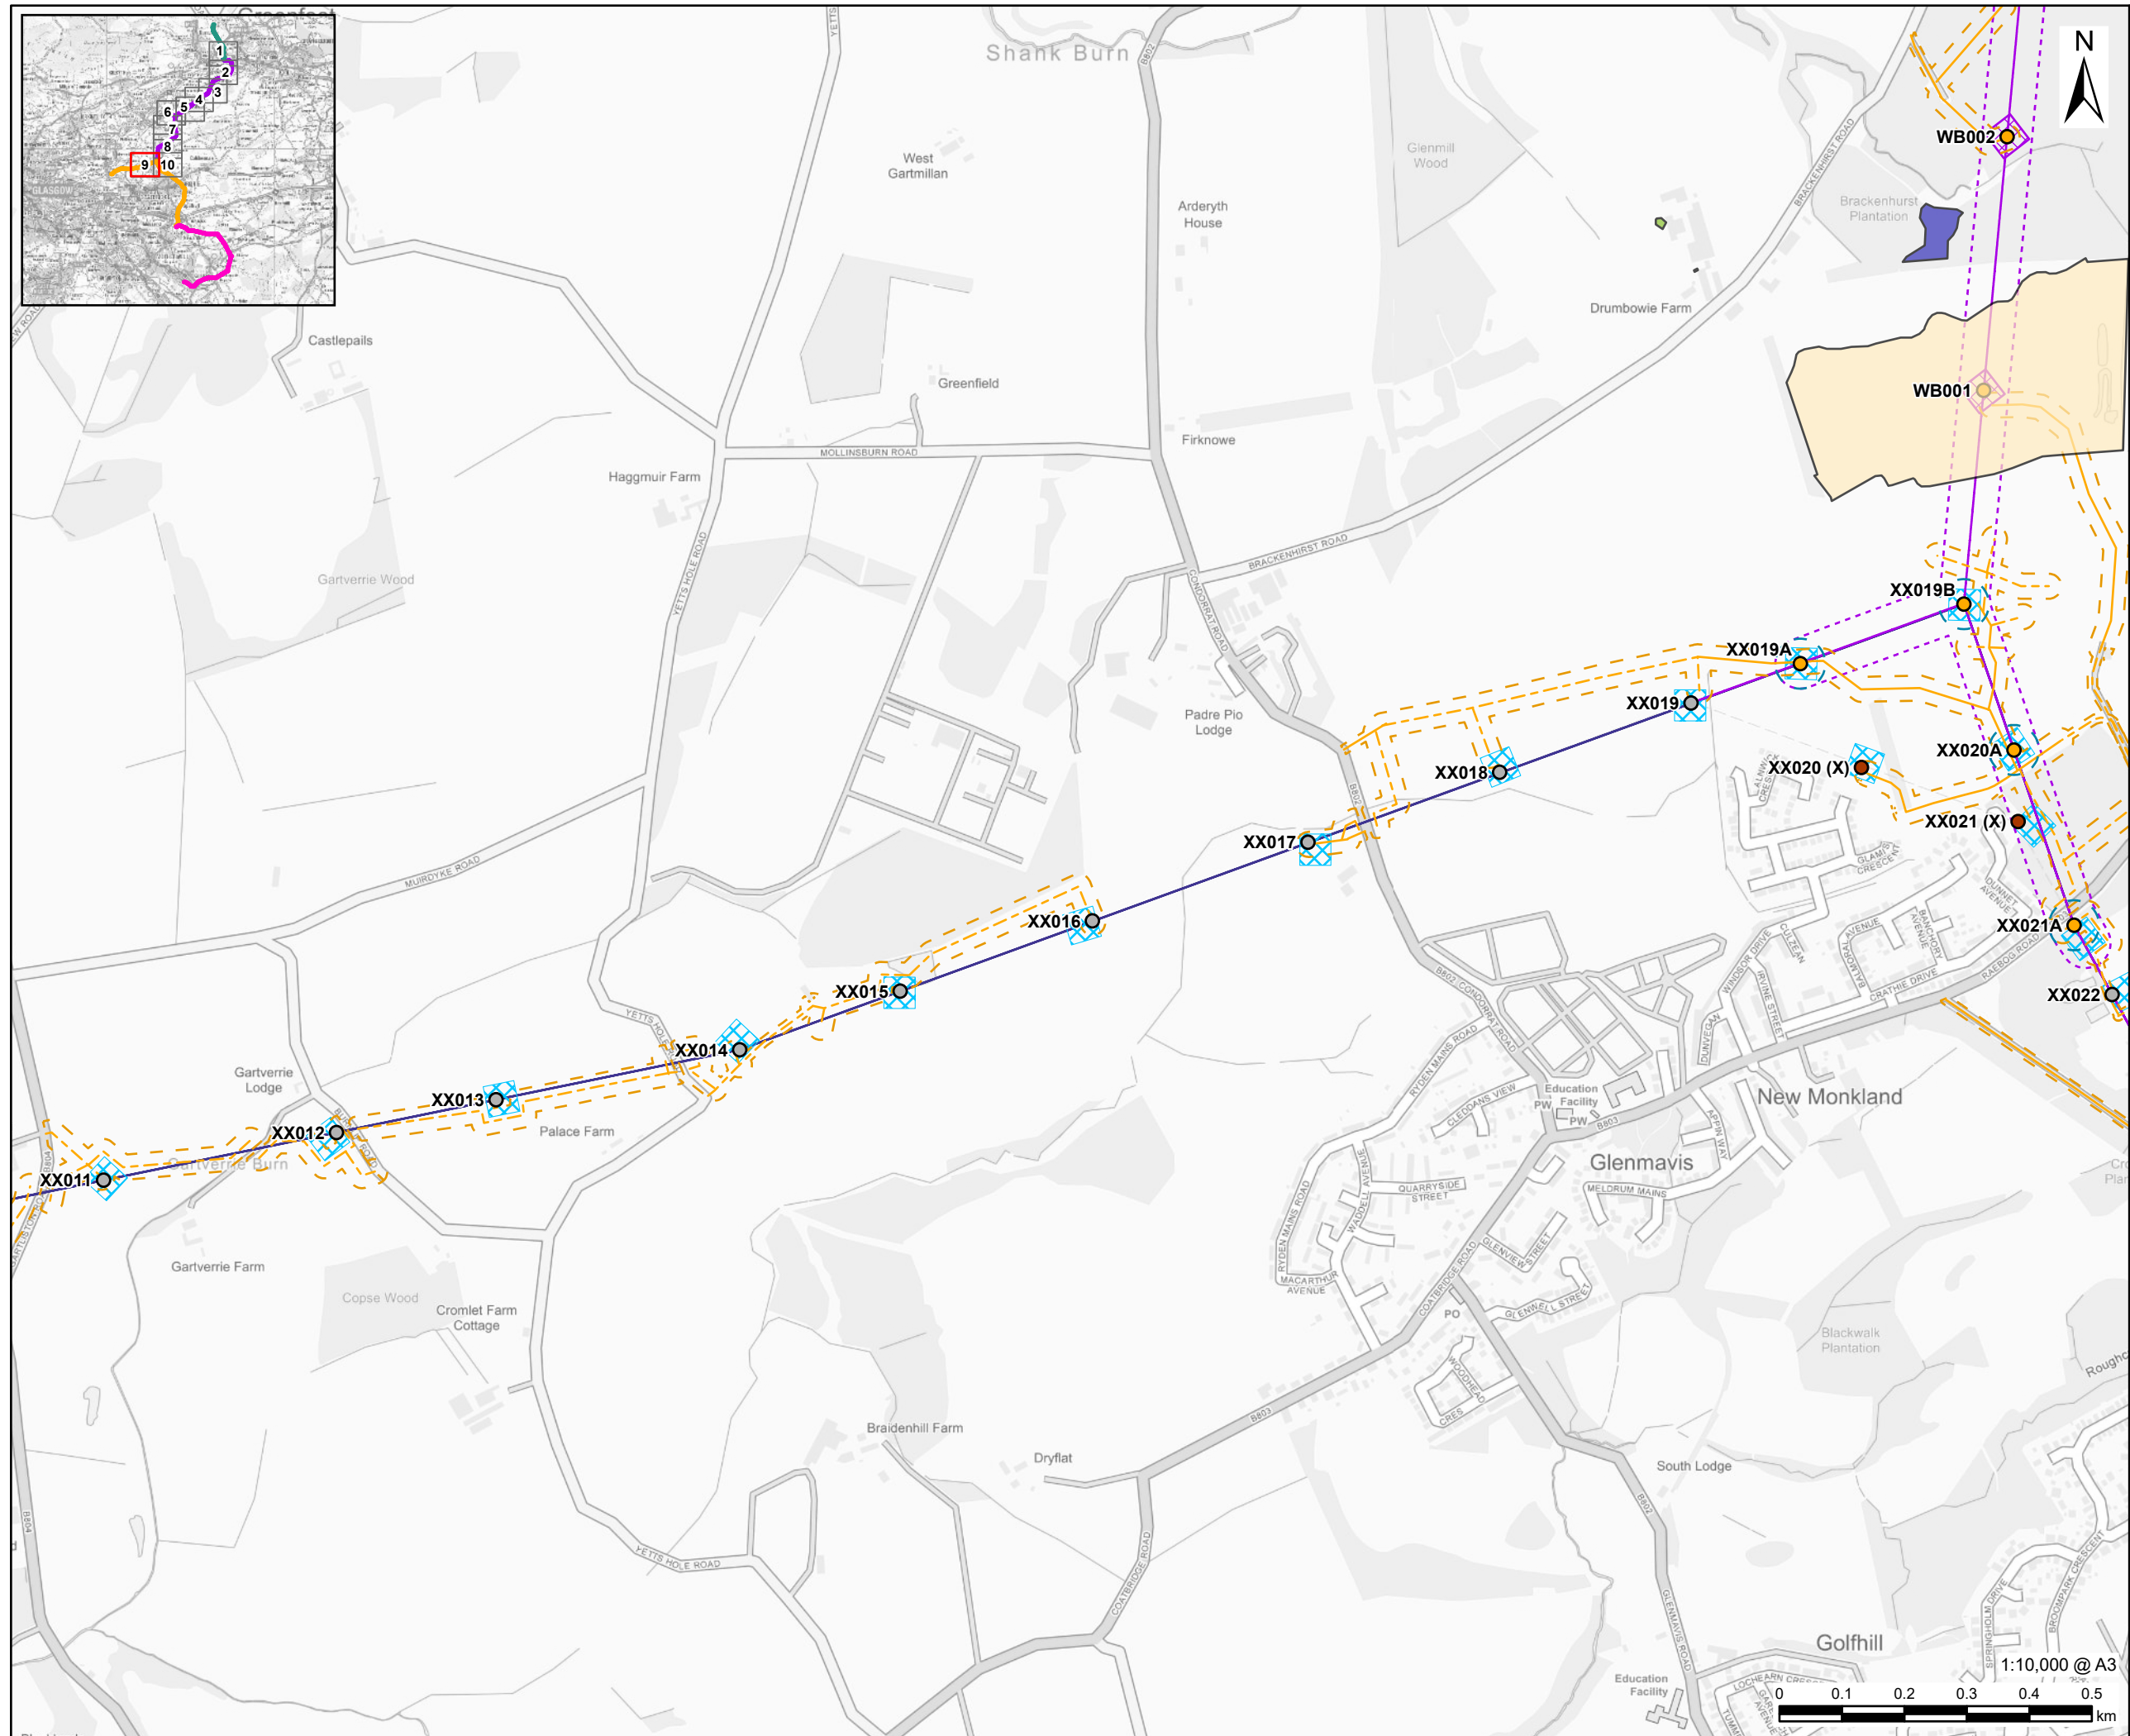

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM, or as required by law. AECOM accepts no responsibility and denies any liability whatsoever to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

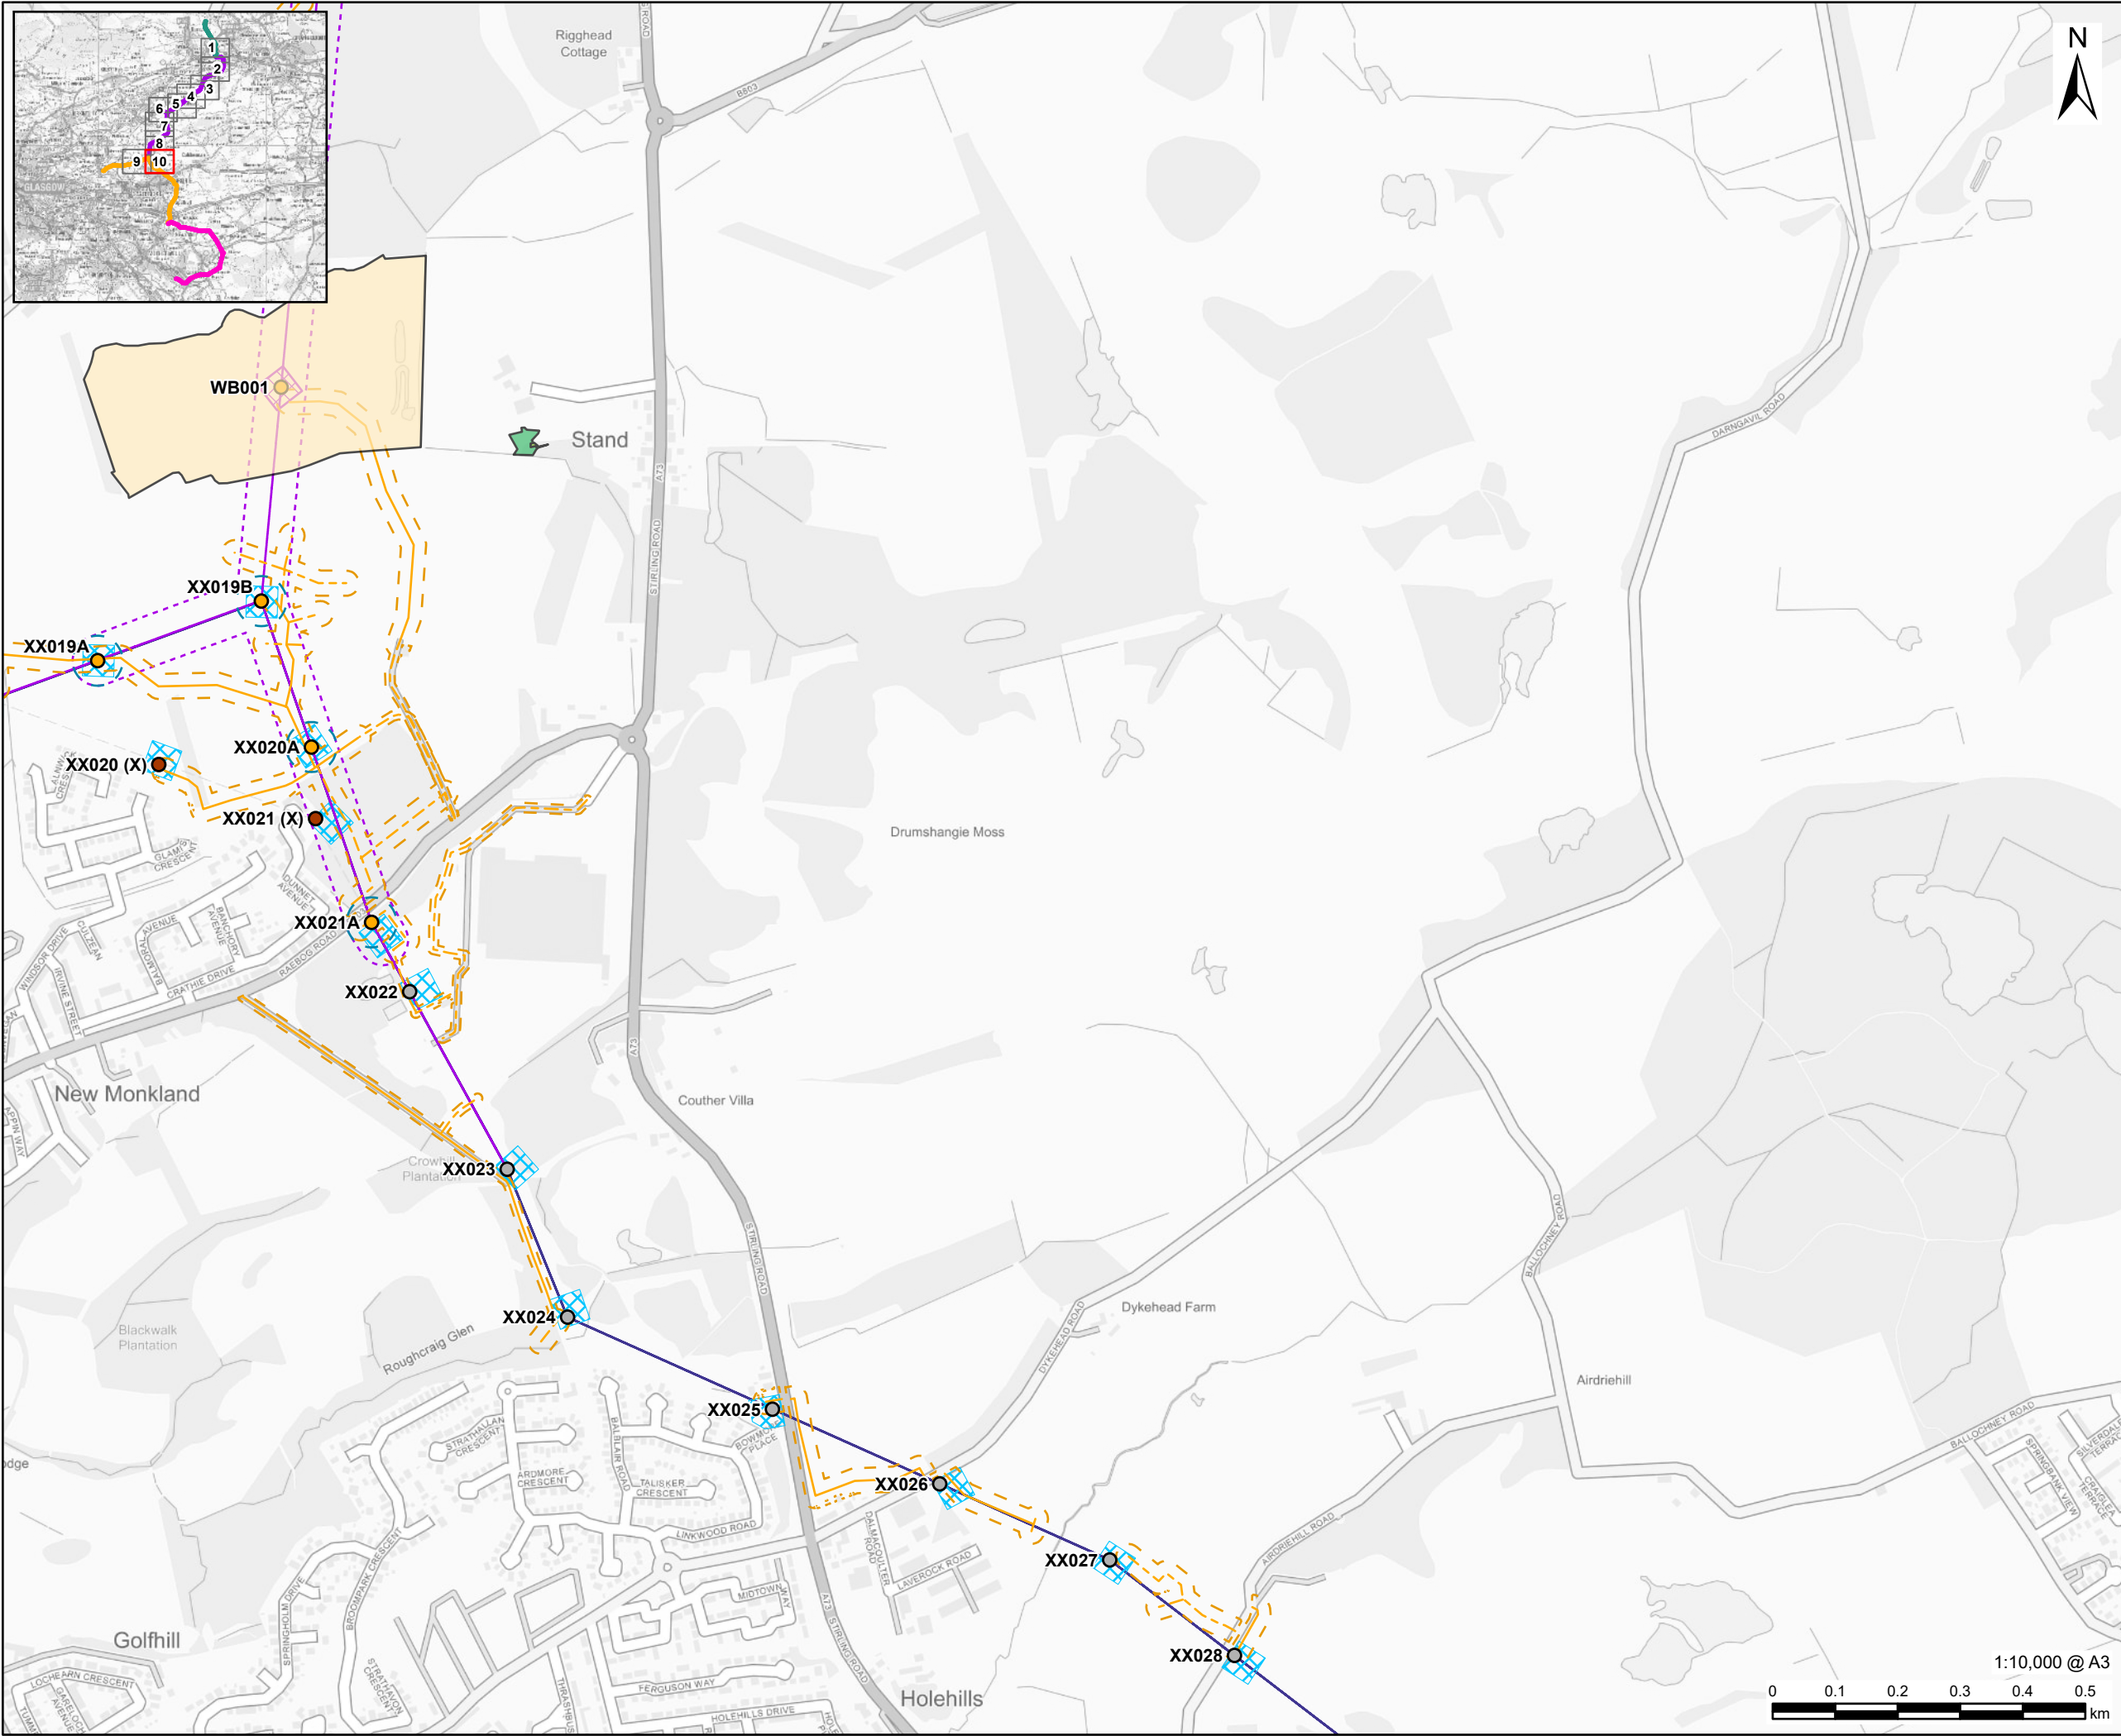

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Tower to be Removed
- New Build Tower Compound
- XX Tower Compound
- New Build Overhead Line
- XX Uprated Overhead Line
- New Build Overhead Line Limit of Deviation
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation

Potential Sources of Contamination

- Colliery
- Limekiln
- Opencast
- Quarry

NOTES

Contains OS data © Crown copyright 2025
© Groundsure, valid at the time of purchase 23/10/2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Potential Sources of Contamination

FIGURE NUMBER

Figure 10.5 (Sheet 10 of 10)