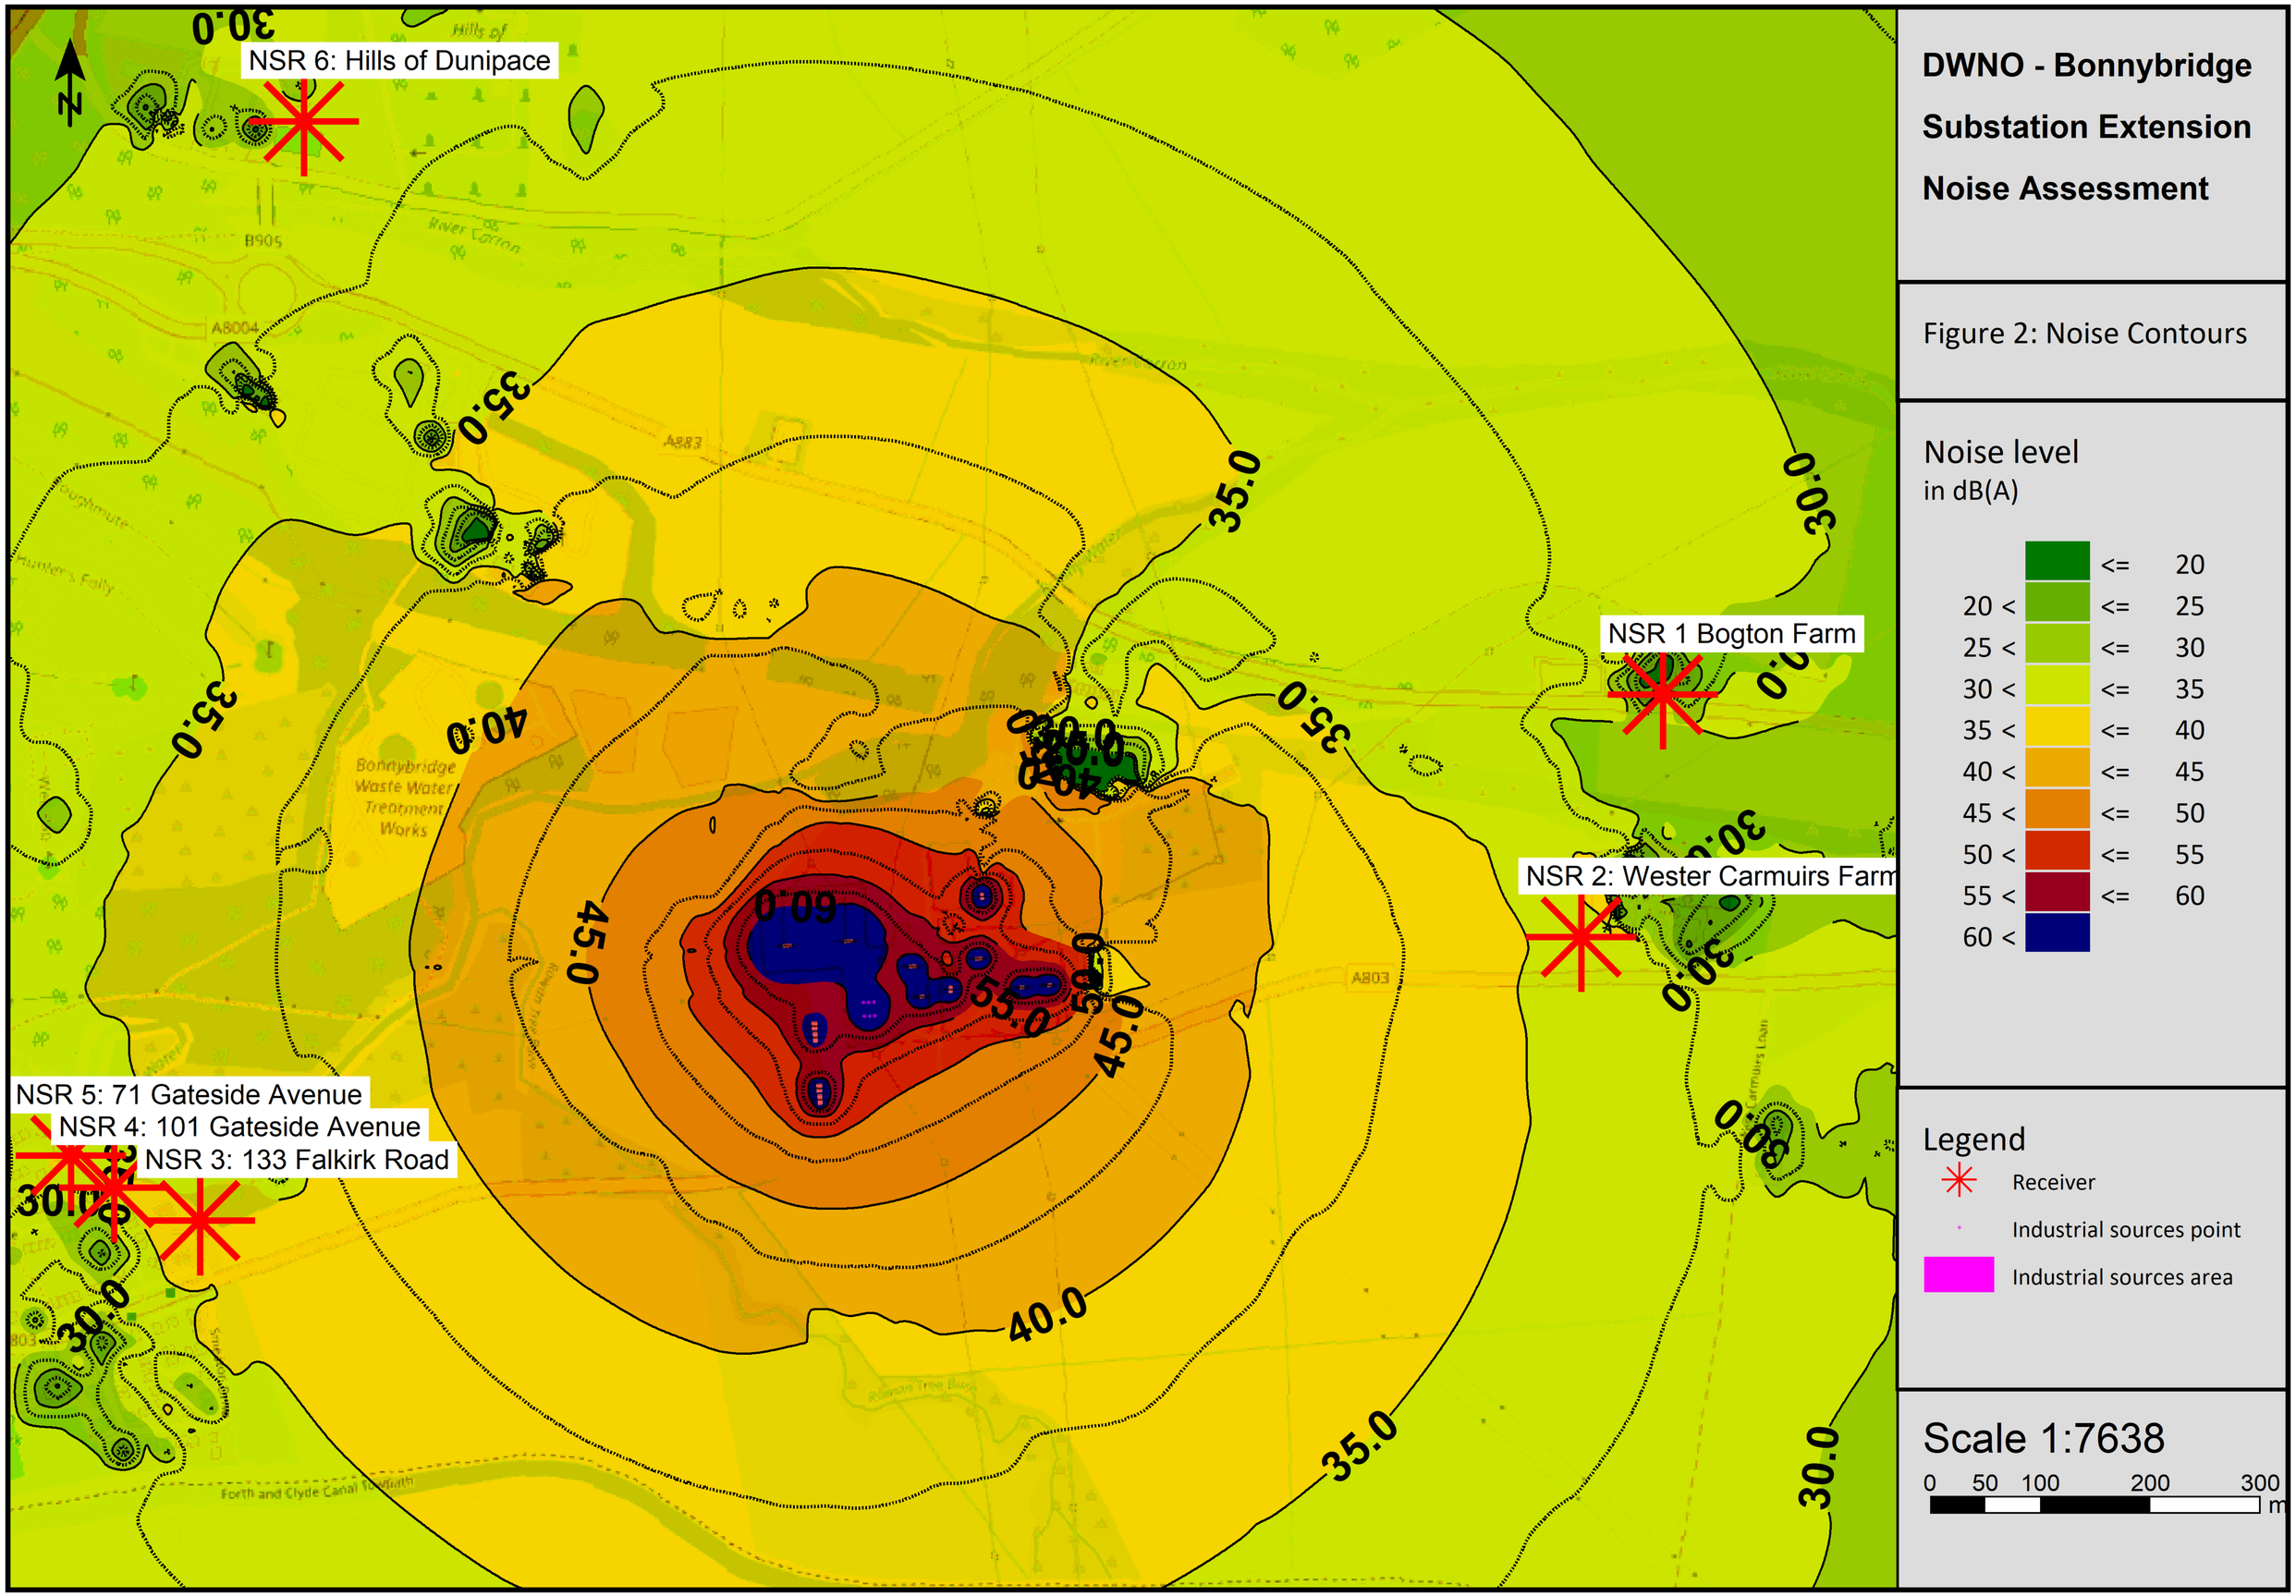
DWNO - Bonnybridge Substation Extension Noise Assessment
Figure 2: Noise Contours
Noise level
in dB(A)
<= 20
20 < <= 25
25 < <= 30
30 < <= 35
35 < <= 40
40 < <= 45
45 < <= 50
50 < <= 55
55 < <= 60
60 <
Legend
Receiver
Industrial sources point
Industrial sources area
Scale 1:7638
0 50 100 200 300 m
NSR 6: Hills of Dunipace
NSR 1 Bogton Farm
NSR 2: Wester Carmuirs Farm
NSR 5: 71 Gateside Avenue
NSR 4: 101 Gateside Avenue
NSR 3: 133 Falkirk Road
Bonnybridge Waste Water Treatment Works
30.0
35.0
40.0
45.0
50.0
55.0
60.0