


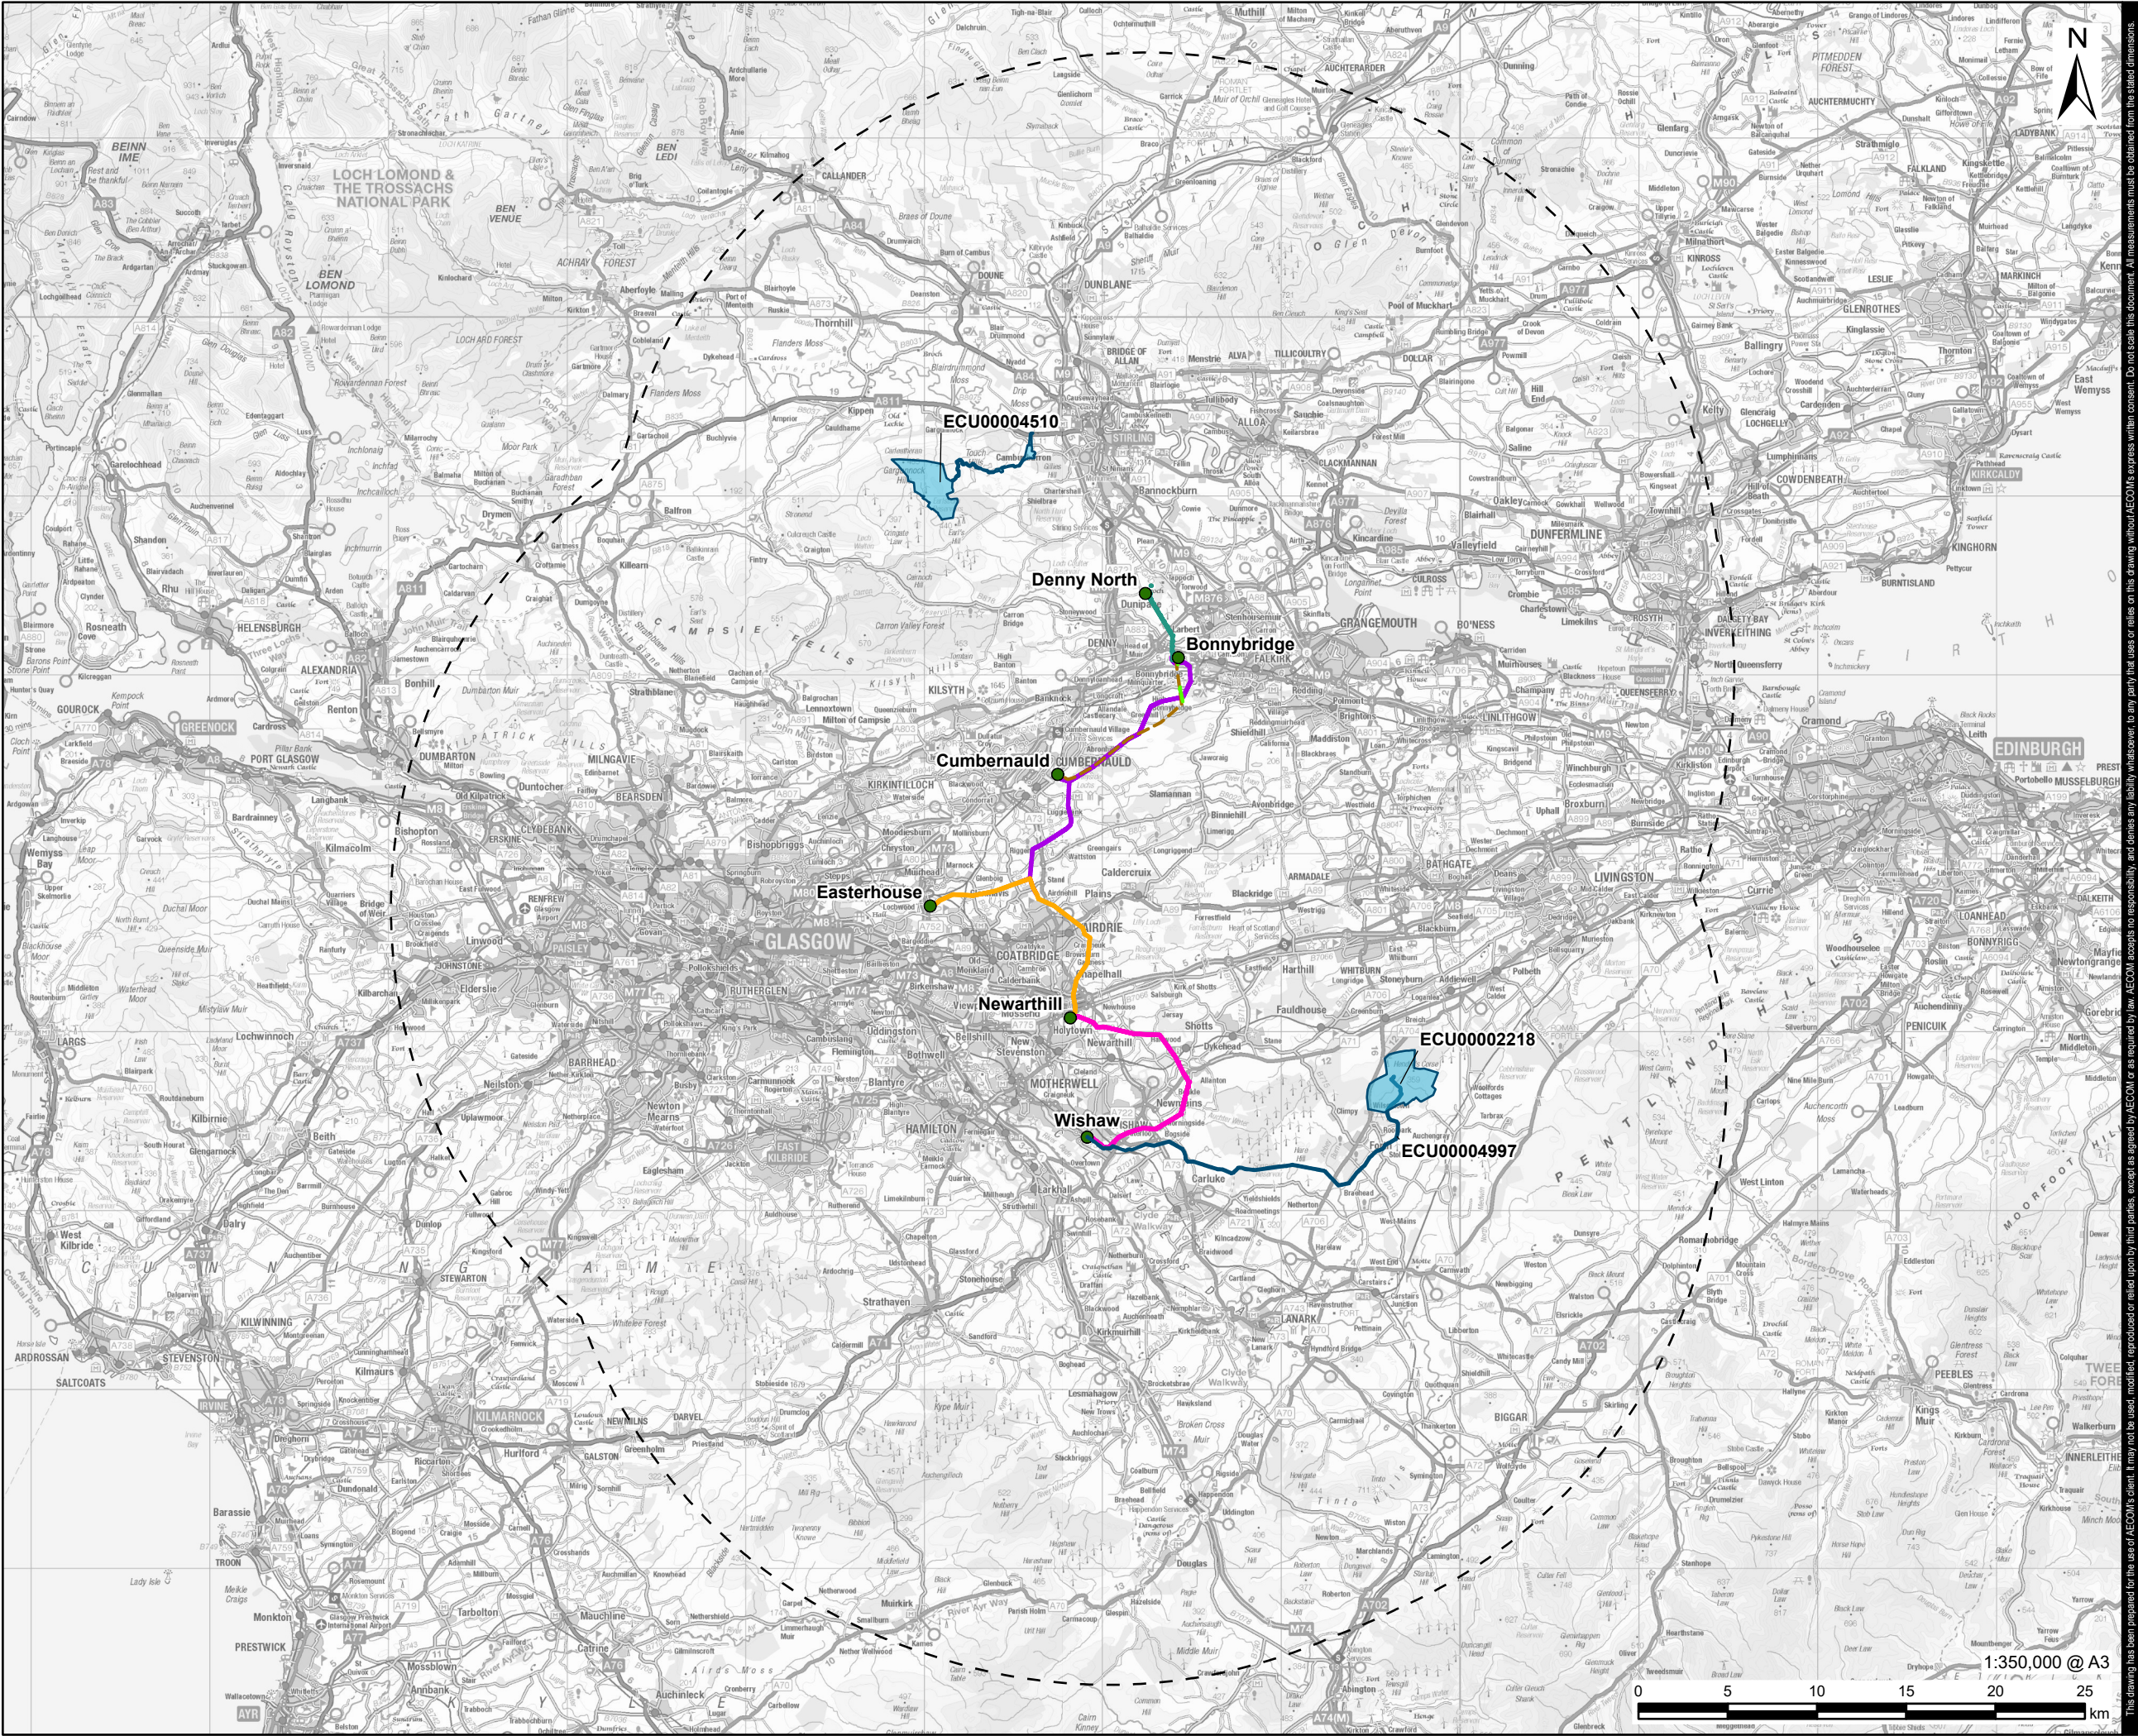

- Substation Location
- New Build Overhead Line
- CB Route Removal
- AA Route Undergrounding
- Updated Overhead Line
- ZG Route
- XR Route
- XX Route
- - - Zone of Influence (30km)
- Planning Application

Contains OS data © Crown copyright 2025
Contains public sector information licensed under the Open Government License v3.0

Environmental Impact Assessment Report

60602788

Inter-Project Cumulative Assessment (impacts to Special Protection Areas to account for bean geese only)

Figure 16.2