




This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

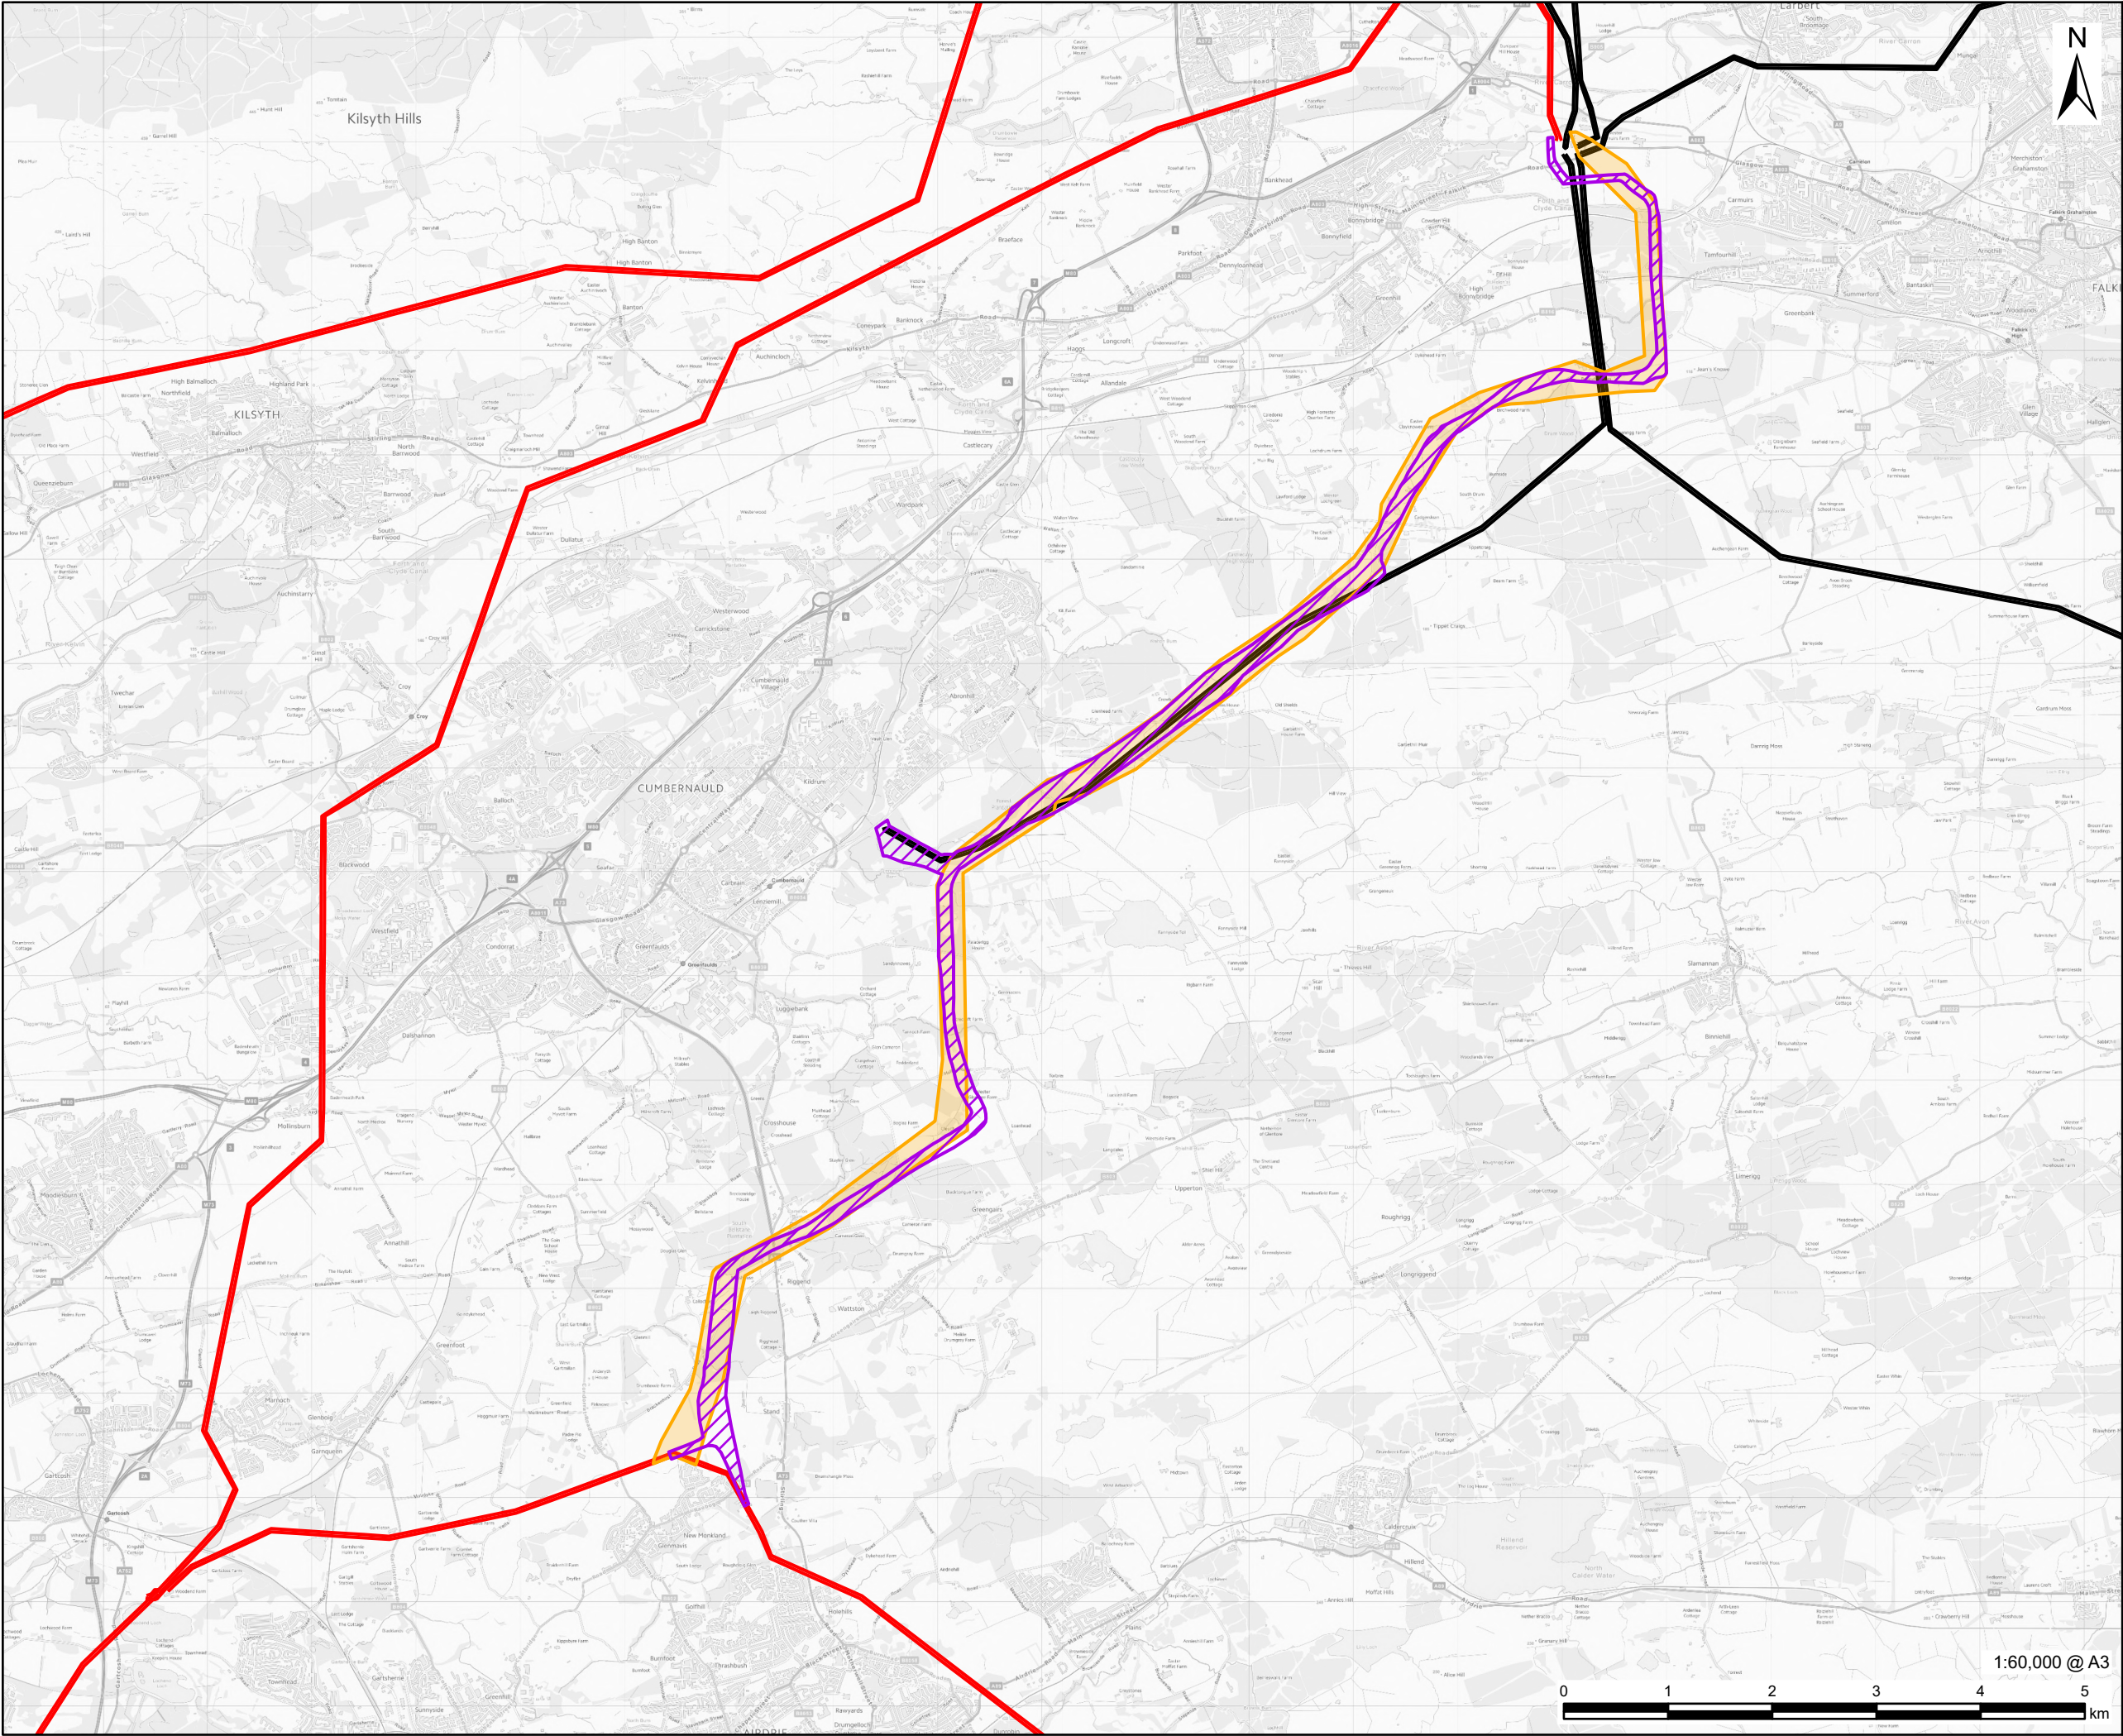

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND
 Modified Preferred Route Option
 2021 Preferred Route Option
SPT Network
 132kV
 275kV
 400kV

NOTES
Contains OS data © Crown copyright 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Modified Preferred Route Option

FIGURE NUMBER
Figure 3.3