Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

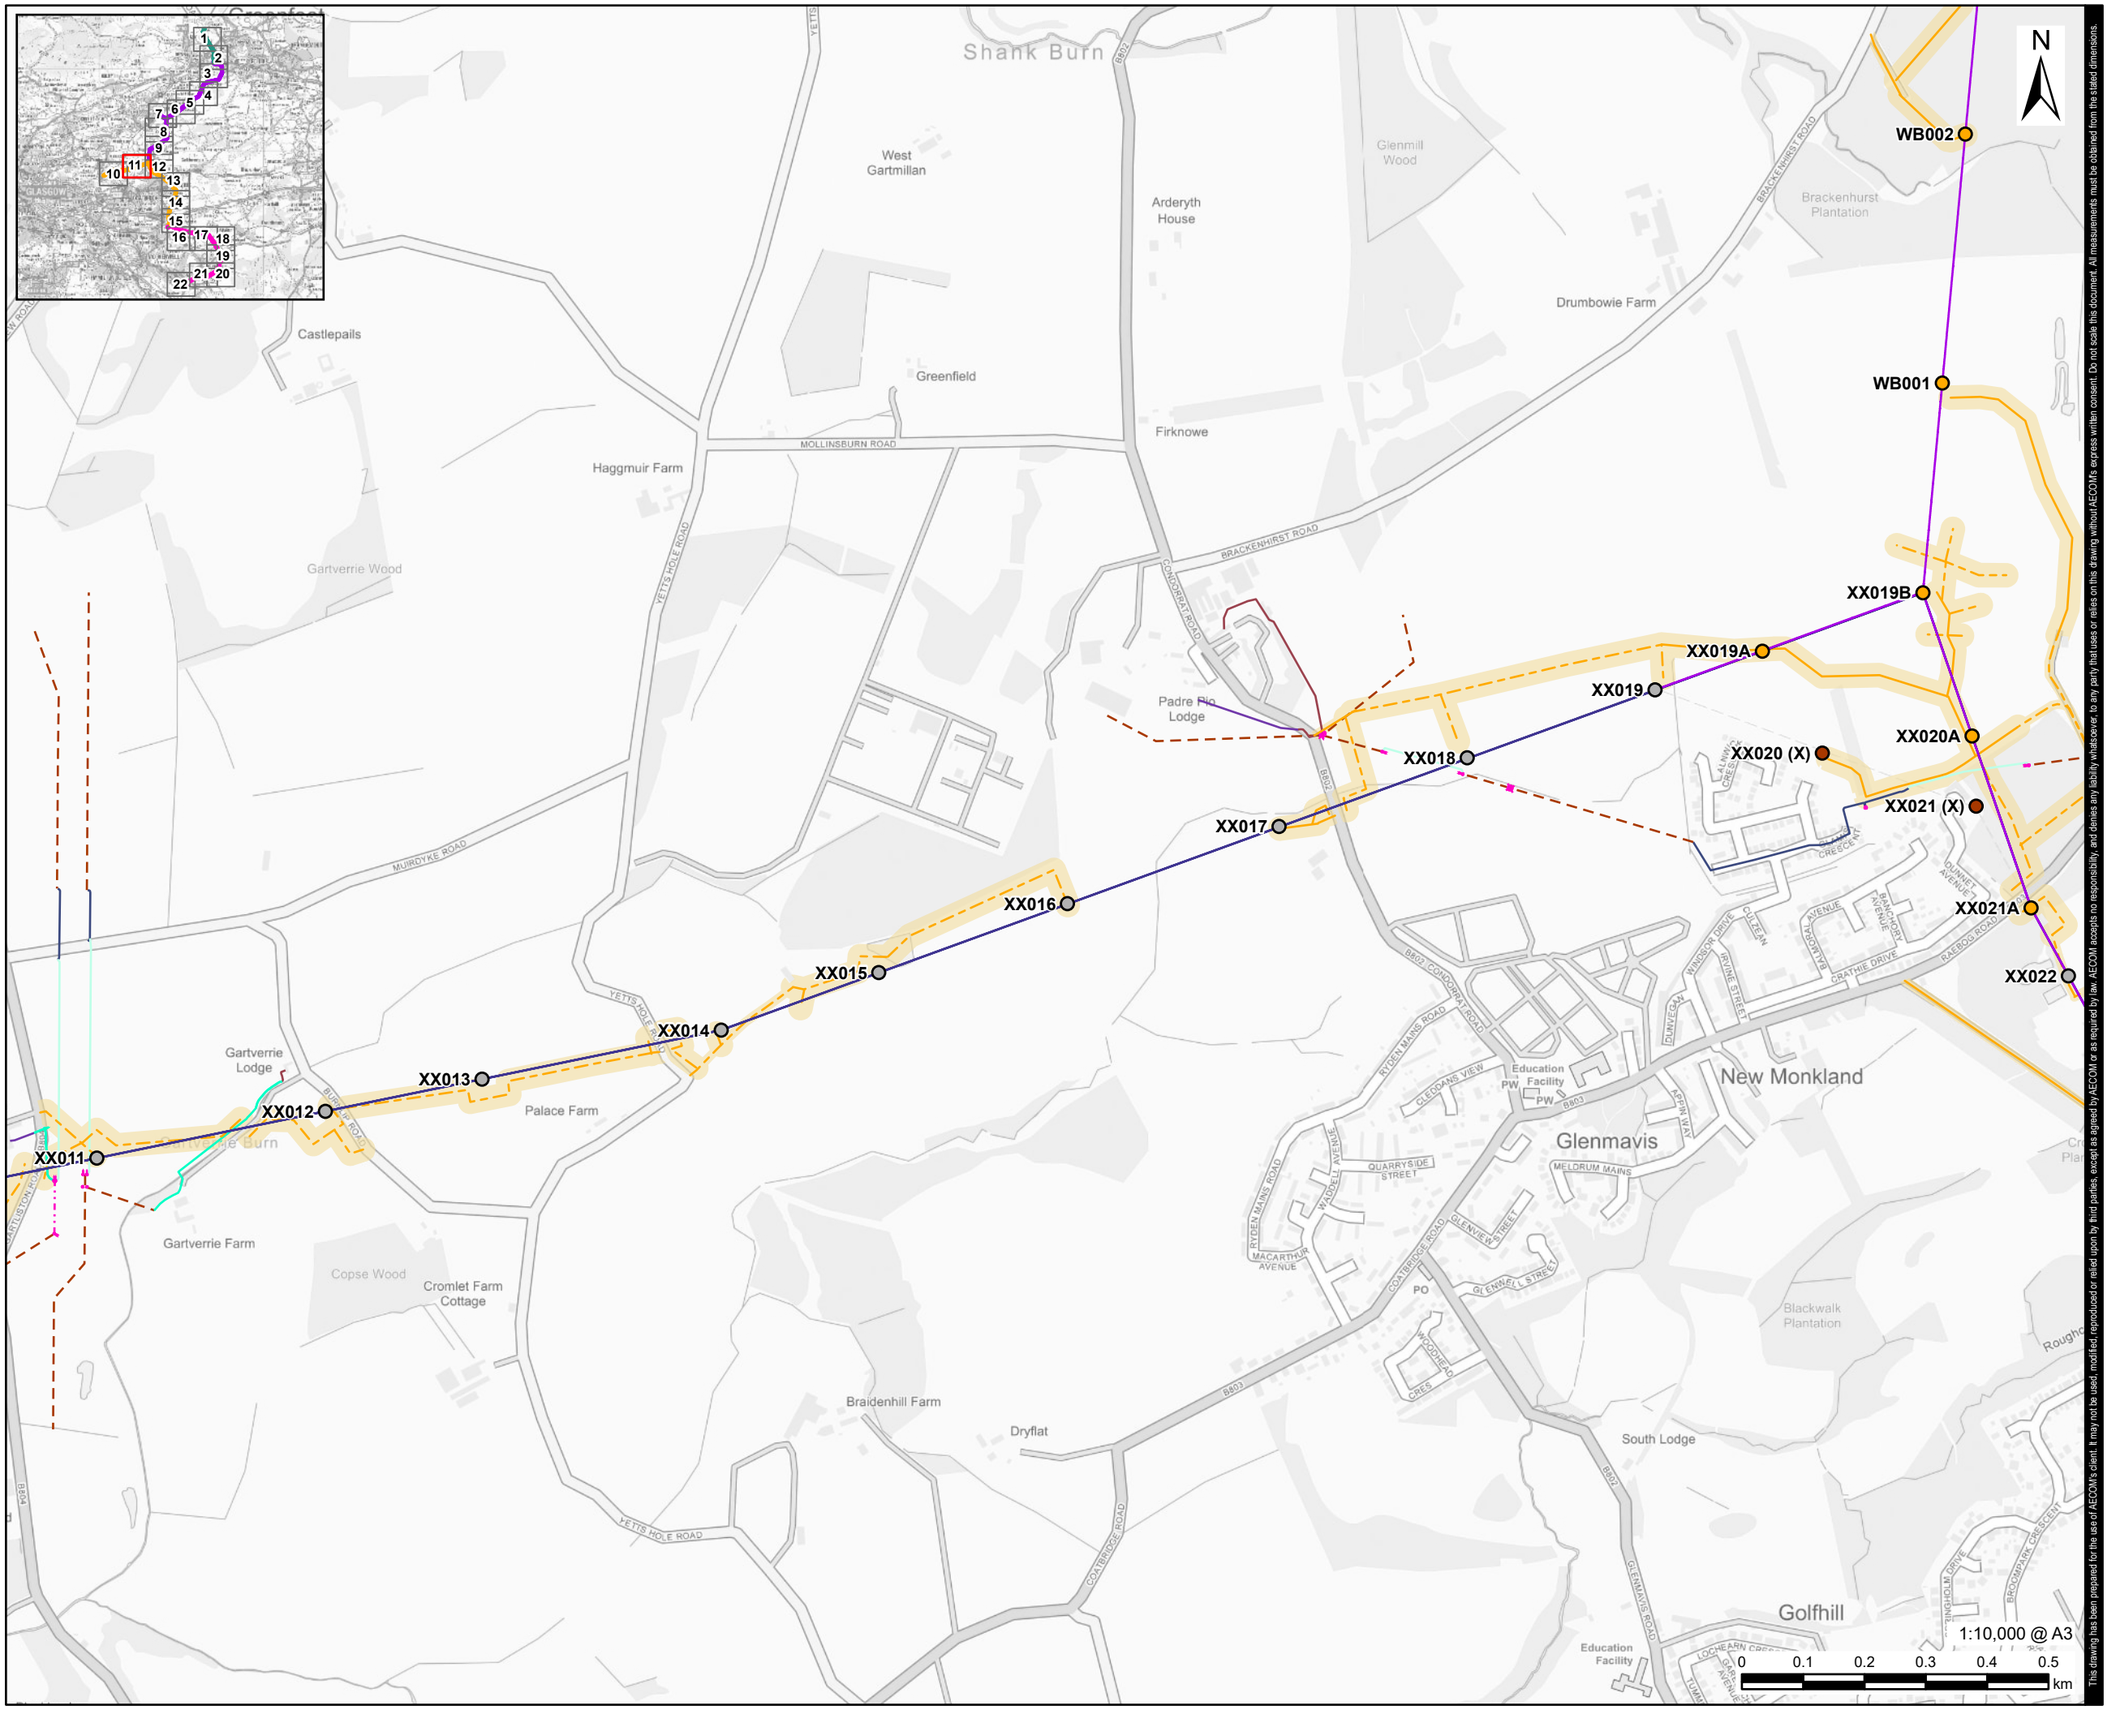

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Tower to be Removed
- New Build Overhead Line
- XX Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- New 11kV Overhead Line
- New 11kV Pole
- Proposed LV Underground Cable
- Proposed LV Overhead Line
- Proposed 11kV Underground Cable
- Existing LV Underground Cable
- Exisitng 11kV Overhead Line
- Exisitng LV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 11 of 22)

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

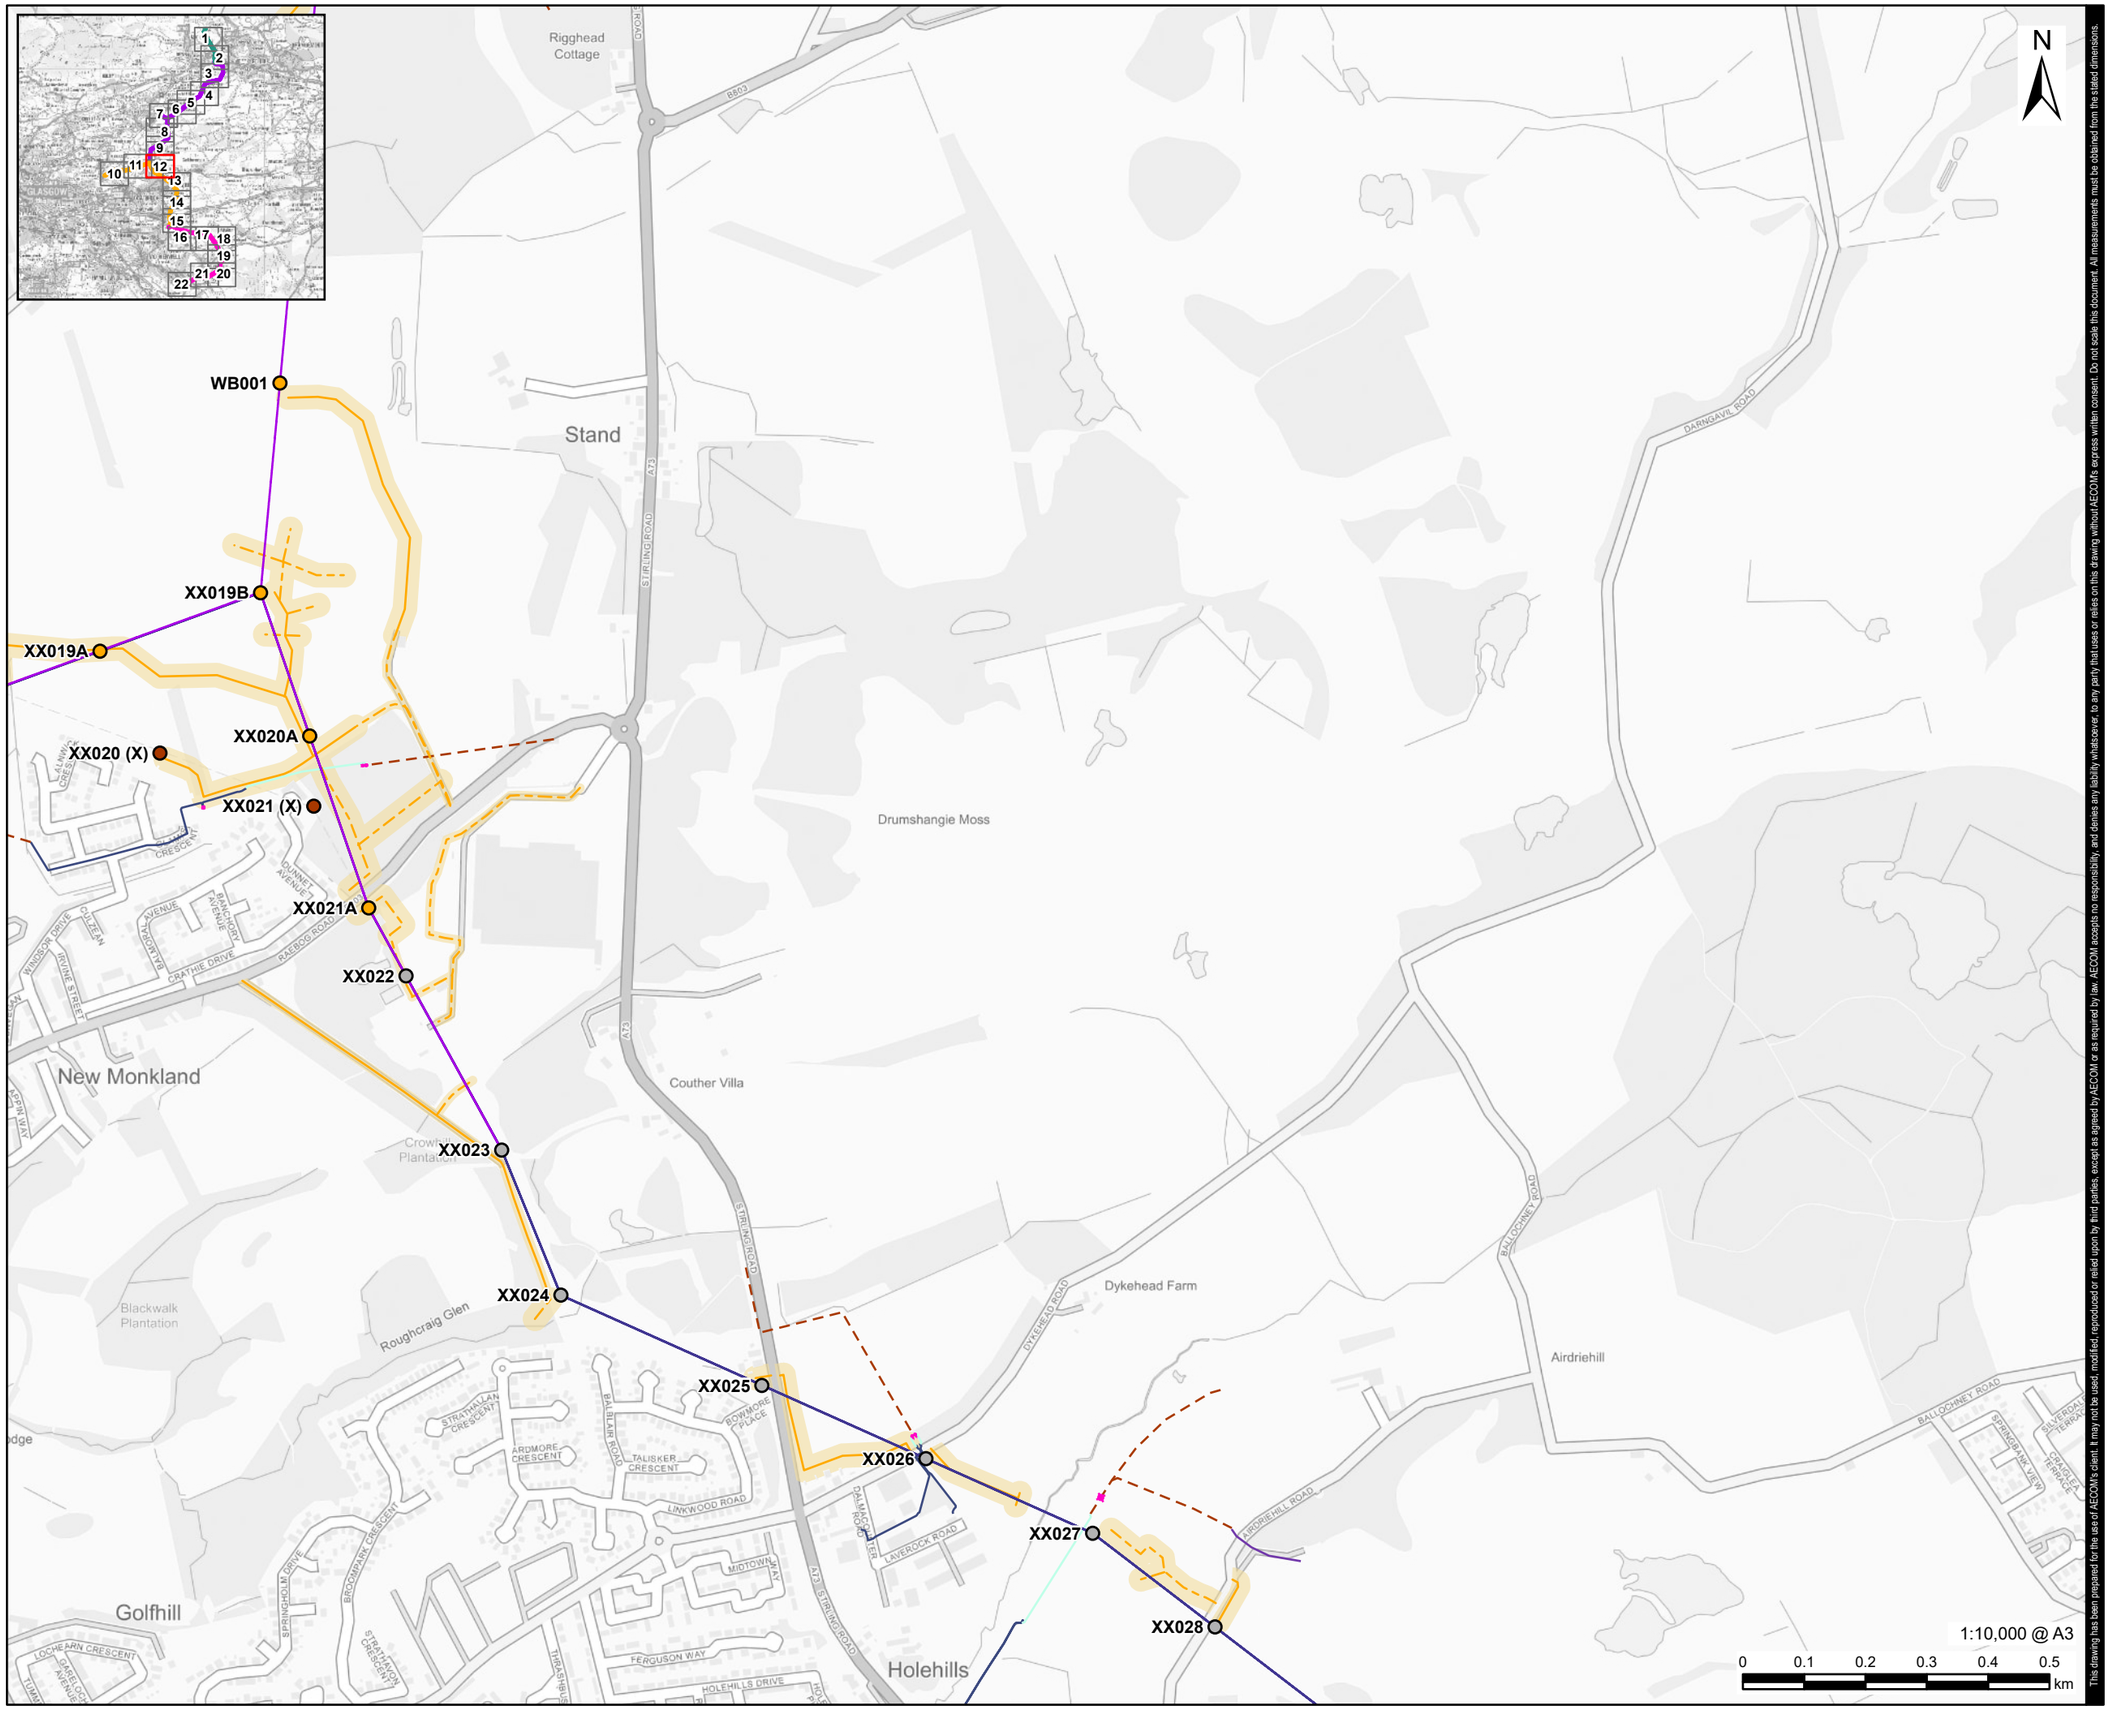

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Tower to be Removed
- New Build Overhead Line
- XX Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- New 11kV Pole
- Proposed 11kV Underground Cable
- Exisitng 11kV Overhead Line
- Exisitng LV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 12 of 22)

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

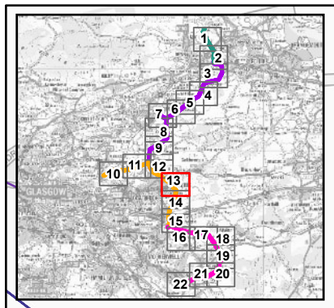

XX029
XX030
XX031
XX032
XX033A
XX034A
XX035A
XX036

Plains
Lochinver
Stepends Farm
Annieshill Farm
Brownieside Farm
Easter Moffat Farm
Greystones
Berries
Clarkston
Dunrobin
Drumgelloch
Petersburn
Moffat Mills
North Calder Water
Burn Wood

Education Facility
Hospital
PW

BALLOCHNEY ROAD
MAIN STREET
BROWNIESIDE ROAD
STEPENDS ROAD
AIRDRIE ROAD
A89
BURNHEAD ROAD
CHURCH CRESCENT
FORREST STREET
PETERSBURN ROAD
VARNSDORF WAY
ROUGHRIGG ROAD
MEADOWSIDE ROAD
WALLACE STREET
JARVIE AVENUE
BRUCE STREET
VICTOR STREET
MOFFAT VIEW
LIVINGSTON DRIVE
KILLEARN CRESCENT
ORCHILL DRIVE
ARBUCKLE ROAD
KINTYRE CRESCENT
ANNIESHILL VIEW
PARK PLACE
MERKLOMMEAD ROAD
ARDEN STREET
STAMFORD STREET
NORTHBERN STREET
STATION ROAD
LEARMONT ROAD
MC LELLAND DRIVE
LEBRUS ROAD
SILVERDALE TERRACE
ARGYLEDALE ROAD
CRAIGLEA TERRACE
SPRINGBANK VIEW
ABERFELDY AVENUE
ATHOLL AVENUE
ARRAIG AVENUE
BALLOCHNEIE DRIVE
ARDENCRAIG PLACE
ARDENCRAIG AVENUE
ARDENCRAIG DRIVE
ARDENCRAIG CRESCENT
ARDENCRAIG GROVE
ARDENCRAIG GARDENS
ARDENCRAIG PARK
BALLOCH PARK
BALLOCH CRESCENT
BALLOCH GARDENS
BALLOCH PLACE
BALLOCH GROVE
BALLOCH DRIVE
BALLOCH WYND
CROFTON WYND
LEGBRANNOCK PLACE
ENDRICK PLACE
CRAWFORD AVENUE
CLEMENT PLACE
CONNOR STREET
WINNING CRESCENT
MACLEOD CRESCENT
COLLIERTREE ROAD
SPRINGFIELD ROAD
ROSEBANK STREET
CRAGHEAD STREET
GLEBE CRESCENT
MCALLISTER AVENUE
GRAHAMSHILL AVENUE
MCGREGOR AVENUE
BANNERCLEUGH ROAD
KATHERINE STREET
STATION ROAD
SUNNYBANK DRIVE
DUNROBIN ROAD
LYLE ROAD
ALLOWAY ROAD
MOFFAT ROAD
WEBSTER MOFFAT AVENUE
WEBSTER MOFFAT CRESCENT
FINLAYSON DRIVE
CLARKSTON DRIVE
CASTLE ROAD
DRUMCLAIR PLACE
CRONYWOOD DRIVE
BANKHEAD PLACE
BANKHEAD AVENUE
TORRANCE AVENUE
CRAIGBURN CRESCENT
CRAIGBURN AVENUE
MOORCROFT DRIVE
MOORFIELD CRESCENT
MORVAIG DRIVE
BYATT DRIVE
TOWERS ROAD
CRAIGVALE CRESCENT
CRAIGVALE AVENUE
ASHGROVE
ELM GROVE
WILLOW DRIVE
OAKBANK STREET
CRAIGNEUK AVENUE
HAWTHORN DRIVE
SYCAMORE CRESCENT
MAPLE QUADRANT
HOWLETNEST ROAD
GLENDALE AVENUE
NORTH CALDER DRIVE
GLENMARK
GLEN ROAD
WEST DR
PETERSBURN PLACE
GLENACRE DRIVE
GRANGEBURN AVENUE
PARKHAVEN AVENUE
HEATHERBELL AVENUE
BARRA DR
KILTARIE CRESCENT
KILTARIE AVENUE
CRAIGSON PLACE
REAM AVENUE
FORGE ROAD
FORGEWOOD DR
ARDERN ROAD
DISART ROAD
BALLOCH ROAD
CALDERSIDE PLACE
B8058
B8058

N

1:10,000 @ A3

0 0.1 0.2 0.3 0.4 0.5 km

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XX Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Proposed 33kV Underground Cable
- Existing HV Underground Cable
- Exisitng LV Overhead Line

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 13 of 22)

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

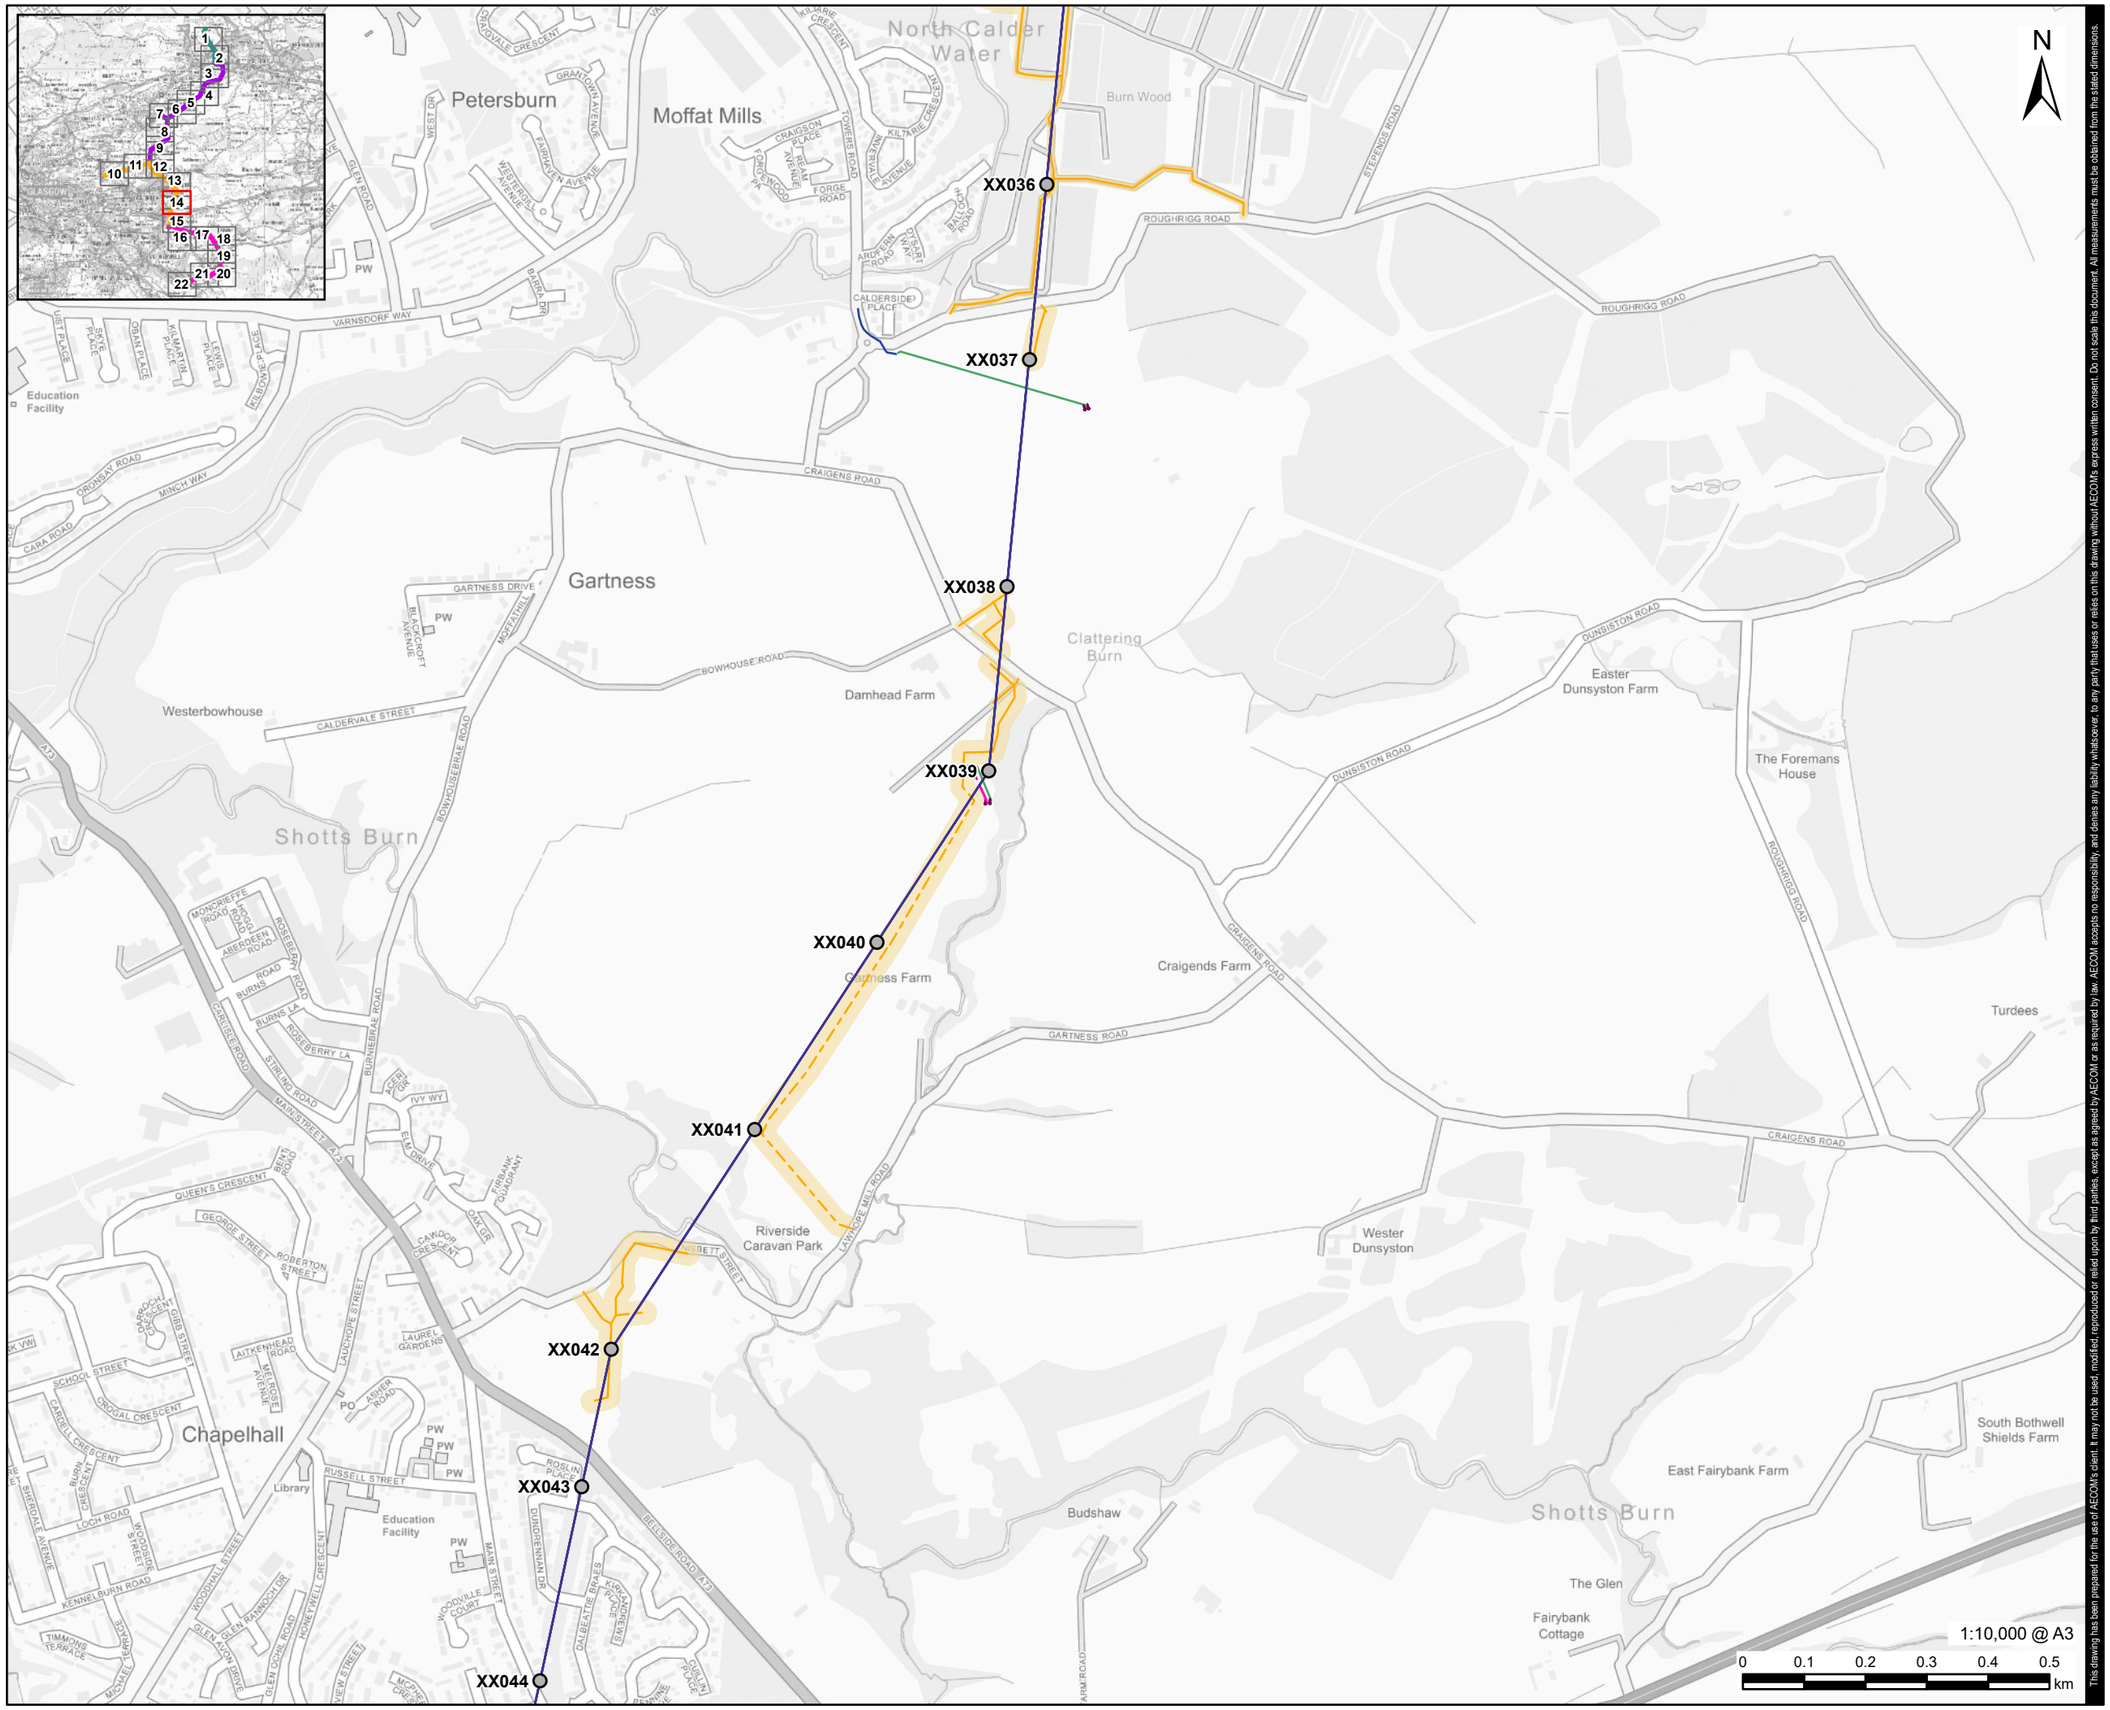

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XX Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- New 33kV Overhead Line
- New 33kV Pole
- Proposed 33kV Underground Cable
- Existing HV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 14 of 22)

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

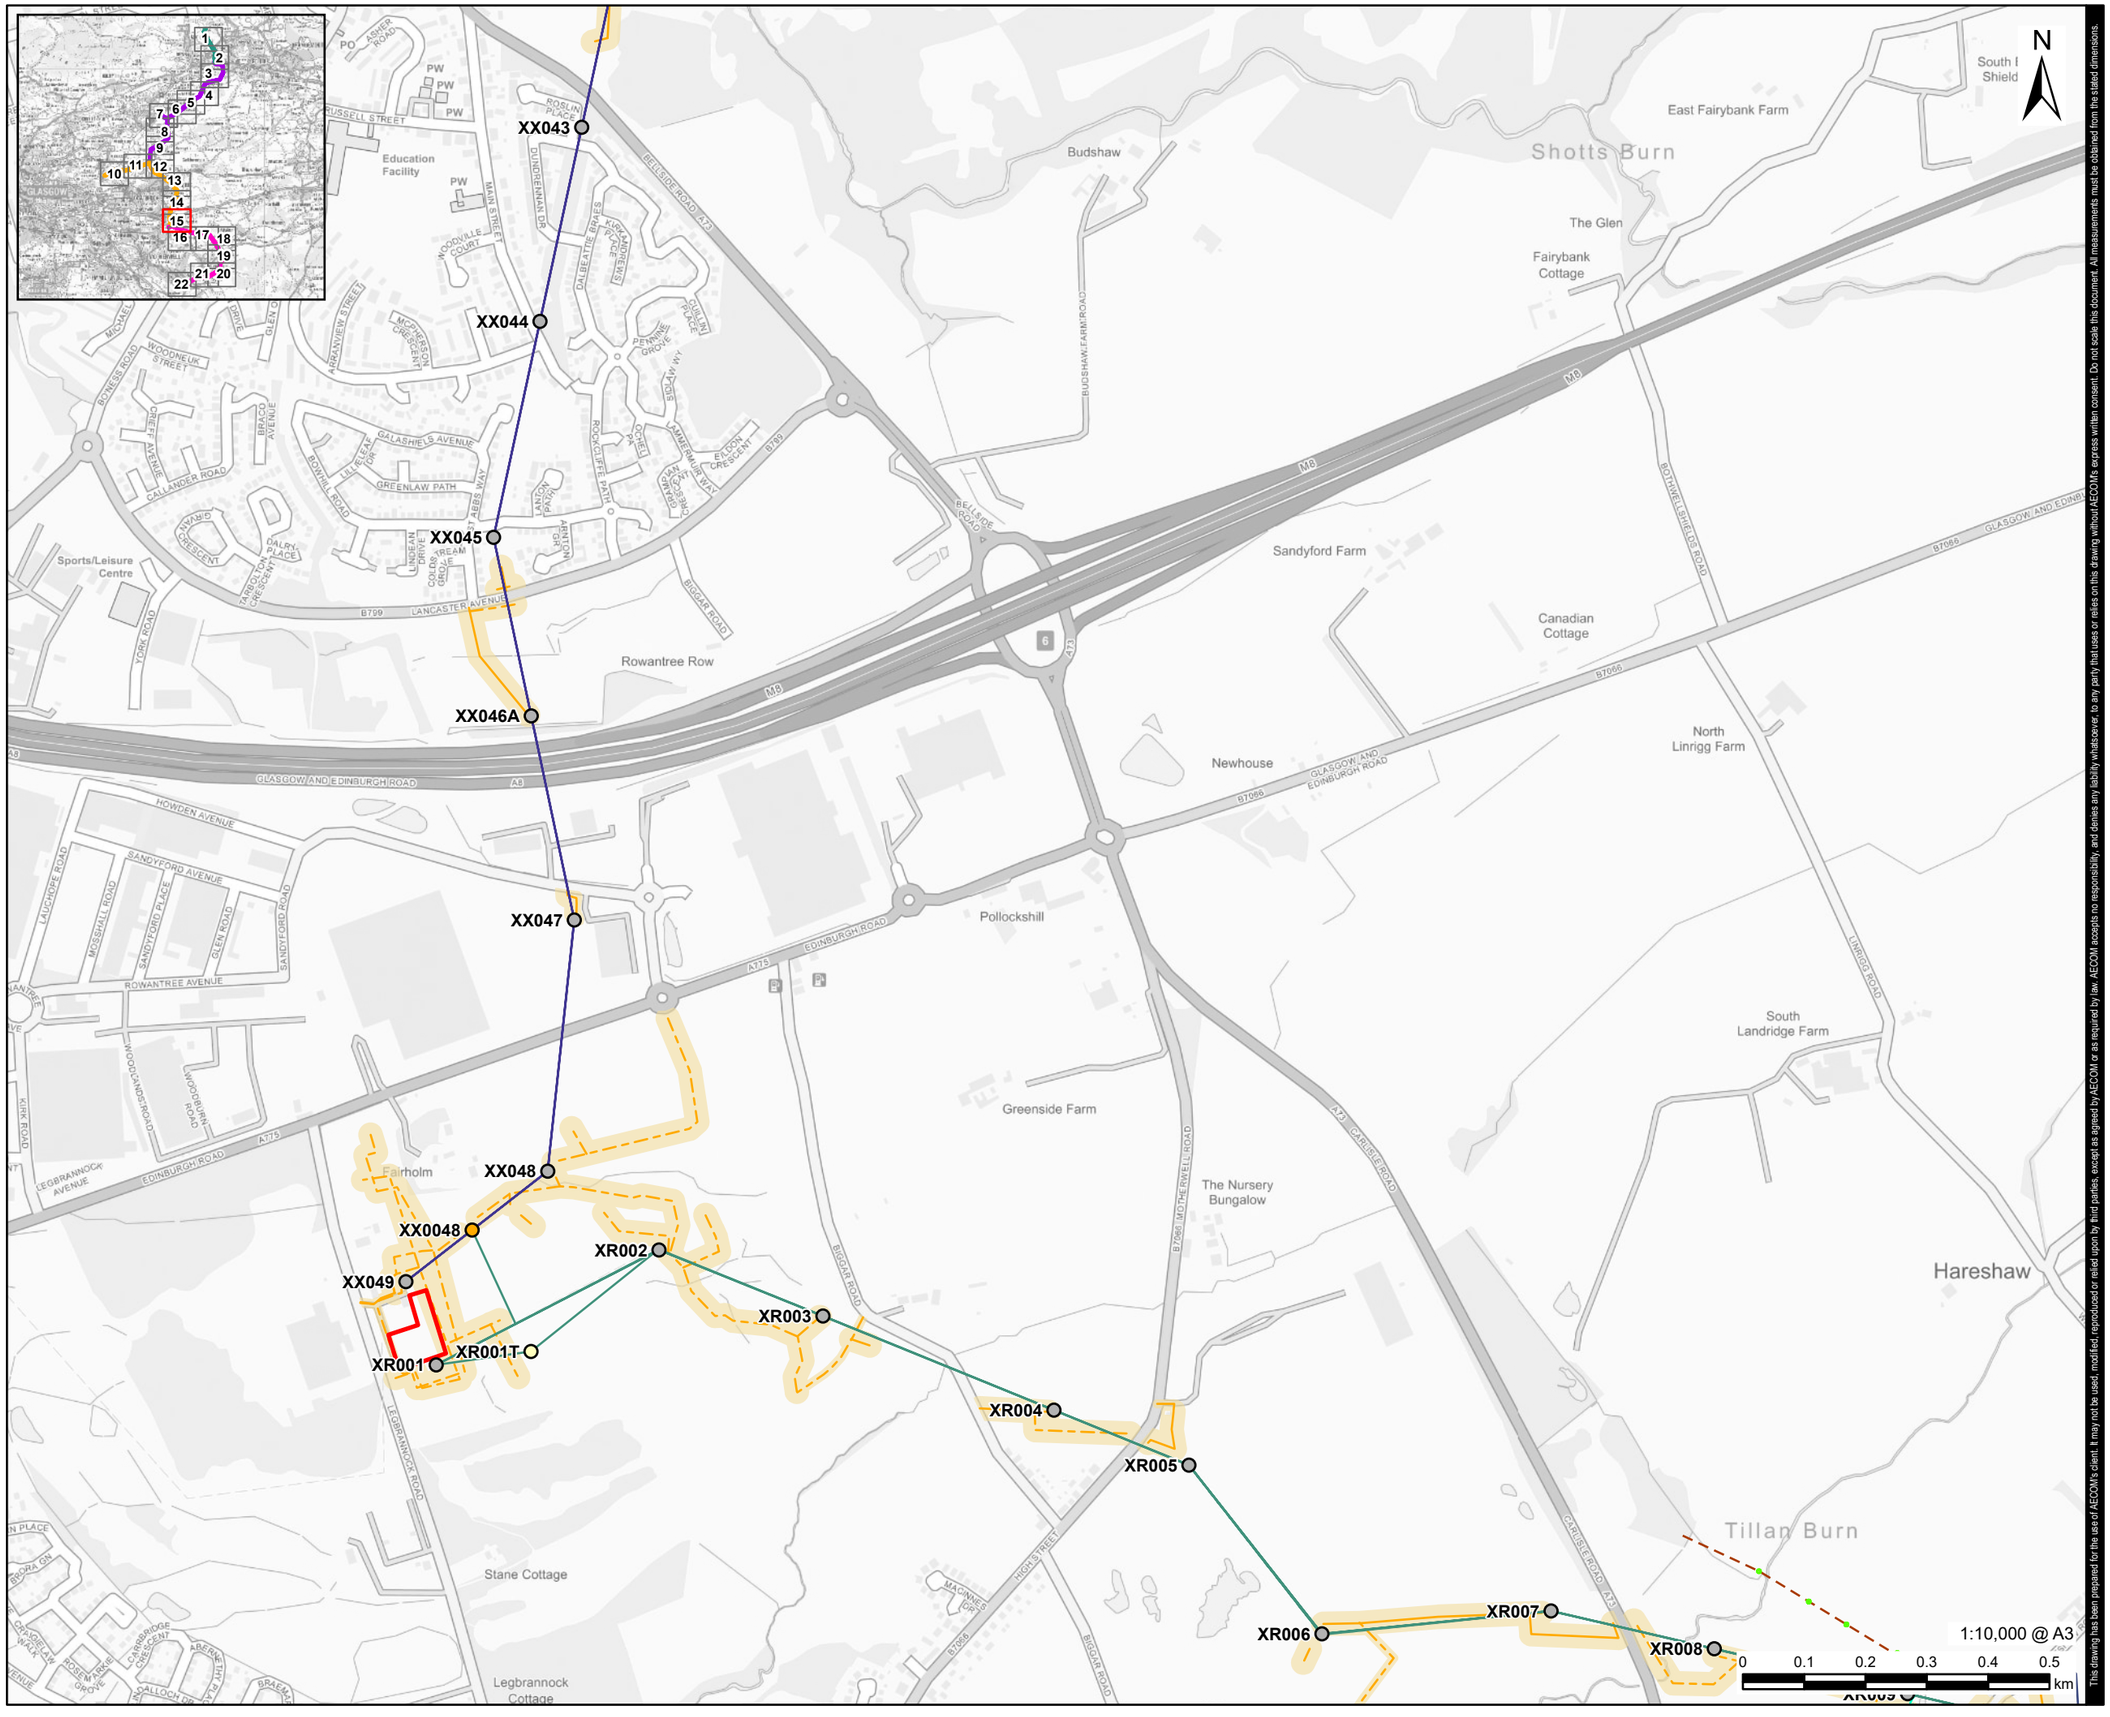

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Newarthill Substation Site Boundary
- XX Uprated Overhead Line
- XR Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Exisitng Pole
- Proposed LV Underground Cable
- Proposed LV Overhead Line
- Exisitng 11kV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 15 of 22)

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

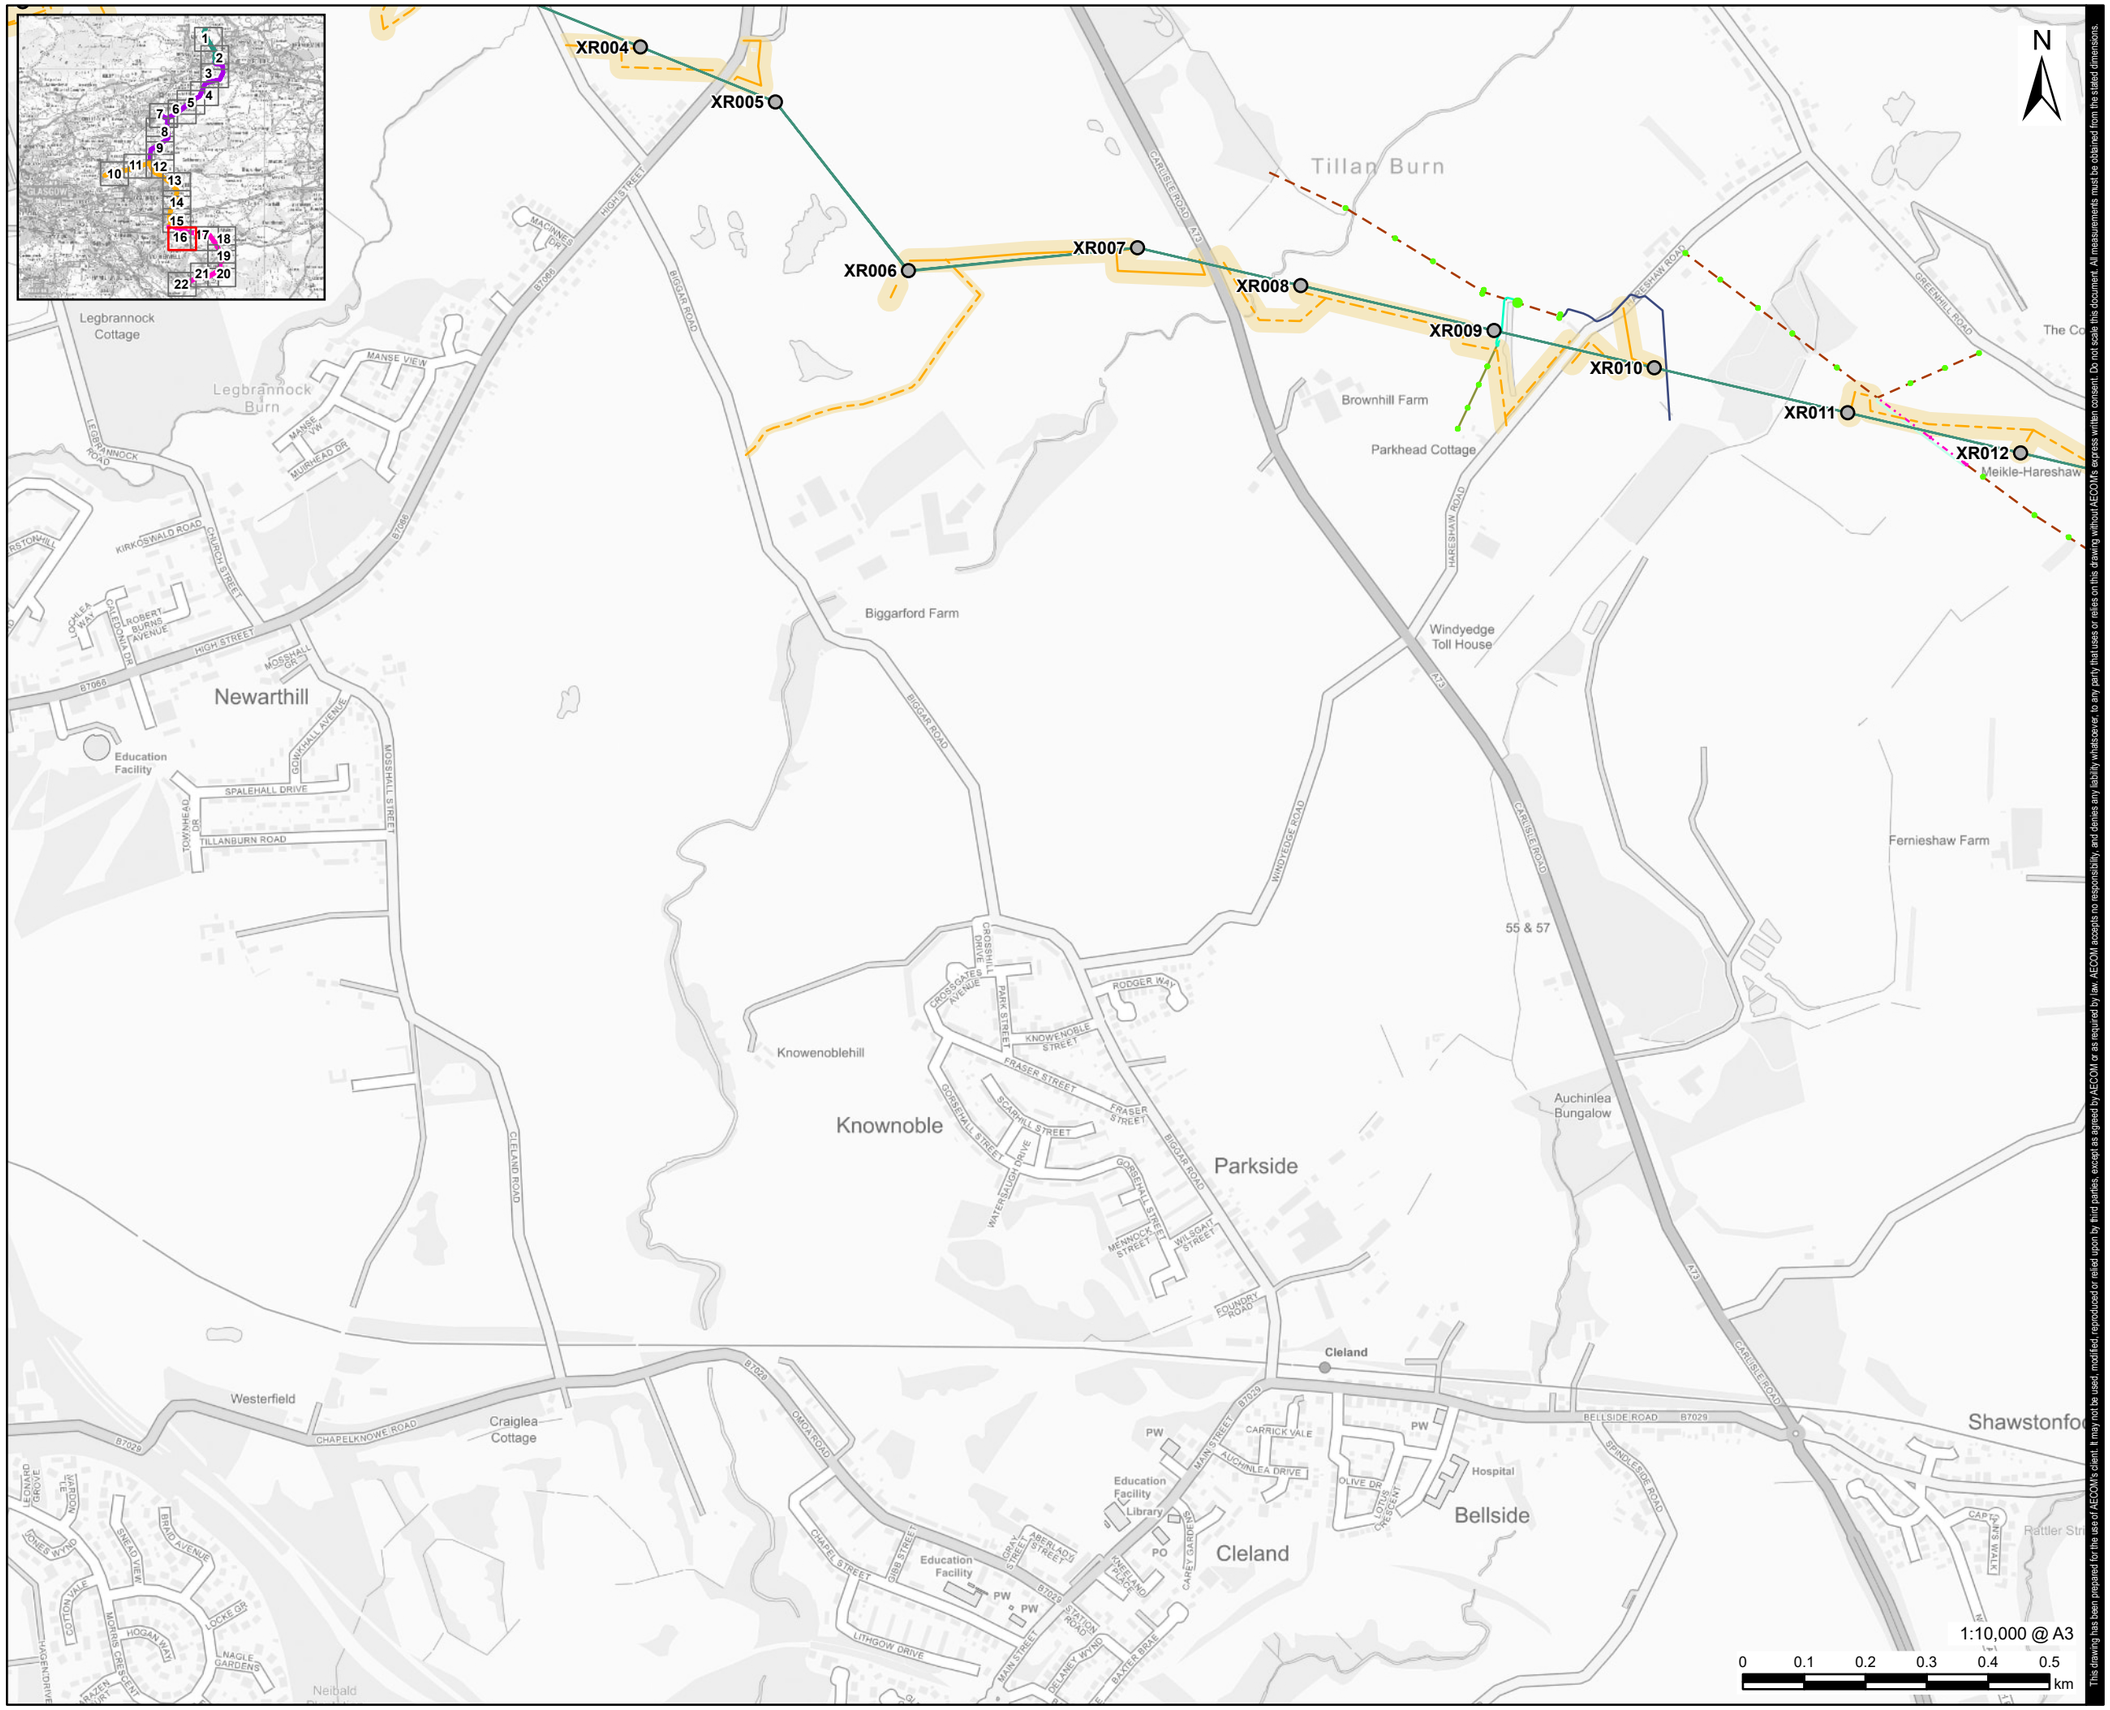

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Exisitng Pole
- New 11kV Overhead Line
- New 11kV Pole
- Proposed LV Underground Cable
- Proposed LV Overhead Line
- Proposed 11kV Underground Cable
- Existing Overhead Service Cable
- Exisitng 11kV Overhead Line
- Existing 11kV Underground Cable

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 16 of 22)

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

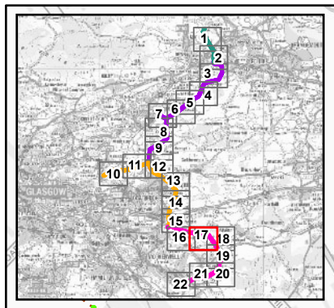

XR011
XR012
XR013
XR014
XR015
XR016
XR017
XR018
XR019
XR020
XR021
XR022

Heatherhead Plantation
Spoutcroft Farm
The Courtyard
Langloan Strip
Hareshaw Moss
View Strip
Poplar Plantation
Plummet Strip
North Muirhouse Wood
Pelican Wood
Muirhouse Farm
Rabbit Strip
Mossbog Strip
Fernieshaw Farm
South Muirhouse Wood
Lookout Clump
Ward Strip
Penty
North Hill Strip
Hill Glen
Penty Farm Cottage
South Foulburn Strip
Penty Wood
Shank Strip
Hill of Murdostoun
Meadowside Strip
Boiler Strip
Shapie Knowe Strip
Big Wood
Shawstonfoot
Muiredge House
Hill Bank Wood
Rattler Strip
Muiredge Wood
Stocks Road Strip
Pine Strip

BIRNIEHILL ROAD
JERSEY ROAD
MUIREDGE AND JERSEY ROAD
GREENHILL ROAD
FERNIESHAW ROAD
FOULBURN ROAD
SHAWSTONFOOT ROAD
CARNIEGLE ROAD
CAPTAINS WALK
NORTH AND SOUTH LODGE
A73
B7029

N

1:10,000 @ A3

0 0.1 0.2 0.3 0.4 0.5 km

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Exisitng Pole
- New 11kV Overhead Line
- New 11kV Pole
- New 33kV Overhead Line
- Proposed LV Underground Cable
- Proposed 11kV Underground Cable
- Proposed 33kV Underground Cable
- Exisitng 11kV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 17 of 22)

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

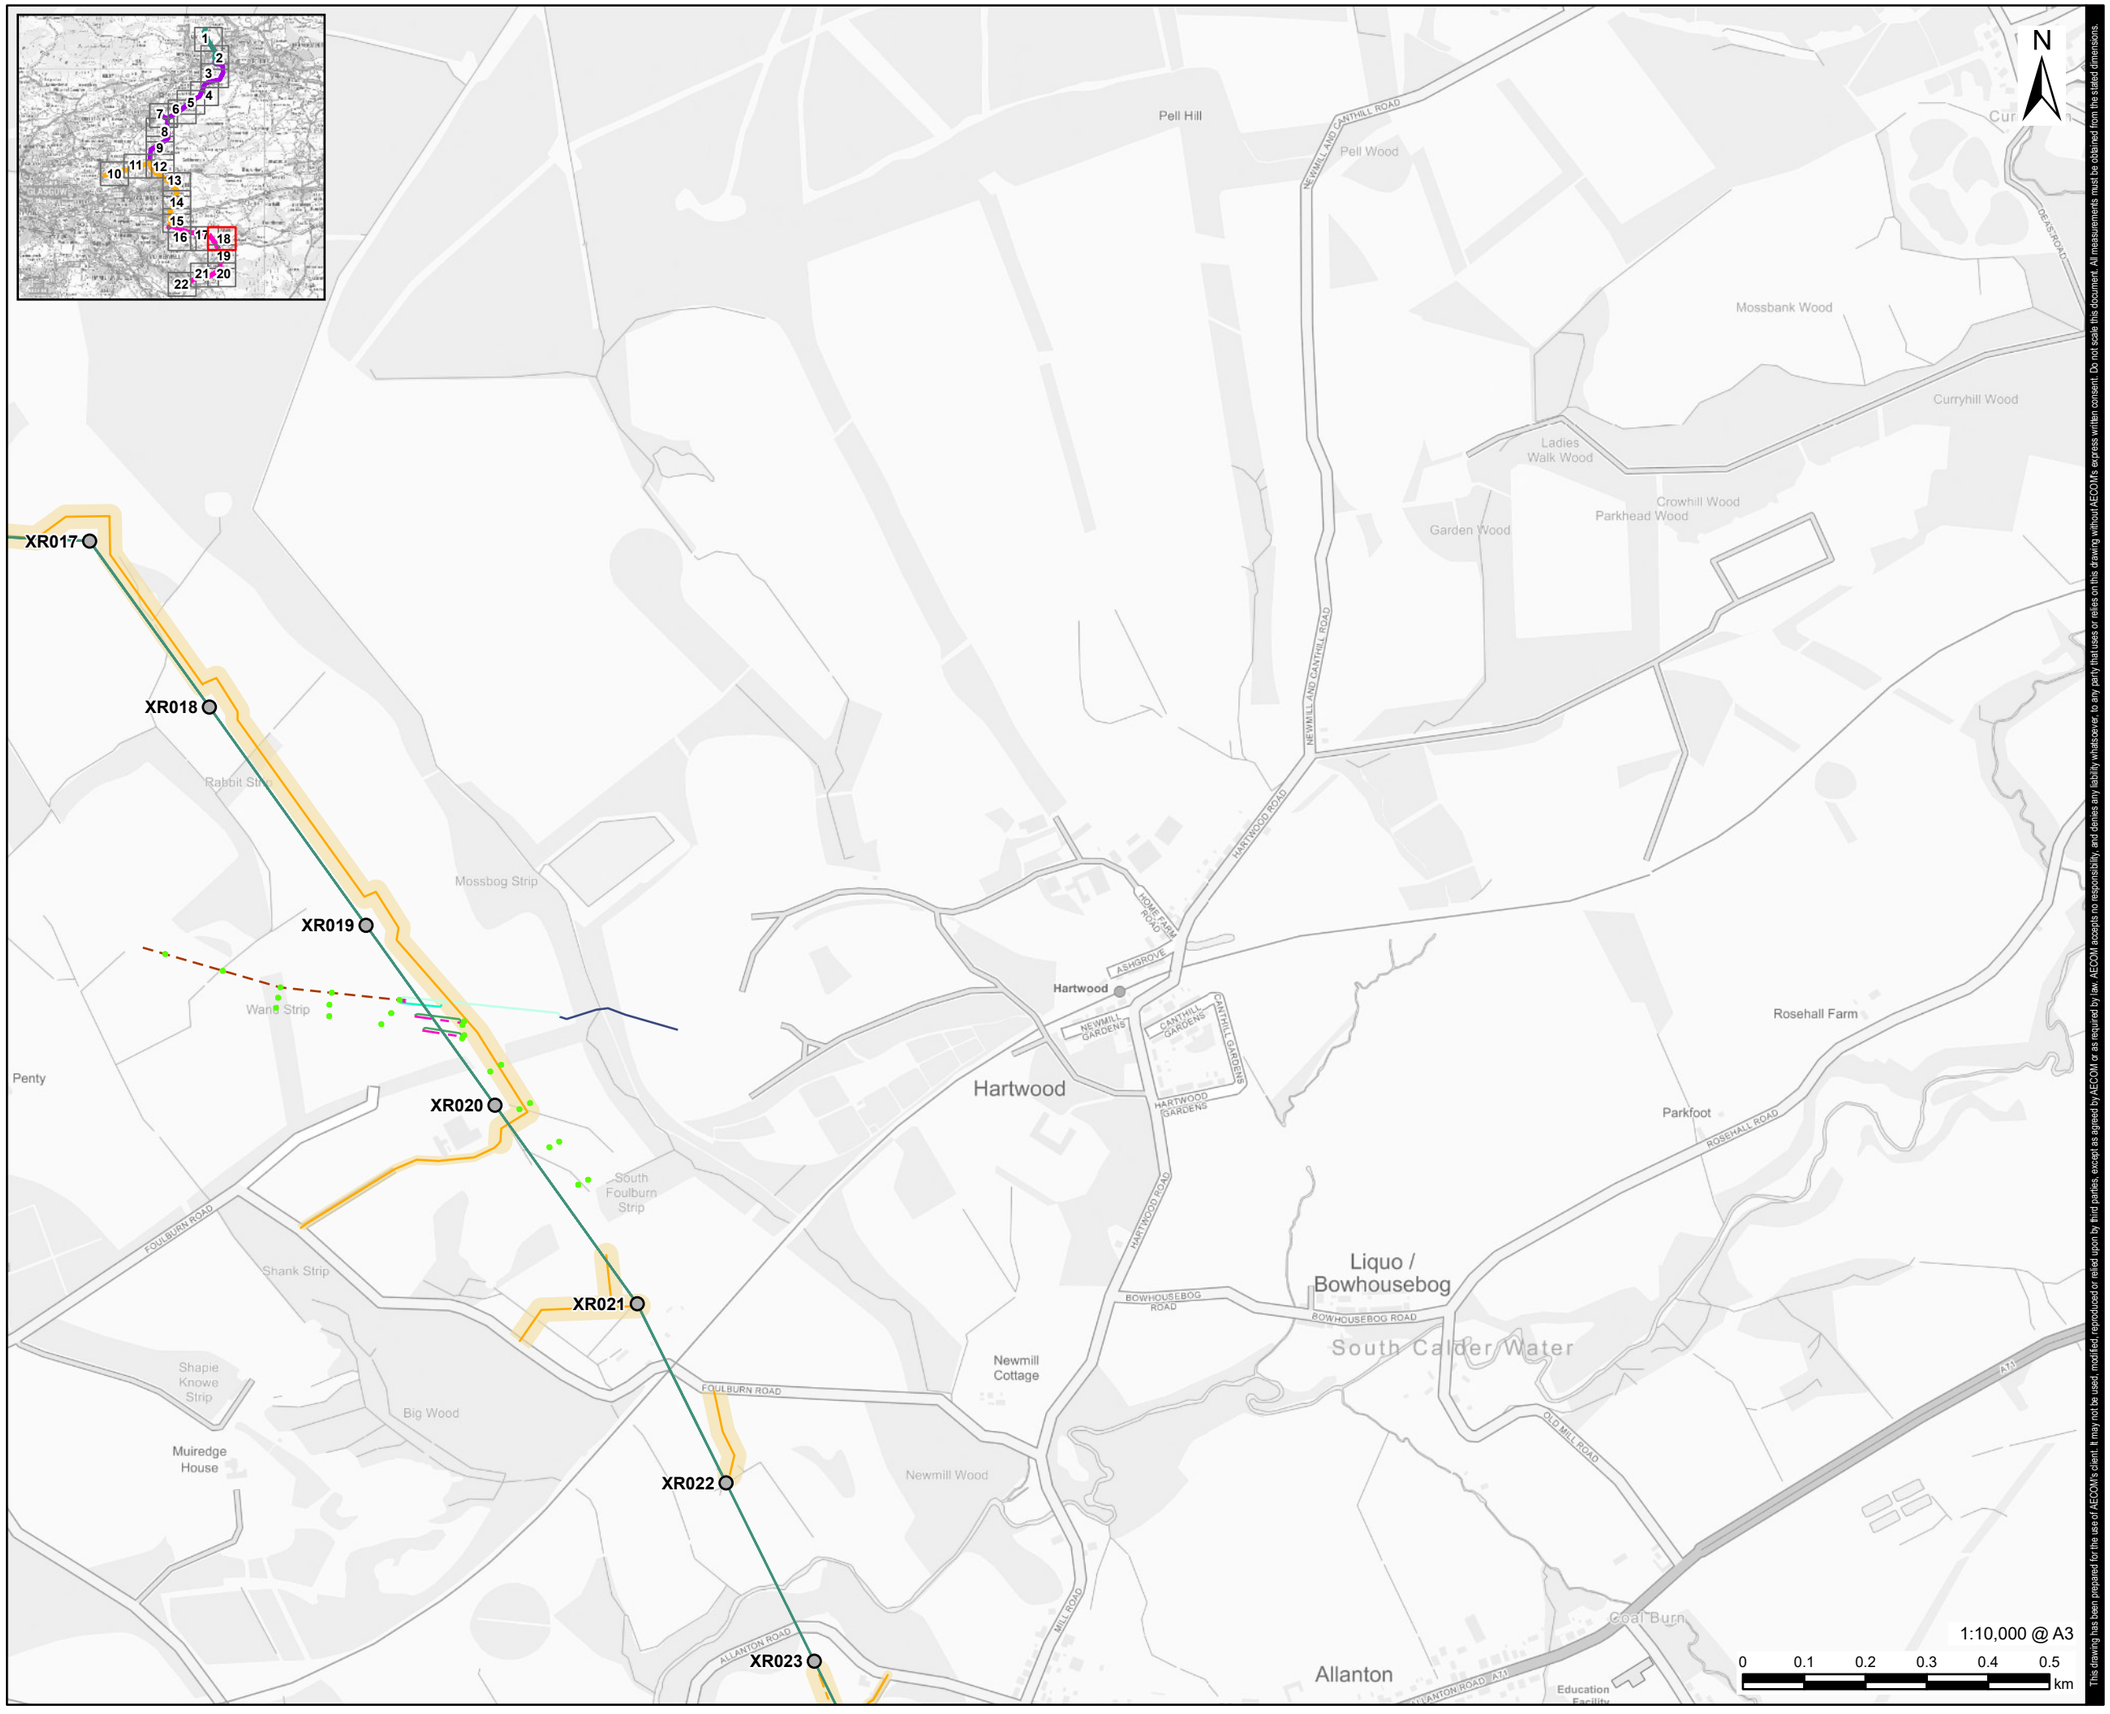

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Exisitng Pole
- New 11kV Pole
- New 33kV Overhead Line
- Proposed LV Underground Cable
- Proposed 11kV Underground Cable
- Proposed 33kV Underground Cable
- Exisitng 11kV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 18 of 22)

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

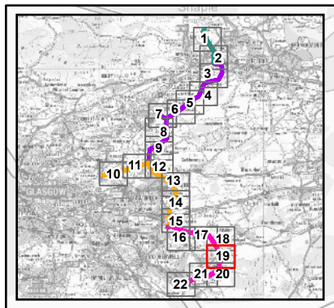

XR022
XR023
XR024
XR025
XR026
XR027
XR028
XR029
XR030

Big Wood
Cottage
FOULBURN ROAD
Newmill Wood
OLD MILL ROAD
MILL ROAD
ALLANTON ROAD
Allanton
Coal Burn
ALLANTON ROAD A721
Education Facility
PO
PW
CALDER ROAD
COLTNESS AVENUE
NEWARK CT
KINGSHILL ROAD
HOUGHSIDE CRESCENT
SPRINGHEAD ROAD
ALLARBANK STREET
HAWTHORN PLACE
WILSON ROAD
REDMIRE CRESCENT
DARNHILL PLACE
HARTFIELD TERRACE
DURA ROAD
Hartfield Cottage
Barnhill Farm
Bolt Strip
Easterhouse Cottage
Easterhouse
Brucefield
MUIRDYKESTOWN ROAD
Castle Park
Jay Wood
Newarkgate Wood
Swanpark
Kennel Knowe Wood
Bonkle
Brownhill Wood
CHURCH ROAD
BROWNHILL VIEW
CARNEY PLACE
MEADOWFIELD PLACE
A11
Buchtknowe Plantation
West Croft Farm
Douglasdale
Newark Plantation
Calkers Wood
Trebor or Number 3
Number 4 Holding
HAWTHORN AVENUE
MAUSBERN STREET
AUCHTER AVENUE
AEDALE CRESCENT
Cathburn Farm
Cathburn Holdings
CATHBURN ROAD
Highlintmill
Number 14 Holding
Gallow Hill
Upper Daviesdykes
Lower Daviesdykes
DAVIESDYKE ROAD
Rumbling Sikes
Kirkhall

N

1:10,000 @ A3

0 0.1 0.2 0.3 0.4 0.5 km

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Exisitng Pole
- New 11kV Pole
- Proposed 11kV Underground Cable
- Exisitng 11kV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 19 of 22)

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx

Revision: 1 Drawn:MLS Checked: LC Approved: ON Date: 2026-06-09

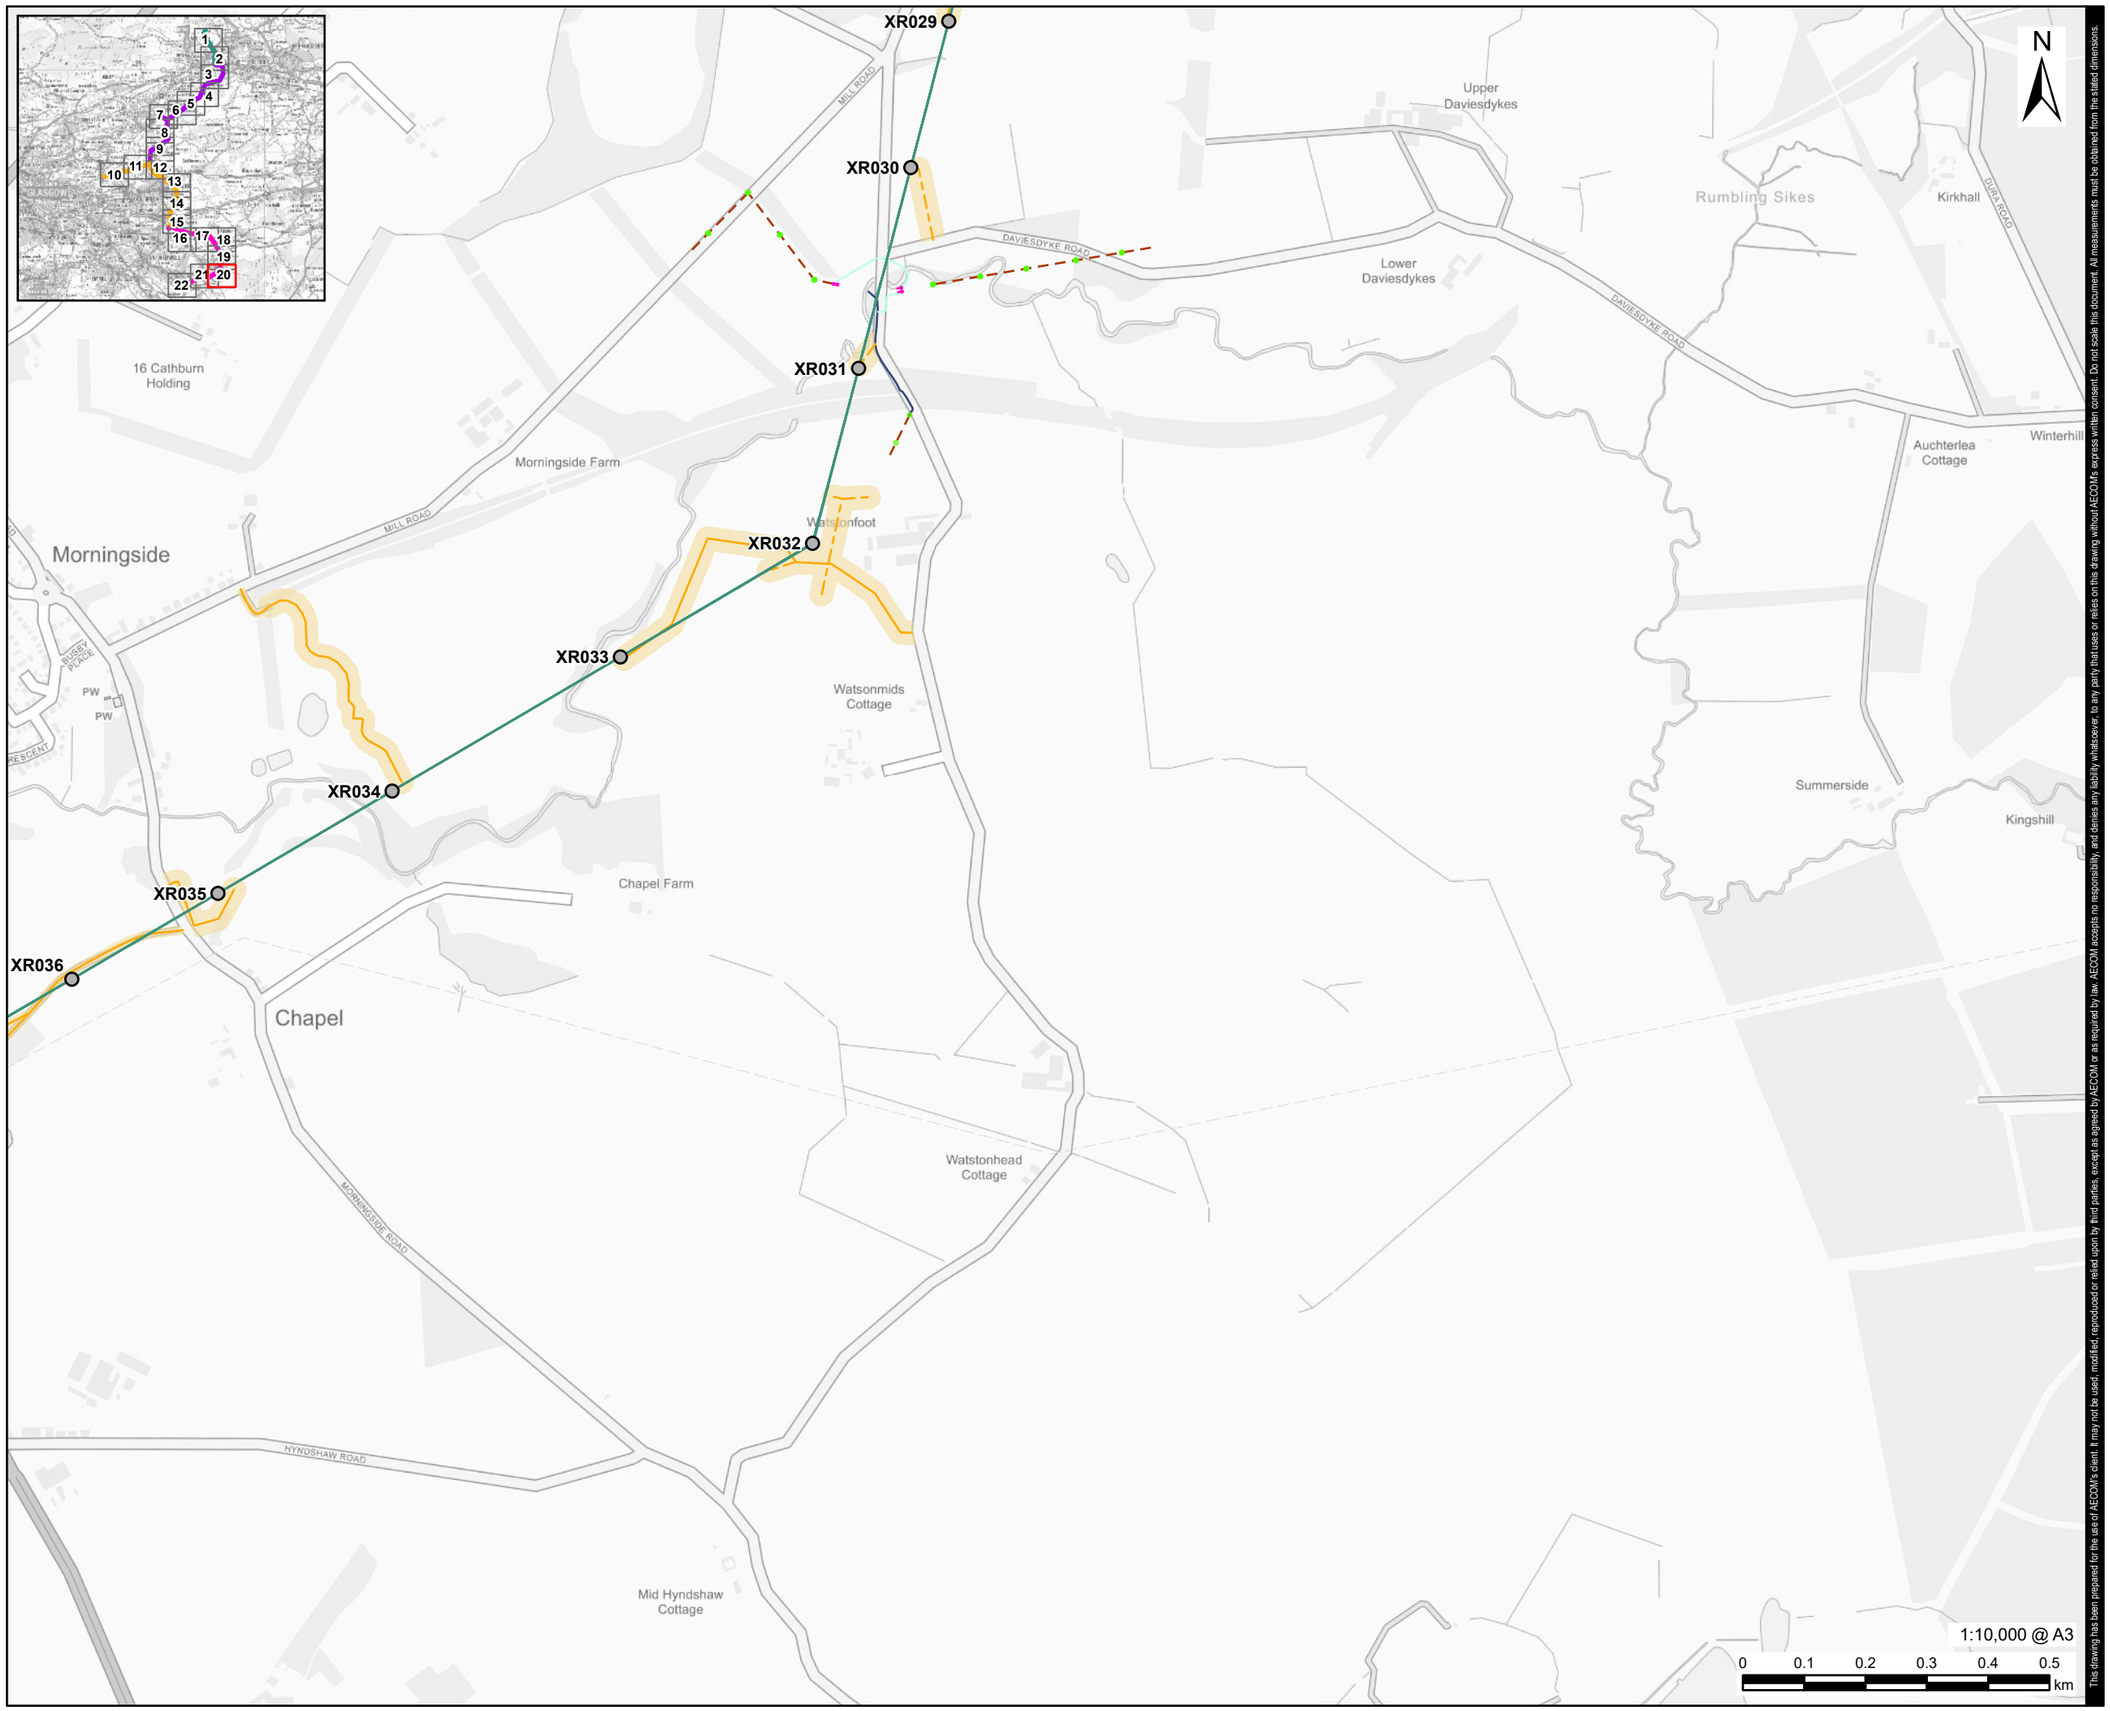

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Uprated Overhead Line
- Temporary Stone Track
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Limit of Deviation
- Exisitng Pole
- New 11kV Pole
- Proposed 11kV Underground Cable
- Exisitng 11kV Overhead Line
- Existing 11kV Underground Cable

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Distribution Line Diversion Works Plan

FIGURE NUMBER

Figure 4.5 (Sheet 20 of 22)

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_4.aprx