Revision: 1 Drawn: AM Checked: MLS Approved: ON Date: 2026-05-20

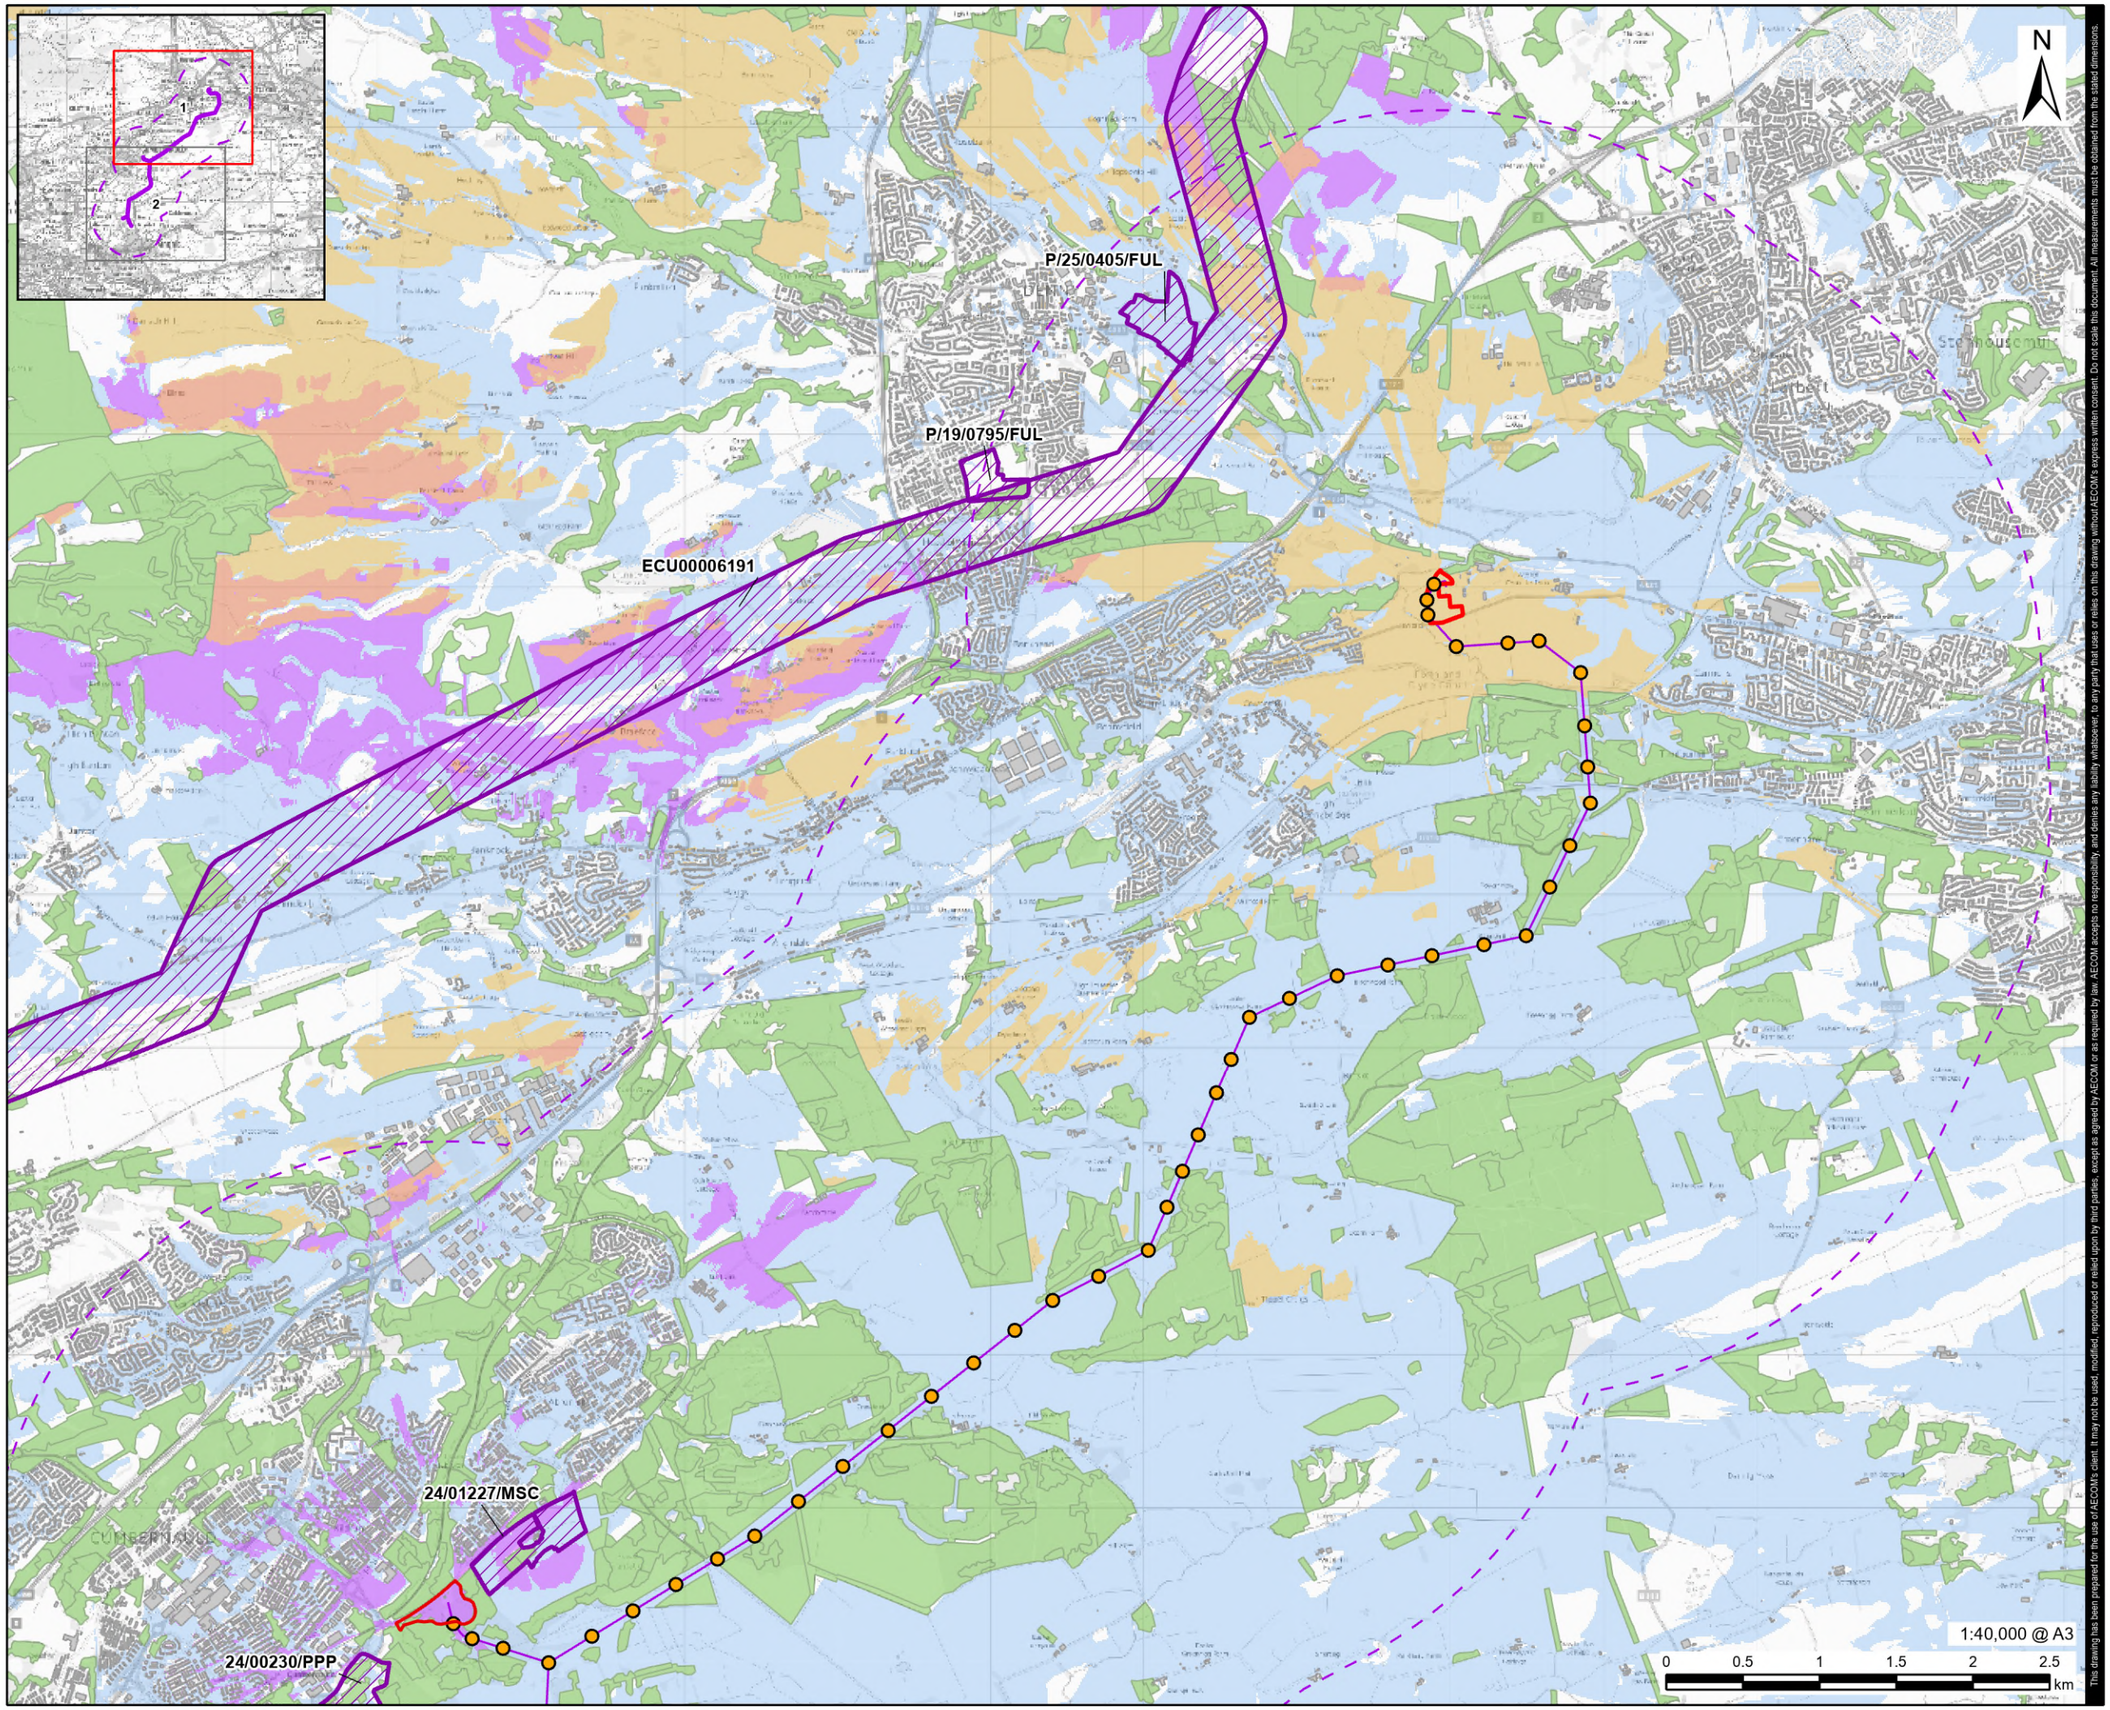

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Filename: C:\Users\lemonsmithm\Documents\DWNO02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_6_Landscape.aprx

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Substation Site Boundary
- New Build Overhead Line
- Landscape Study Area - 3km
- Building - 7.5m Height
- National Forest Inventory Scotland - Woodland - 10m Height
- Planning Application

Zone of Theoretical Visibility

- Tower Only Visible
- Cumbernauld Substation, Bonnybridge Substation and Tower Visible
- Cumbernauld Substation and Tower Visible
- Bonnybridge Substation and Tower Visible

NOTES

Contains OS data © Crown copyright 2025
Contains, or is based on, information supplied by the Forestry Commission. © Crown copyright and database right 2023 Ordnance Survey [AC0000814847].
Contains public sector information licensed under the Open Government Licence v3.0.
Zone of Theoretical Visibility (ZTV) has been generated using OS Terrain 5 digital terrain model (DTM) which does not take into account the screening effects of vegetation, buildings or other structures.
Existing Buildings have been incorporated into the DTM from OS Open Map Local with an assumed height of 7.5m.
Woodland from National Forest Inventory has been incorporated into the DTM with an assumed height of 10m. Areas of woodland to be felled have been excluded.
ZTV for Bonnybridge is based upon the indicative substation layout with a maximum height of 13.25m
ZTV for Cumbernauld Substation is based upon the indicative substation layout with a maximum height of 15.5m.
ZTV is based upon the indicative new tower locations with a maximum height of 63m.
All heights mentioned above are above ground level (AGL) unless otherwise specified.

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Cumulative Schemes and Zone of Theoretical Visibility

FIGURE NUMBER

Figure 6.8

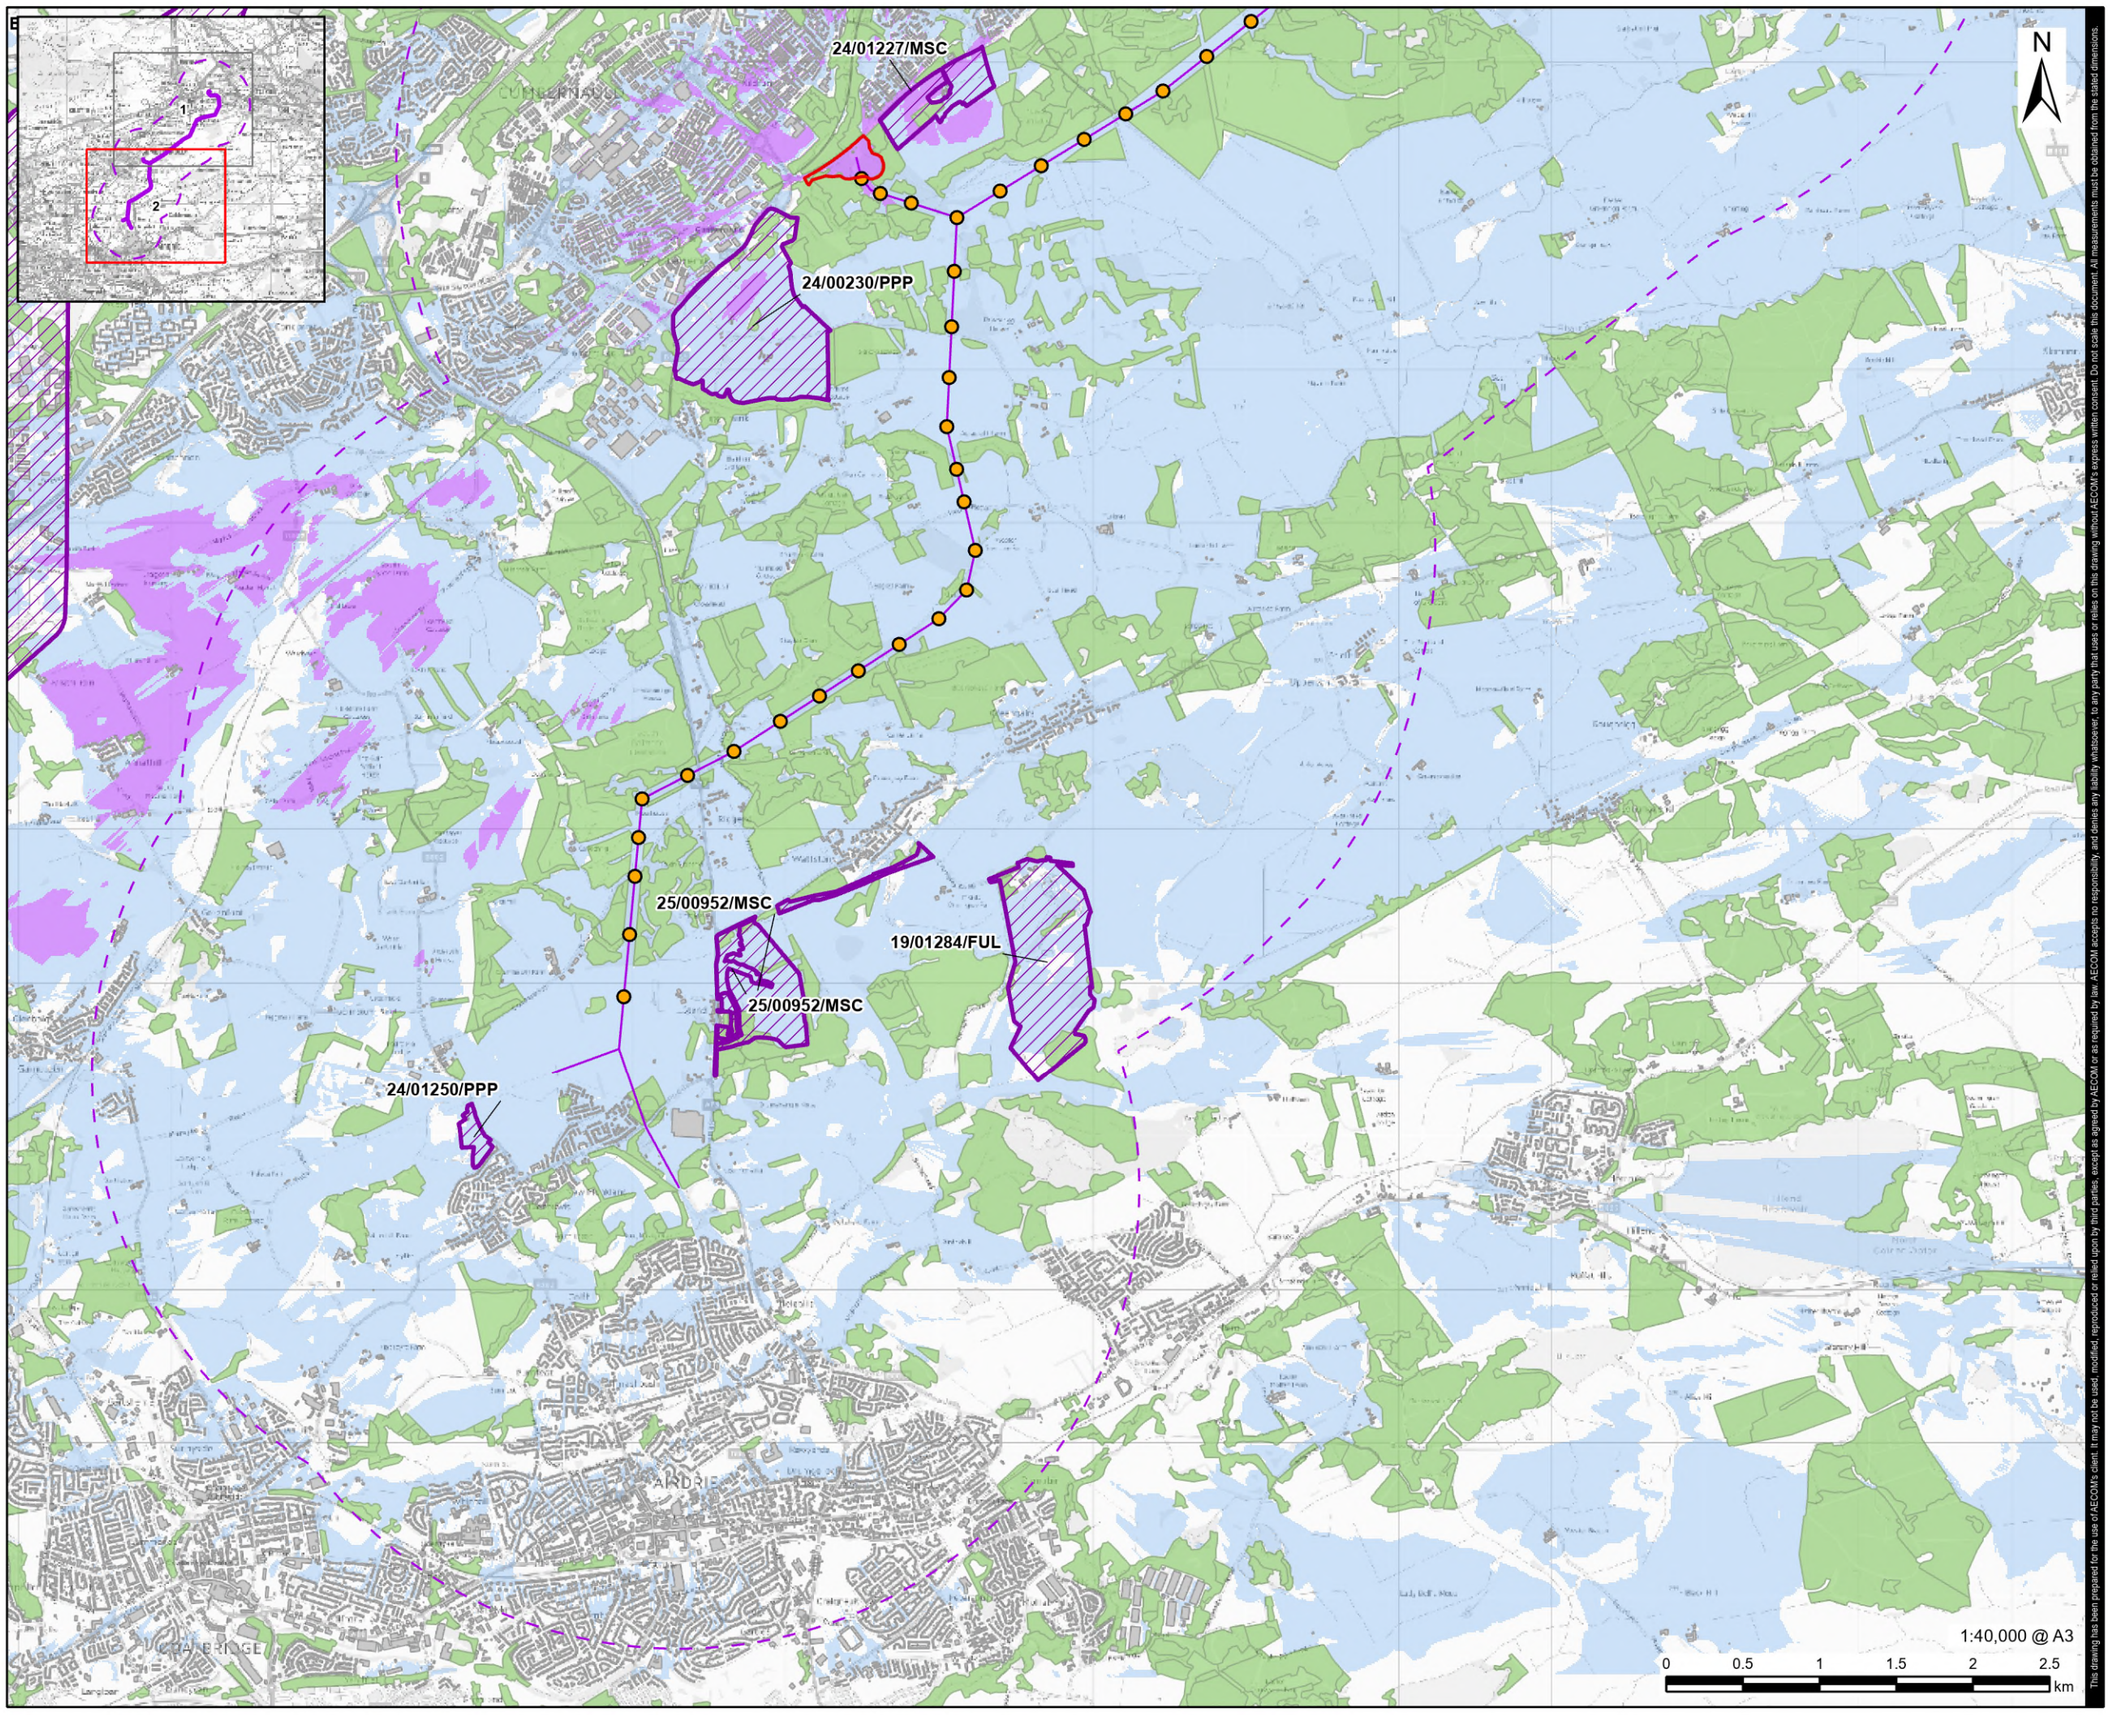

Revision: 1 Drawn: AM Checked: MLS Approved: ON Date: 2026-05-20

Filename: C:\Users\lemonsmithm\Documents\DWNO\02_Maps\DWNO EIA Report\DWNO_EIA_Chapter_6_Landscape.aprx

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- New Build Overhead Line
- Landscape Study Area - 3km
- Building - 7.5m Height
- National Forest Inventory Scotland - Woodland - 10m Height
- Planning Application

Zone of Theoretical Visibility

- Tower Only Visible
- Cumbernauld Substation, Bonnybridge Substation and Tower Visible
- Cumbernauld Substation and Tower Visible
- Bonnybridge Substation and Tower Visible

NOTES

Contains OS data © Crown copyright 2025
Contains, or is based on, information supplied by the Forestry Commission. © Crown copyright and database right 2023 Ordnance Survey [AC0000814847].
Contains public sector information licensed under the Open Government Licence v3.0.
Zone of Theoretical Visibility (ZTV) has been generated using OS Terrain 5 digital terrain model (DTM) which does not take into account the screening effects of vegetation, buildings or other structures.
Existing Buildings have been incorporated into the DTM from OS Open Map Local with an assumed height of 7.5m.
Woodland from National Forest Inventory has been incorporated into the DTM with an assumed height of 10m. Areas of woodland to be felled have been excluded.
ZTV for Bonnybridge is based upon the indicative substation layout with a maximum height of 13.25m
ZTV for Cumbernauld Substation is based upon the indicative substation layout with a maximum height of 15.5m.
ZTV is based upon the indicative new tower locations with a maximum height of 63m.
All heights mentioned above are above ground level (AGL) unless otherwise specified.

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Cumulative Schemes and Zone of Theoretical Visibility

FIGURE NUMBER

Figure 6.8

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.