


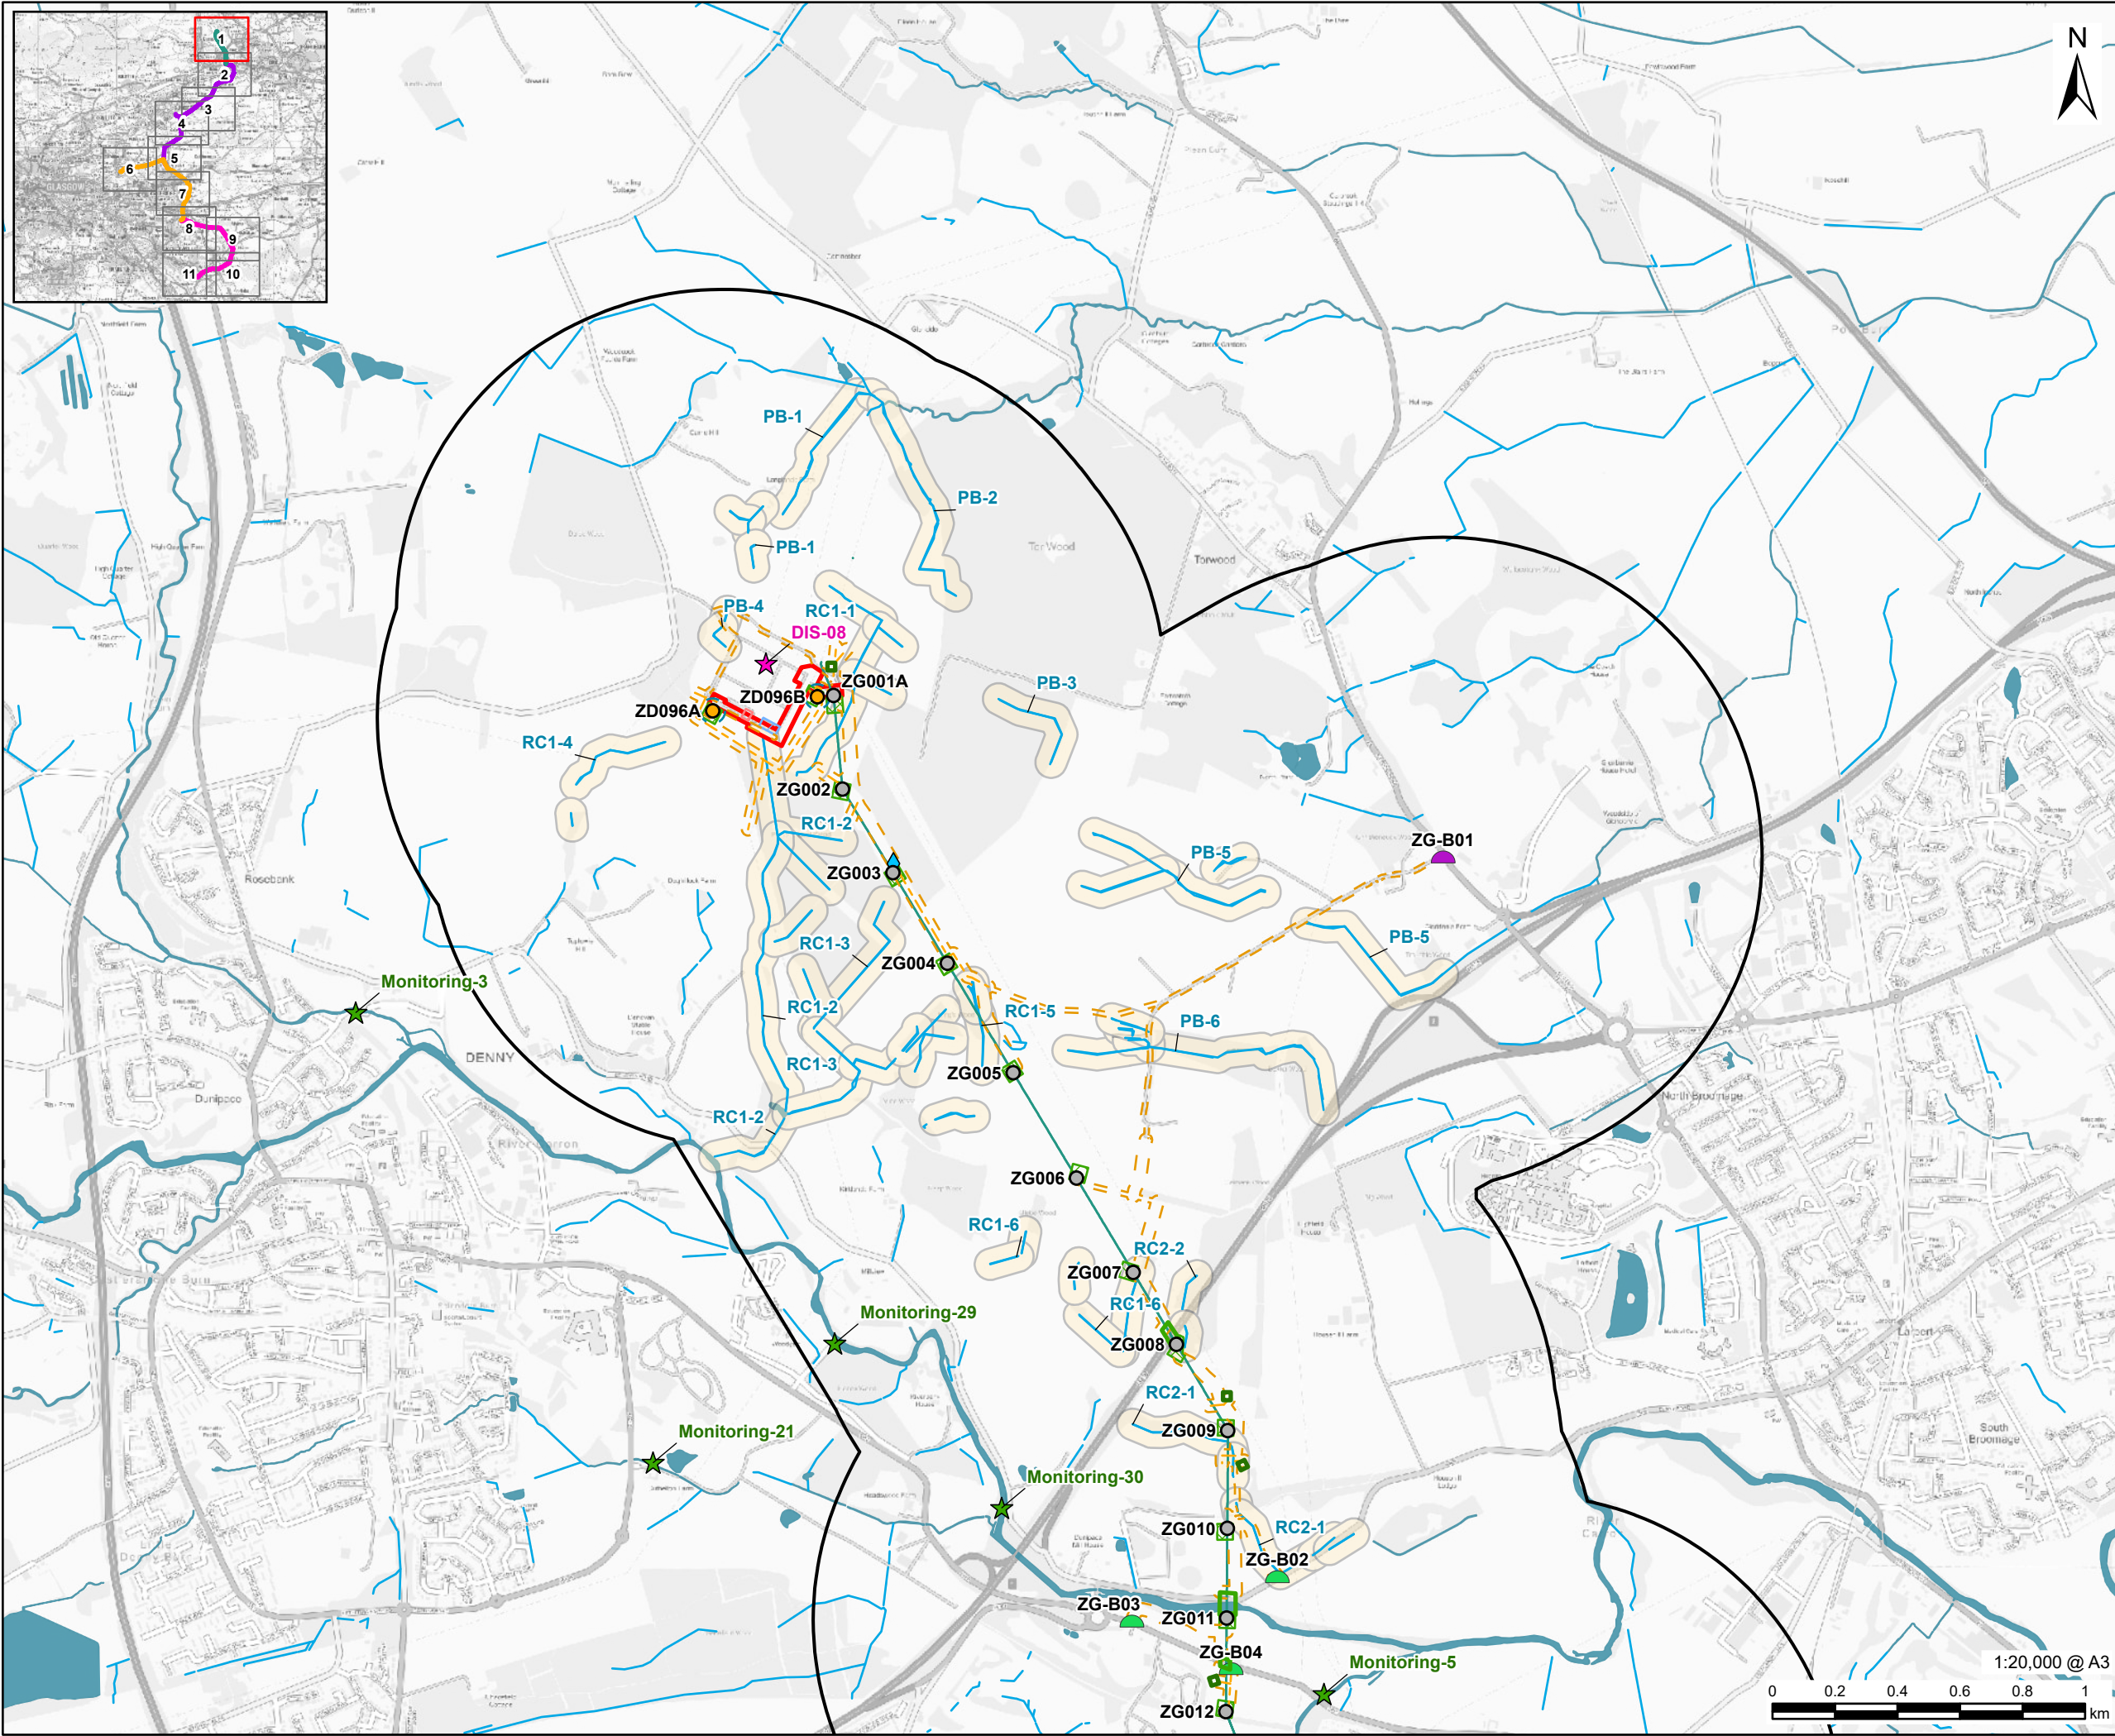

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Denny North Substation Site Boundary
- ZG Tower Compound
- ZG Upgraded Overhead Line
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Substation Laydown Area
- Scaffolding
- Pulling Position
- Water Crossing
- Existing Bellmouth
- New Bellmouth
- 1km Study Area
- CAR Authorisation (Discharges)
- SEPA Monitoring Location
- Surface Water Feature
- Surface Water Area
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE


Surface Water Receptors

FIGURE NUMBER

Figure 9.1 (Sheet 1 of 11)

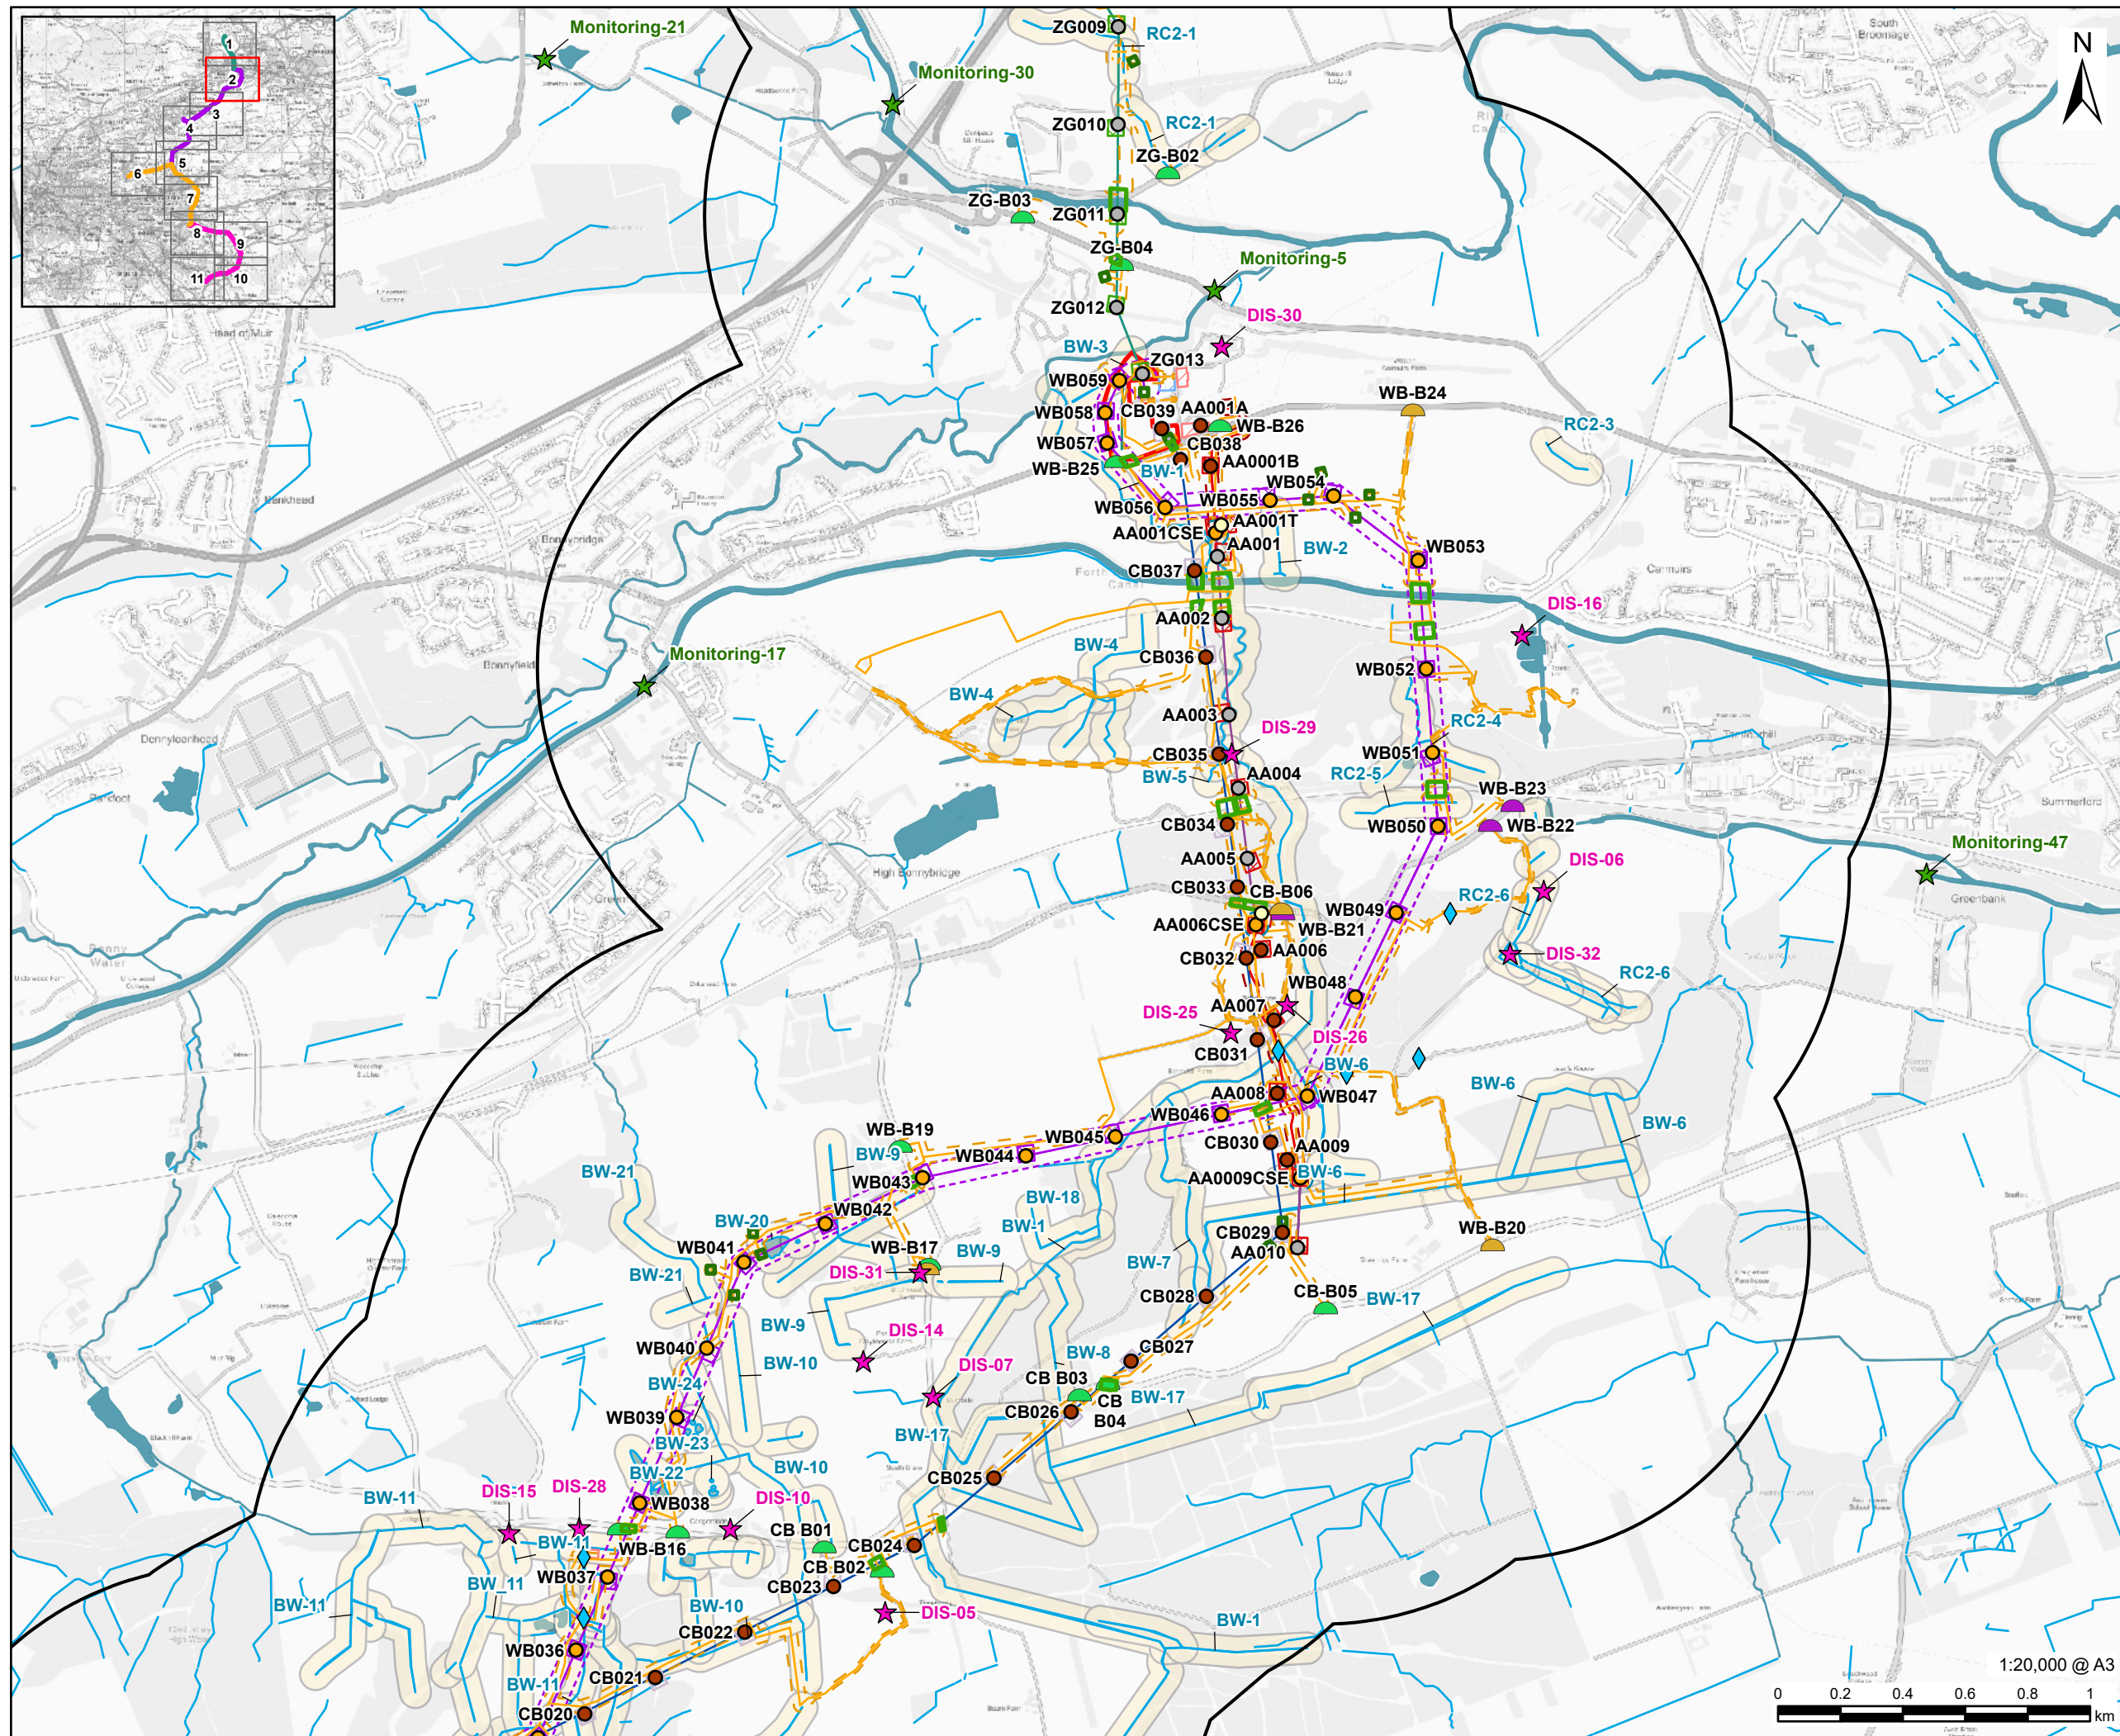

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale the images. All measurements must be obtained from the stated dimensions.

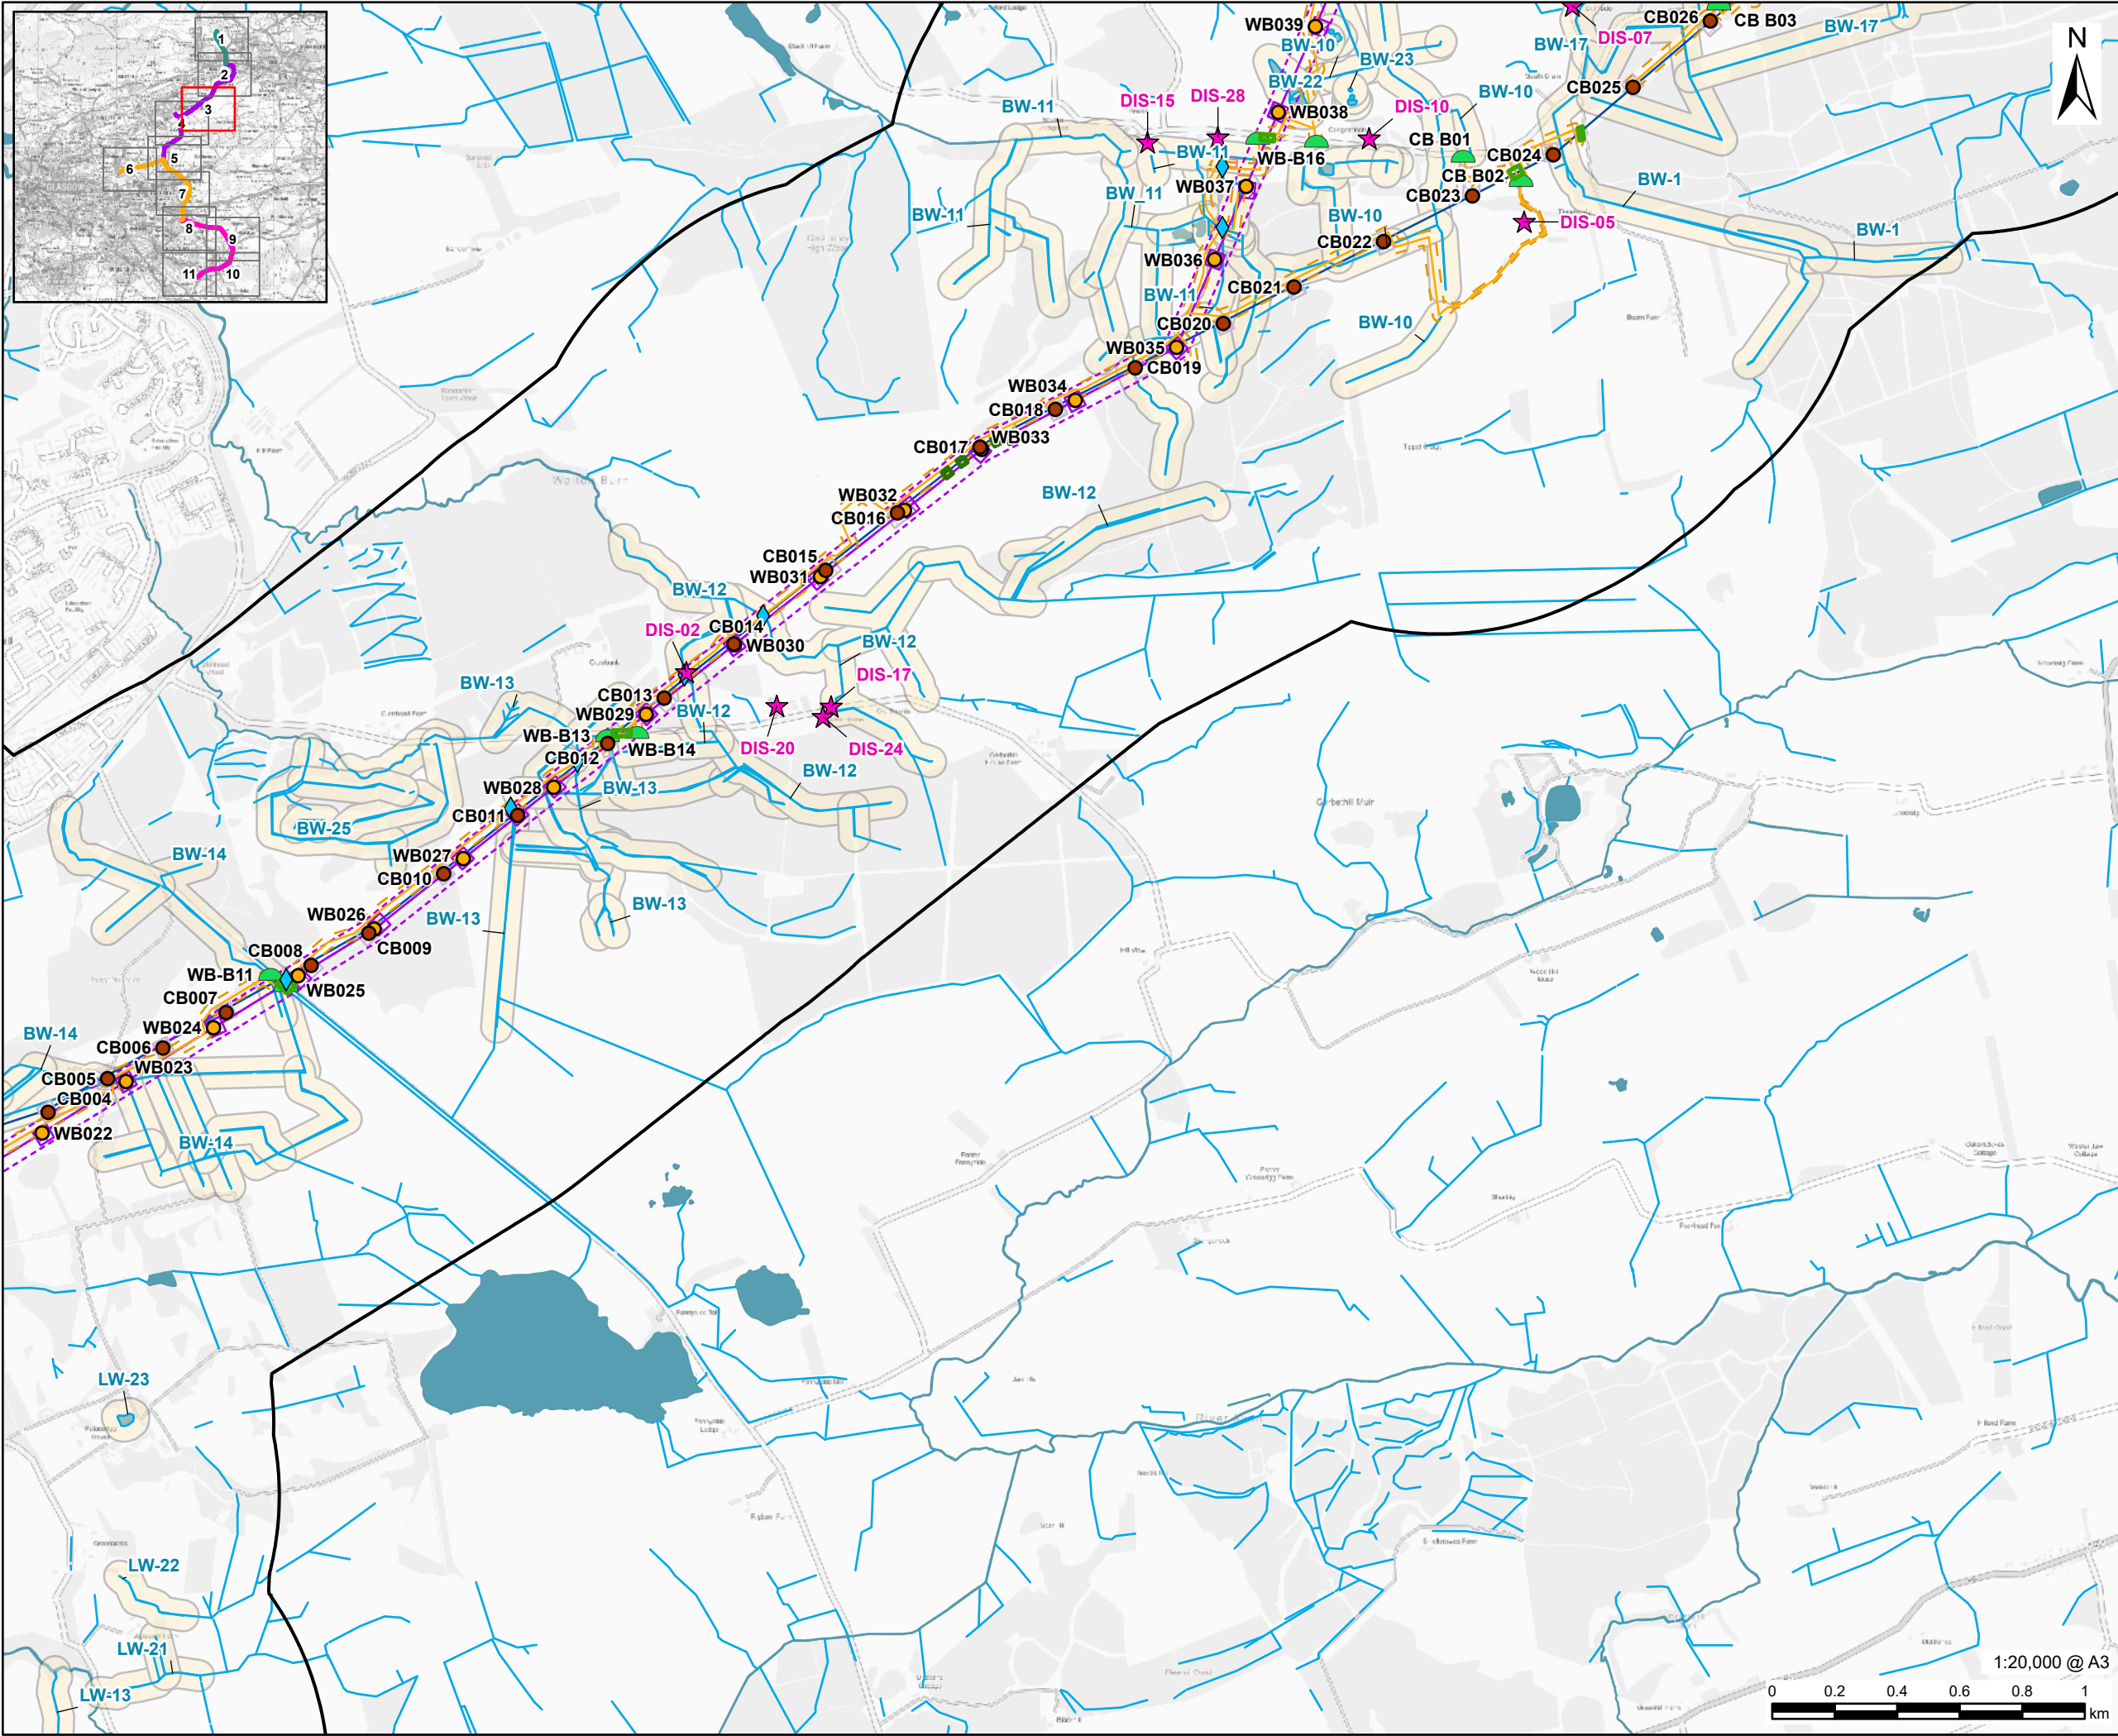

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- New Tower
 - Tower to be Removed
 - New Build Tower Compound
 - CB Tower Compound
 - New Build Overhead Line
 - CB Route Removal
 - New Build Overhead Line Limit of Deviation
 - Temporary Trackway
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Temporary Stone Track
 - Overhead Line Site Compound
 - Scaffolding
 - Pulling Position
 - Water Crossing
 - New Bellmouth
 - 1km Study Area
 - CAR Authorisation (Discharges)
 - Surface Water Feature
 - Surface Water Area
 - Buffer Zone (50 m)

NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE
Environmental Impact Assessment Report


PROJECT NUMBER
60602788

FIGURE TITLE
Surface Water Receptors

FIGURE NUMBER
Figure 9.1 (Sheet 3 of 11)

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

1:20,000 @ A3
0 0.2 0.4 0.6 0.8 1 km

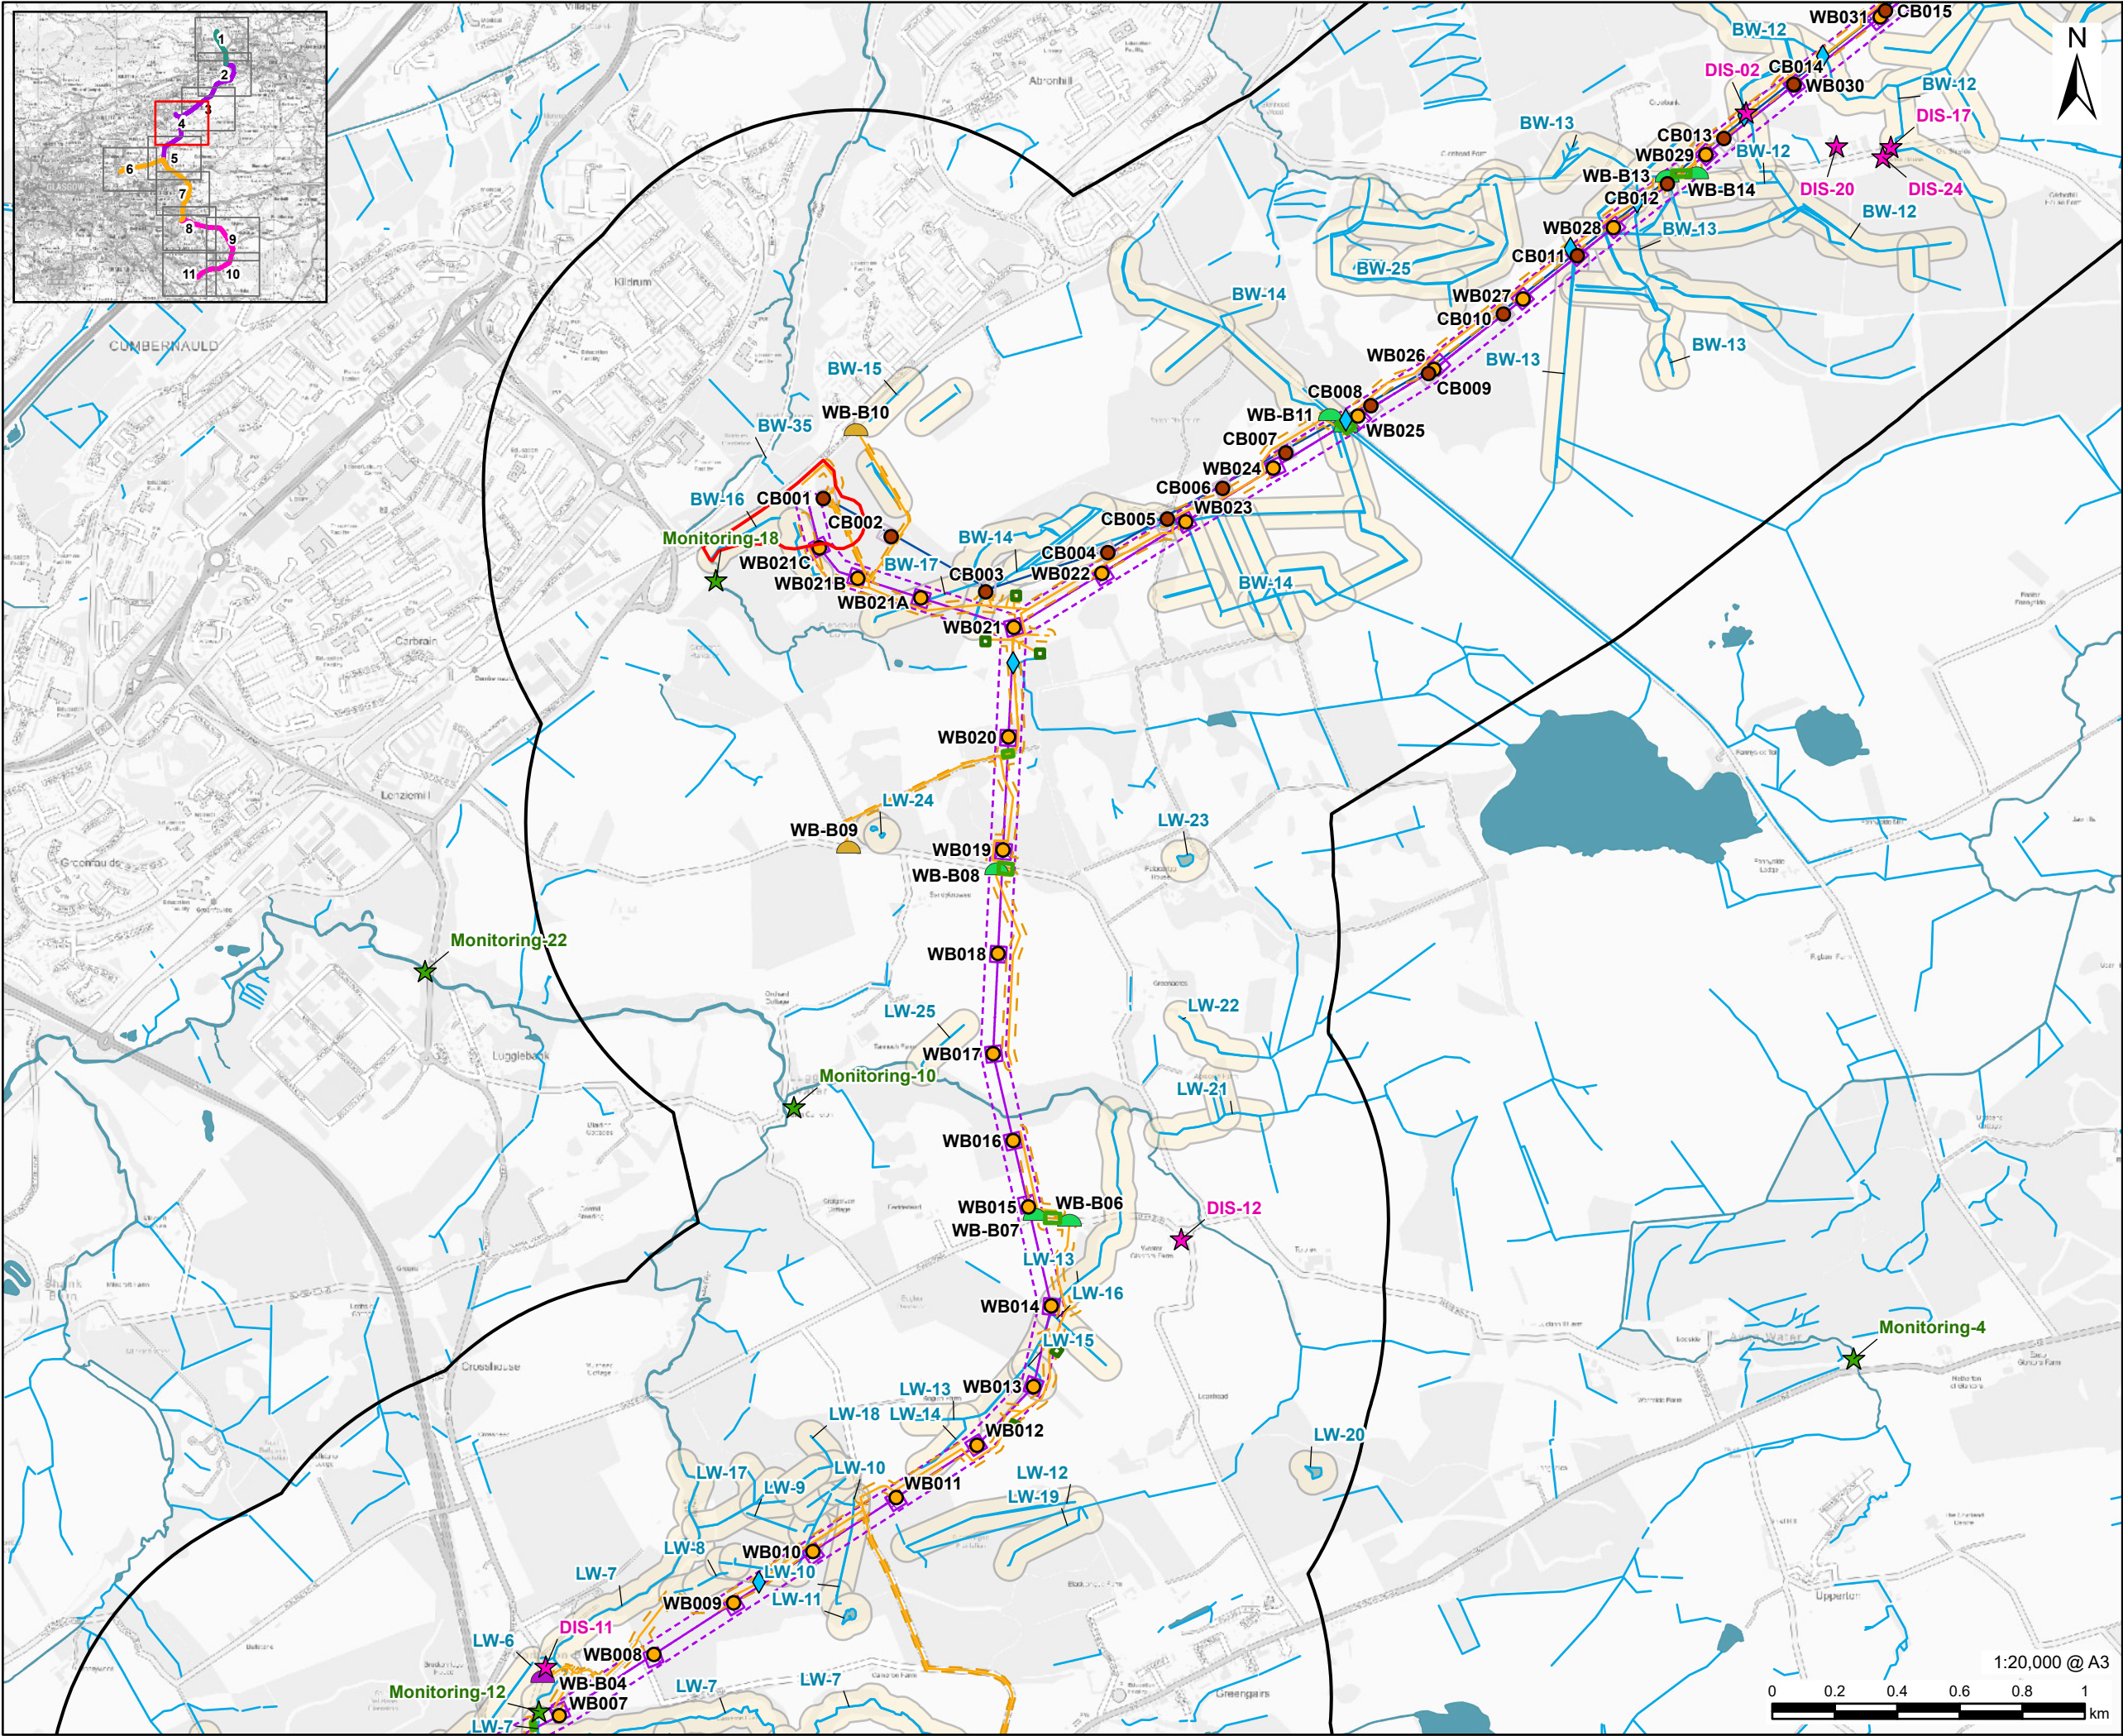

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Tower to be Removed
- Cumbernauld Substation Site Boundary
- New Build Tower Compound
- CB Tower Compound
- New Build Overhead Line
- CB Route Removal
- New Build Overhead Line Limit of Deviation
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Temporary Stone Track
- Scaffolding
- Pulling Position
- Water Crossing
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- CAR Authorisation (Discharges)
- SEPA Monitoring Location
- Surface Water Feature
- Surface Water Area
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Surface Water Receptors

FIGURE NUMBER

Figure 9.1 (Sheet 4 of 11)

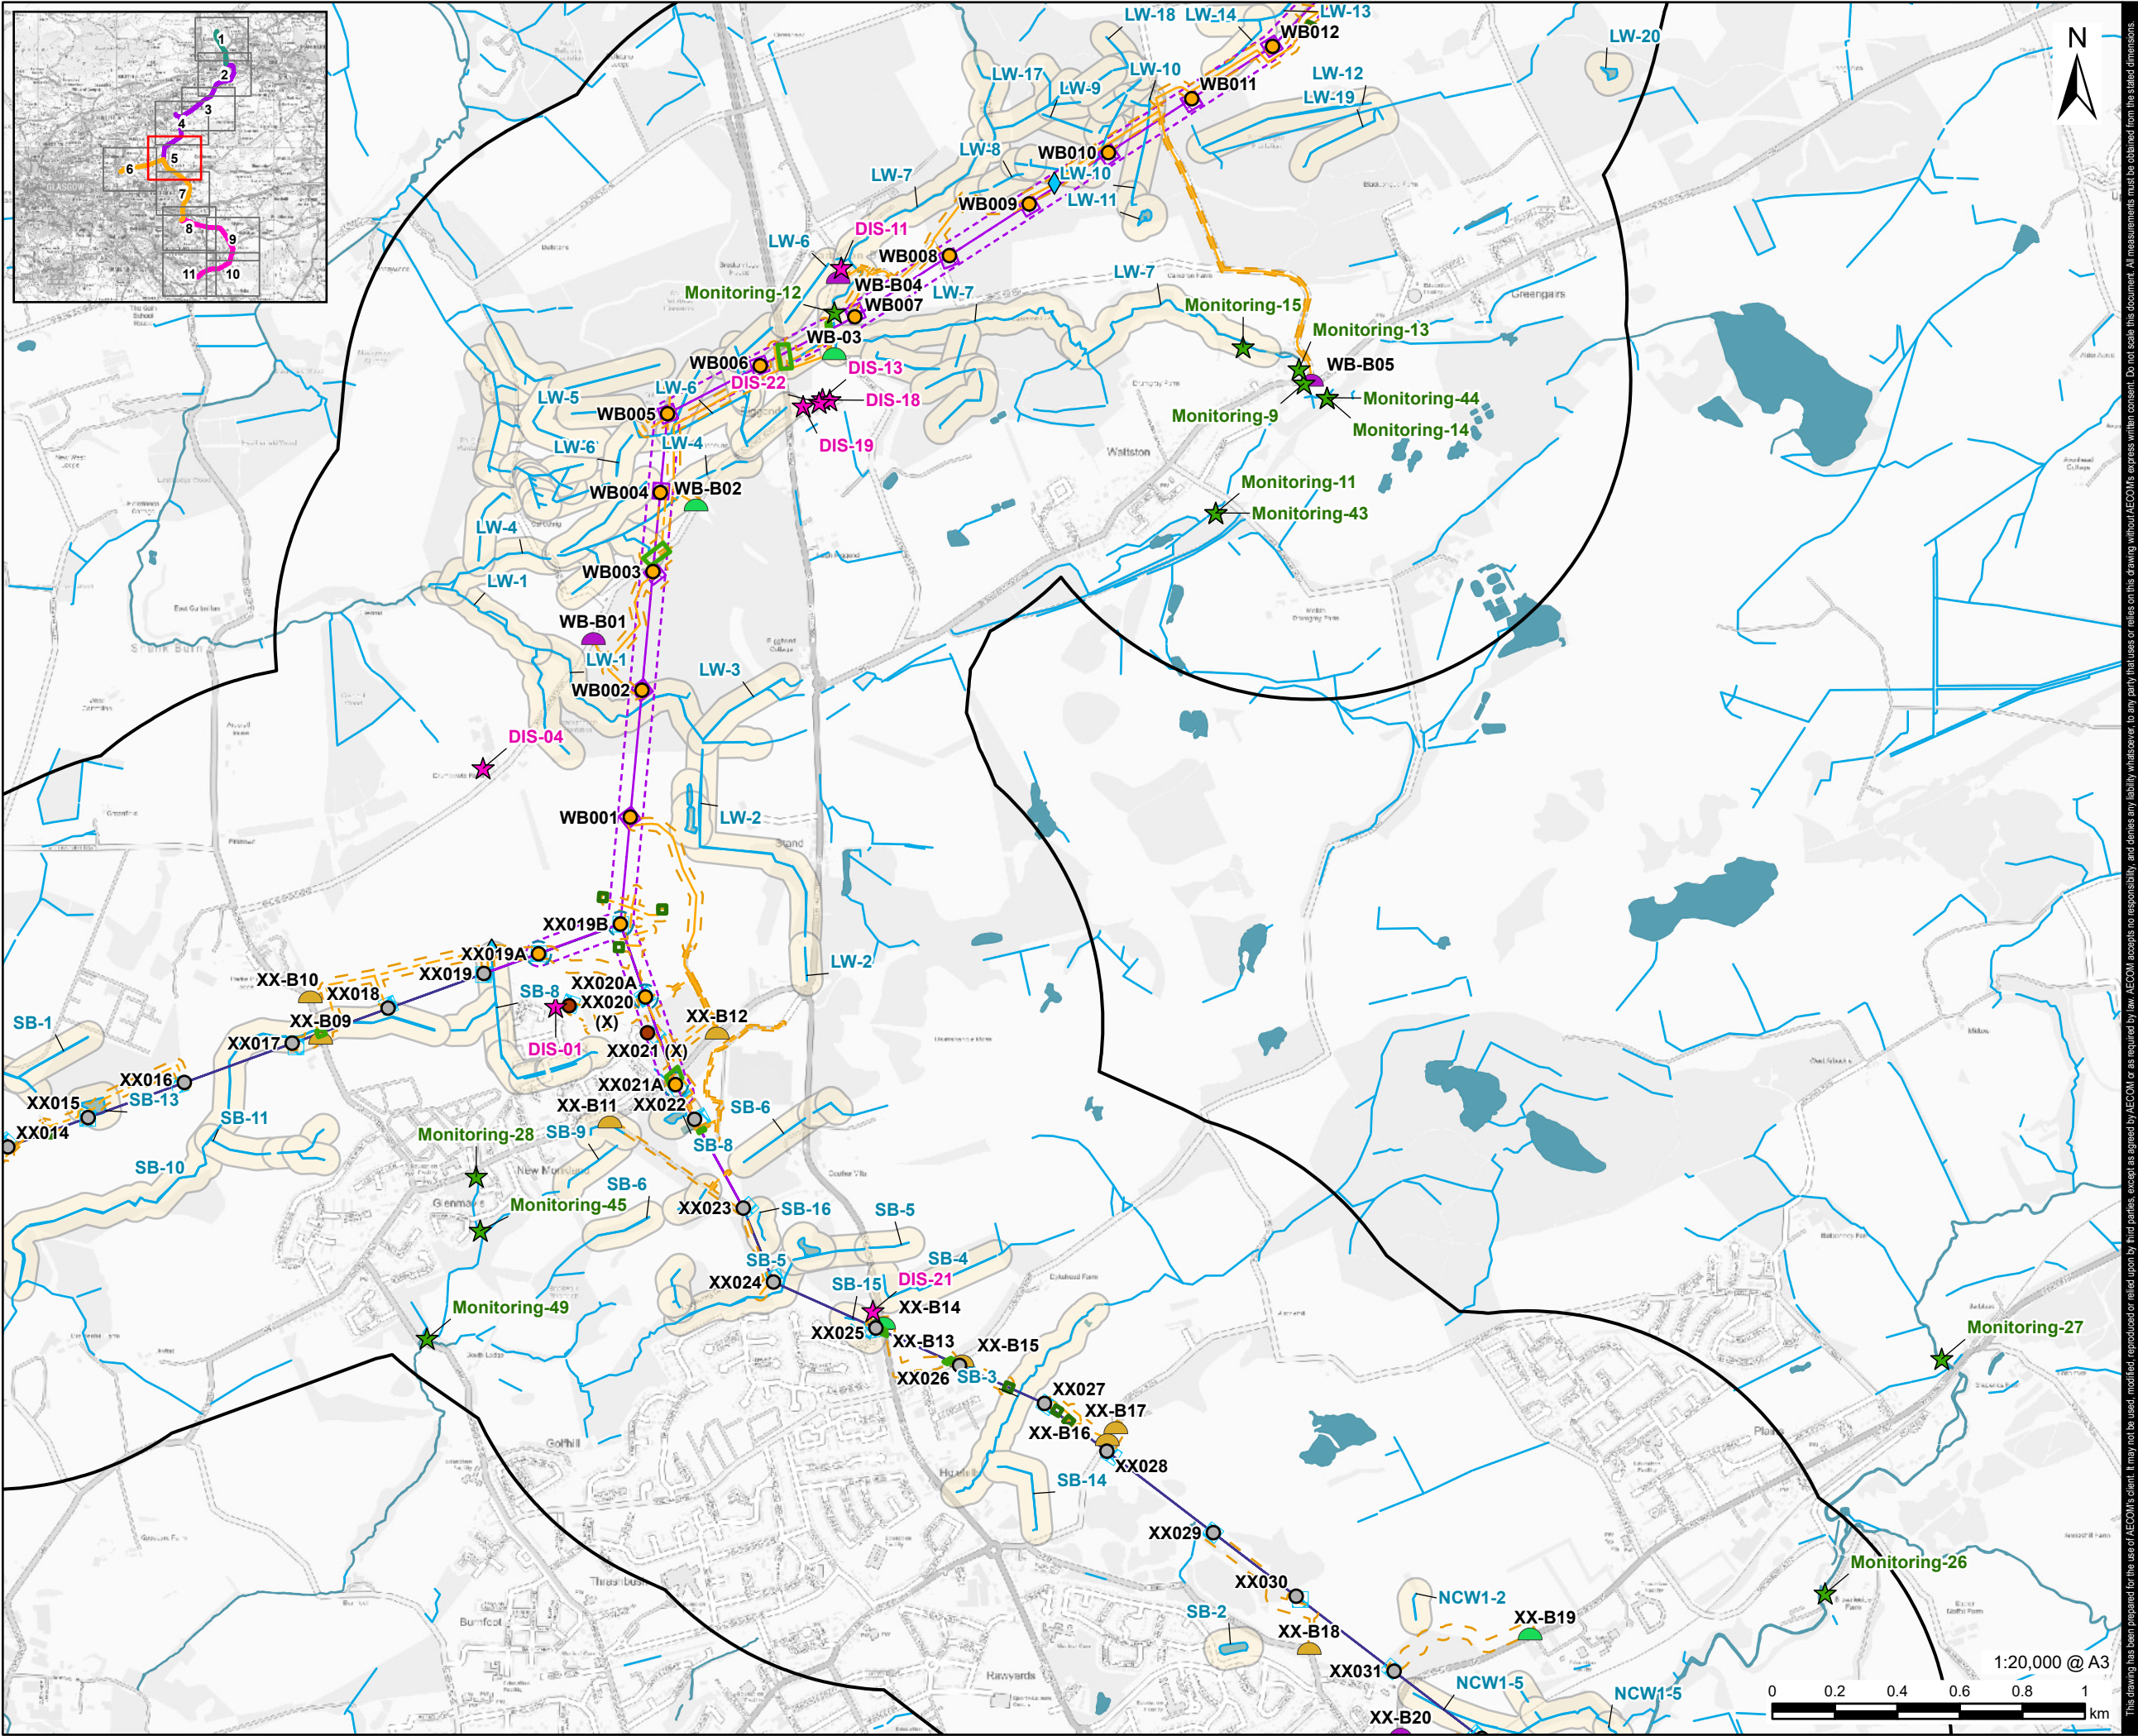

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - New Tower
 - Tower to be Removed
 - New Build Tower Compound
 - XX Tower Compound
 - New Build Overhead Line
 - XX Upgraded Overhead Line
 - New Build Overhead Line Limit of Deviation
 - New Tower Limit of Deviation
 - Temporary Trackway
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Temporary Stone Track
 - Scaffolding
 - Pulling Position
 - Water Crossing
 - Existing Bellmouth
 - New Bellmouth
 - Upgrade Bellmouth
 - 1km Study Area
 - CAR Authorisation (Discharges)
 - SEPA Monitoring Location
 - Surface Water Feature
 - Surface Water Area
 - Buffer Zone (50 m)

NOTES


Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Surface Water Receptors

FIGURE NUMBER
Figure 9.1 (Sheet 5 of 11)

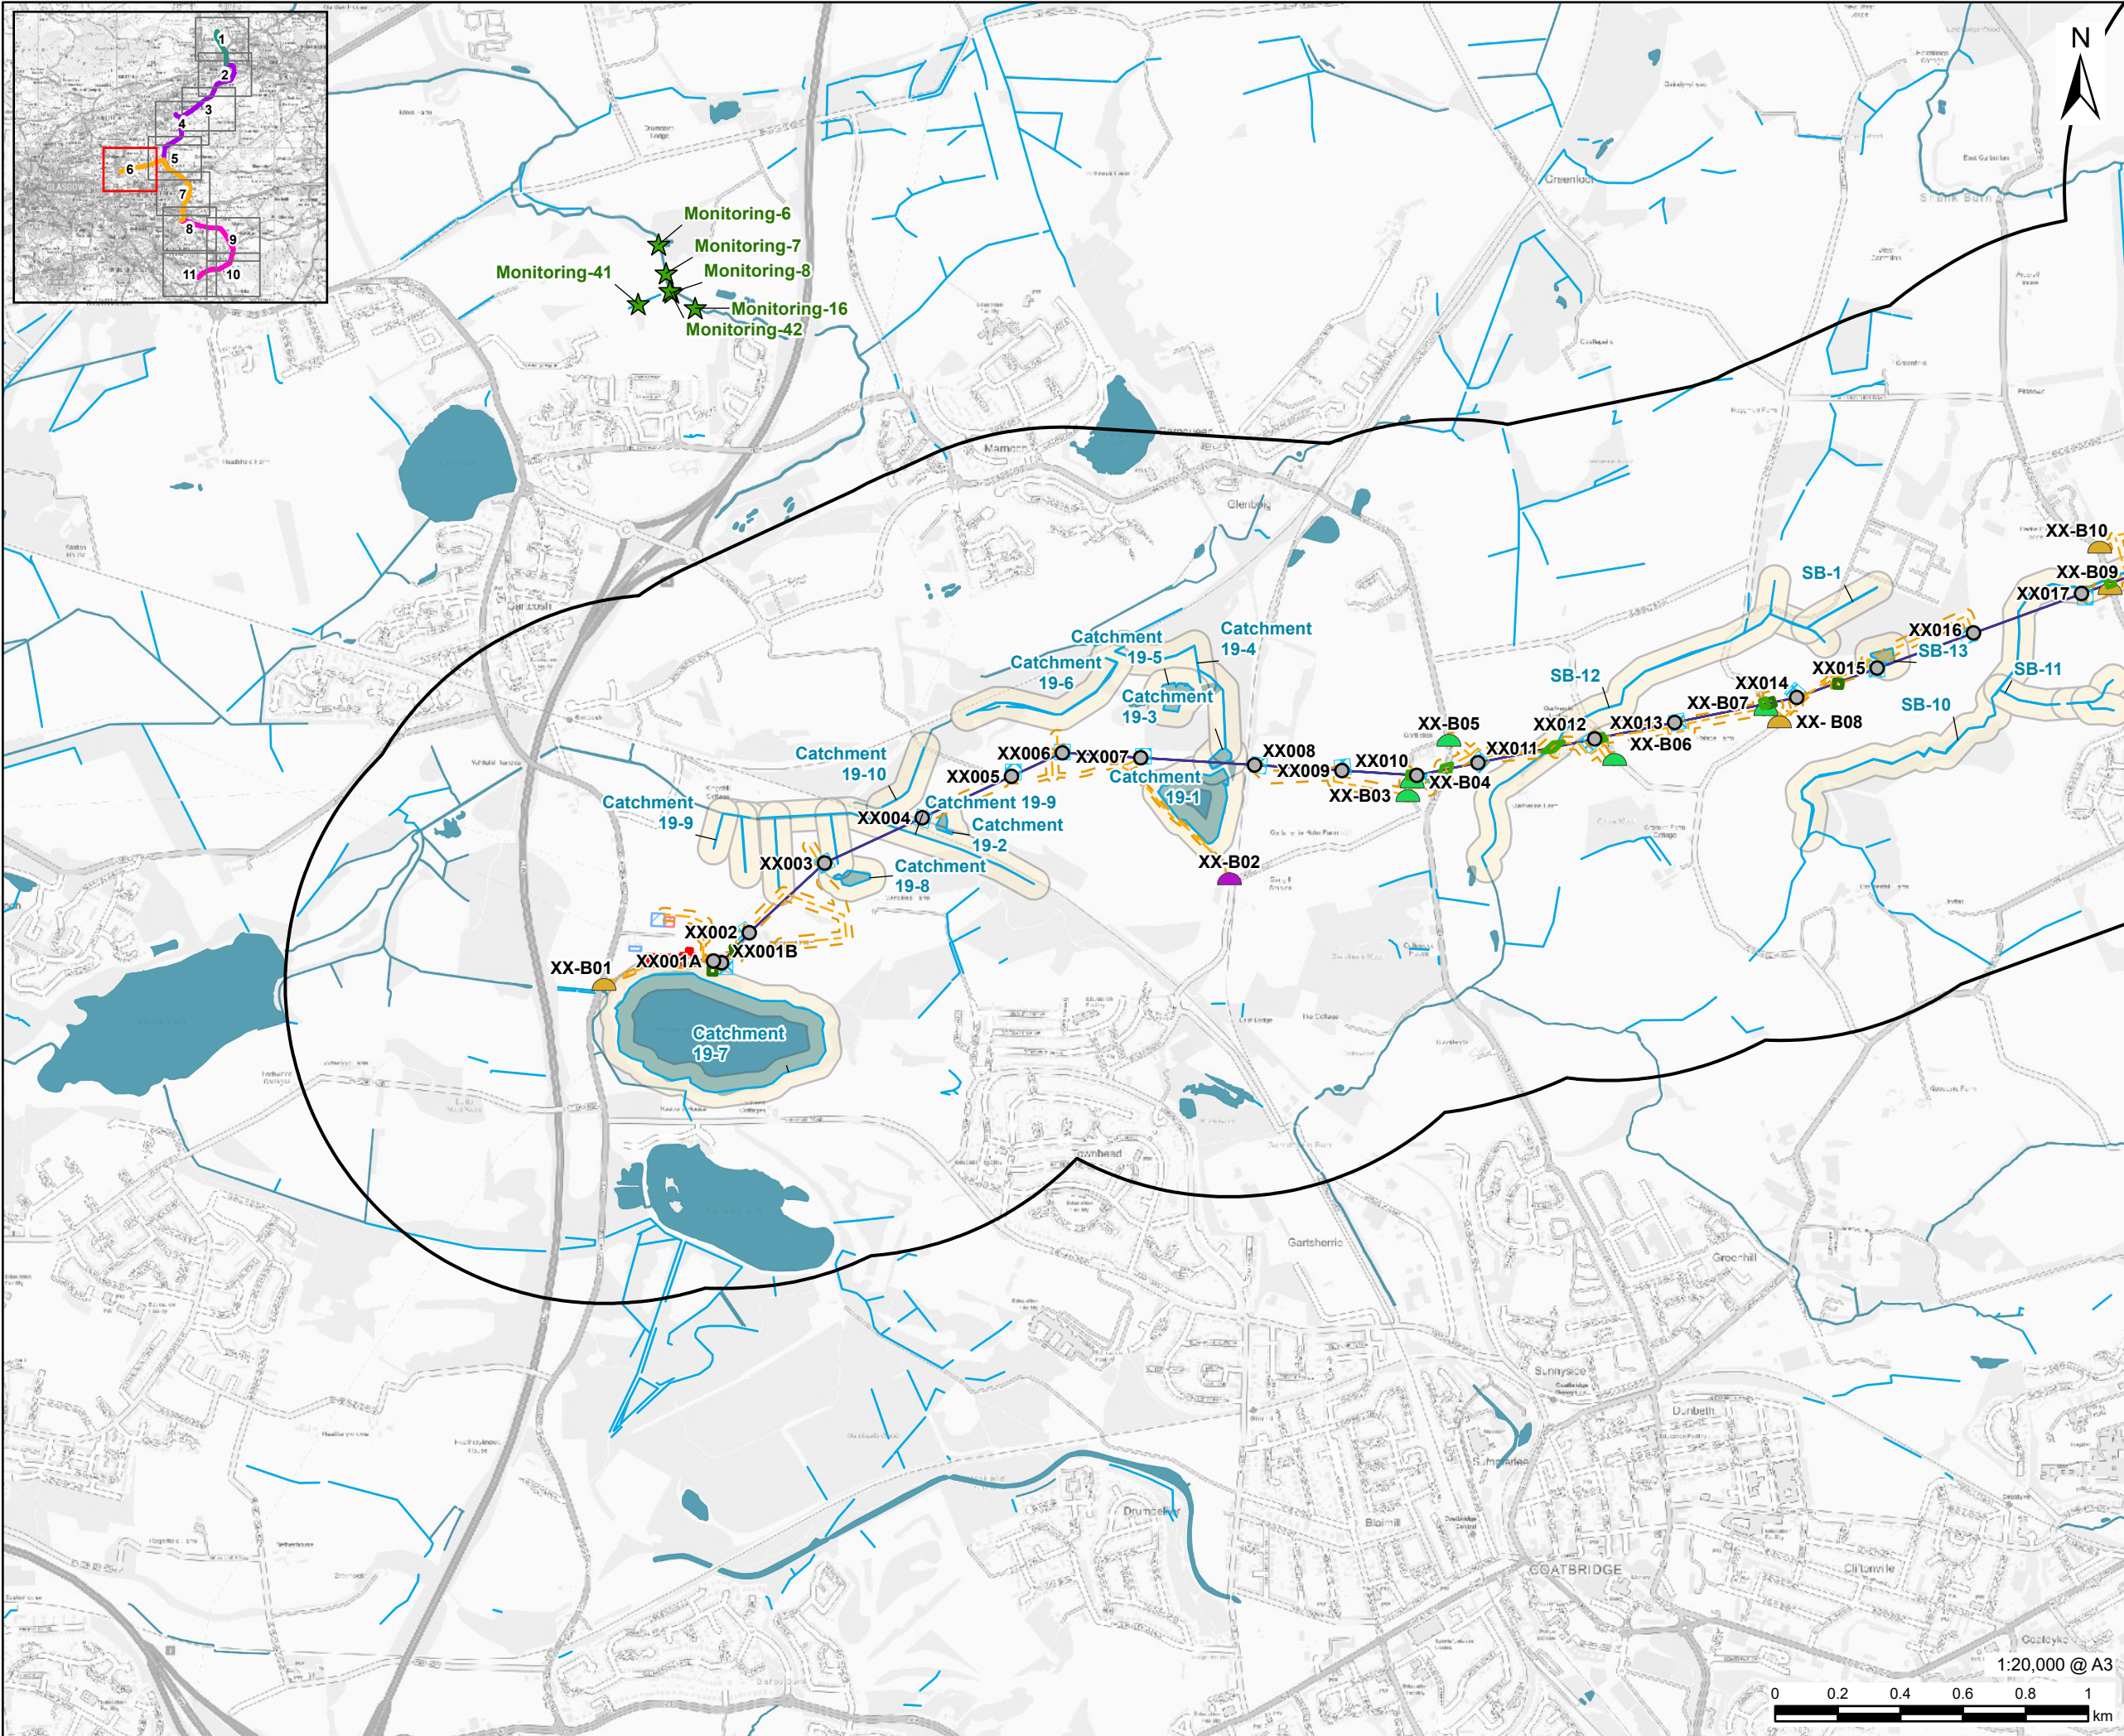

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - Easterhouse Substation Site Boundary
 - XX Tower Compound
 - XX Upgraded Overhead Line
 - Temporary Trackway
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Substation Site Compound
 - Substation Laydown Area
 - Scaffolding
 - Pulling Position
 - Existing Bellmouth
 - New Bellmouth
 - Upgrade Bellmouth
 - 1km Study Area
 - SEPA Monitoring Location
 - Surface Water Feature
 - Surface Water Area
 - Buffer Zone (50 m)

NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025


ISSUE PURPOSE
Environmental Impact Assessment Report


PROJECT NUMBER
60602788

FIGURE TITLE
Surface Water Receptors

FIGURE NUMBER
Figure 9.1 (Sheet 6 of 11)

1:20,000 @ A3



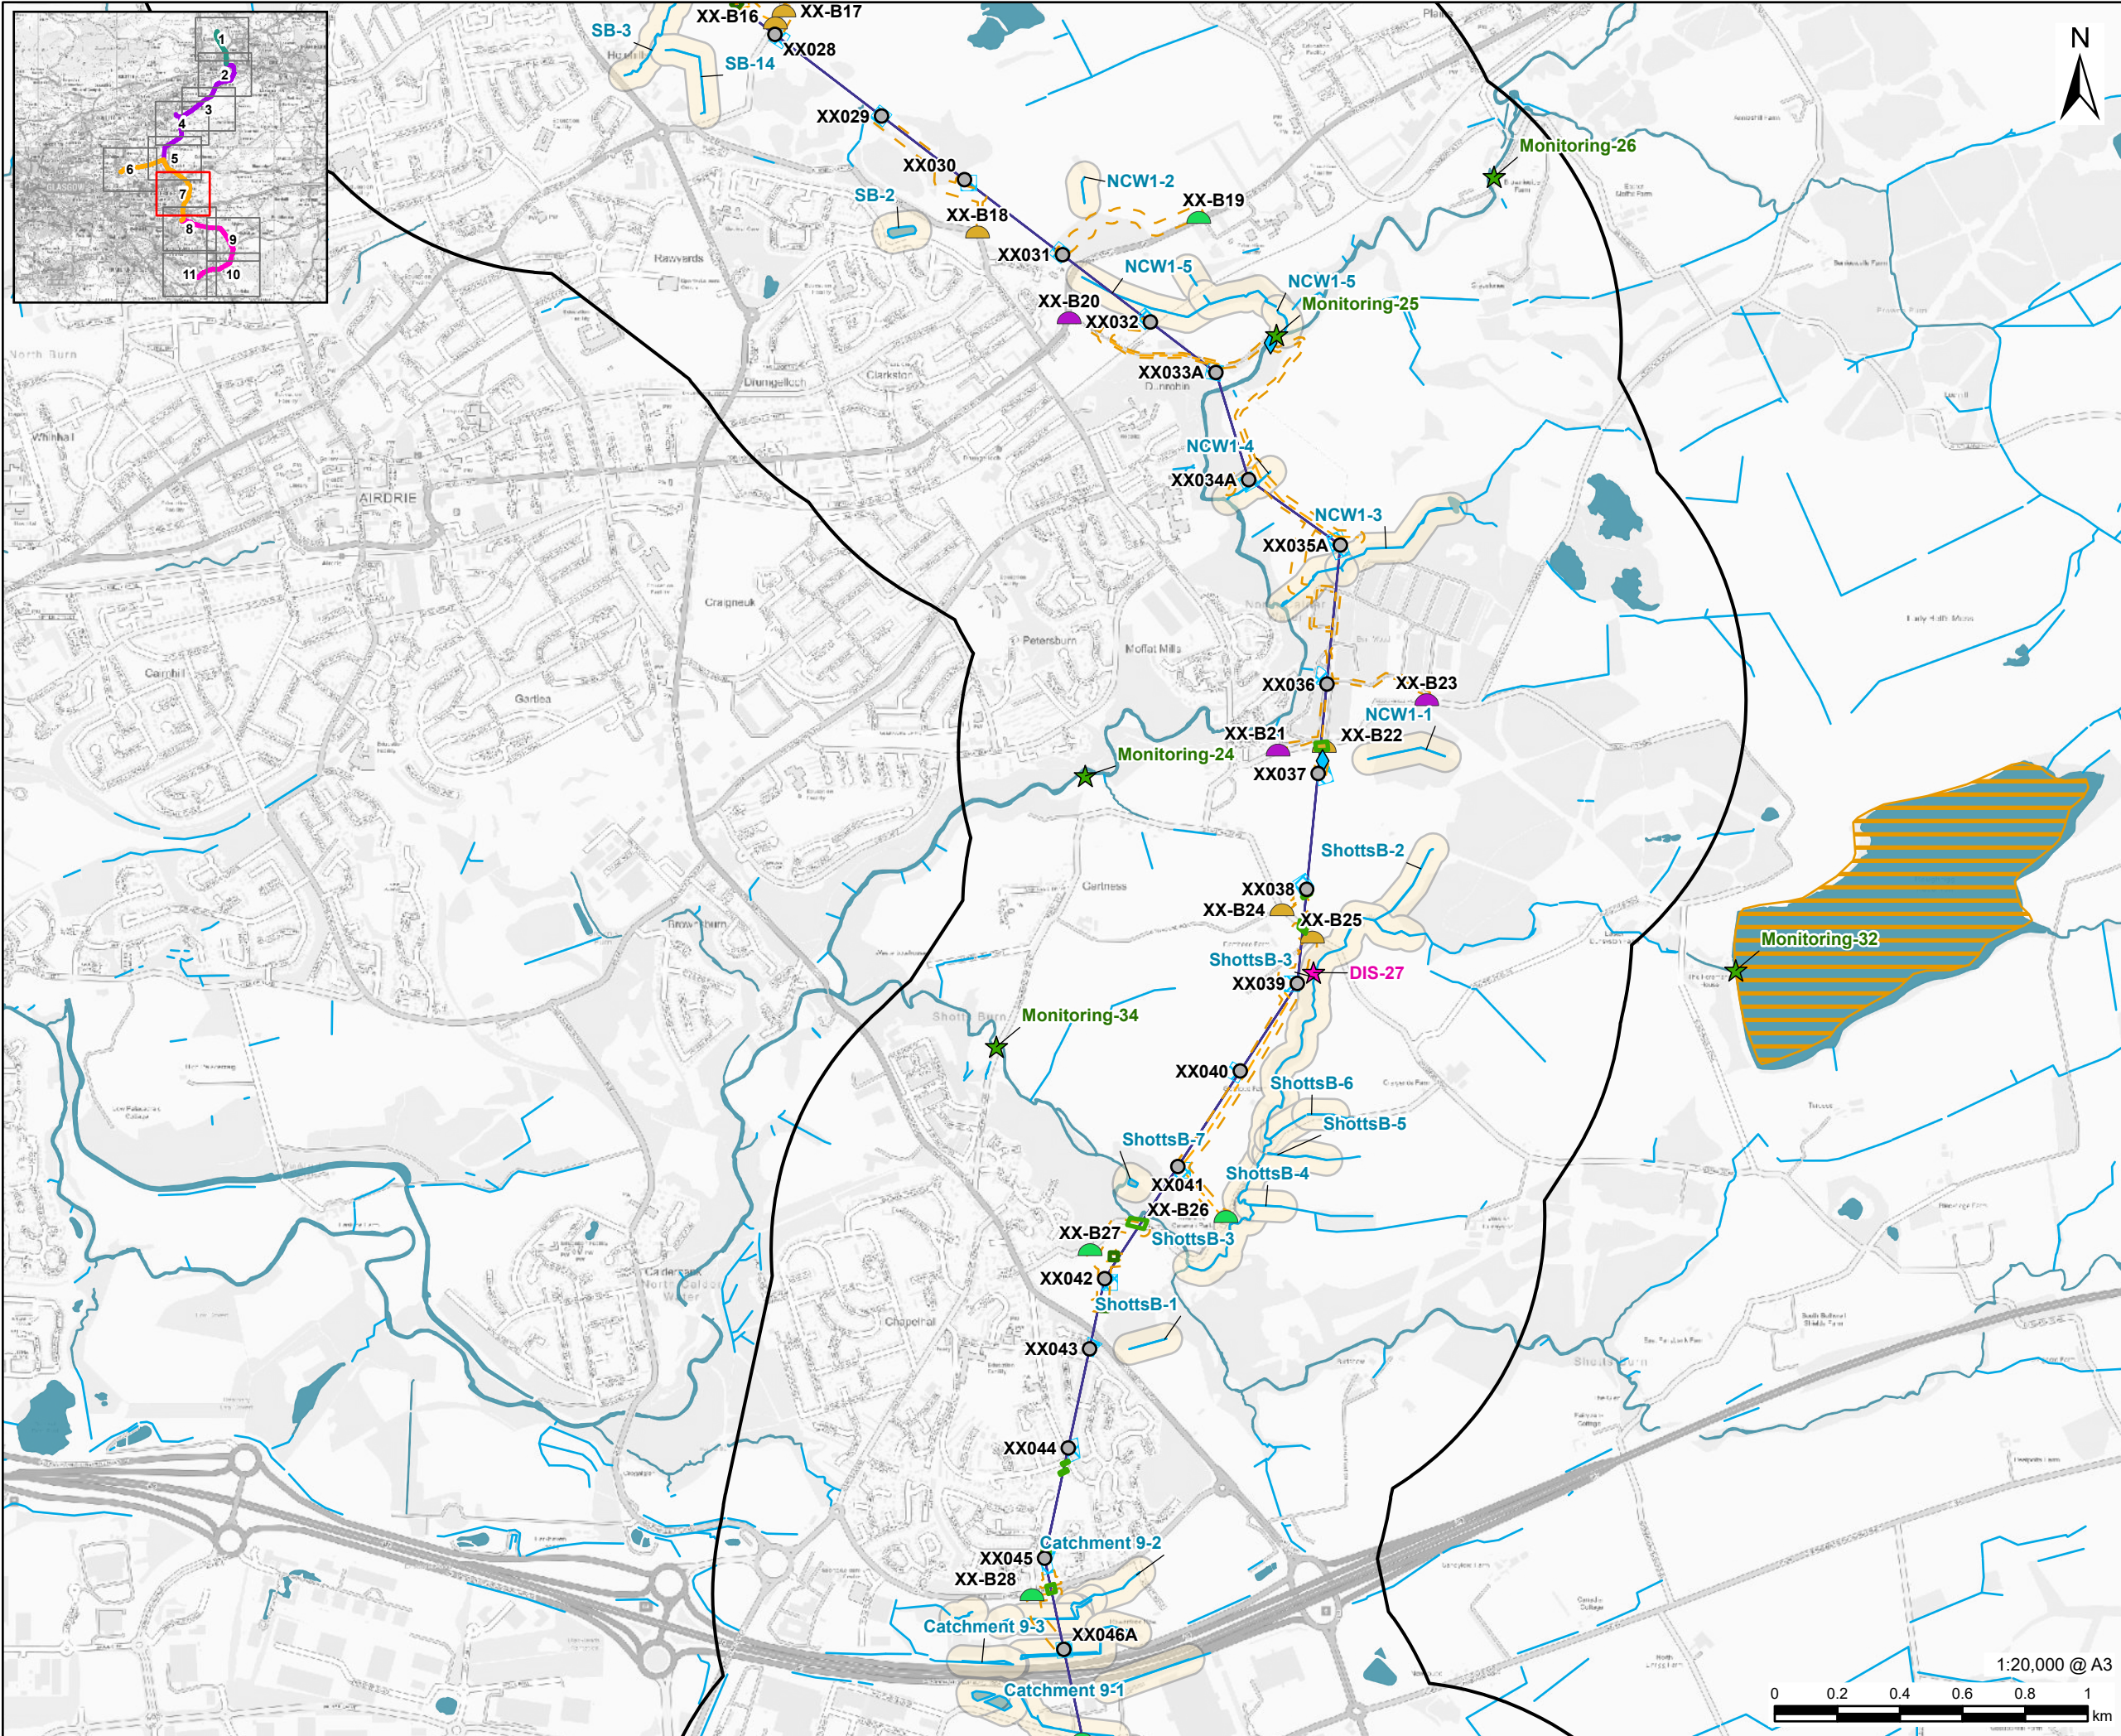

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XX Tower Compound
- XX Upgraded Overhead Line
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Water Crossing
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- CAR Authorisation (Discharges)
- SEPA Monitoring Location
- Surface Water Feature
- Surface Water Area
- WFD Waterbody Status - Poor
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788


FIGURE TITLE

Surface Water Receptors

FIGURE NUMBER

Figure 9.1 (Sheet 7 of 11)



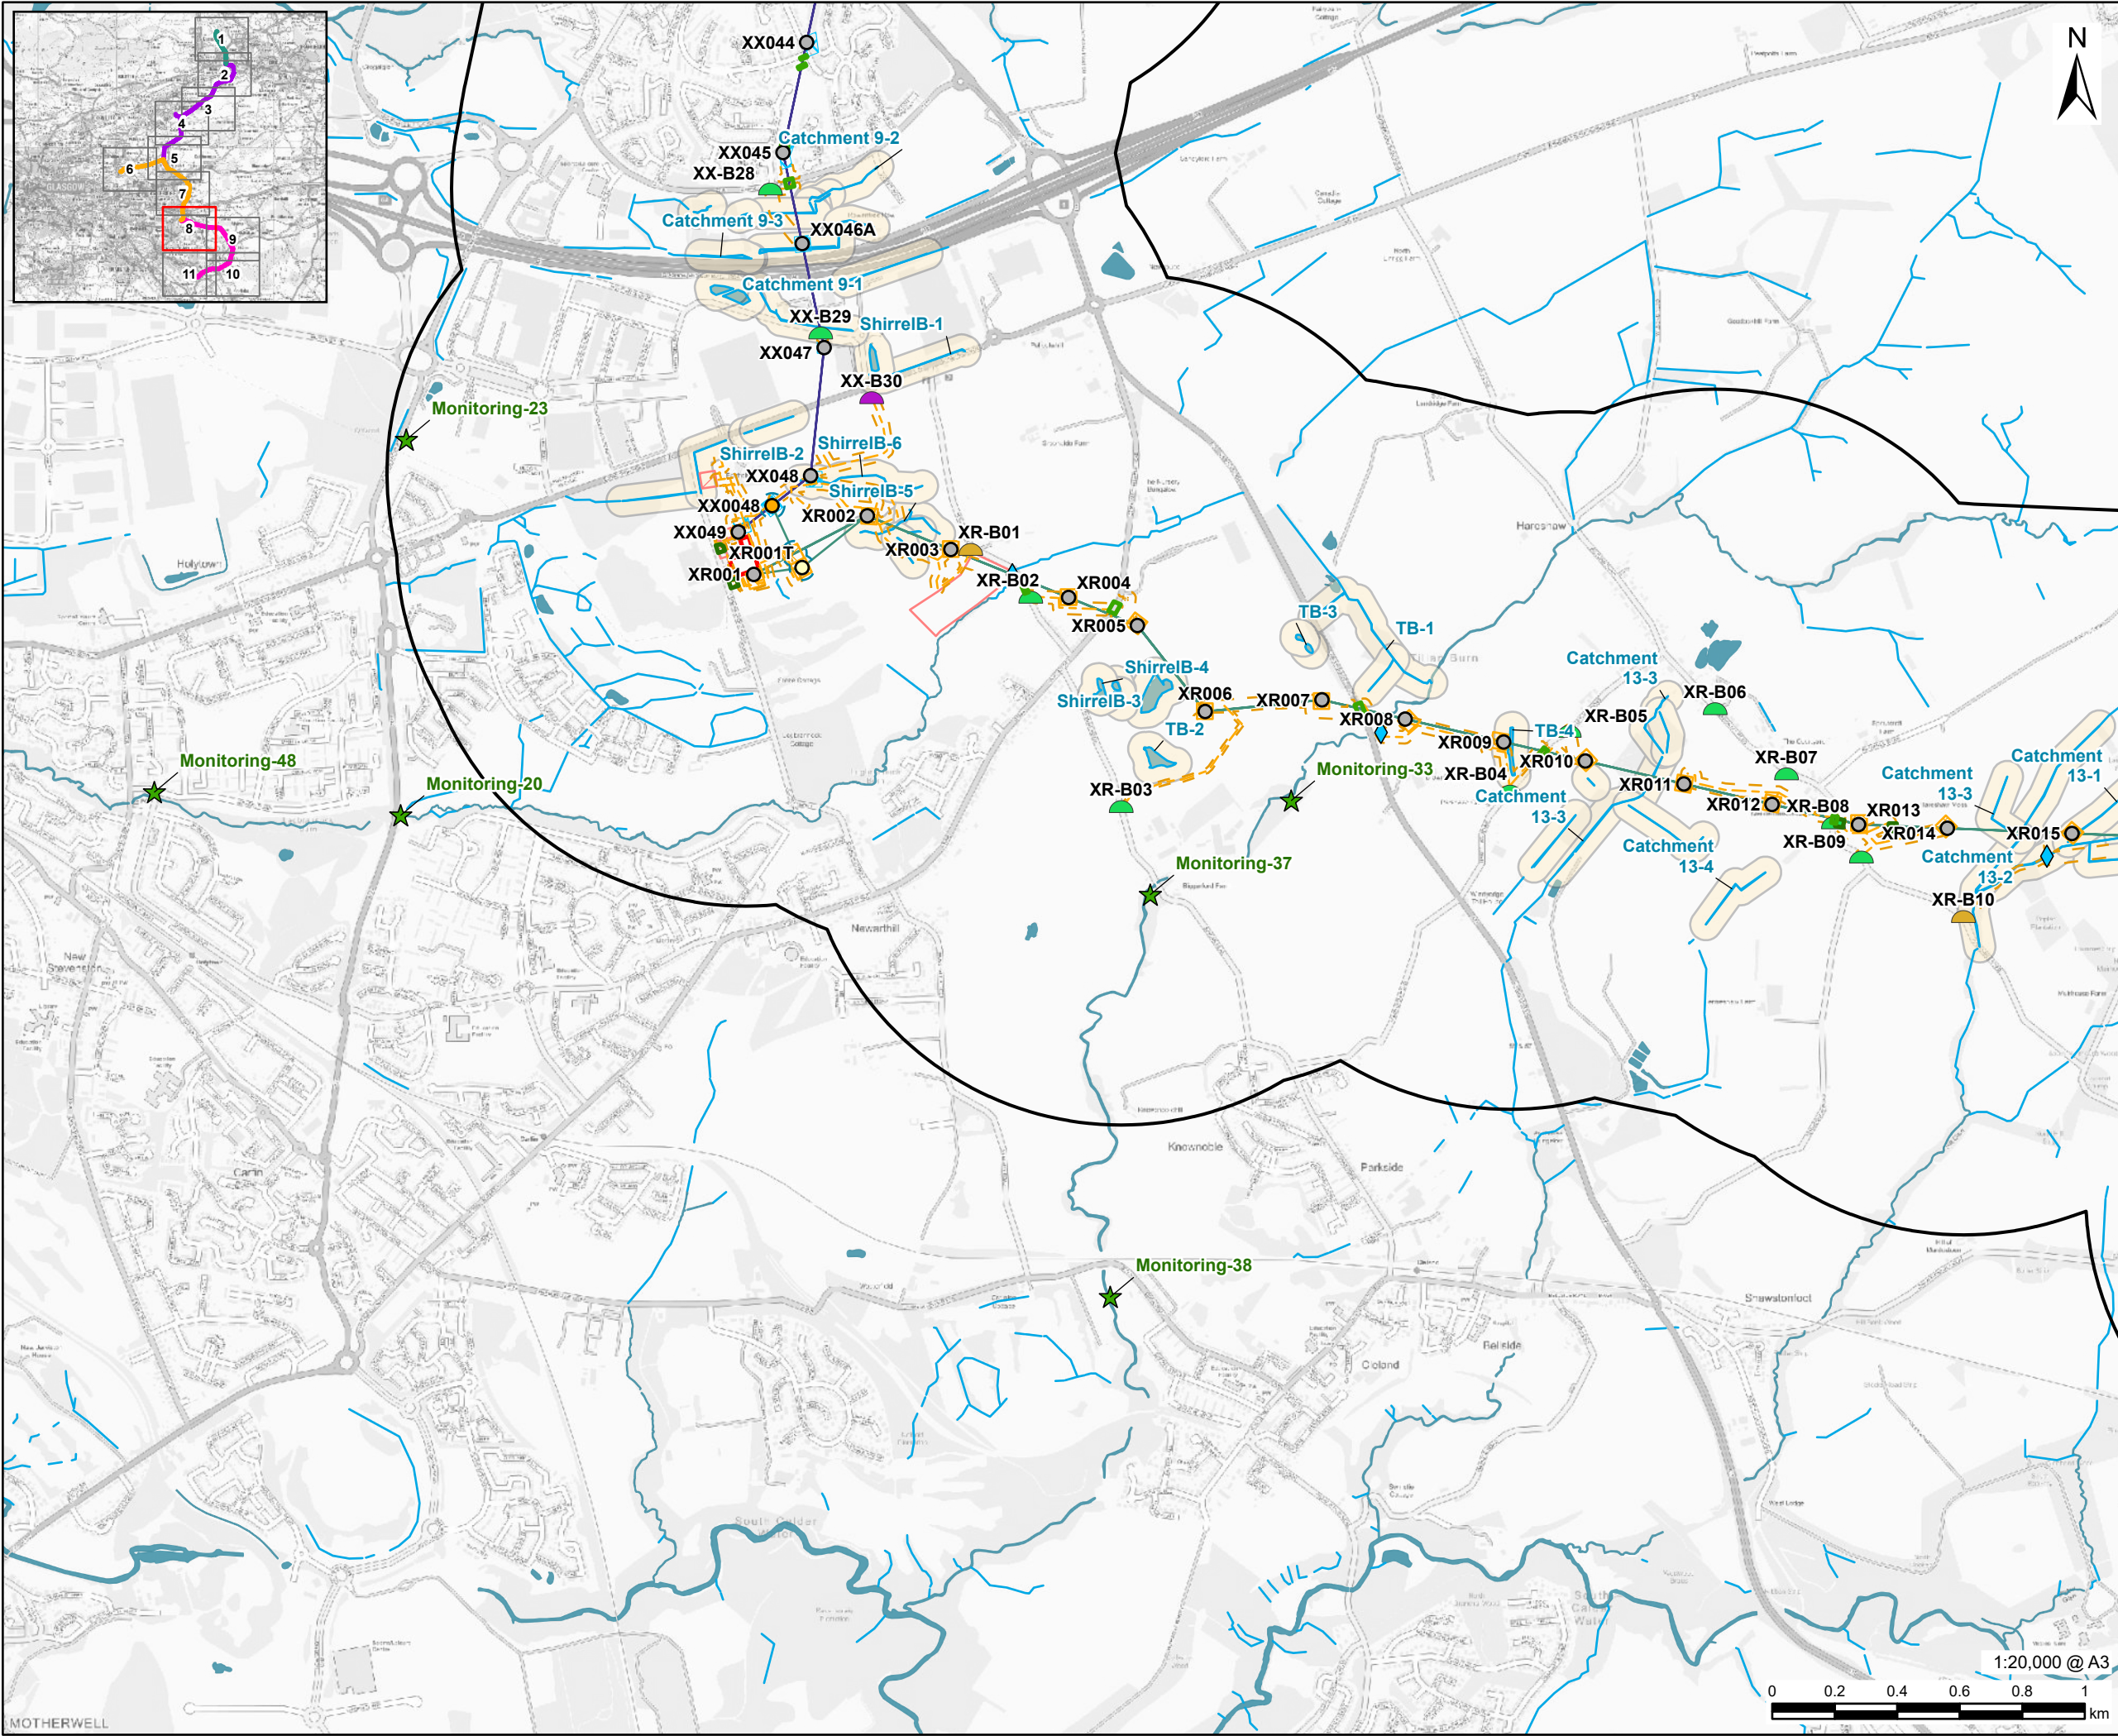

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Newarthill Substation Site Boundary
- XR Tower Compound
- XX Tower Compound
- XR Uprated Overhead Line
- XX Uprated Overhead Line
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Overhead Line Site Compound
- Scaffolding
- Pulling Position
- Water Crossing
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- SEPA Monitoring Location
- Surface Water Feature
- Surface Water Area
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Surface Water Receptors

FIGURE NUMBER

Figure 9.1 (Sheet 8 of 11)

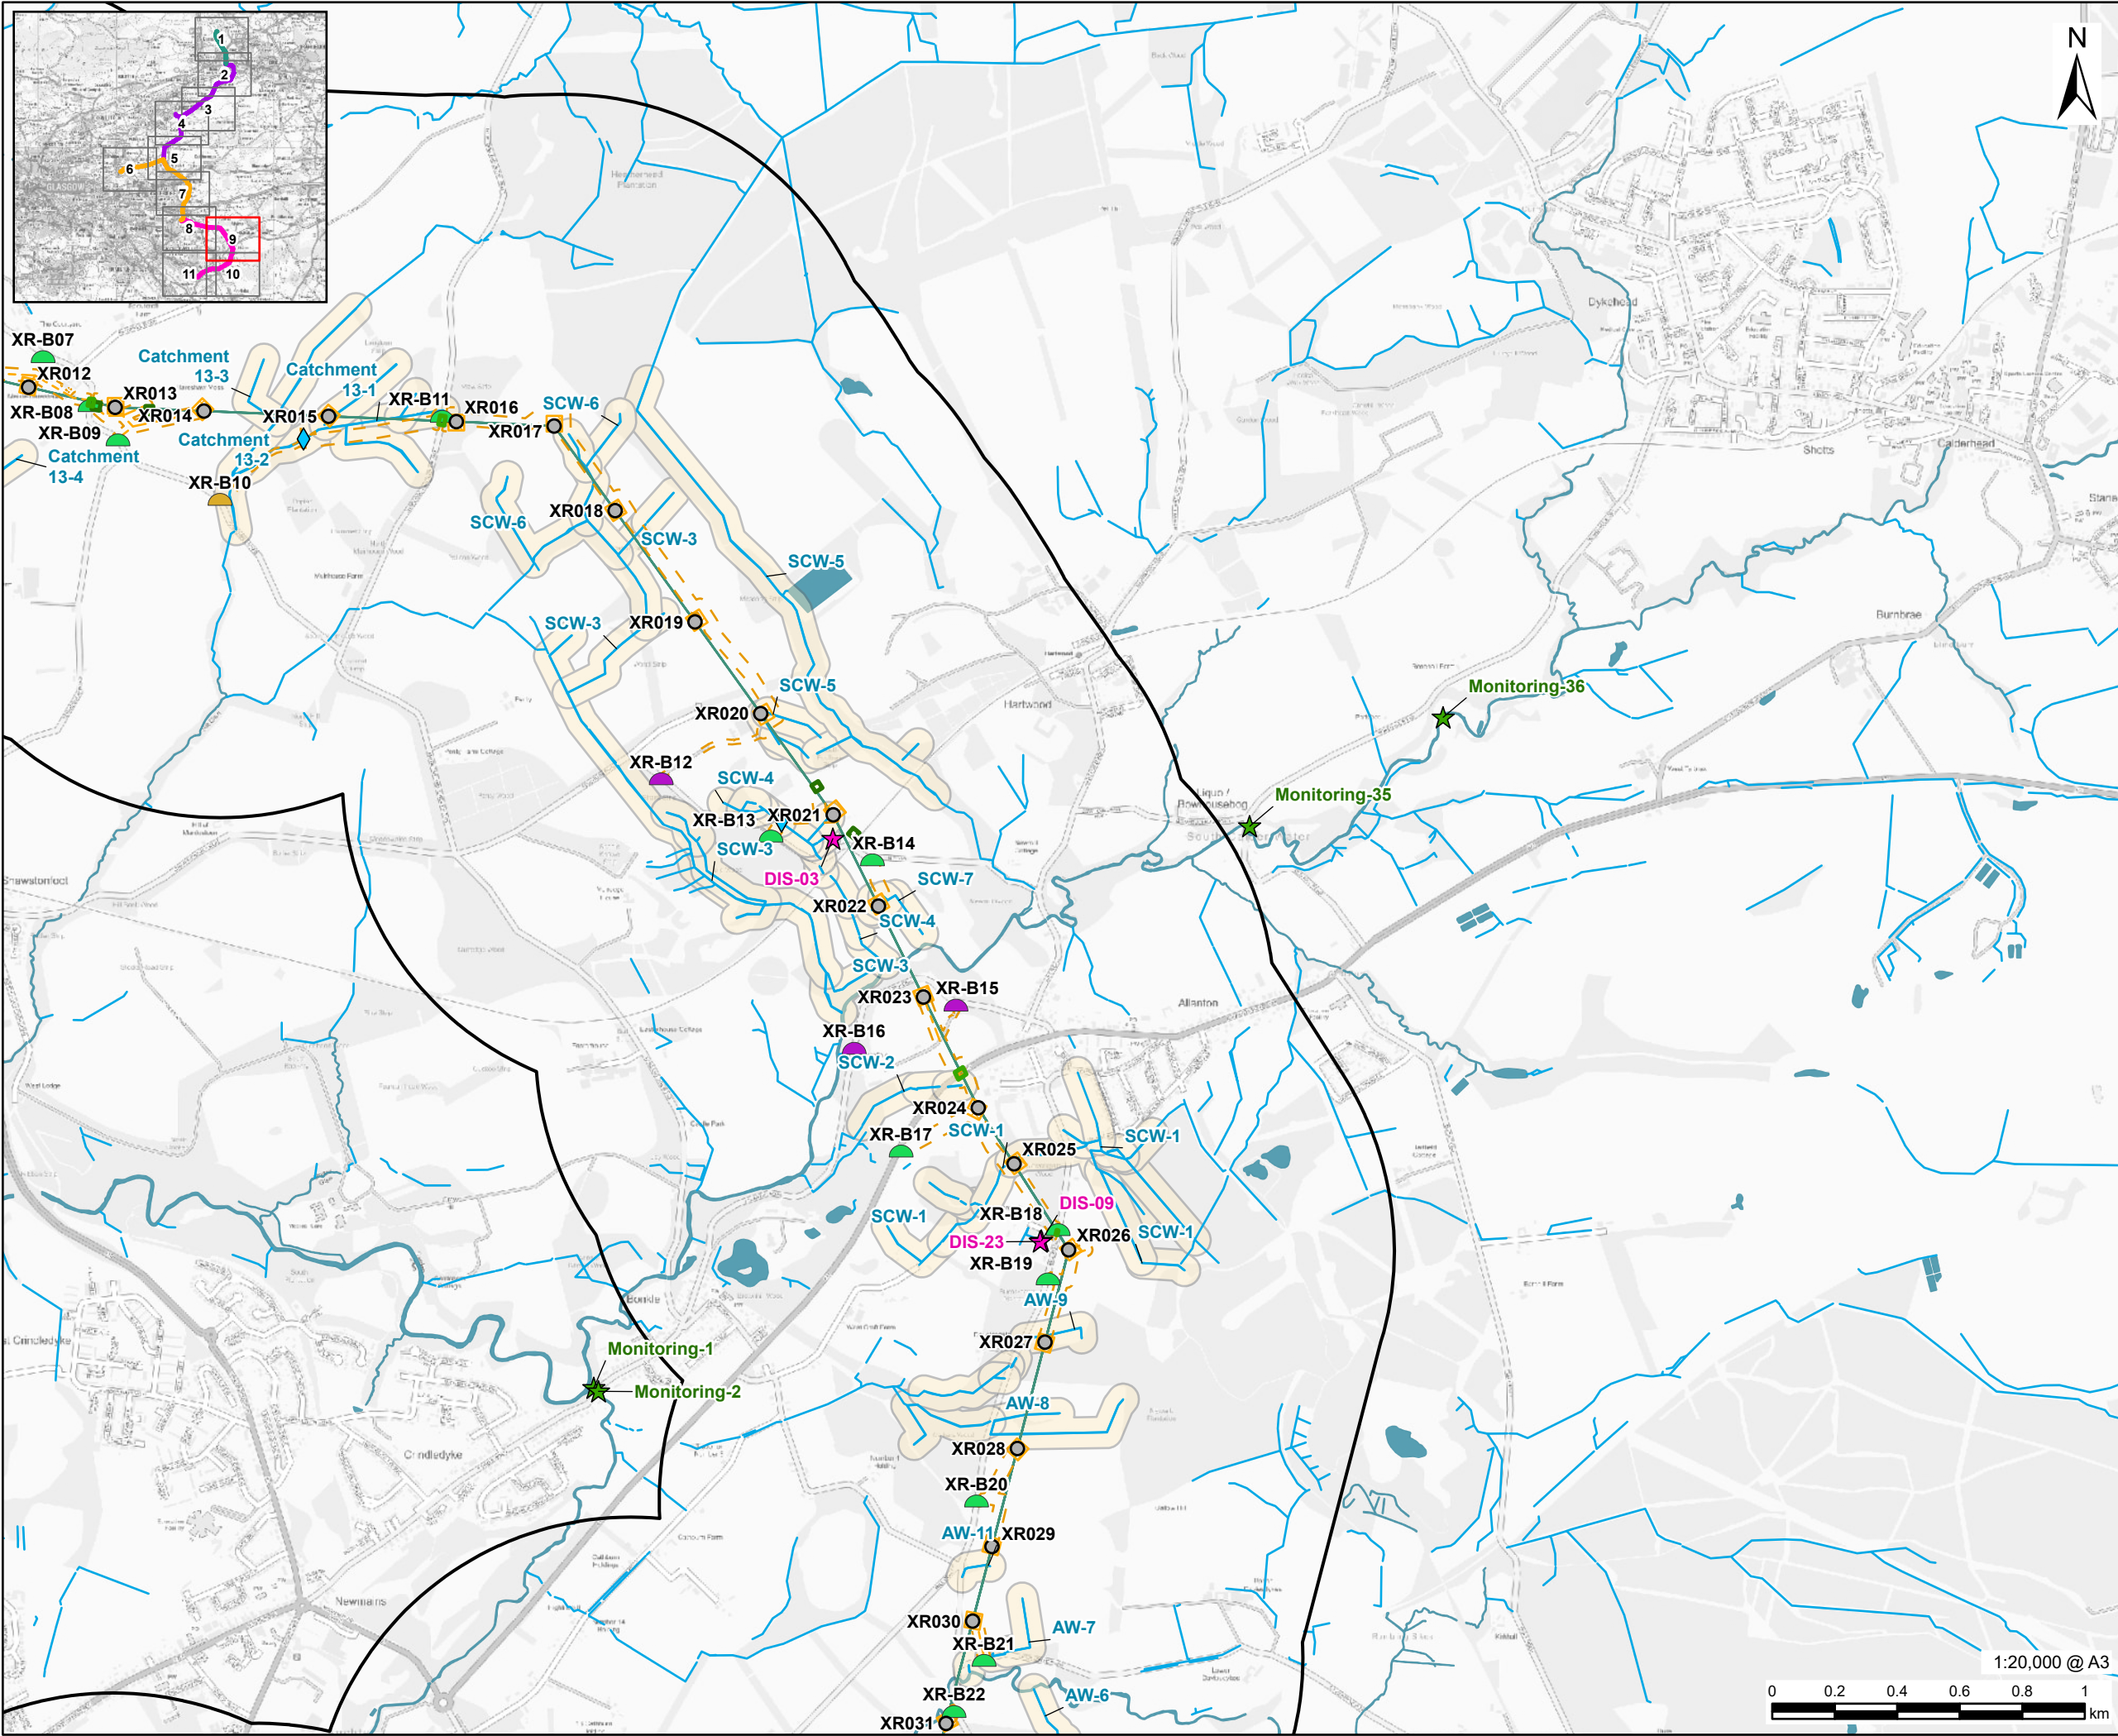

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Tower Compound
- XR Upgraded Overhead Line
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Water Crossing
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- CAR Authorisation (Discharges)
- SEPA Monitoring Location
- Surface Water Feature
- Surface Water Area
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE


Surface Water Receptors

FIGURE NUMBER

Figure 9.1 (Sheet 9 of 11)

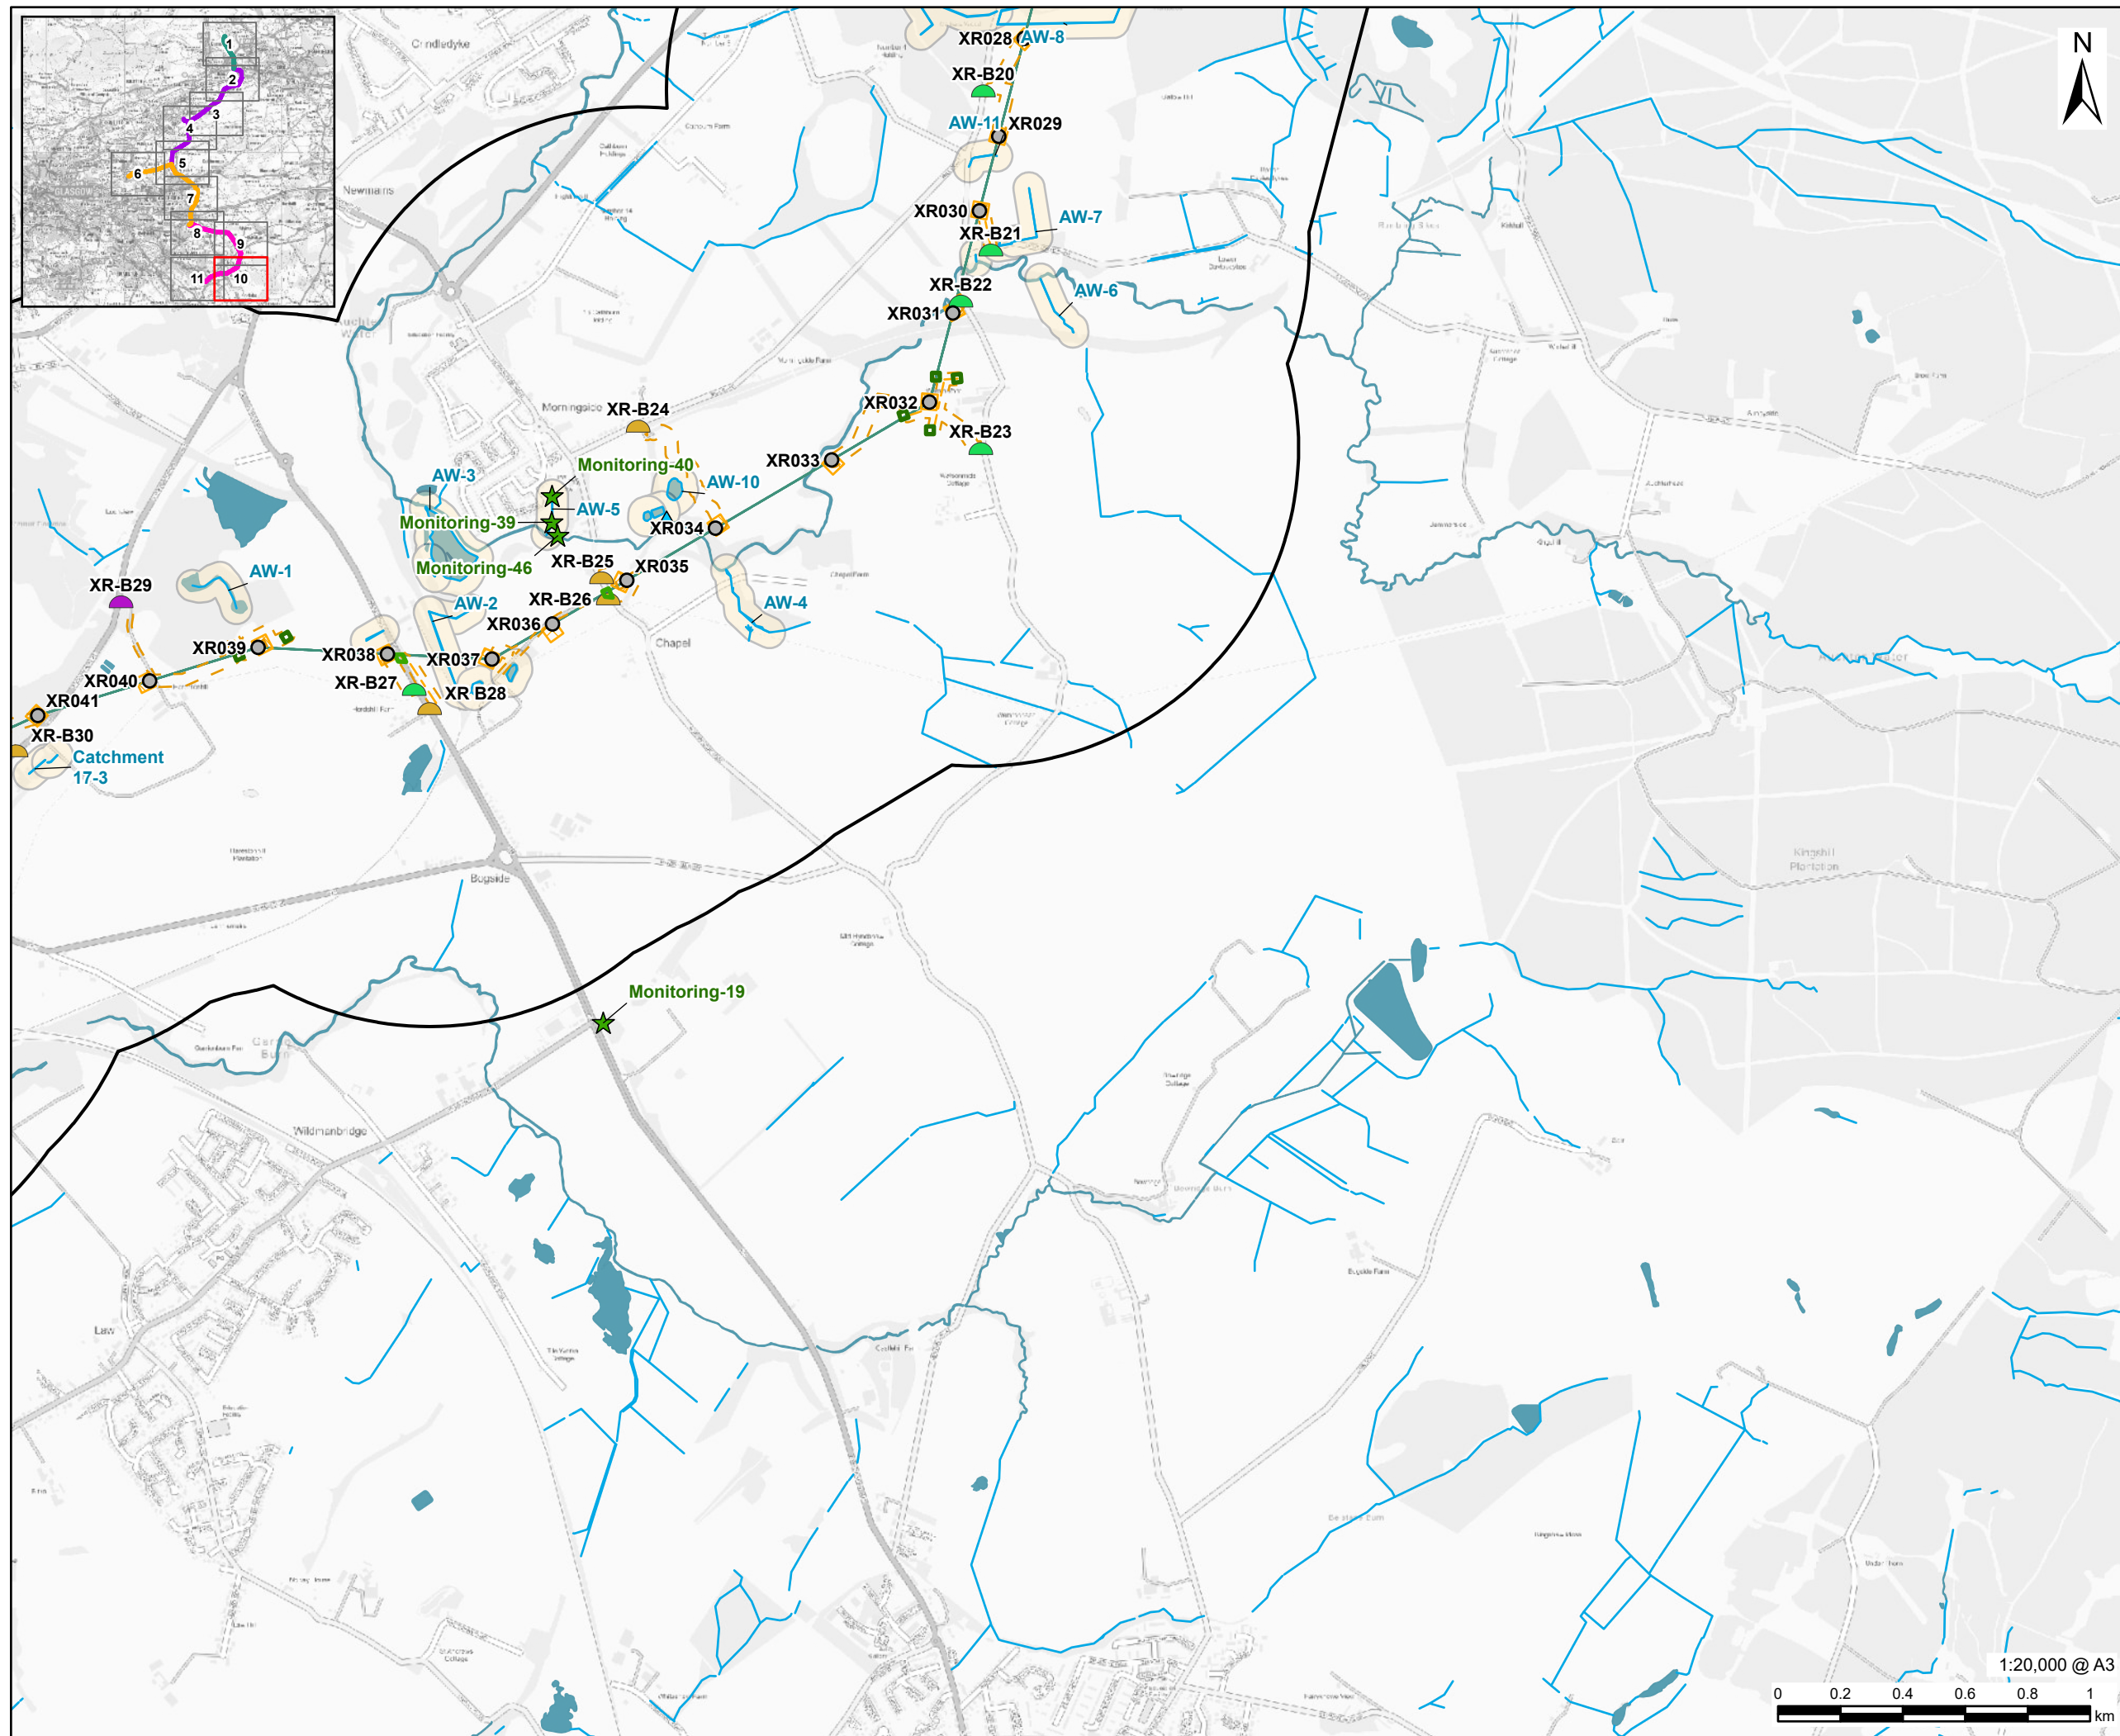

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing, without AECOM's express written consent. Do not scale this drawing. All measurements must be obtained from the stilled dimensions.

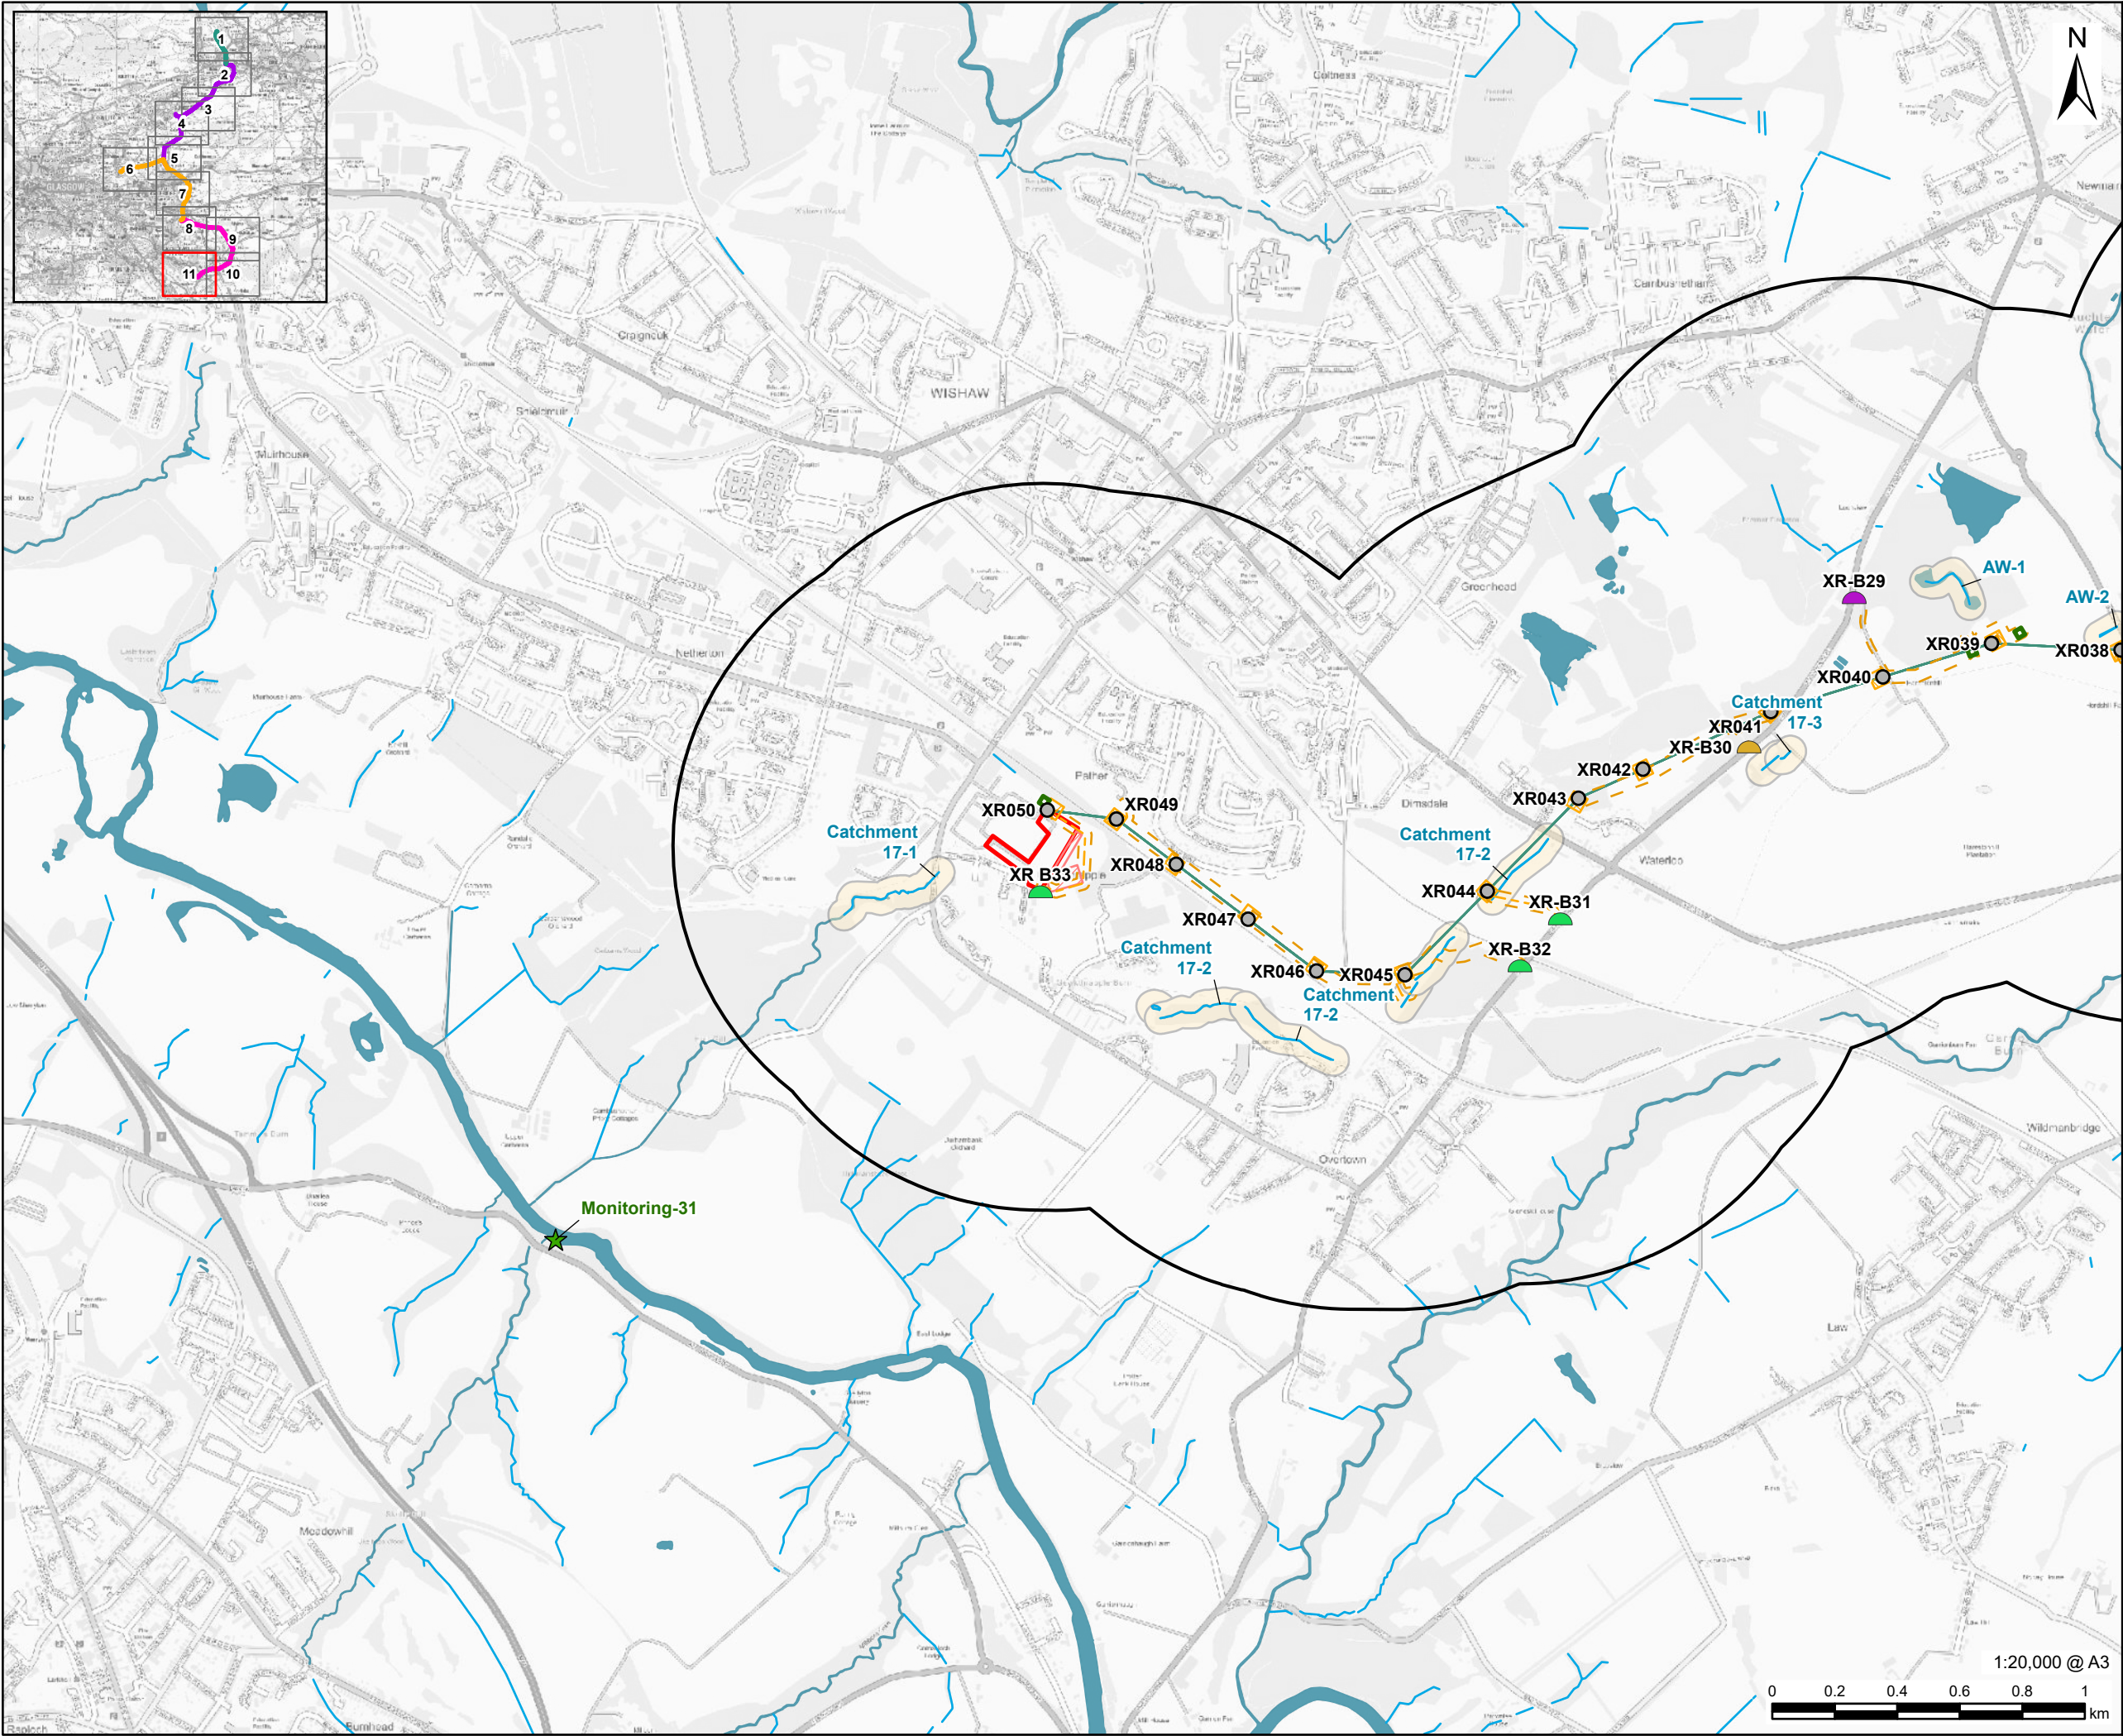

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- Wishaw Substation Site Boundary
- XR Tower Compound
- XR Upgraded Overhead Line
- Temporary Trackway
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- SEPA Monitoring Location
- Surface Water Feature
- Surface Water Area
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Surface Water Receptors

FIGURE NUMBER

Figure 9.1 (Sheet 11 of 11)