


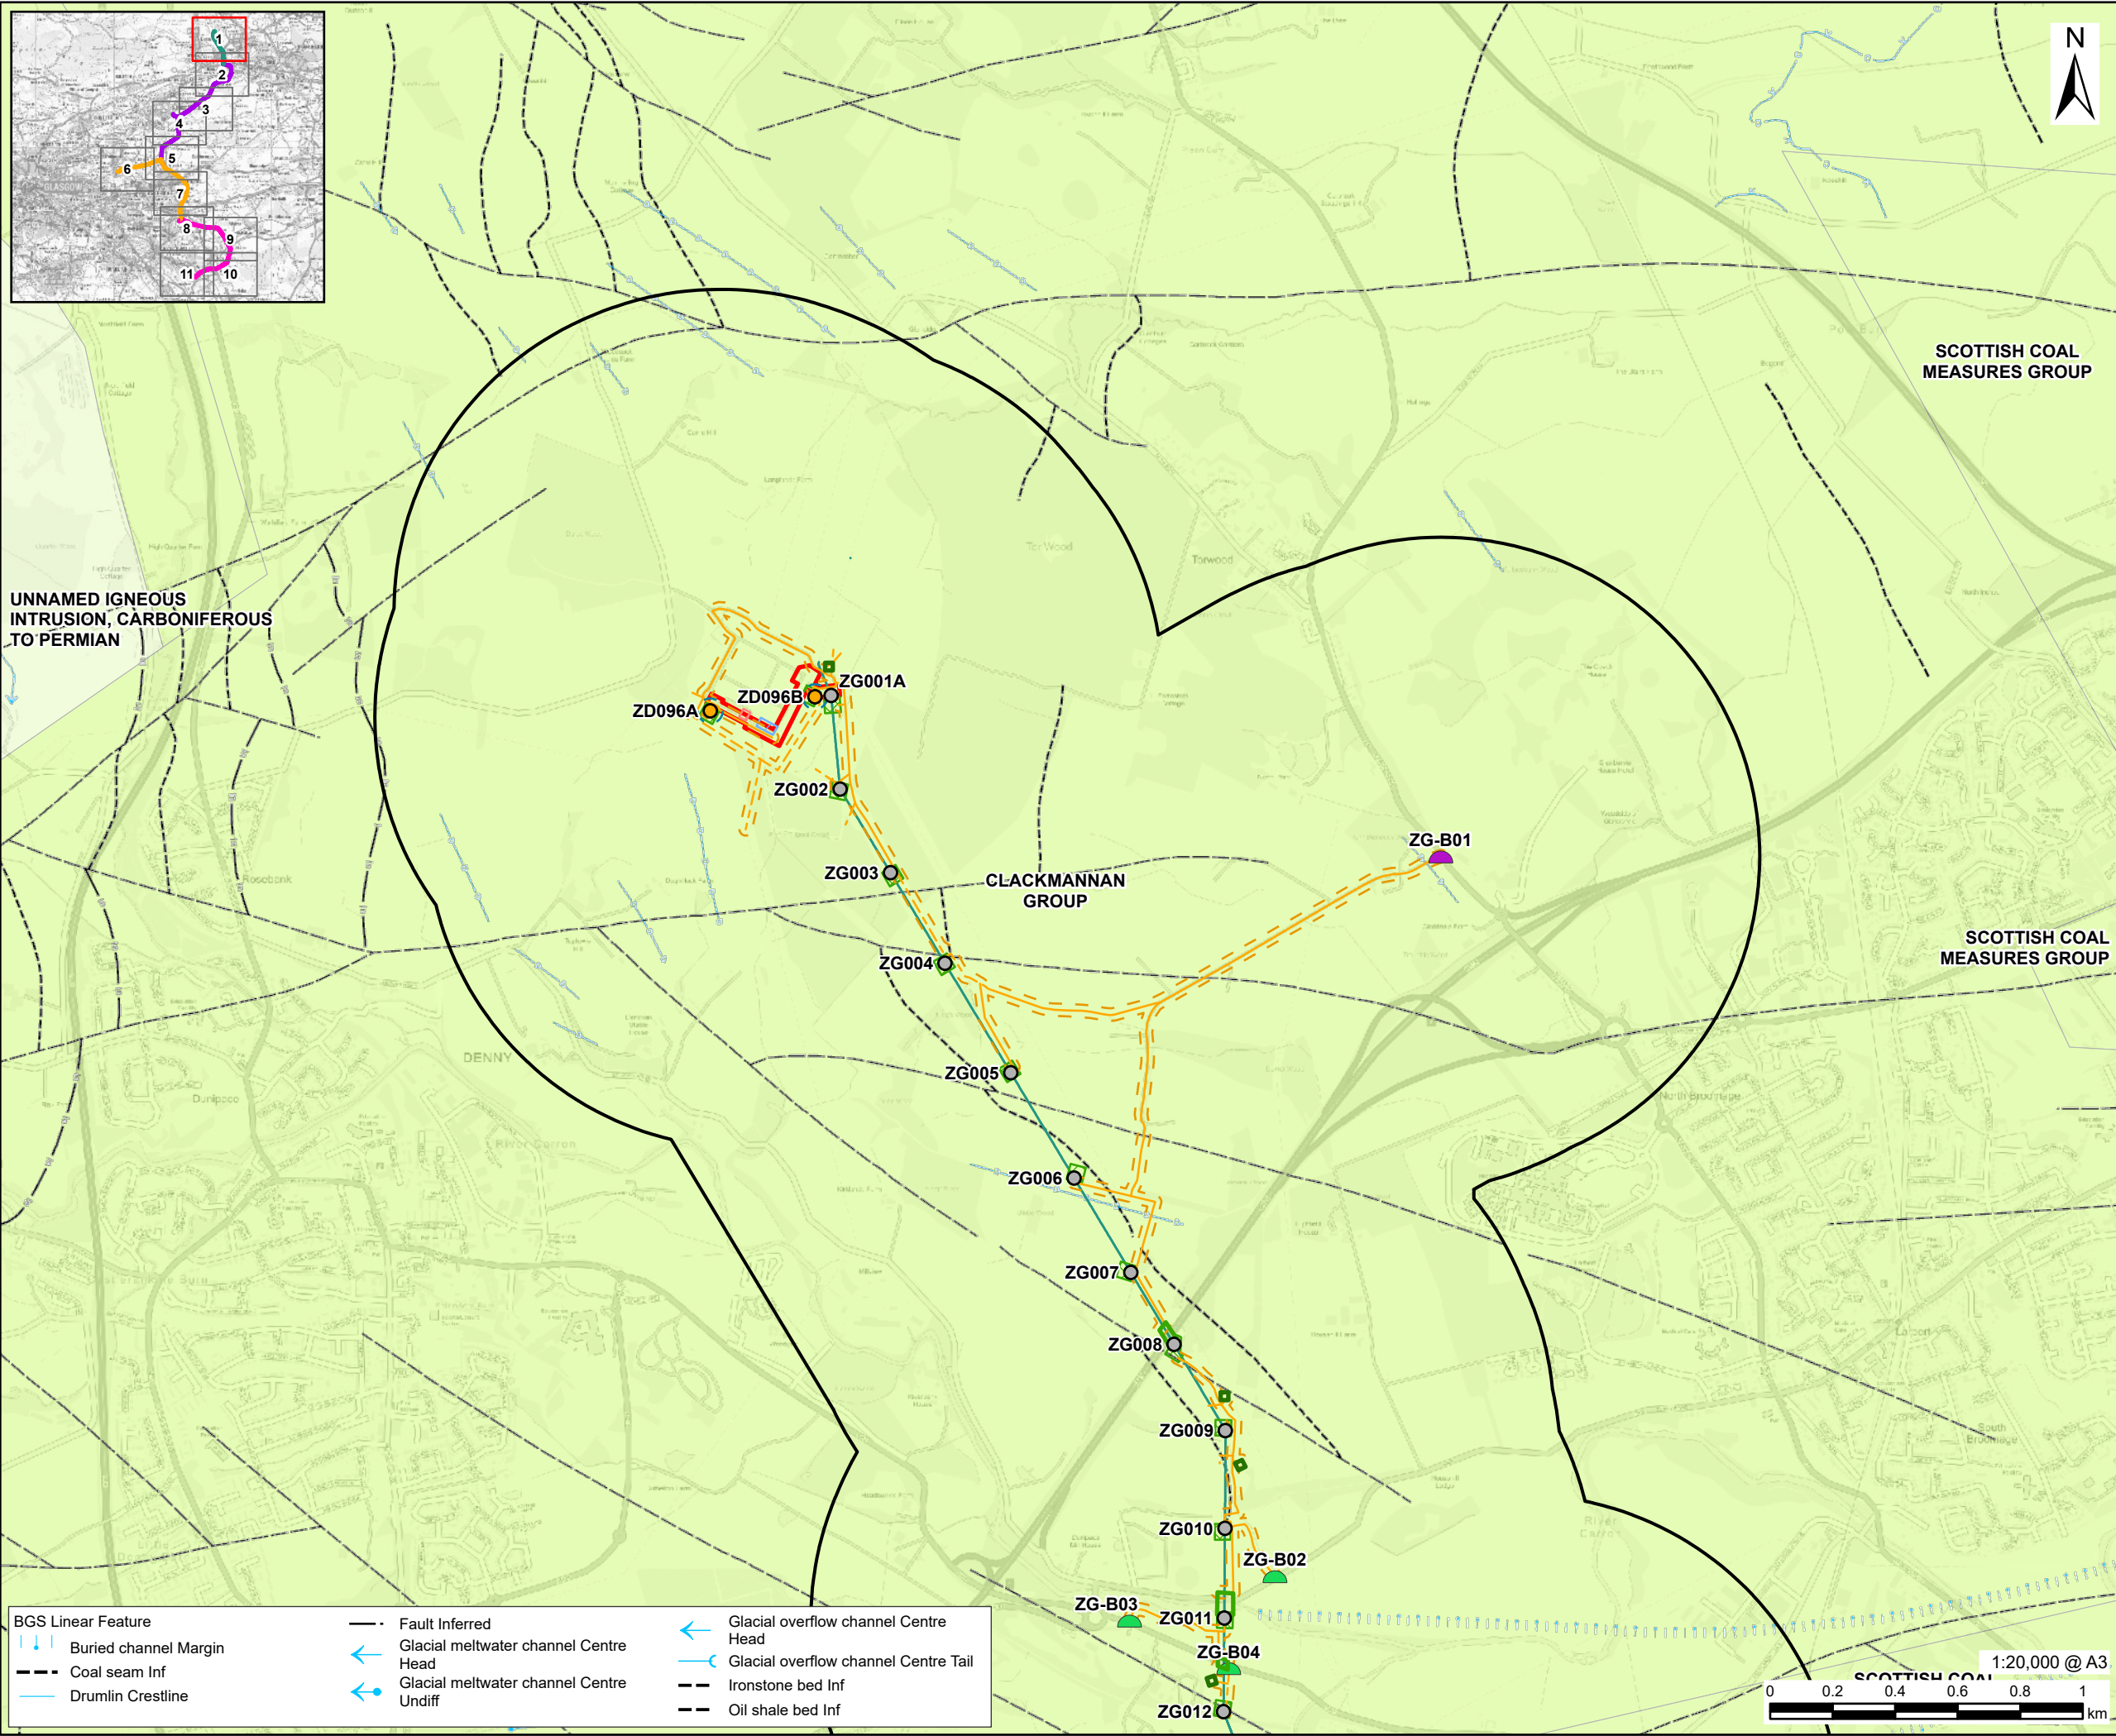

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Denny North Substation Site Boundary
- ZG Tower Compound
- ZG Uprated Overhead Line
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Substation Laydown Area
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer
- Low productivity aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER



60602788

FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 1 of 11)

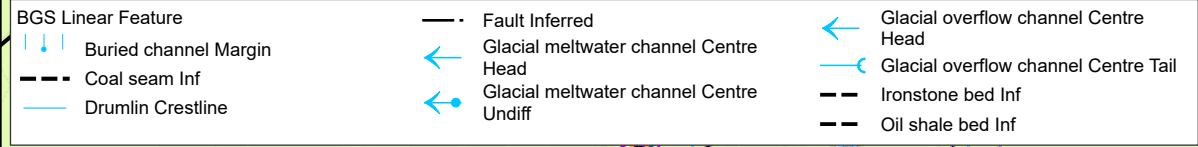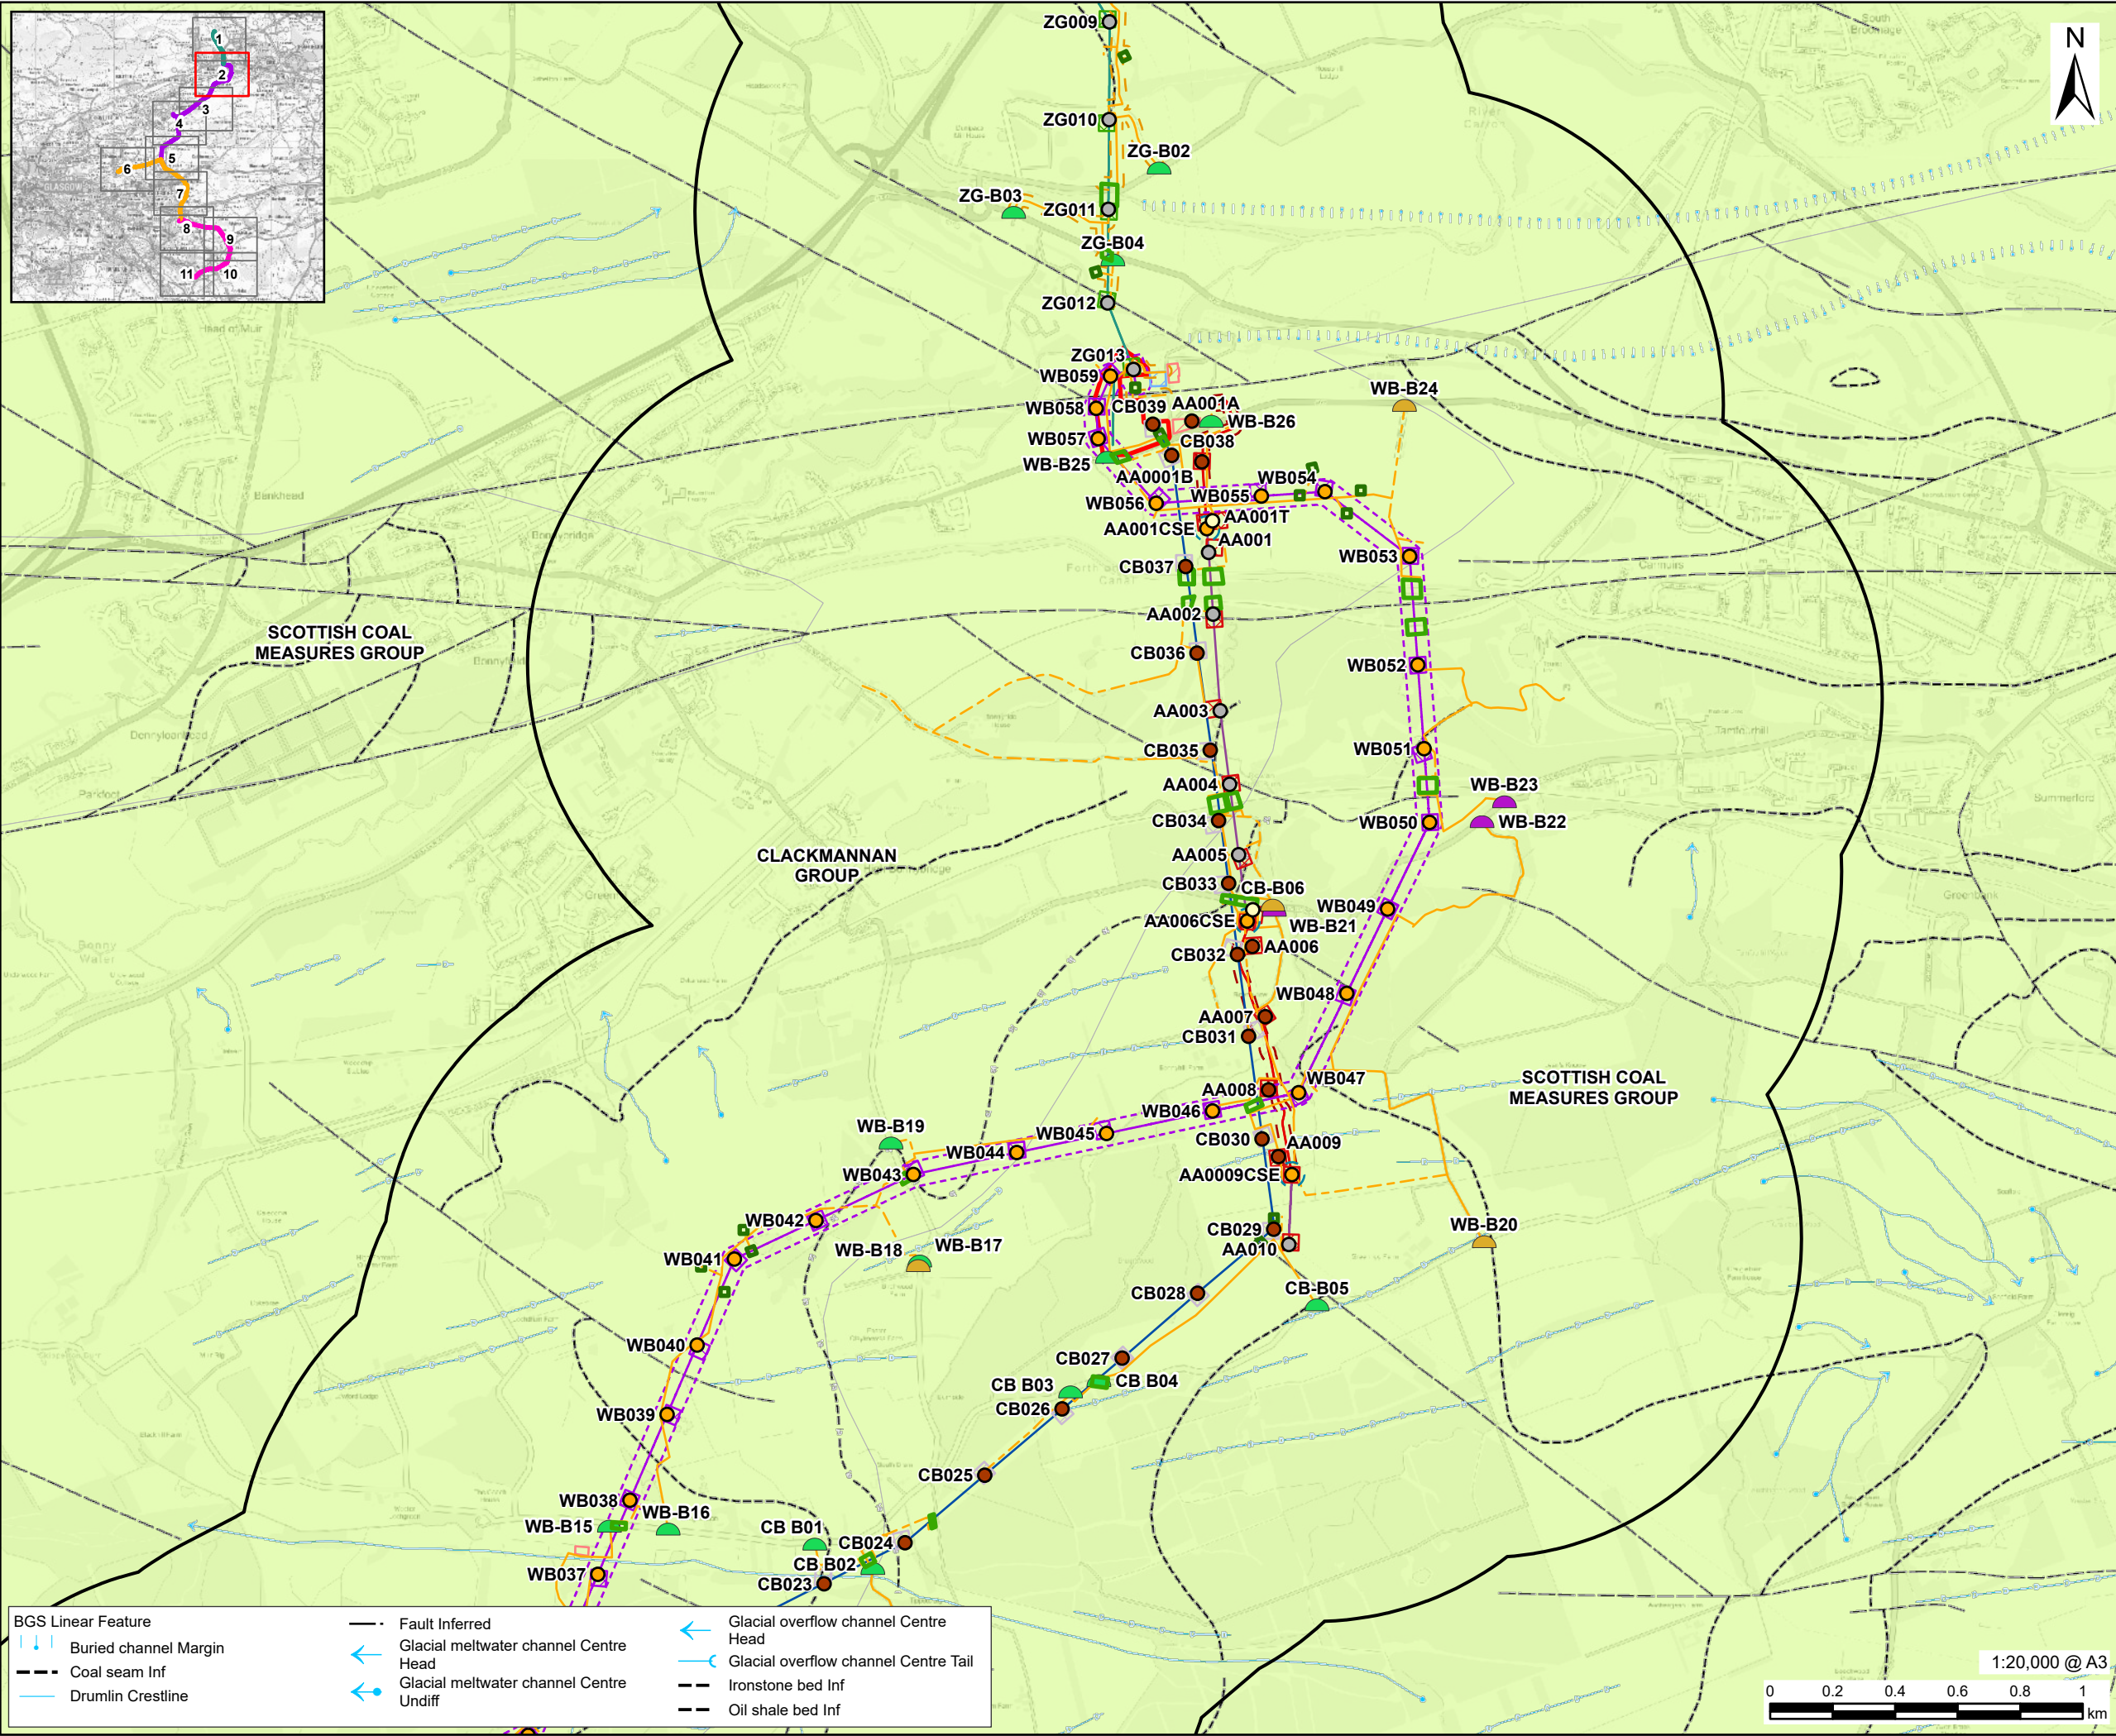

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Tower to be Removed
- Bonnybridge Substation Site Boundary
- New Build Tower Compound
- ZG Tower Compound
- CB Tower Compound
- AA Tower Compound
- New Build Overhead Line
- ZG Upgraded Overhead Line
- CB Route Removal
- AA Alignment
- AA Route Undergrounding
- AA Route Undergrounding Limit of Deviation
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Substation Laydown Area
- Overhead Line Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788


FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 2 of 11)



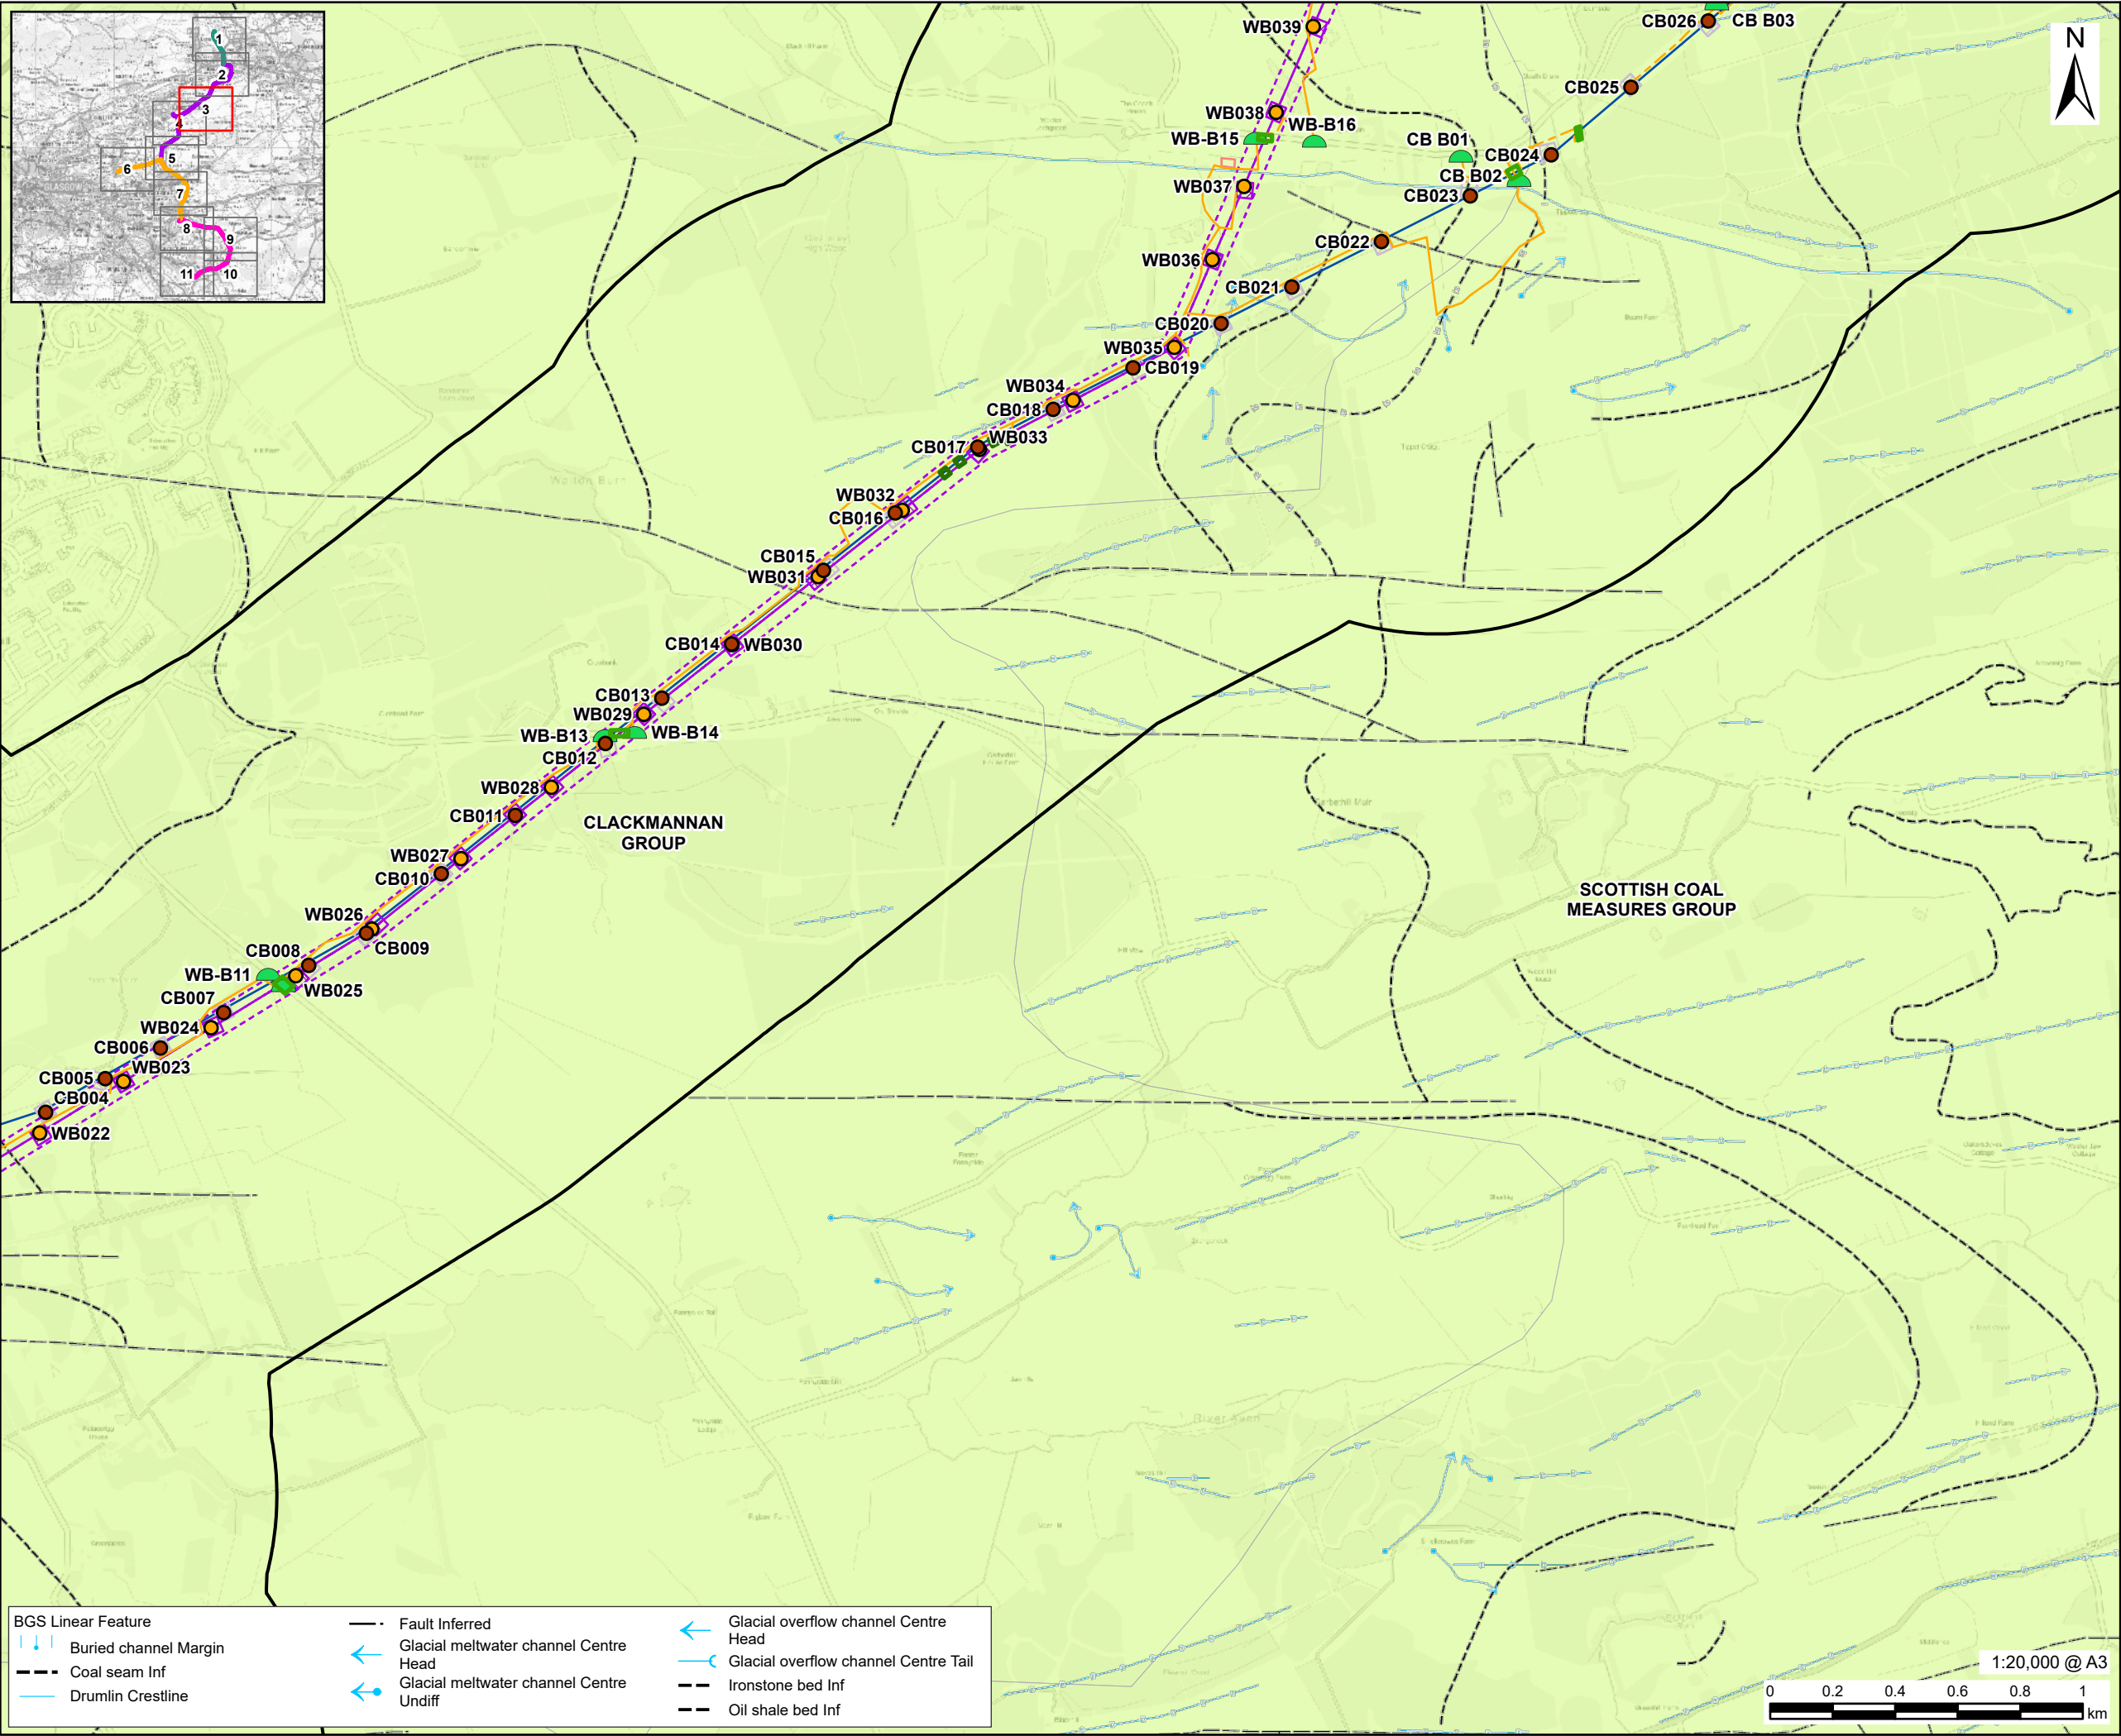

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- New Tower
 - Tower to be Removed
 - New Build Tower Compound
 - CB Tower Compound
 - New Build Overhead Line
 - CB Route Removal
 - Temporary Trackway
 - Temporary Stone Track
 - Overhead Line Site Compound
 - Scaffolding
 - Pulling Position
 - New Bellmouth
 - 1km Study Area
 - Groundwater Aquifer
 - Moderately productive aquifer


NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Groundwater Receptors

FIGURE NUMBER
Figure 9.2 (Sheet 3 of 11)

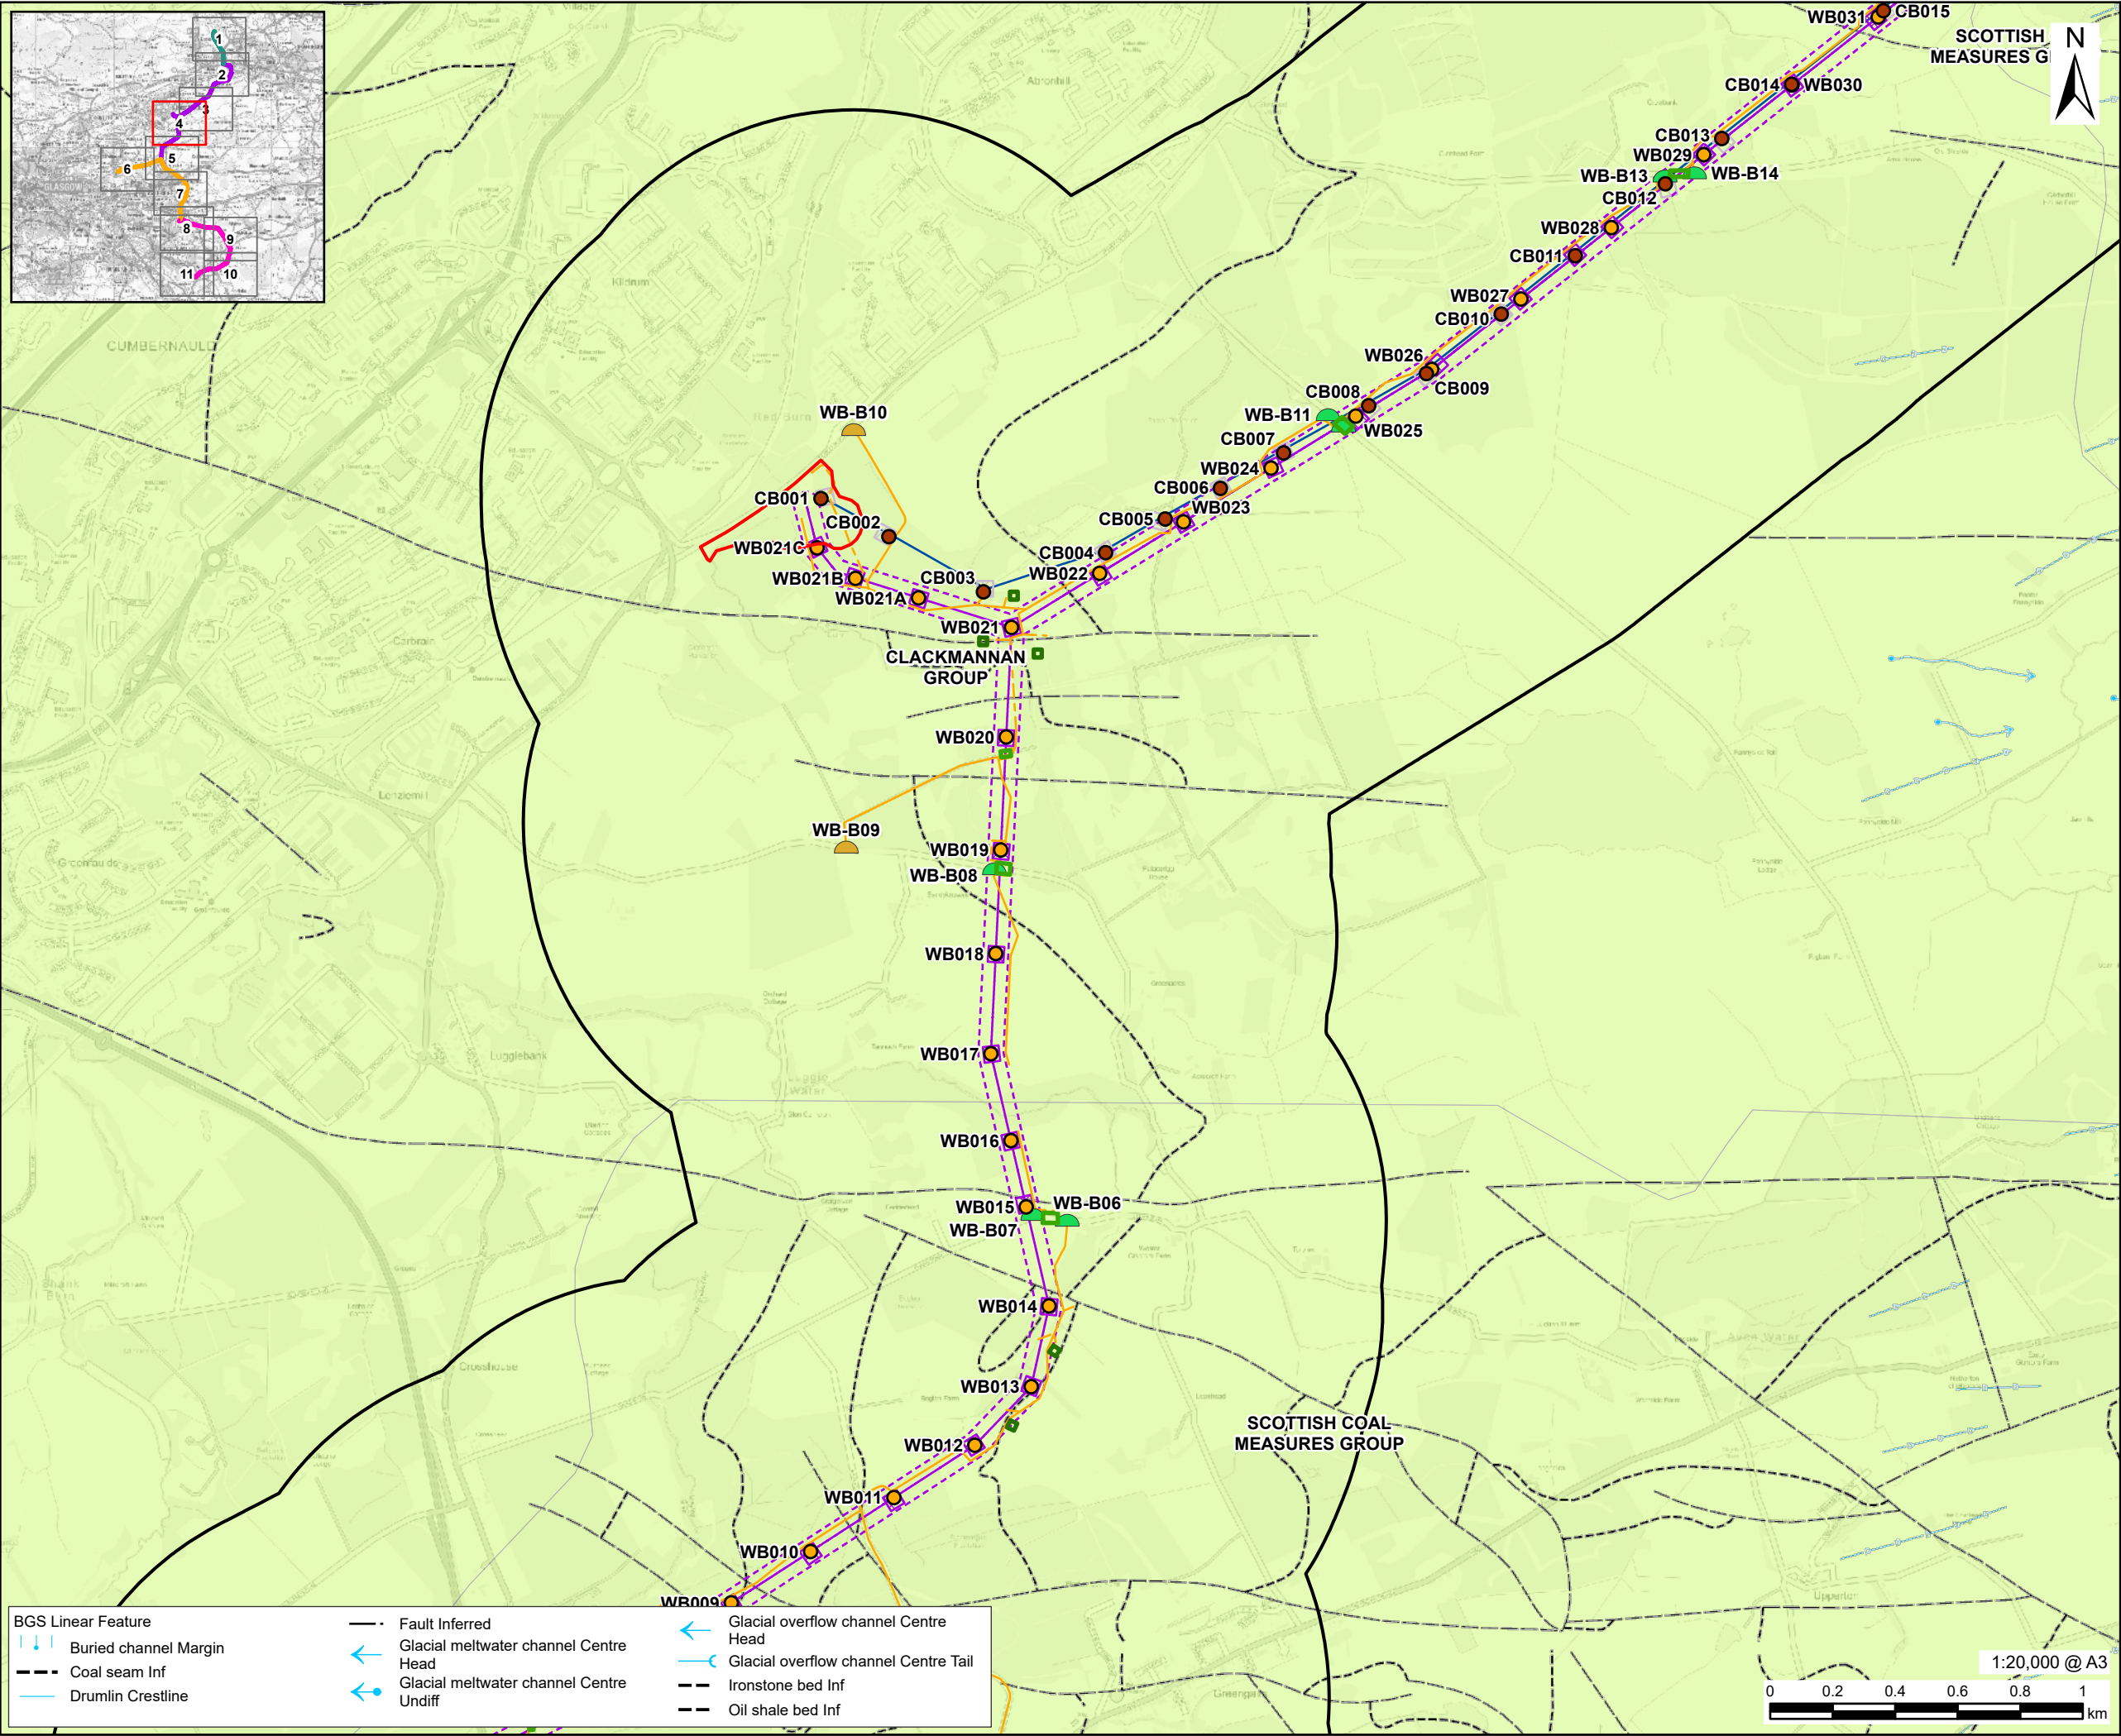

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Tower to be Removed
- Cumbernauld Substation Site Boundary
- New Build Tower Compound
- CB Tower Compound
- New Build Overhead Line
- CB Route Removal
- Temporary Trackway
- Temporary Stone Track
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788


FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 4 of 11)

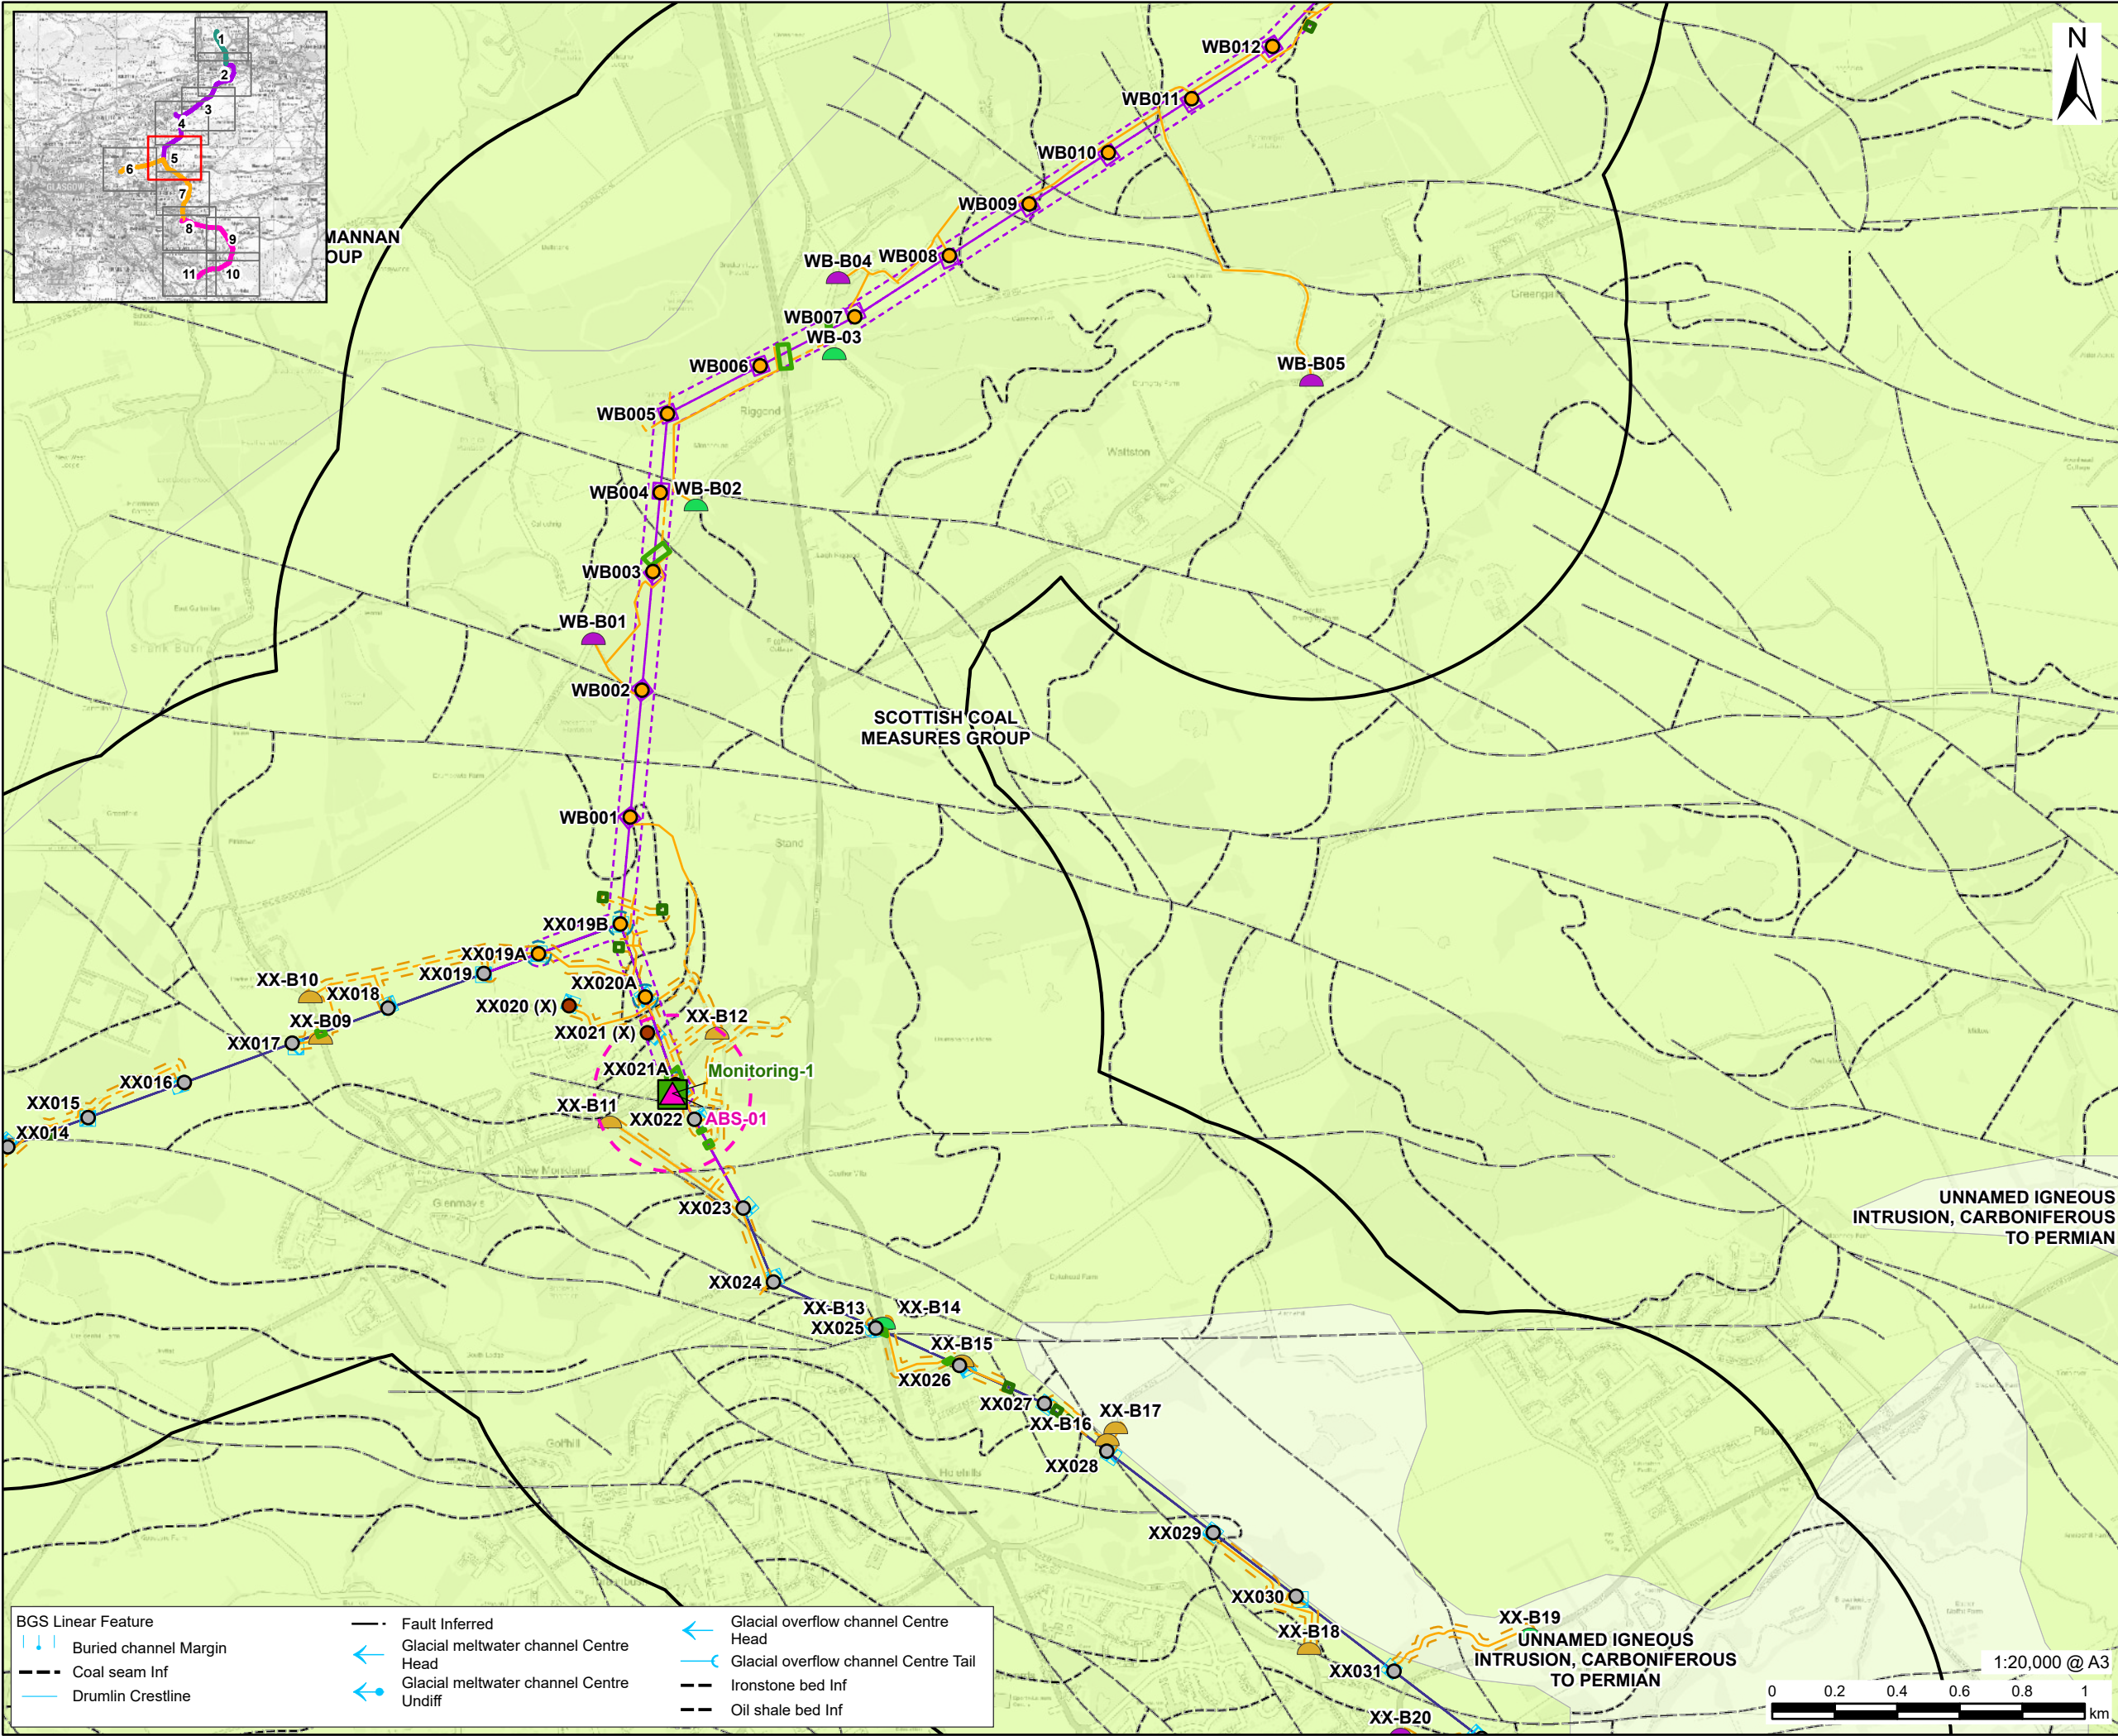

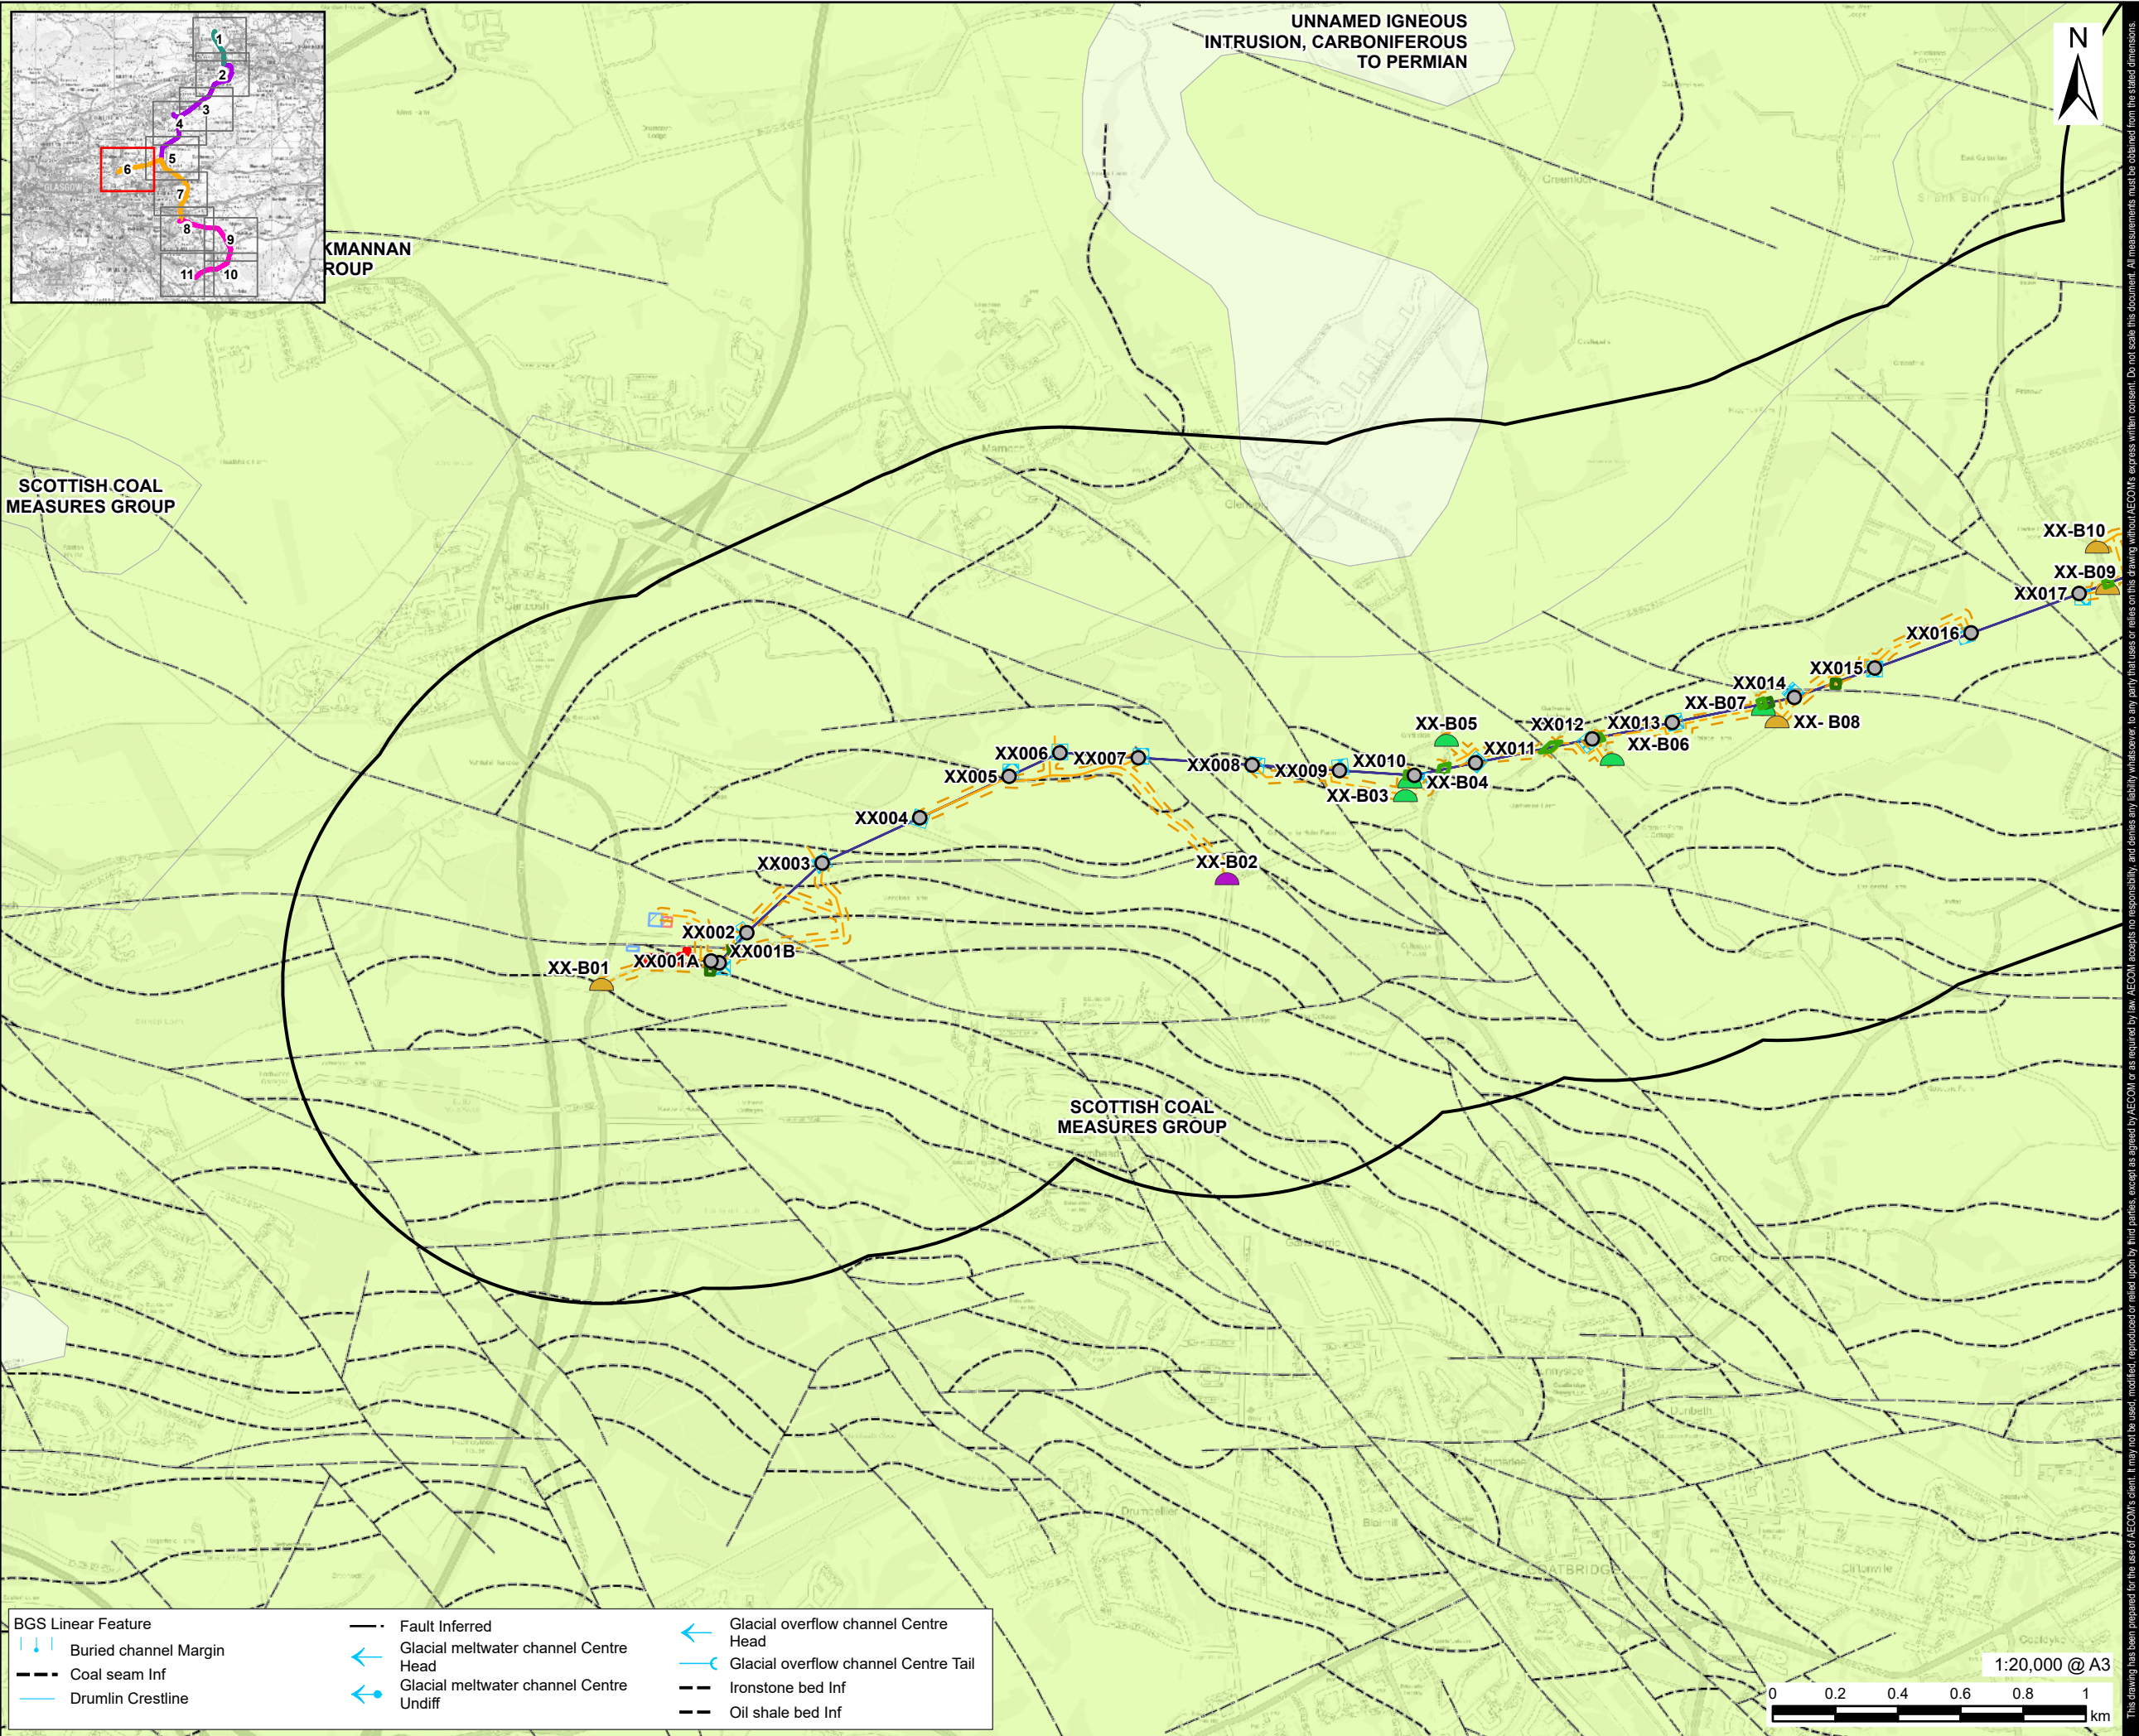

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- Easterhouse Substation Site Boundary
- XX Tower Compound
- XX Upgraded Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Substation Laydown Area
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer
- Low productivity aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788


FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 6 of 11)

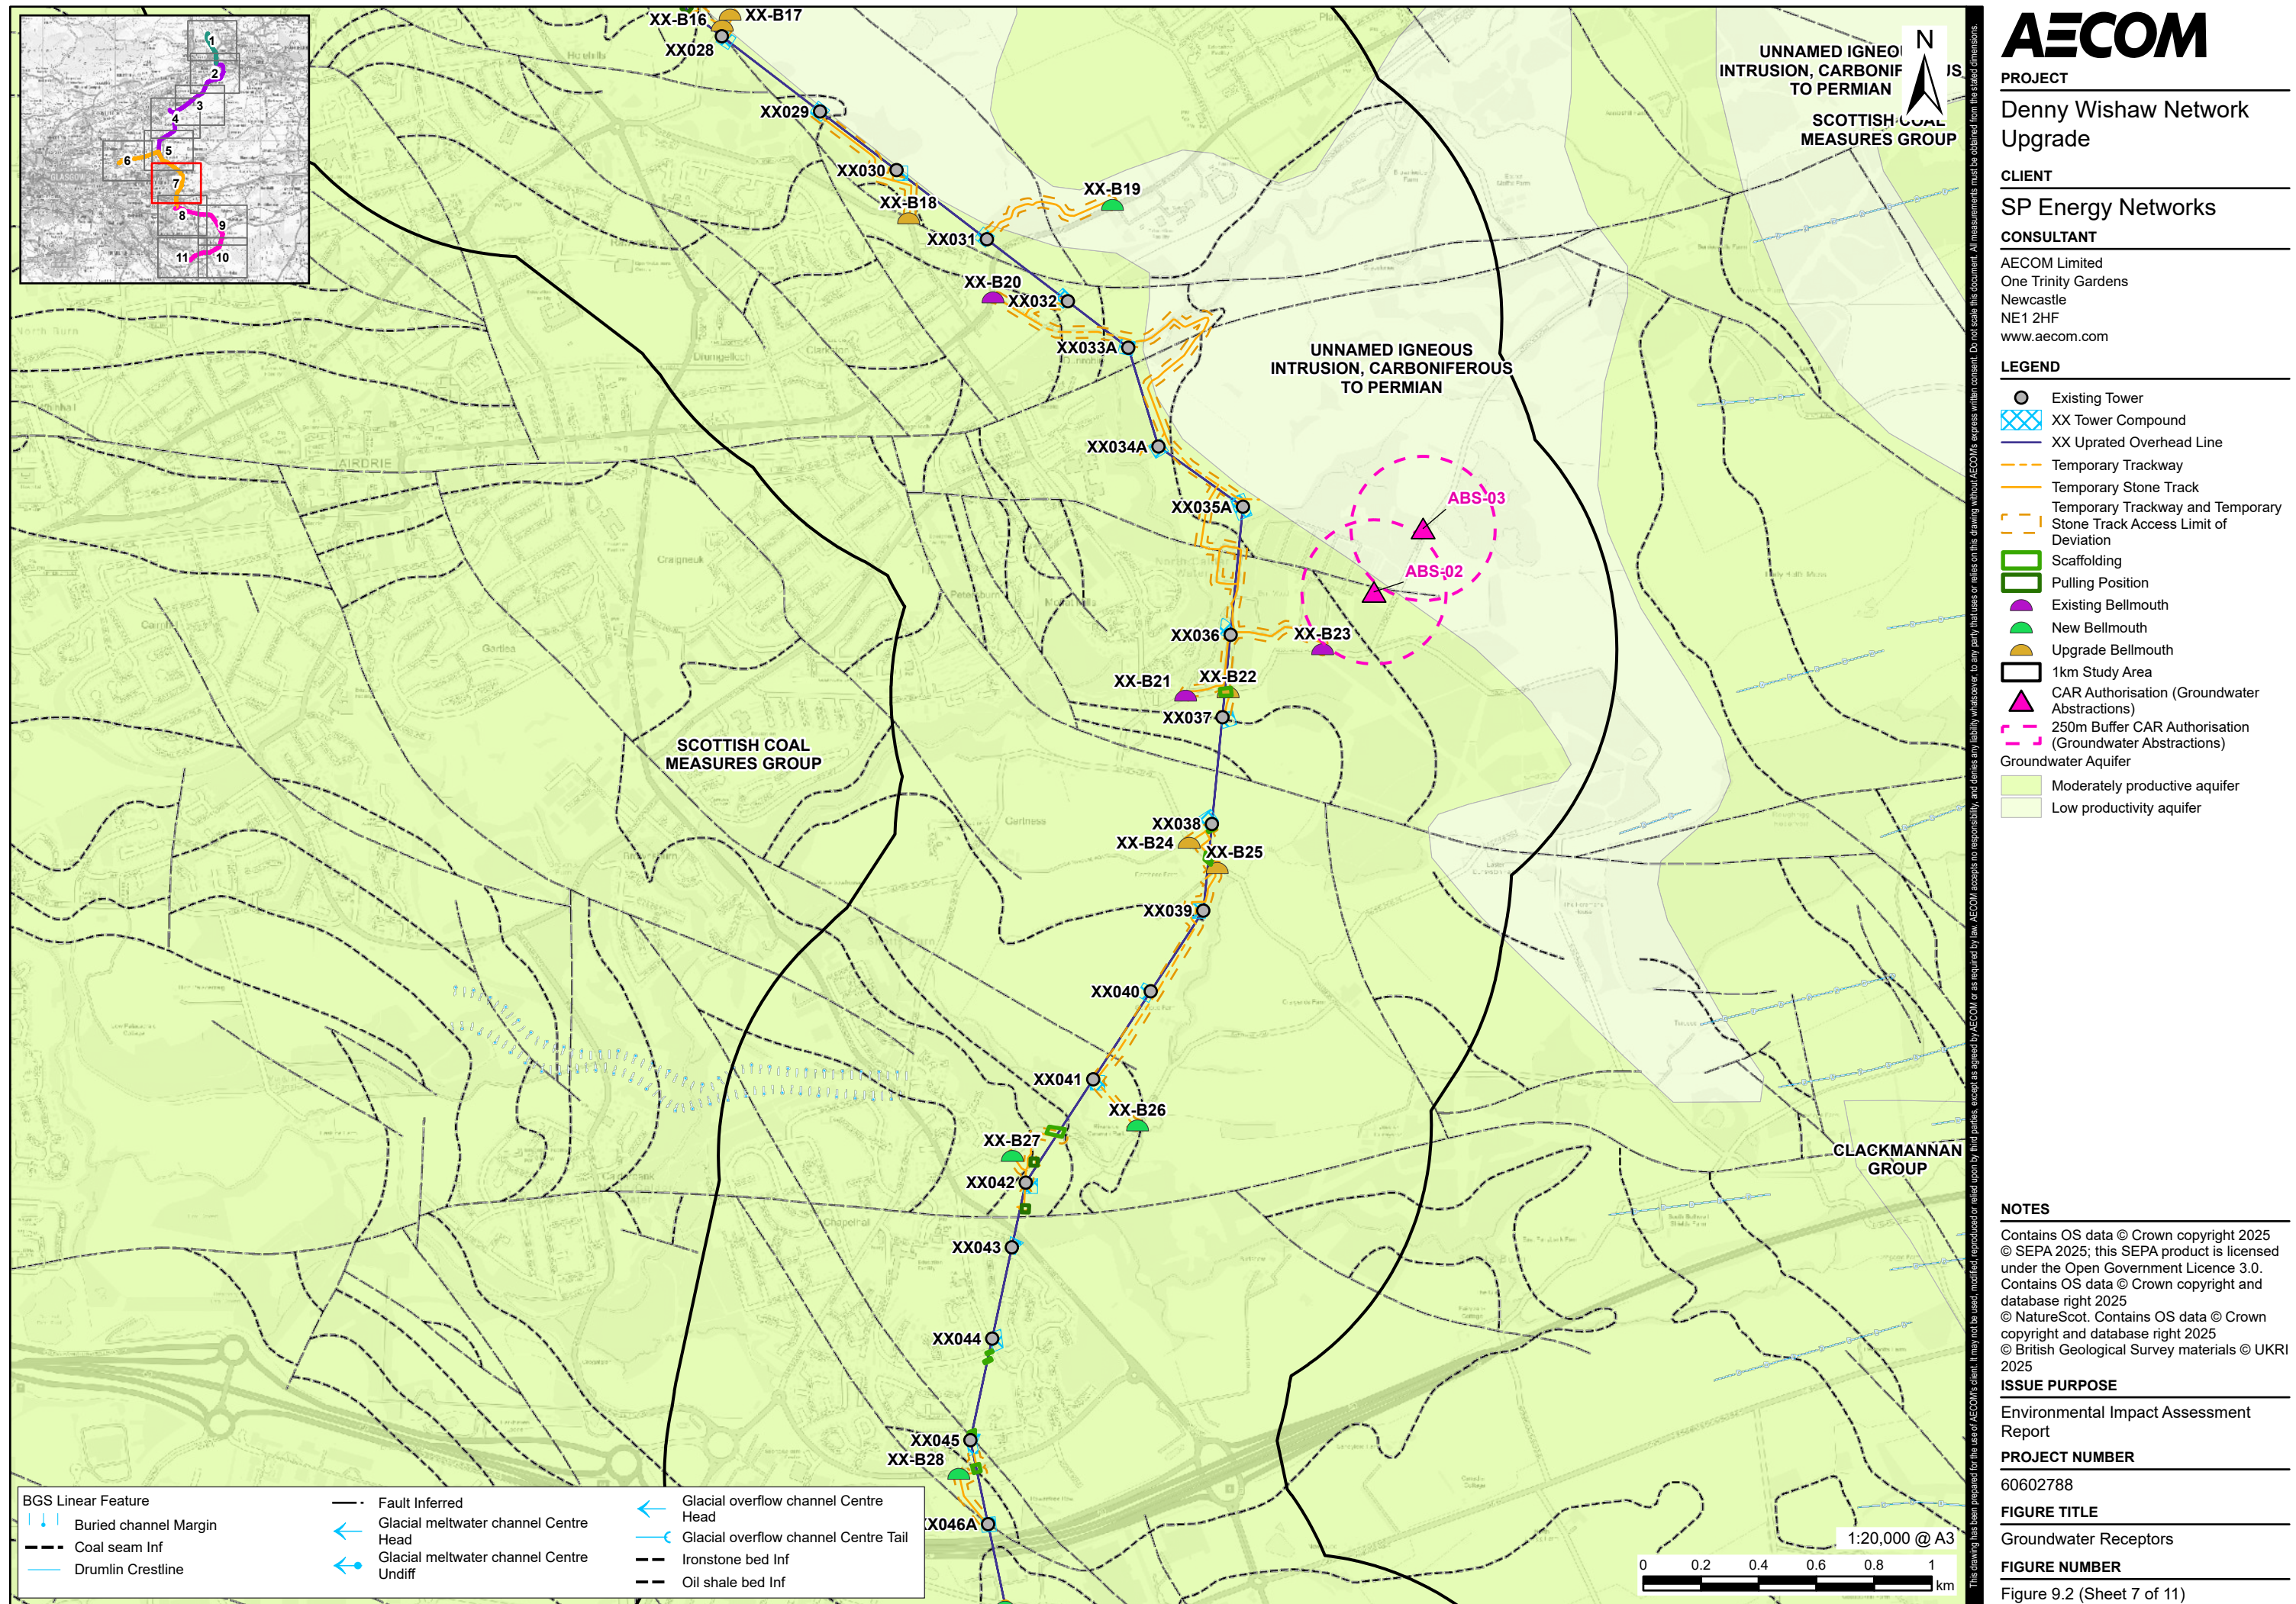

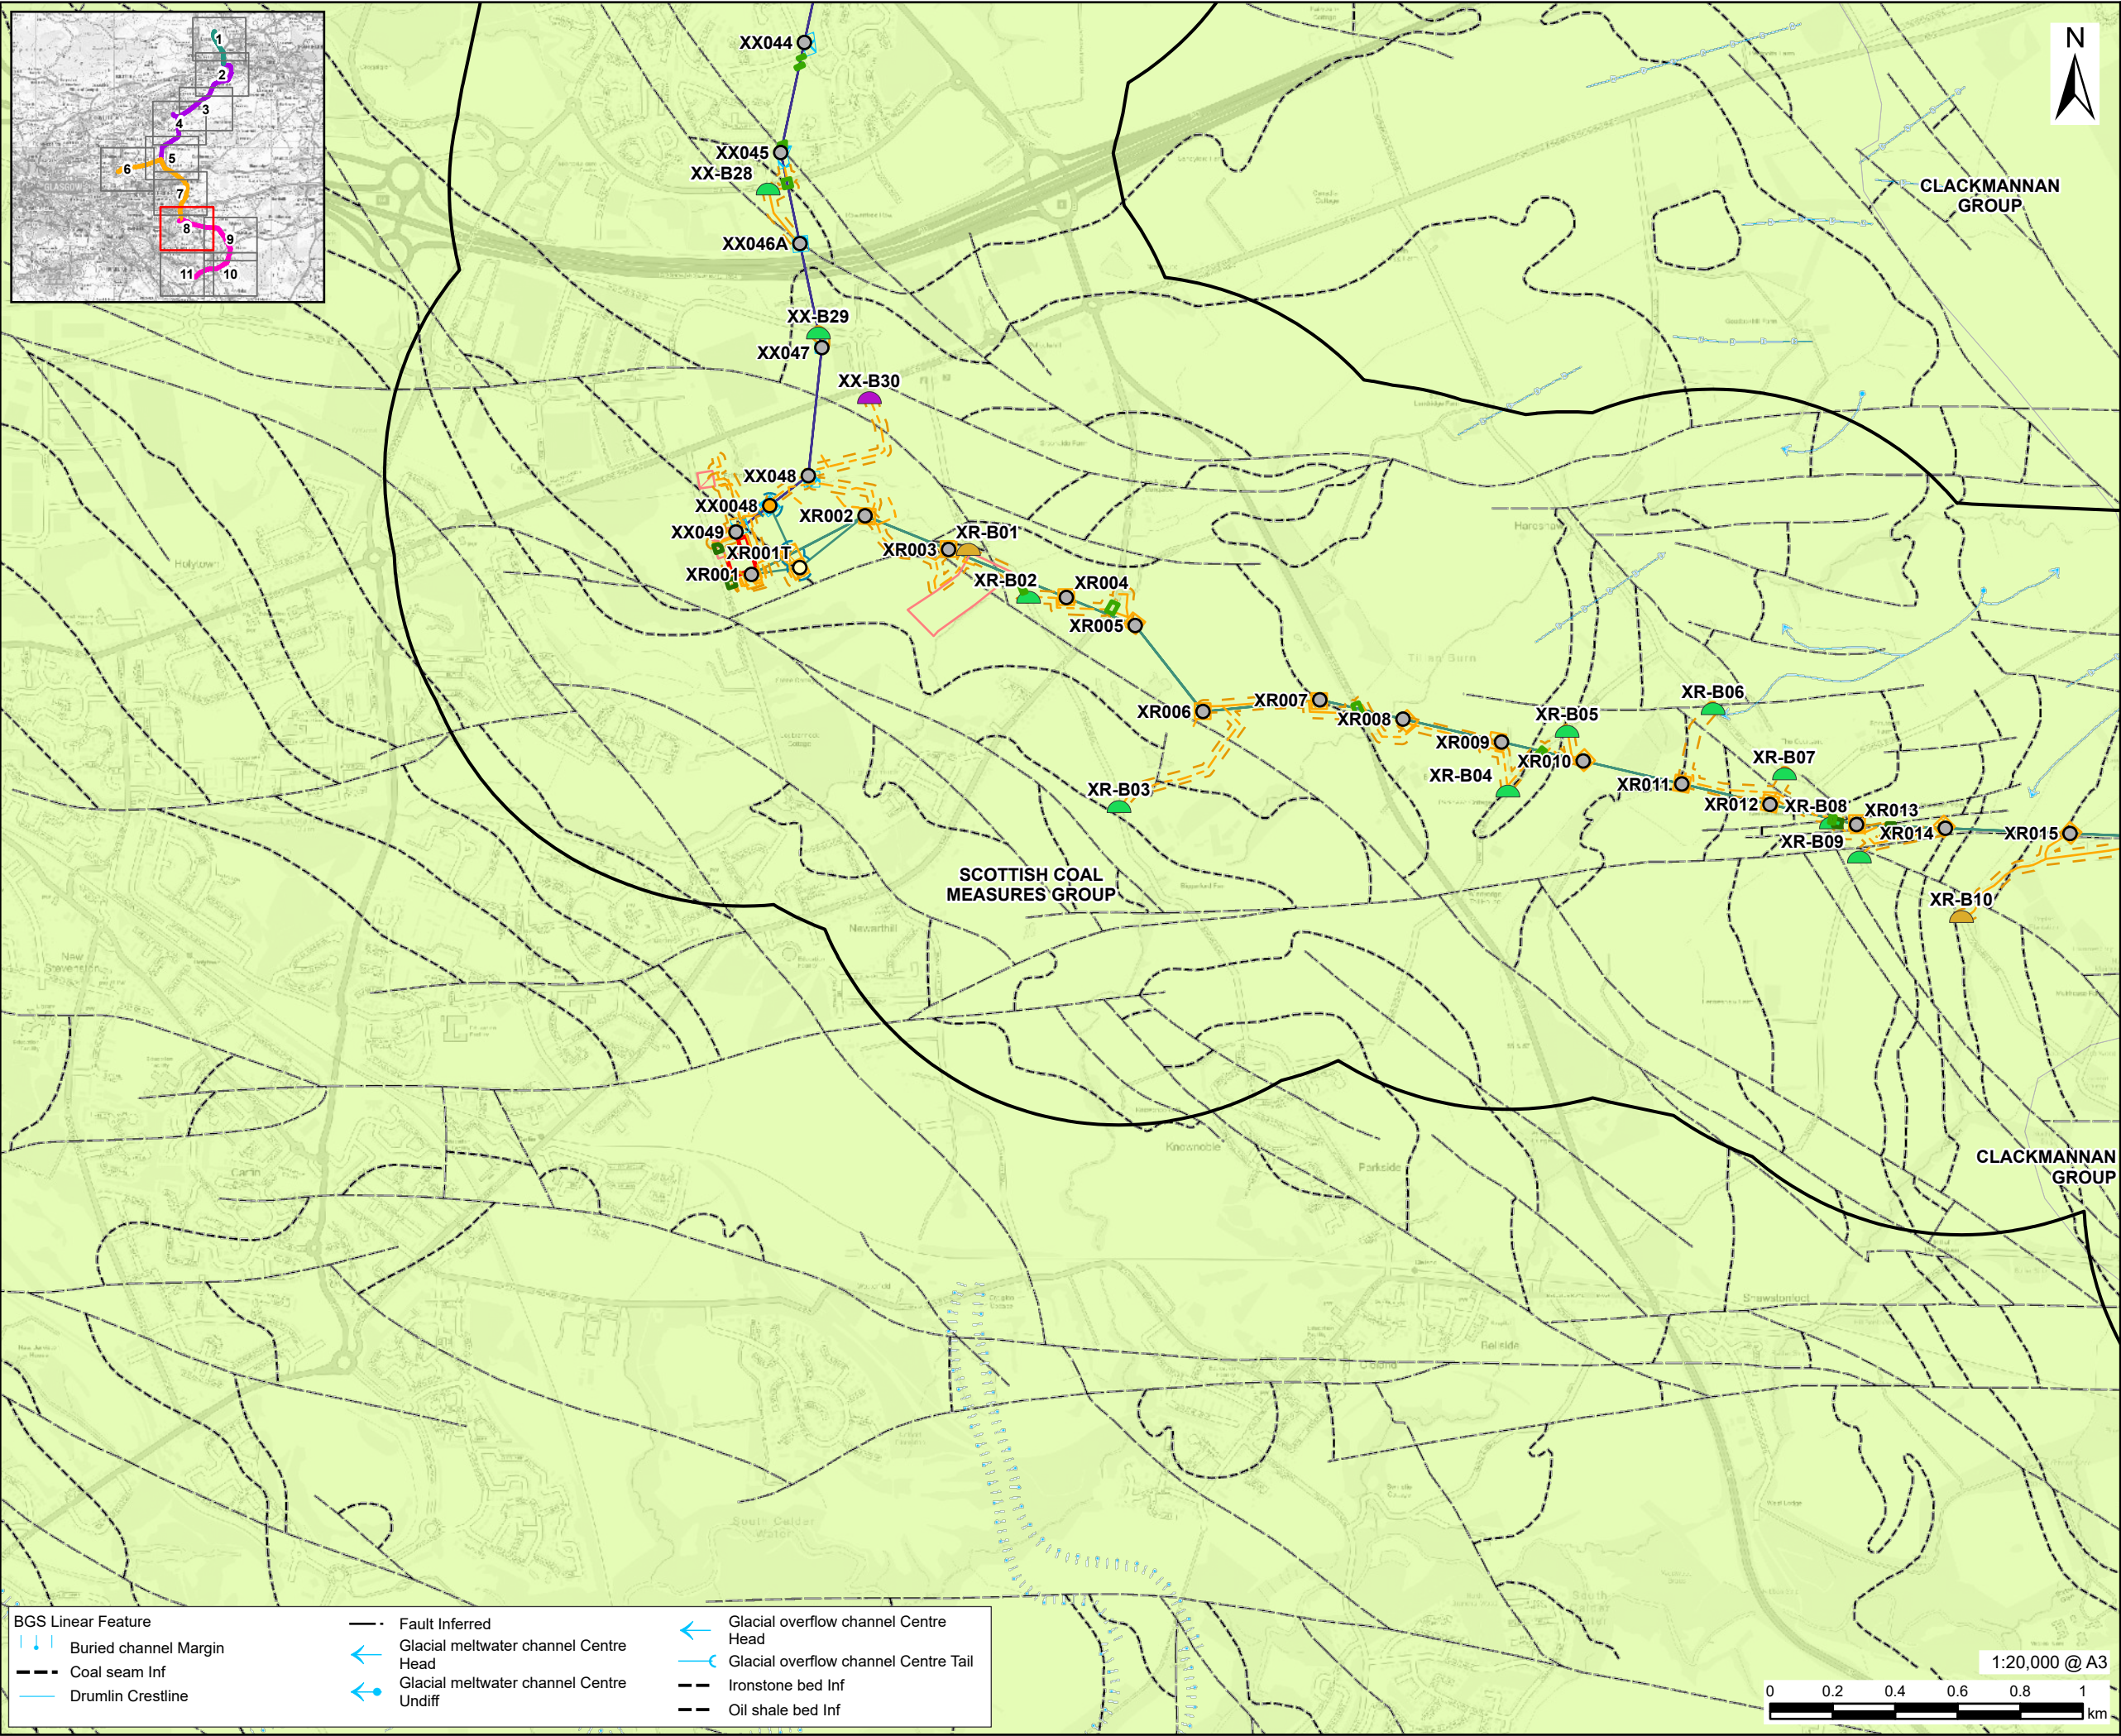

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Newarthill Substation Site Boundary
- XR Tower Compound
- XX Tower Compound
- XR Uprated Overhead Line
- XX Uprated Overhead Line
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Overhead Line Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 8 of 11)

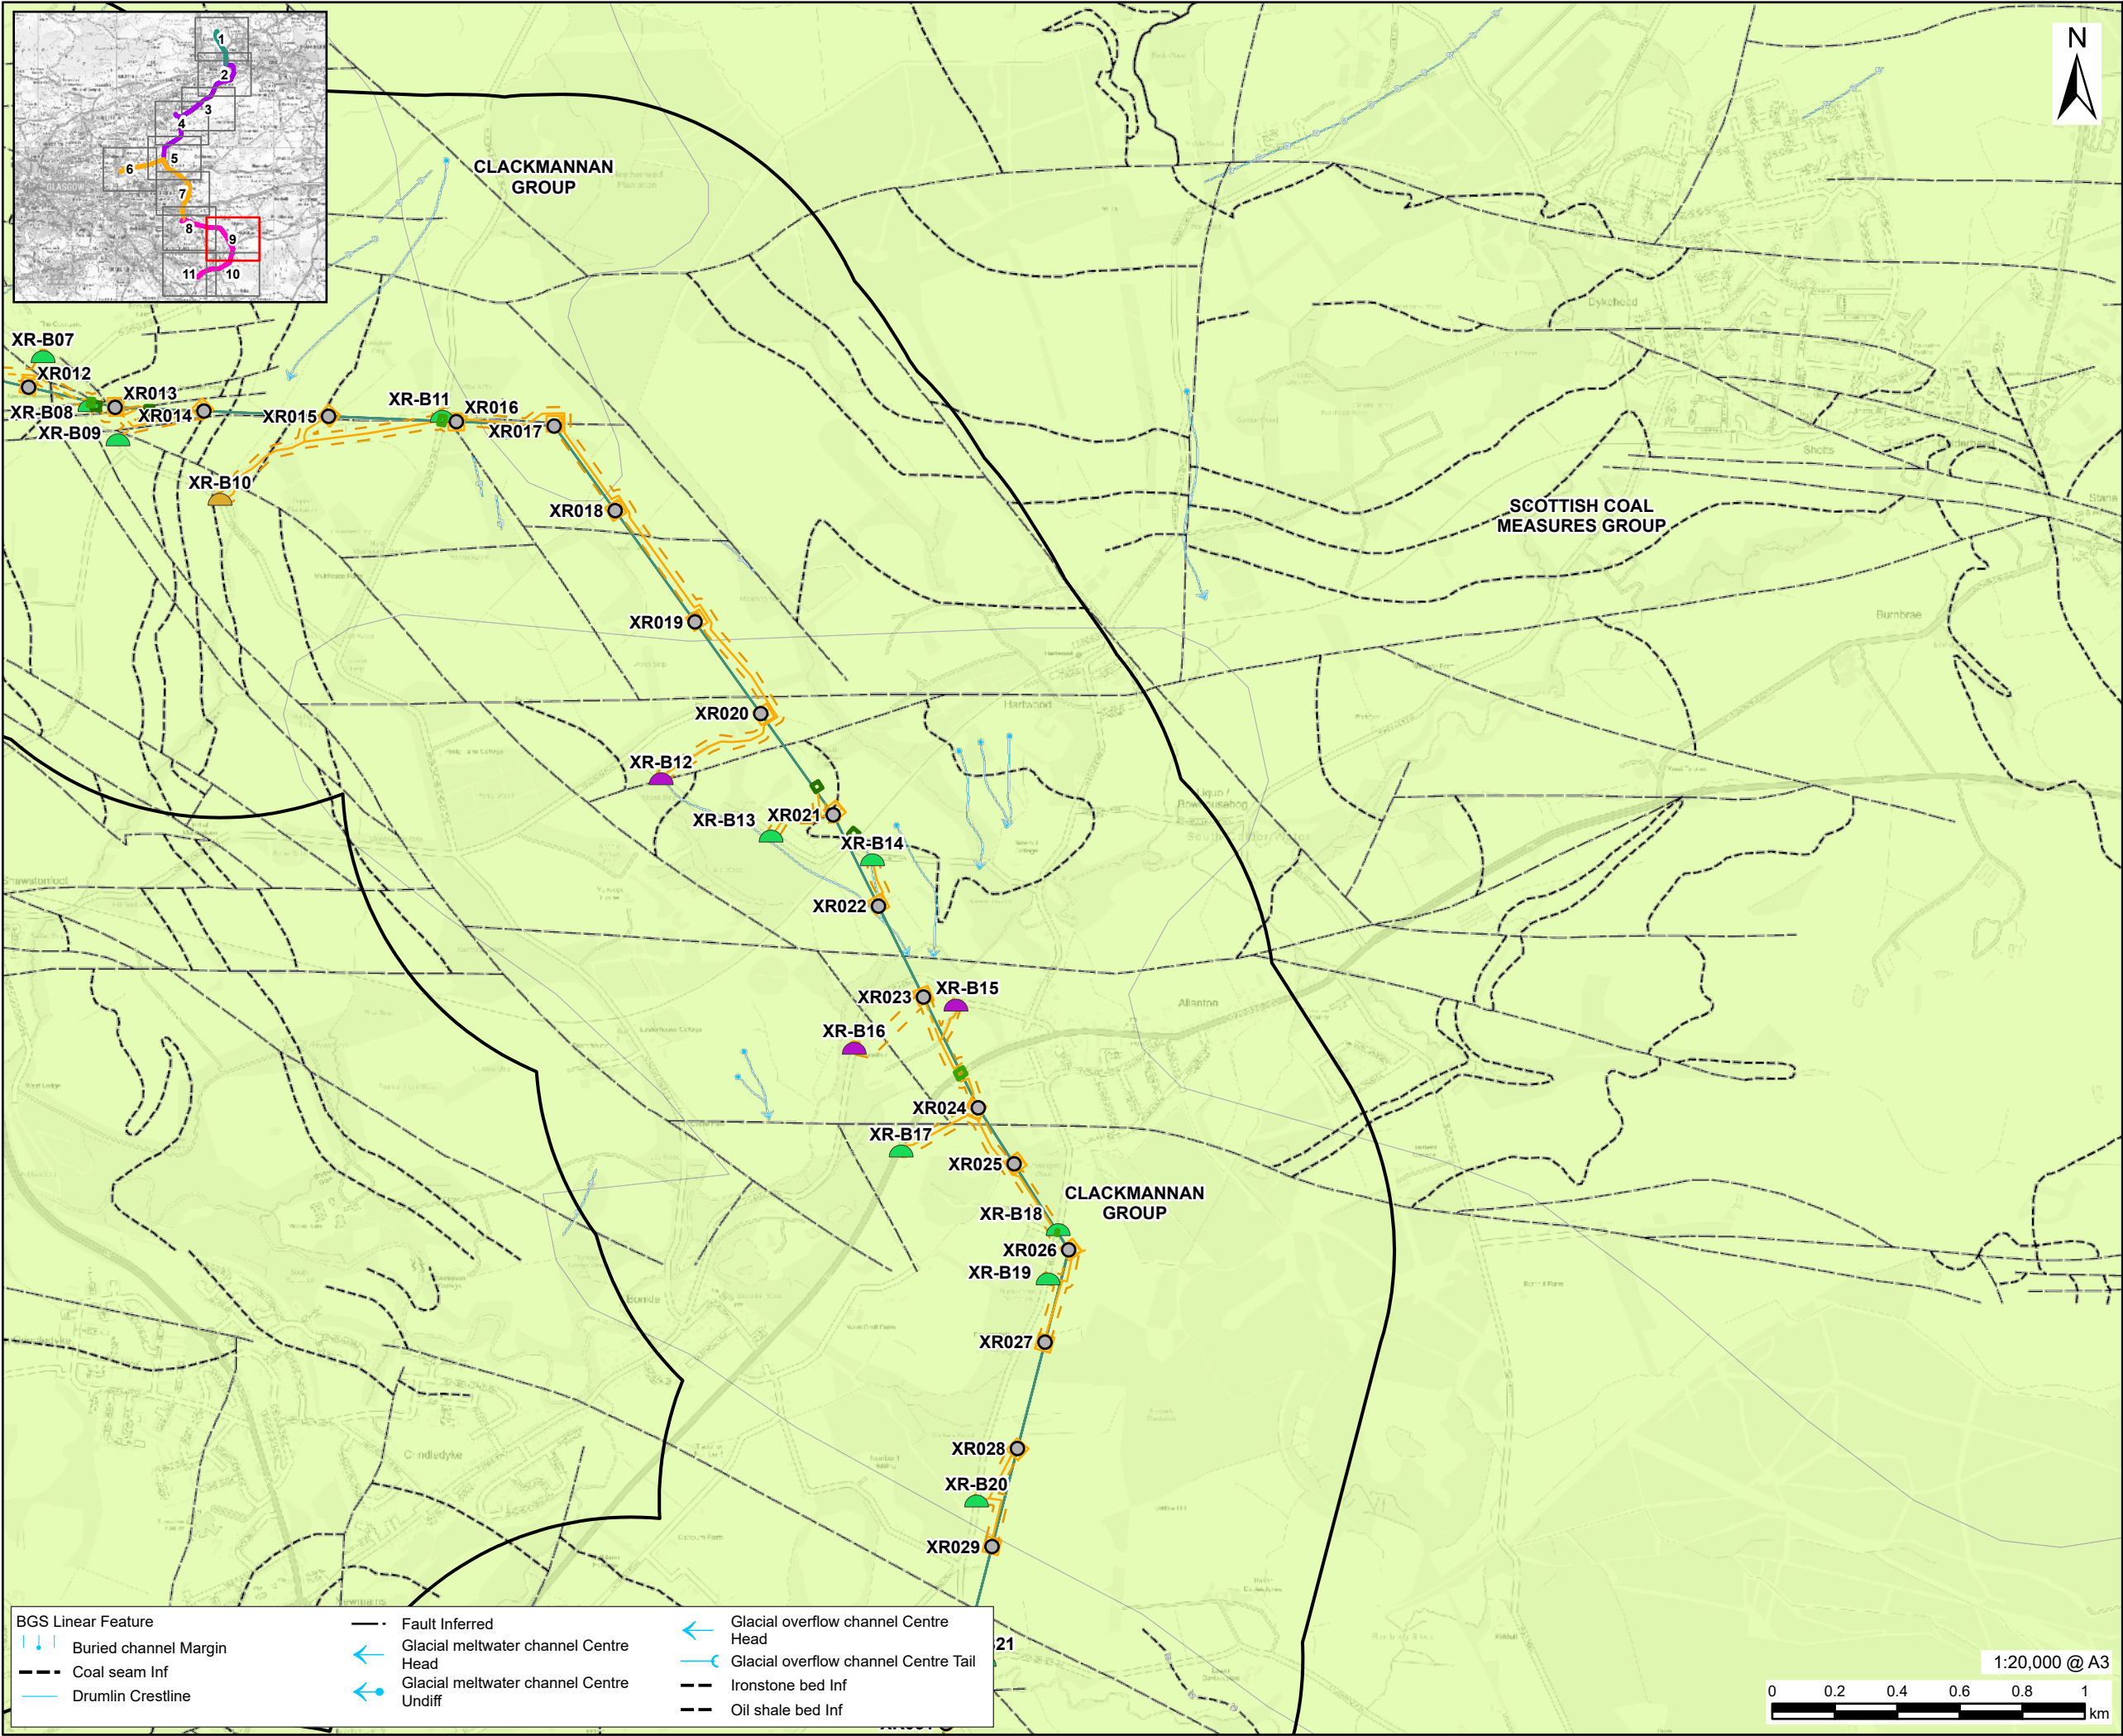

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Tower Compound
- XR Uprated Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 9 of 11)

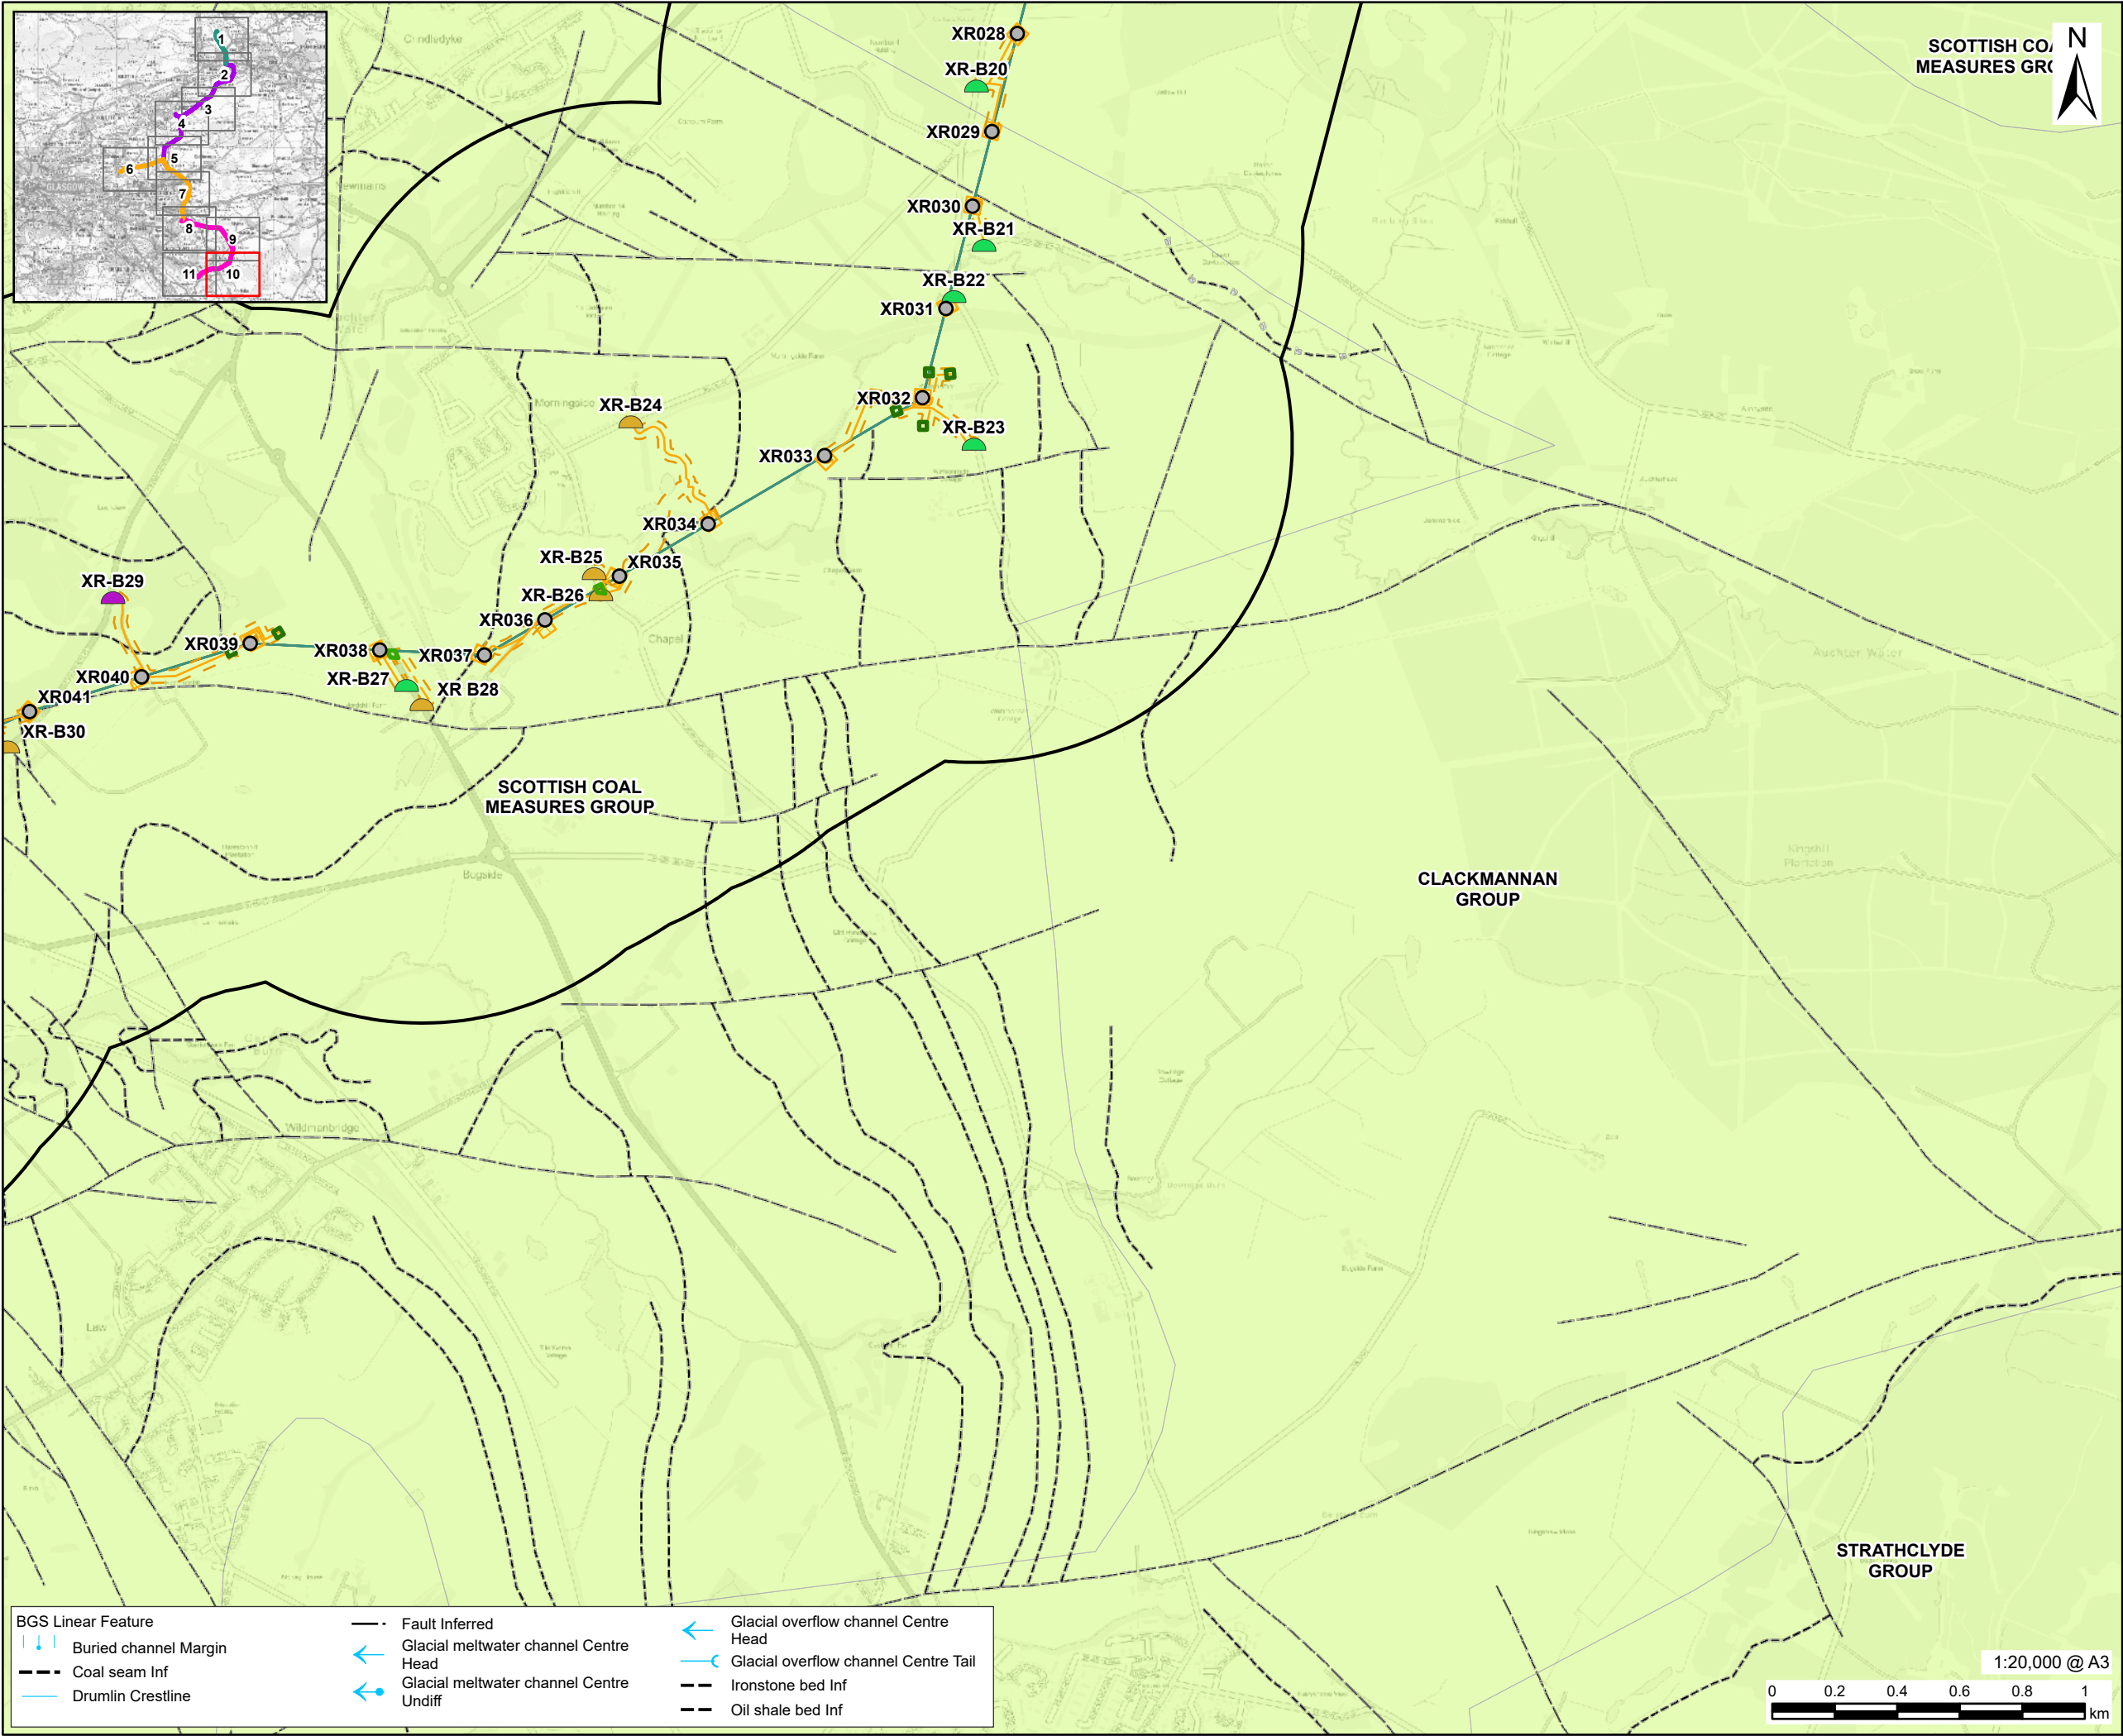

SCOTTISH COAL
MEASURES GROUP



AECOM

PROJECT

Denny Wishaw Network
Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Tower Compound
- XR Uprated Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment
Report

PROJECT NUMBER




60602788

FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 10 of 11)

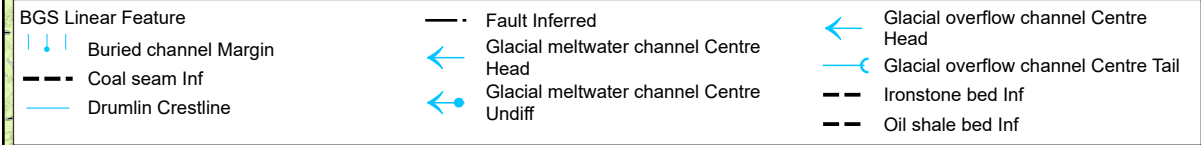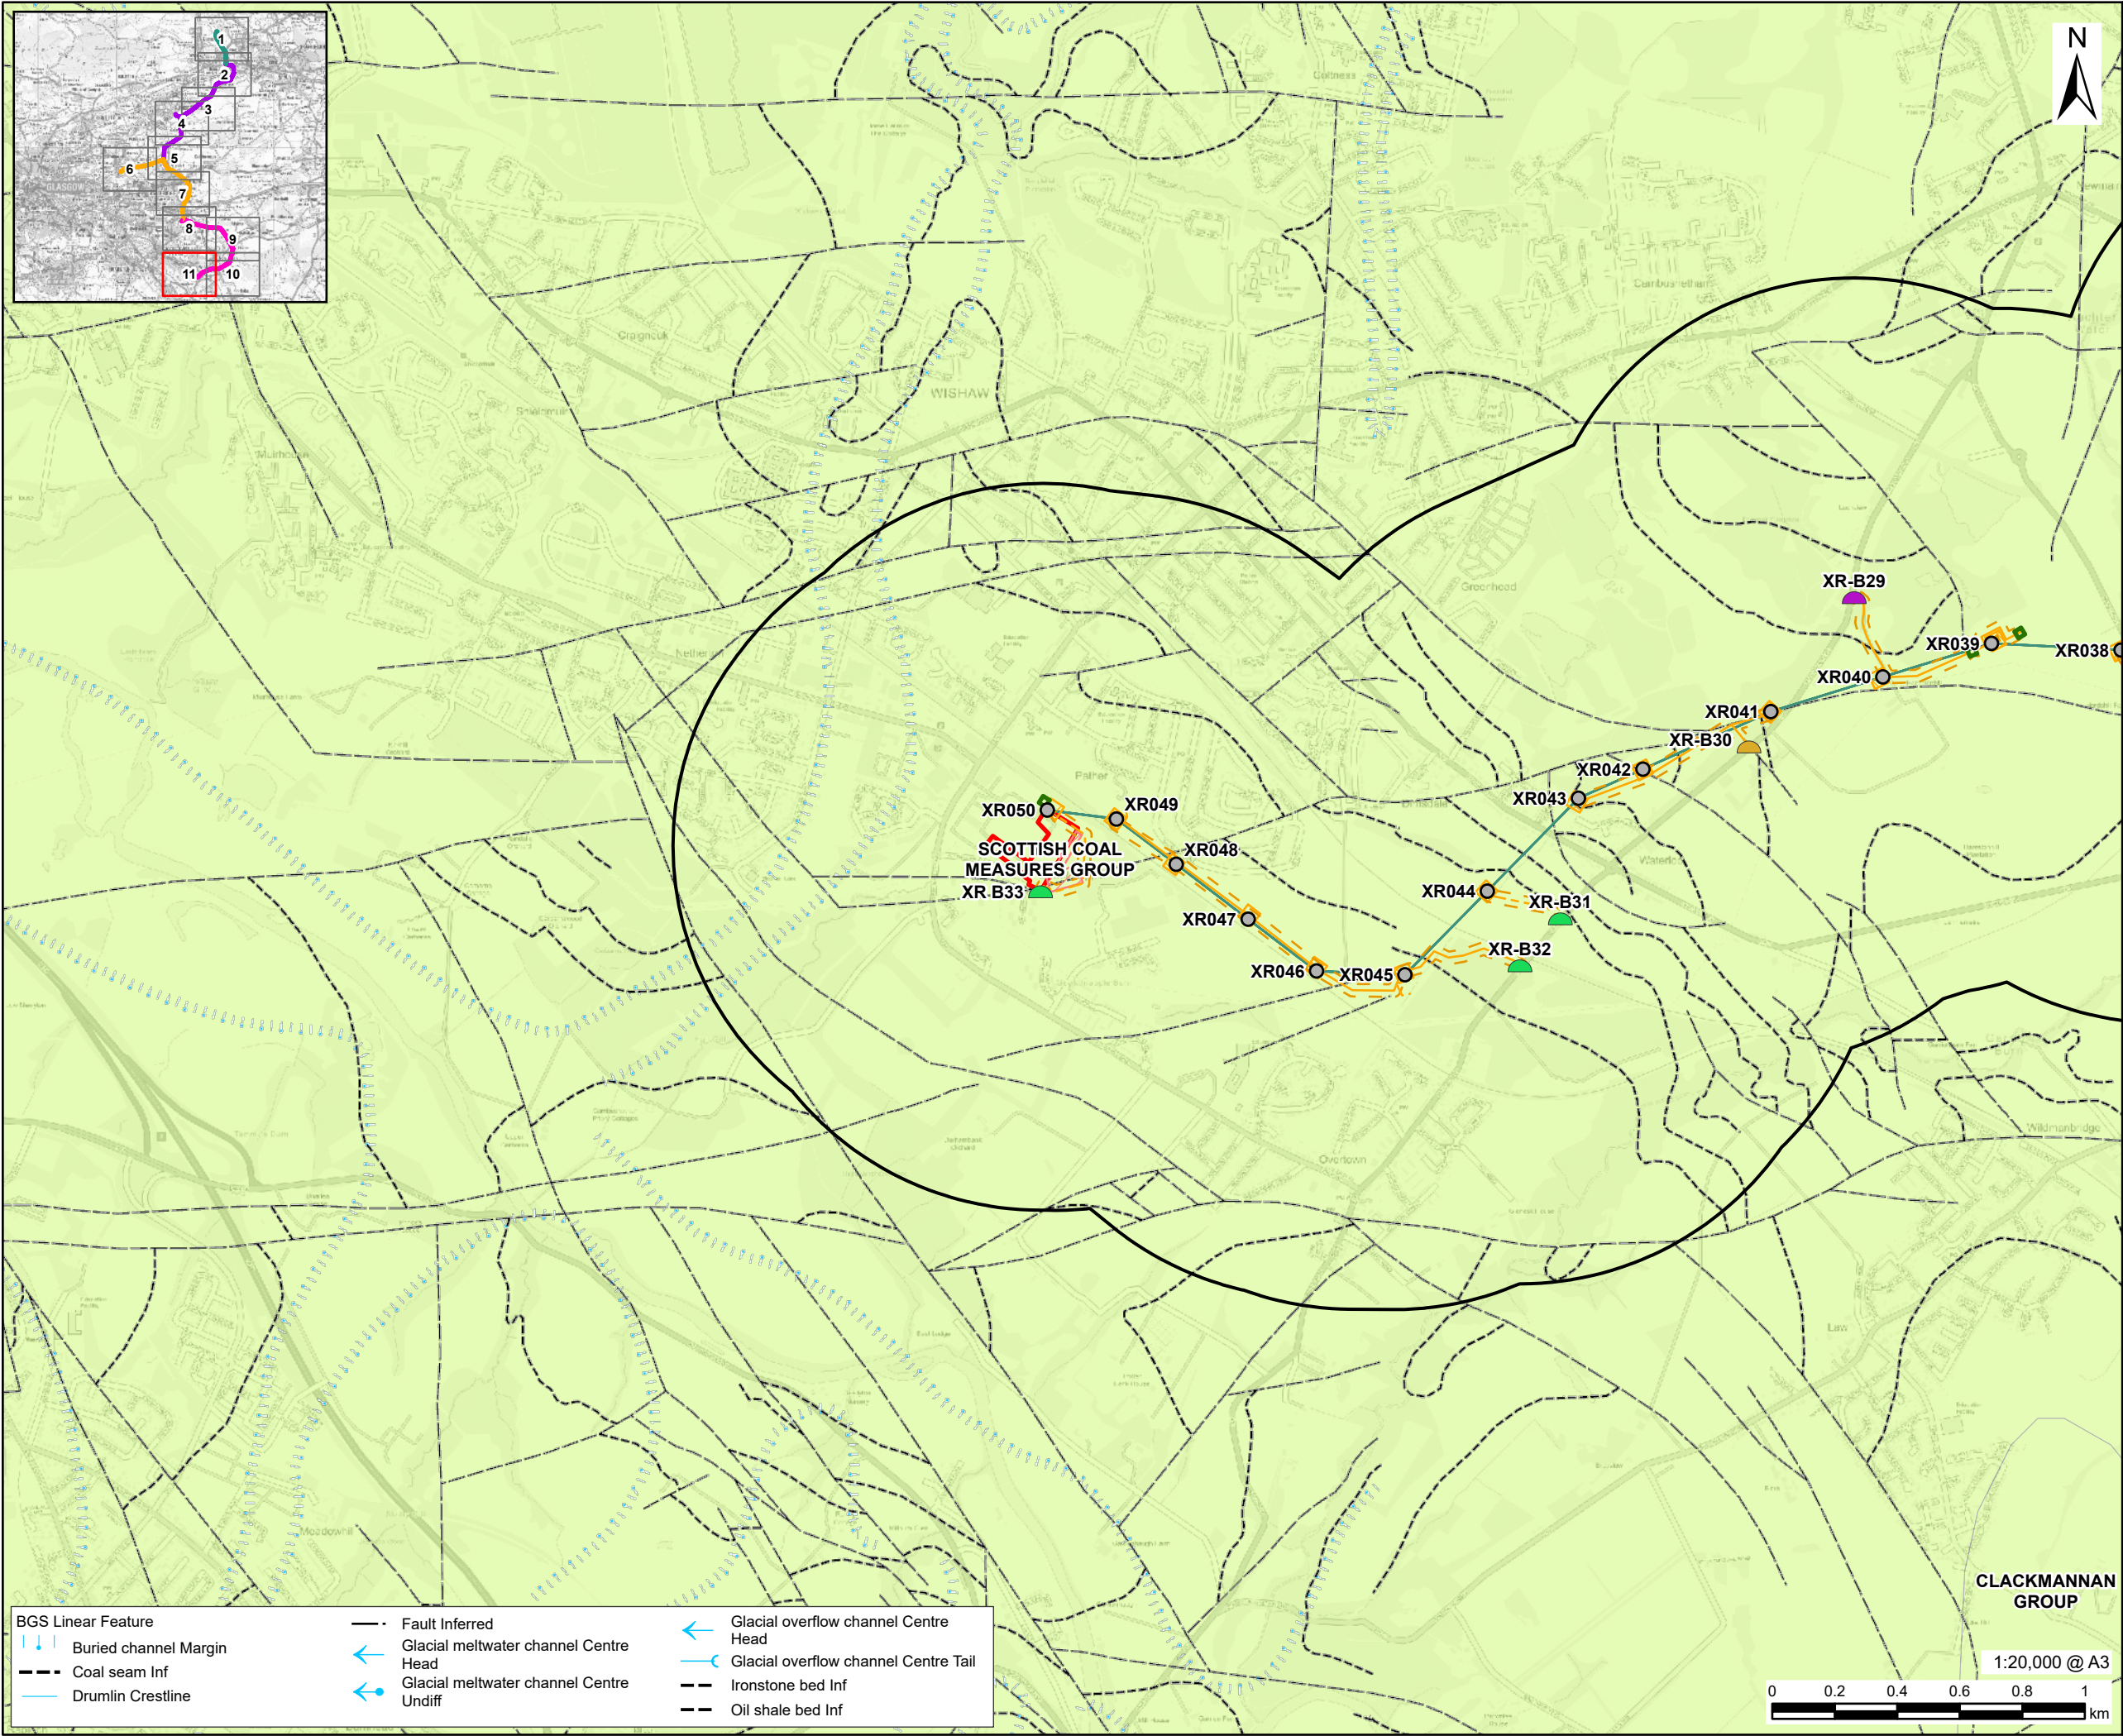

AECOM

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- Wishaw Substation Site Boundary
- XR Tower Compound
- XR Uprated Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Groundwater Aquifer
- Moderately productive aquifer

NOTES

Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025
© NatureScot. Contains OS data © Crown copyright and database right 2025
© British Geological Survey materials © UKRI 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Groundwater Receptors

FIGURE NUMBER

Figure 9.2 (Sheet 11 of 11)