


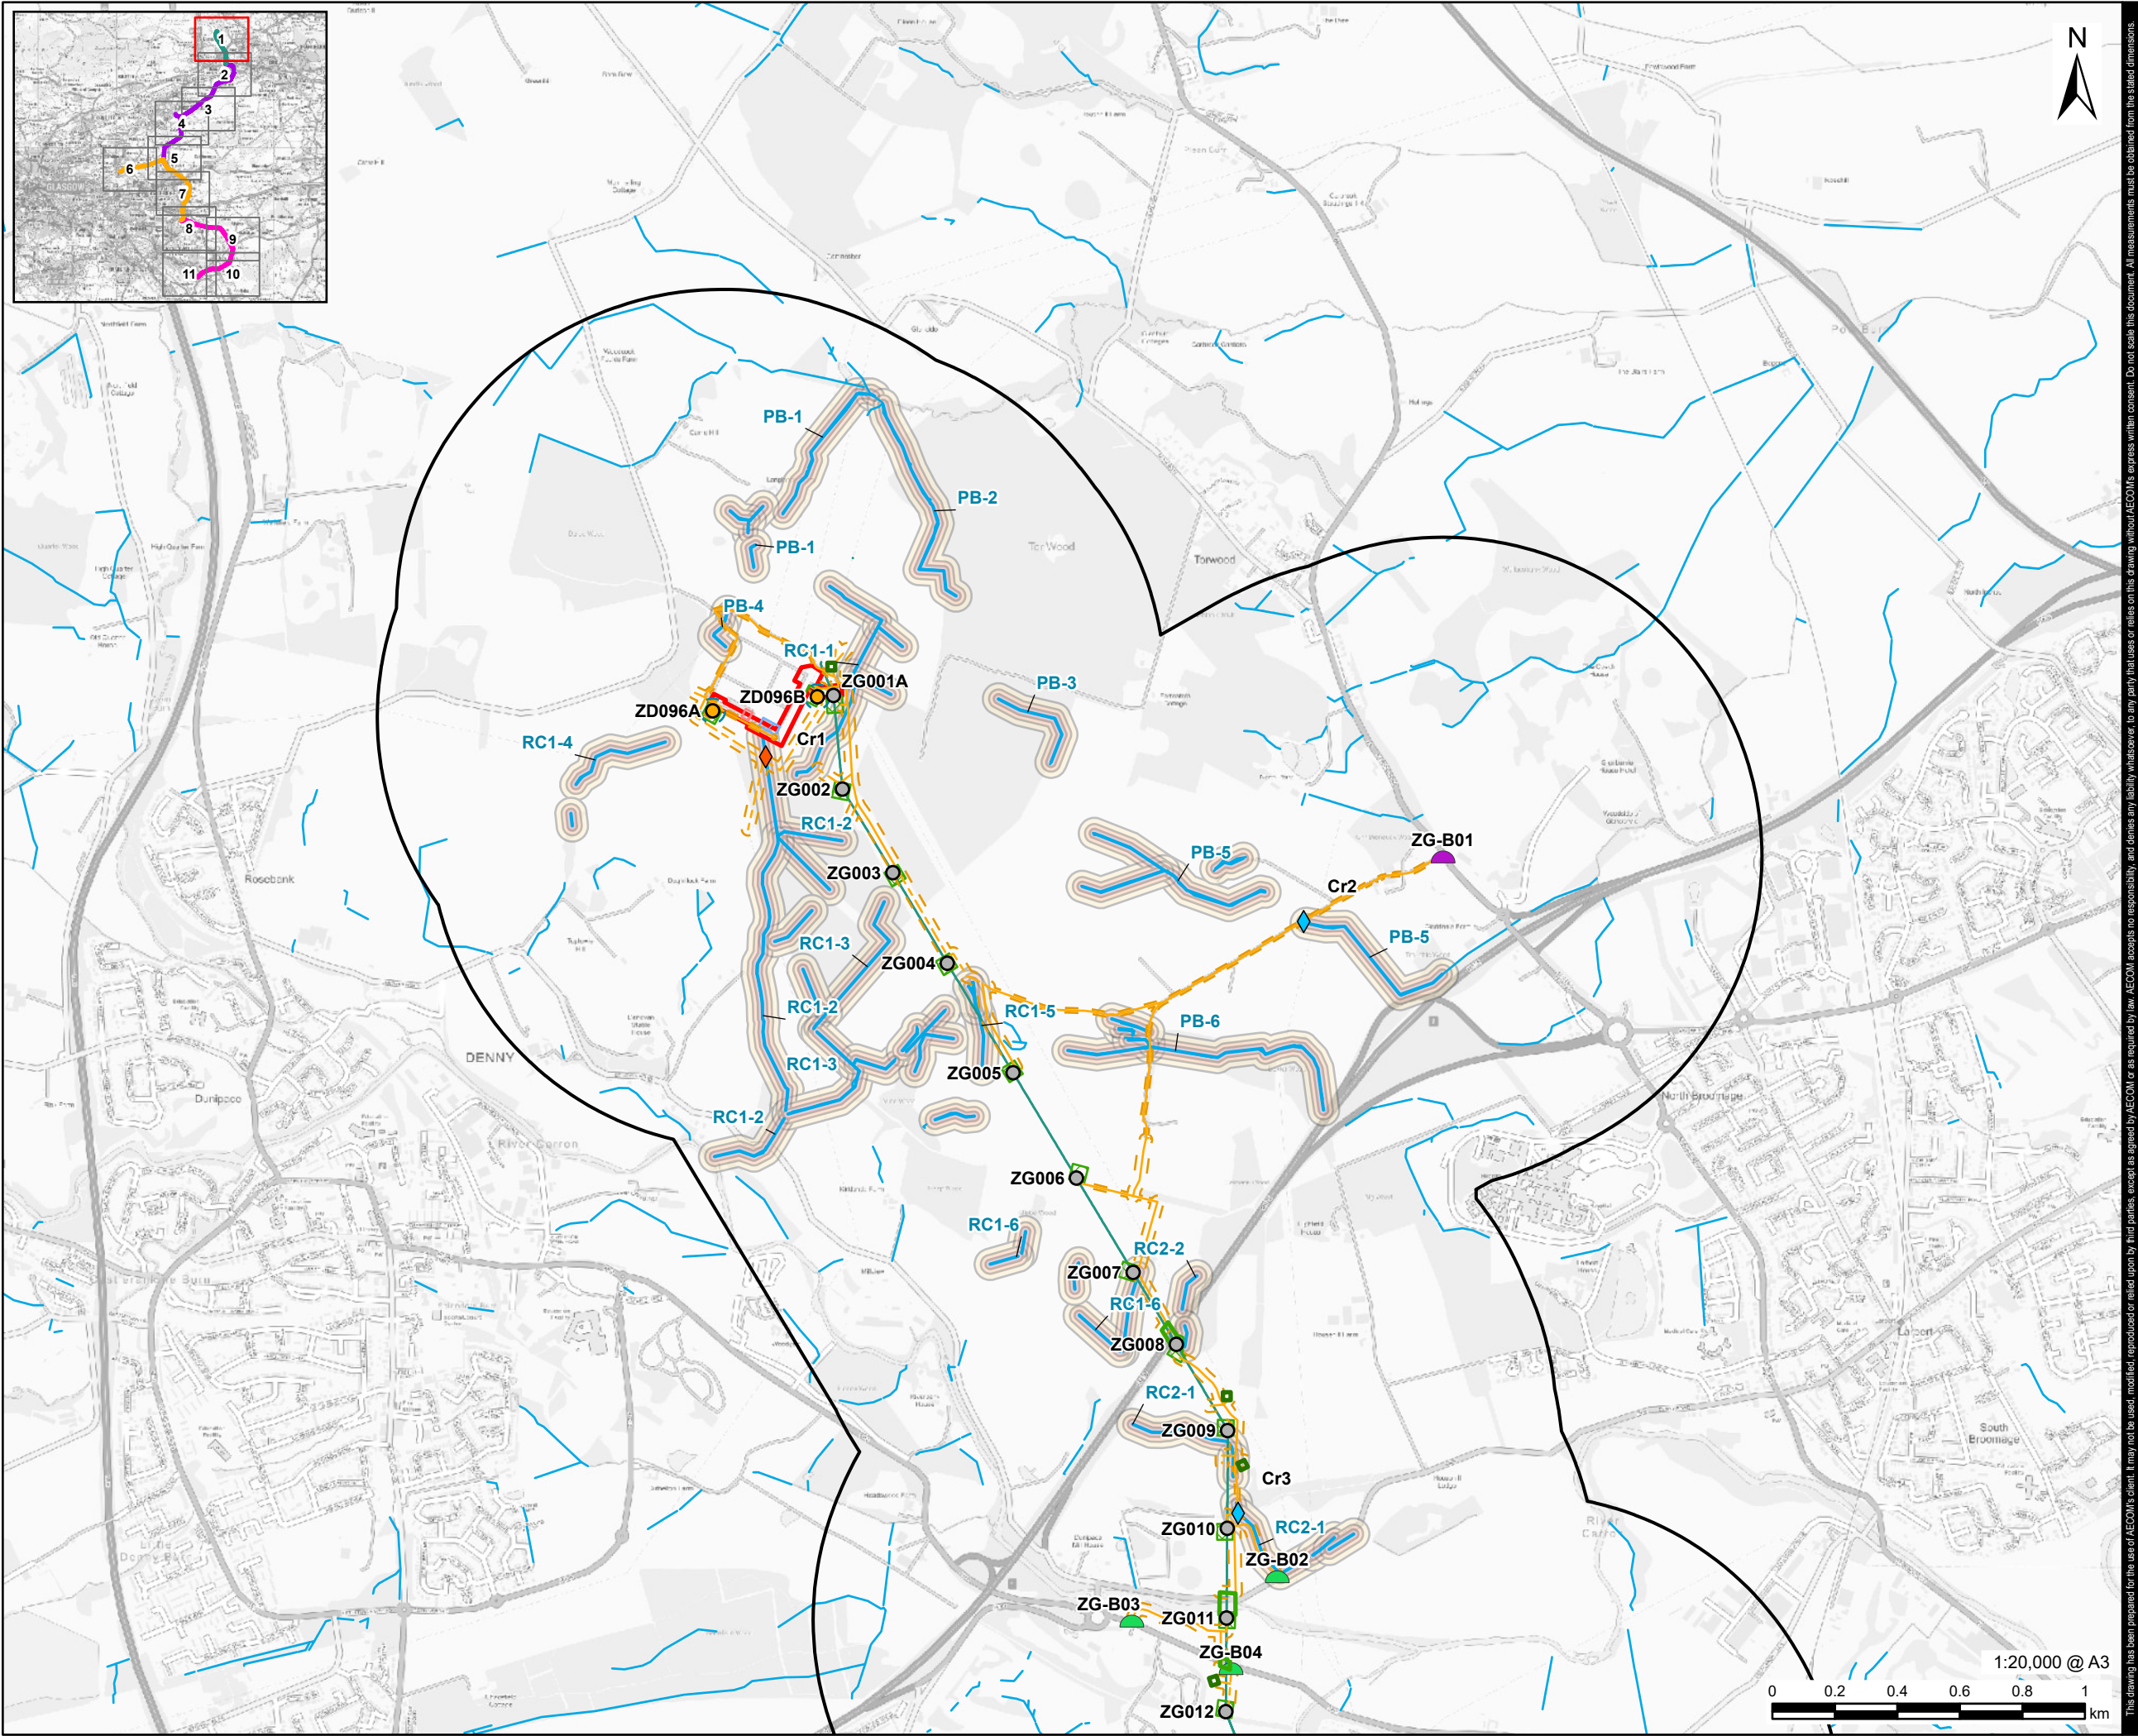

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - New Tower
 - Denny North Substation Site Boundary
 - ZG Tower Compound
 - ZG Uprated Overhead Line
 - New Tower Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Substation Site Compound
 - Substation Laydown Area
 - Scaffolding
 - Pulling Position
 - Existing Bellmouth
 - New Bellmouth
 - 1km Study Area
 - Watercourse Crossing
 - Existing
 - New temporary
 - Surface Water Feature
 - Buffer Zone (15m)
 - Buffer Zone (30 m)
 - Buffer Zone (50 m)


NOTES
Contains OS data © Crown copyright 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Water Course Crossings

FIGURE NUMBER
Figure 9.4 (Sheet 1 of 11)

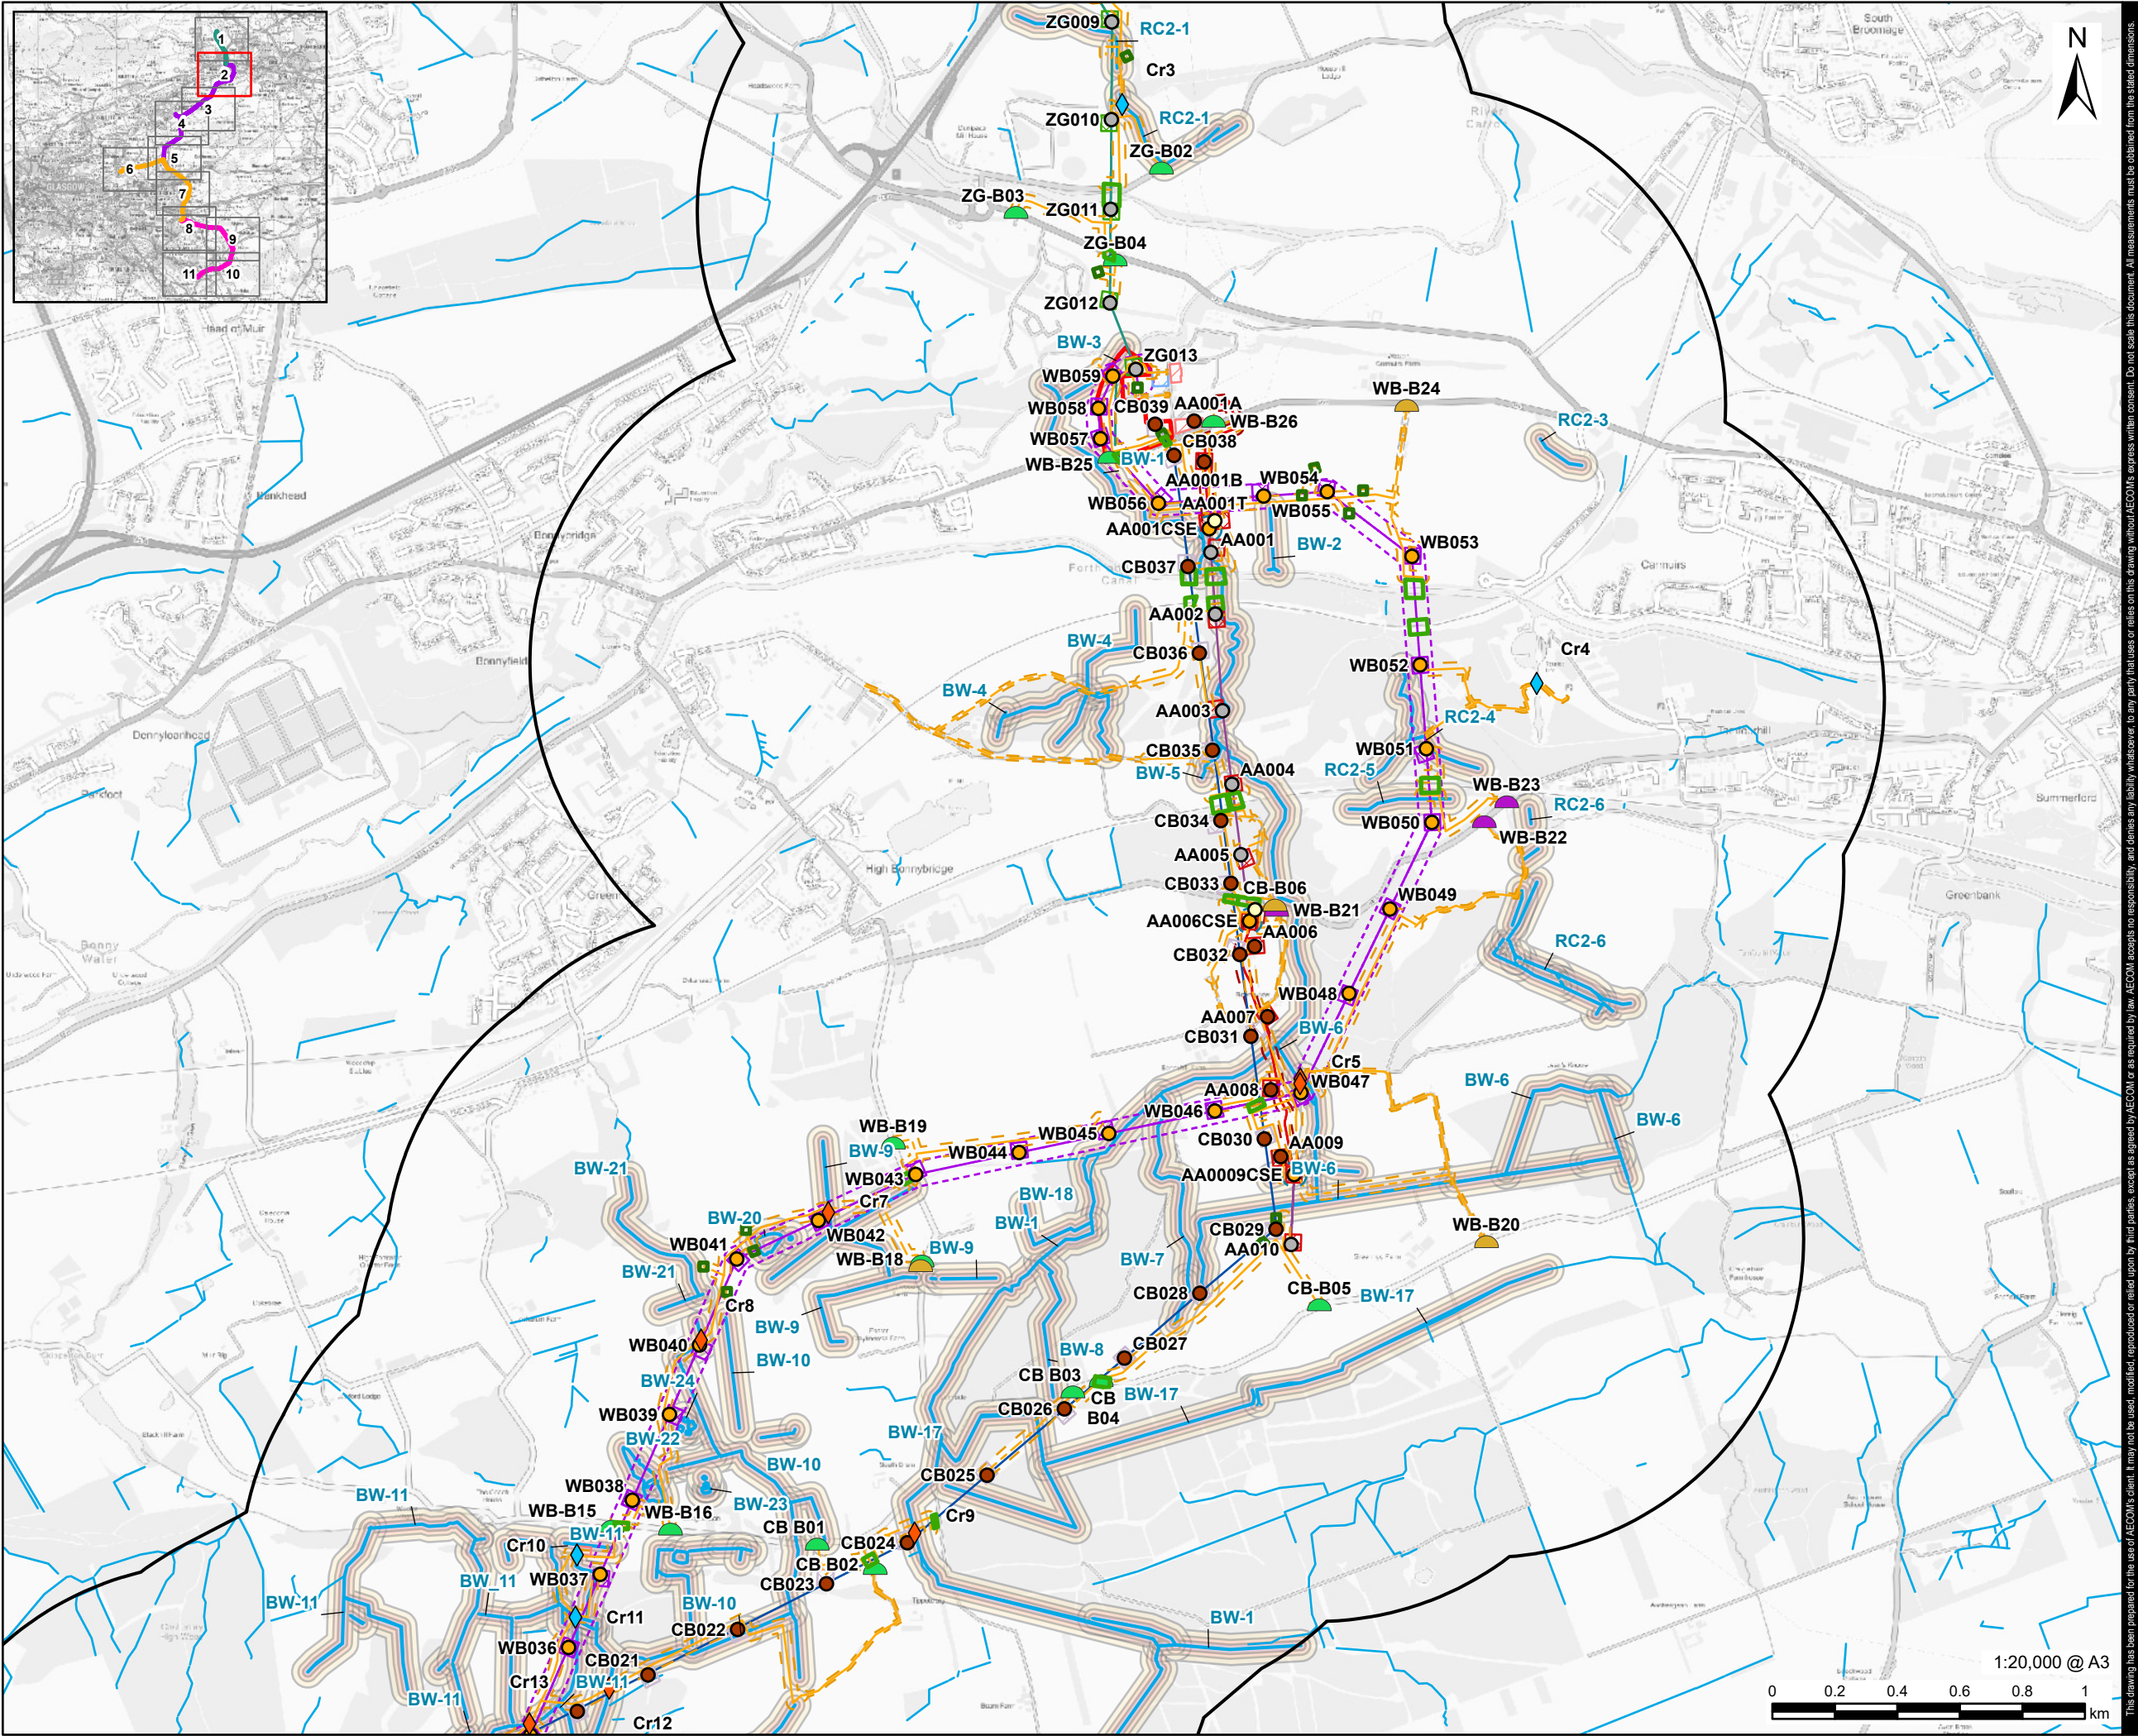

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Tower to be Removed
- Bonnybridge Substation Site Boundary
- New Build Tower Compound
- ZG Tower Compound
- CB Tower Compound
- AA Tower Compound
- New Build Overhead Line
- ZG Upgraded Overhead Line
- CB Route Removal
- AA Alignment
- AA Route Underground
- New Build Overhead Line Limit of Deviation
- AA Route Underground Limit of Deviation
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Substation Laydown Area
- Overhead Line Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Watercourse Crossing
- Existing
- New temporary
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30 m)
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE


Water Course Crossings

FIGURE NUMBER

Figure 9.4 (Sheet 2 of 11)

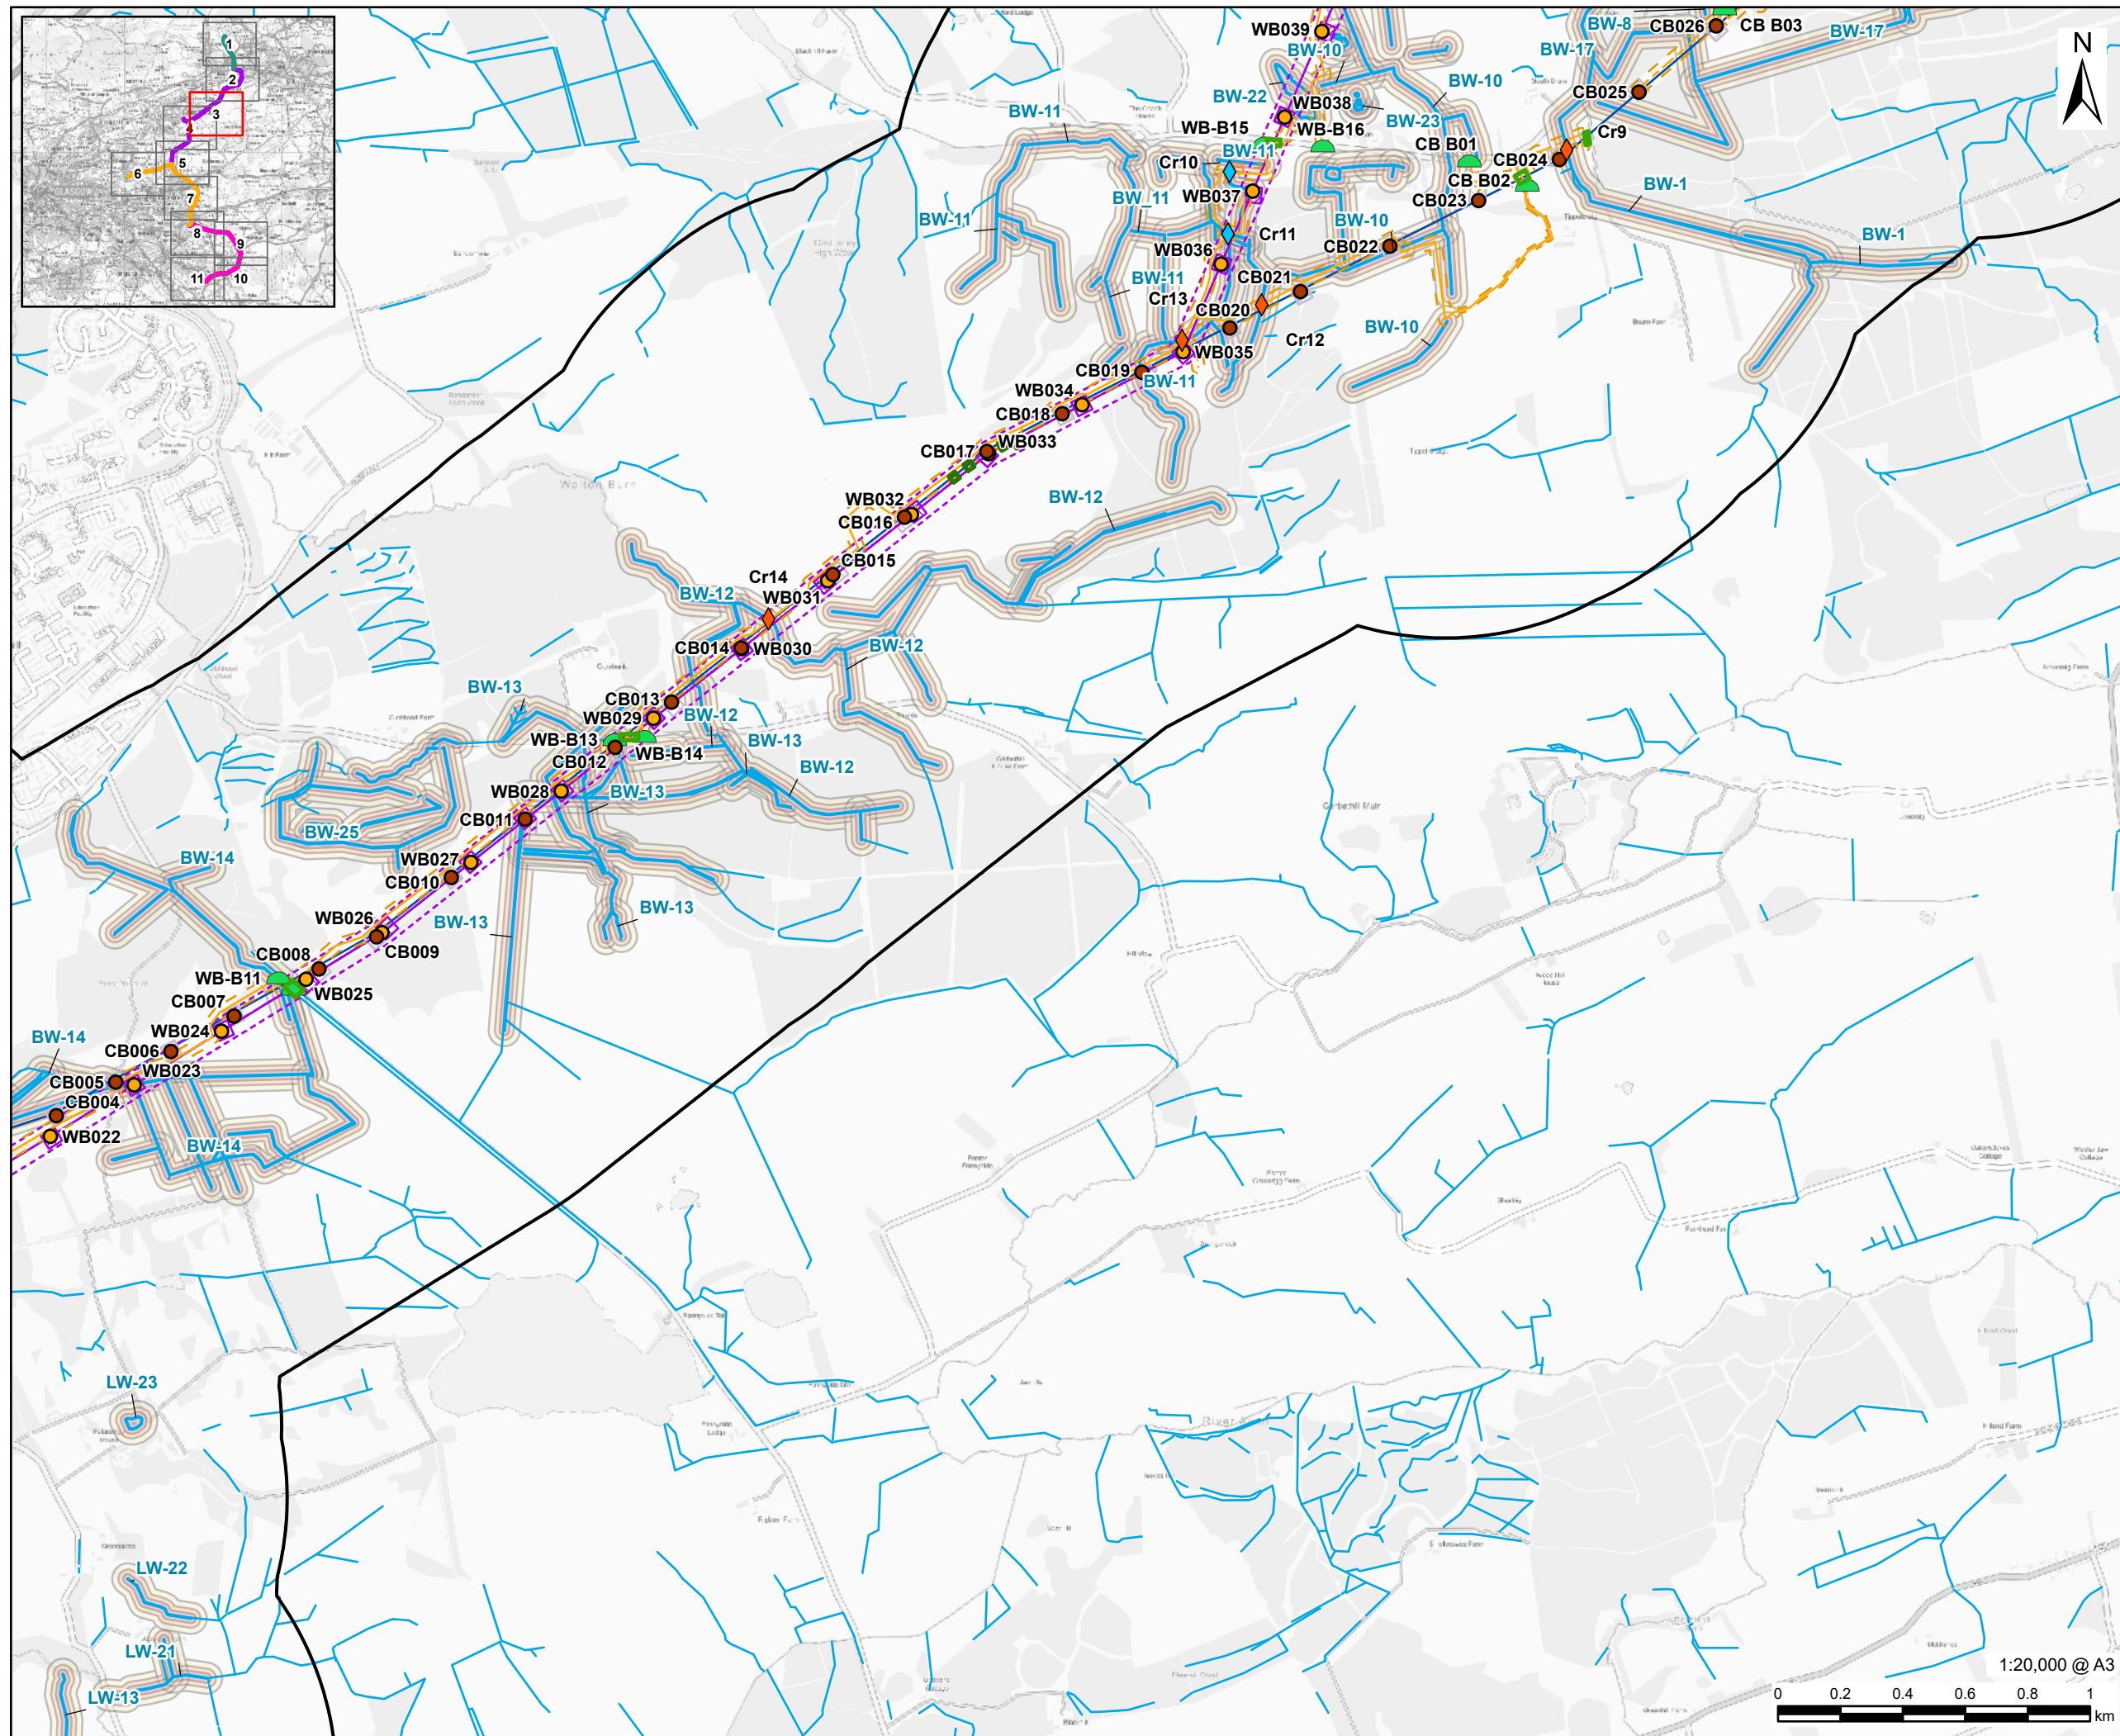

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this drawing. All measurements must be obtained from the stilled dimensions.

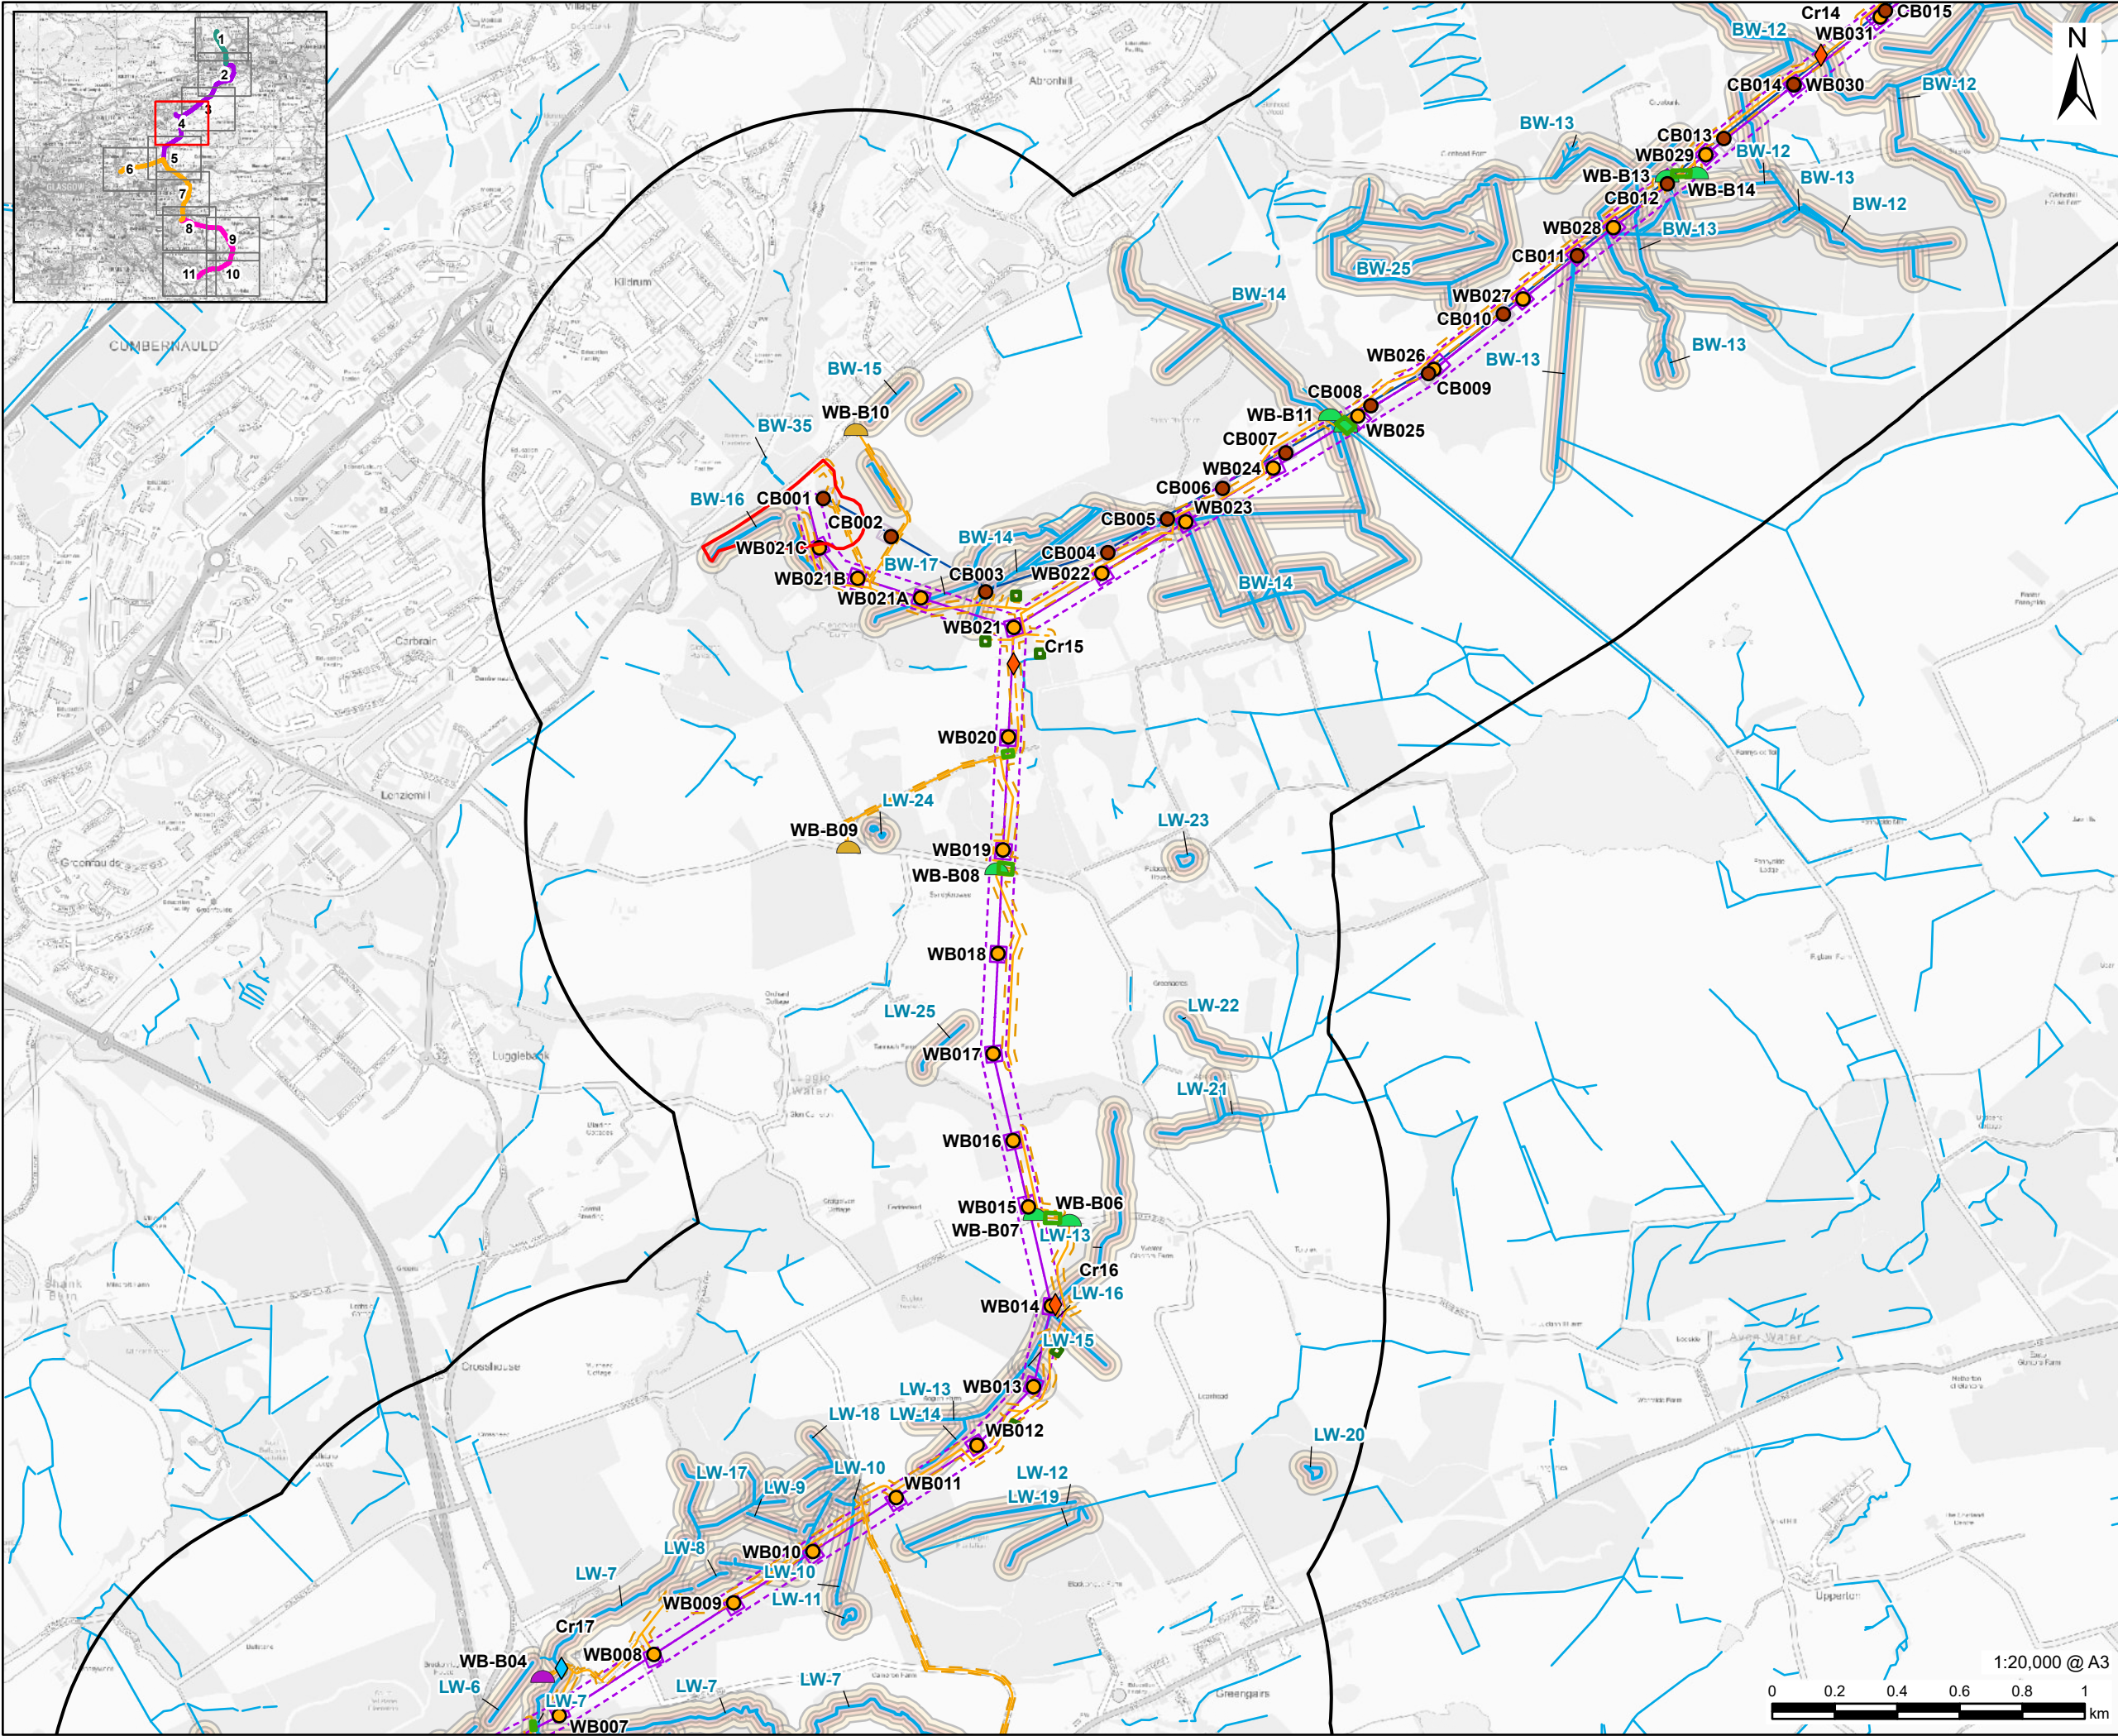

AECOM

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- New Tower
- Tower to be Removed
- Cumbernauld Substation Site Boundary
- New Build Tower Compound
- CB Tower Compound
- New Build Overhead Line
- CB Route Removal
- New Build Overhead Line Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Watercourse Crossing
- Existing
- New temporary
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30m)
- Buffer Zone (50m)



NOTES
Contains OS data © Crown copyright 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Water Course Crossings

FIGURE NUMBER
Figure 9.4 (Sheet 4 of 11)

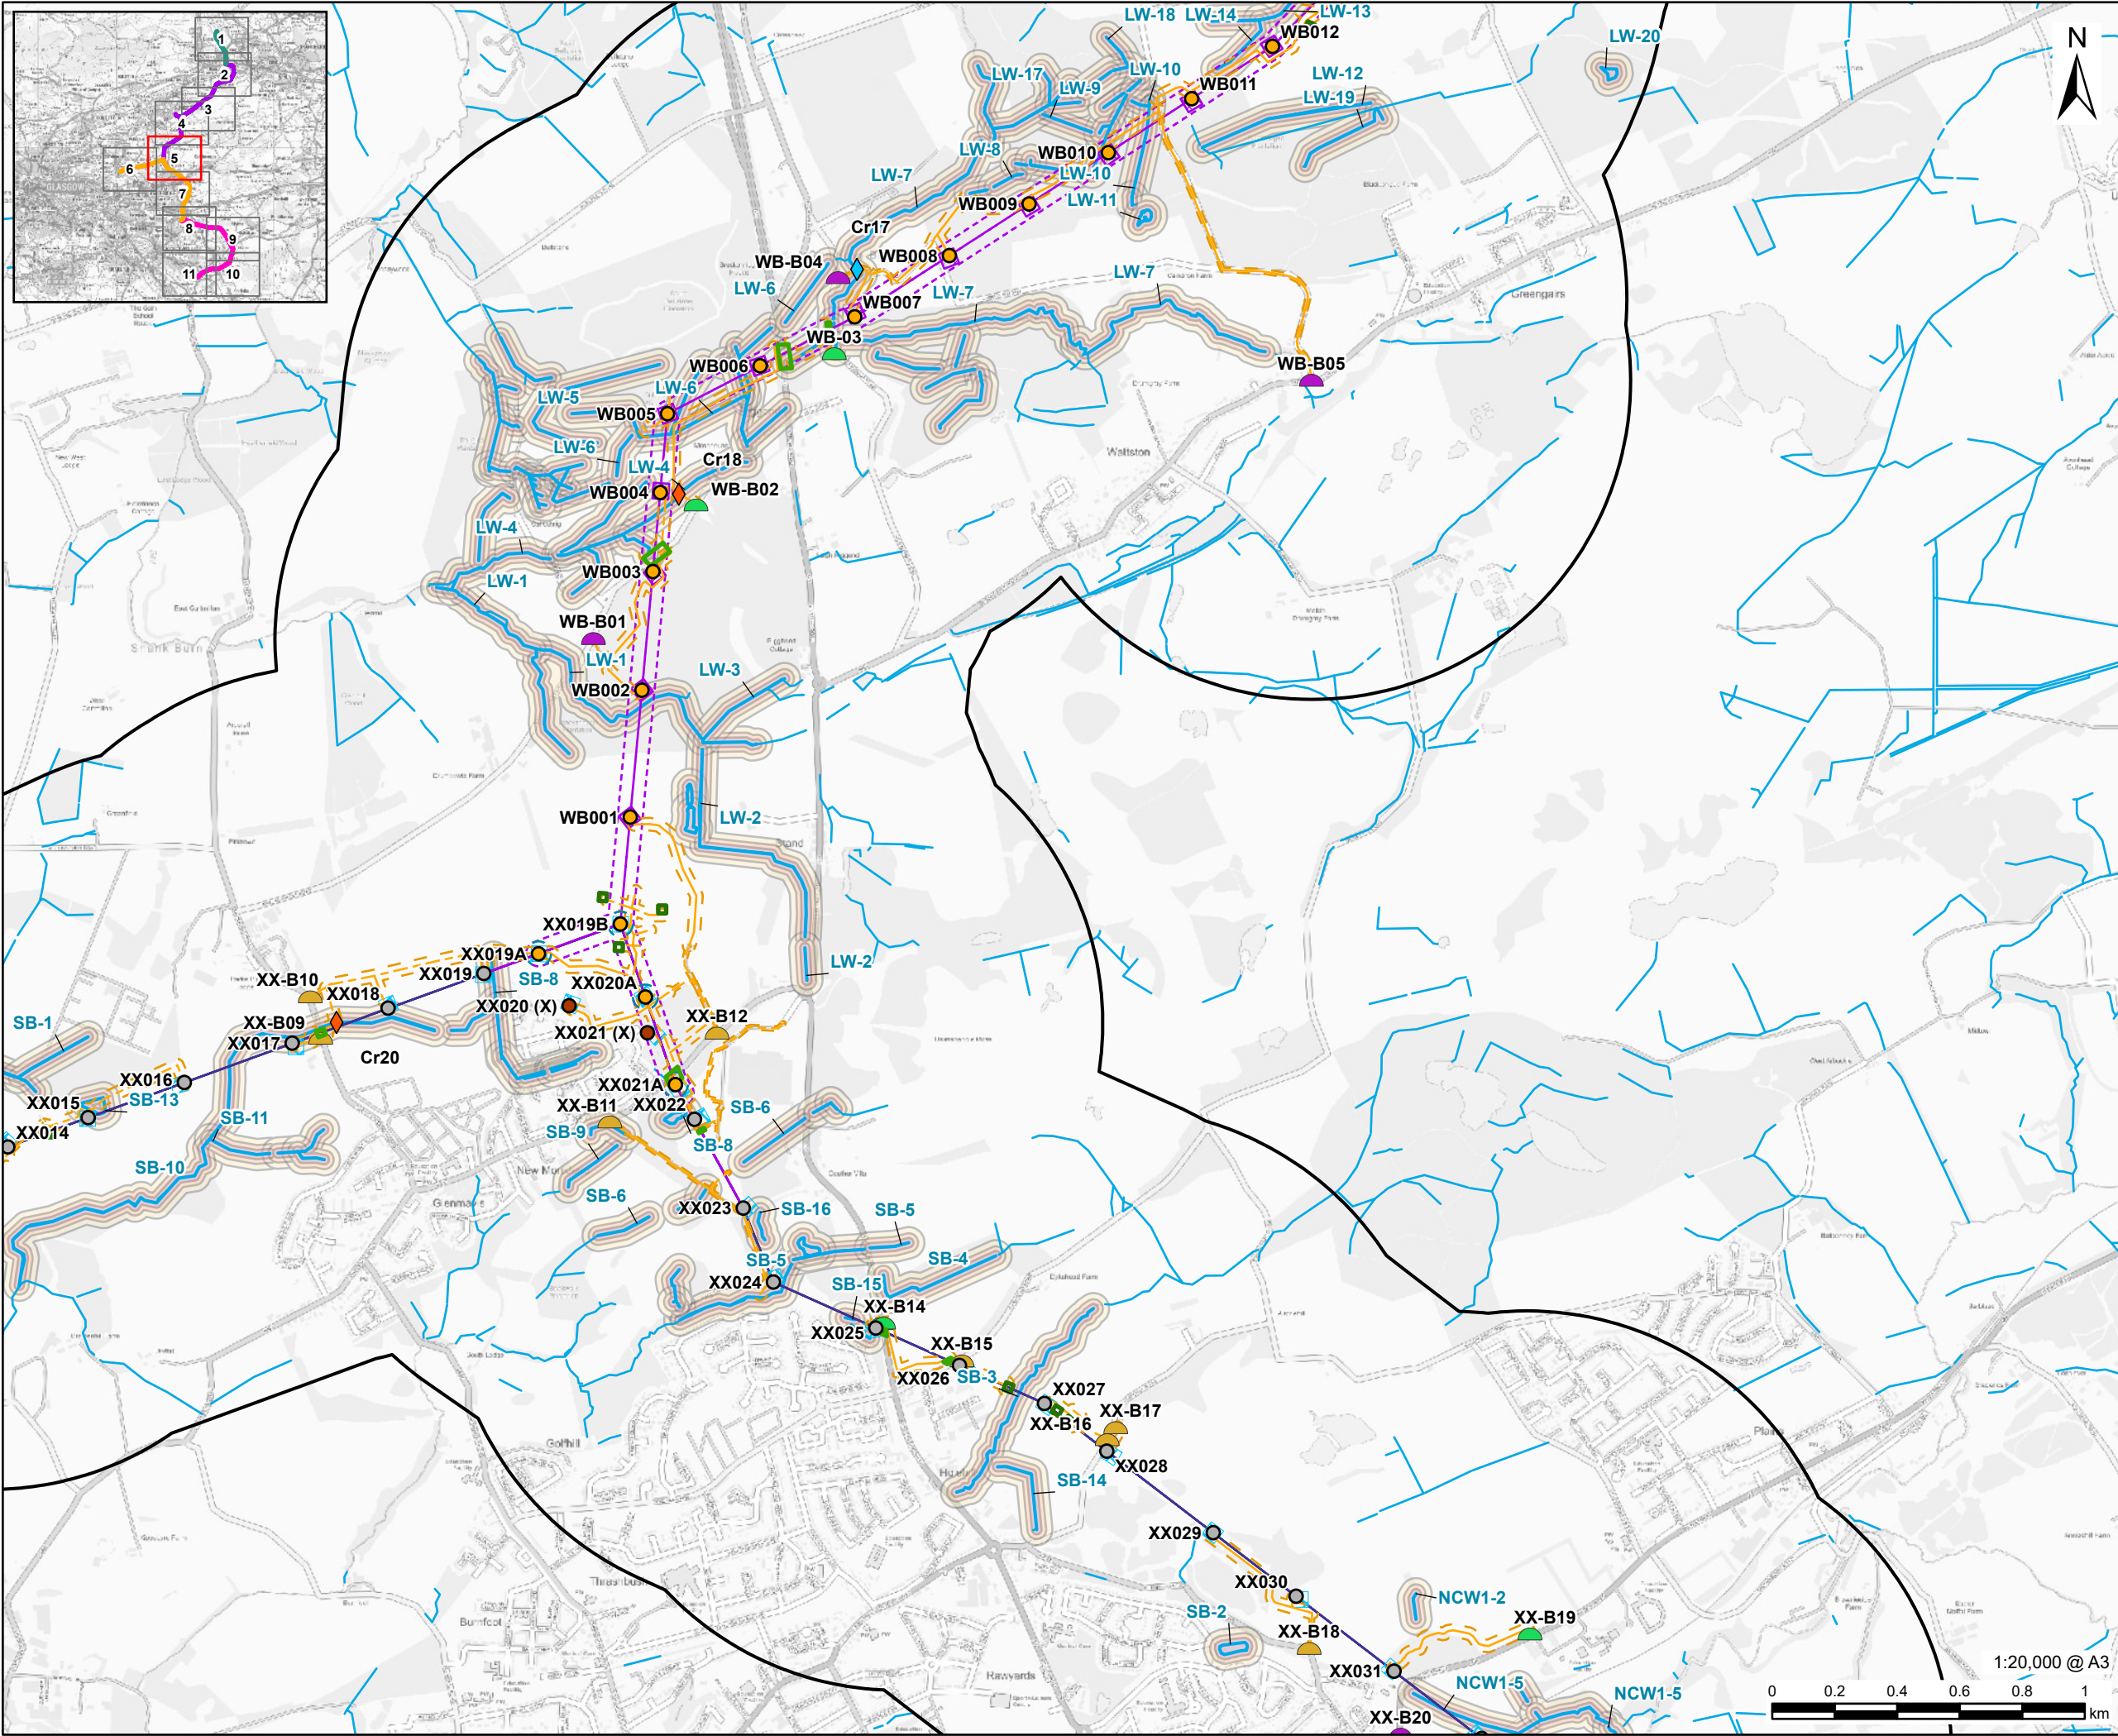

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - New Tower
 - Tower to be Removed
 - New Build Tower Compound
 - XX Tower Compound
 - New Build Overhead Line
 - XX Upgraded Overhead Line
 - New Build Overhead Line Limit of Deviation
 - New Tower Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Scaffolding
 - Pulling Position
 - Existing Bellmouth
 - New Bellmouth
 - Upgrade Bellmouth
 - 1km Study Area
 - Watercourse Crossing
 - Existing
 - New temporary
 - Surface Water Feature
 - Buffer Zone (15m)
 - Buffer Zone (30 m)
 - Buffer Zone (50 m)


NOTES
Contains OS data © Crown copyright 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Water Course Crossings

FIGURE NUMBER
Figure 9.4 (Sheet 5 of 11)

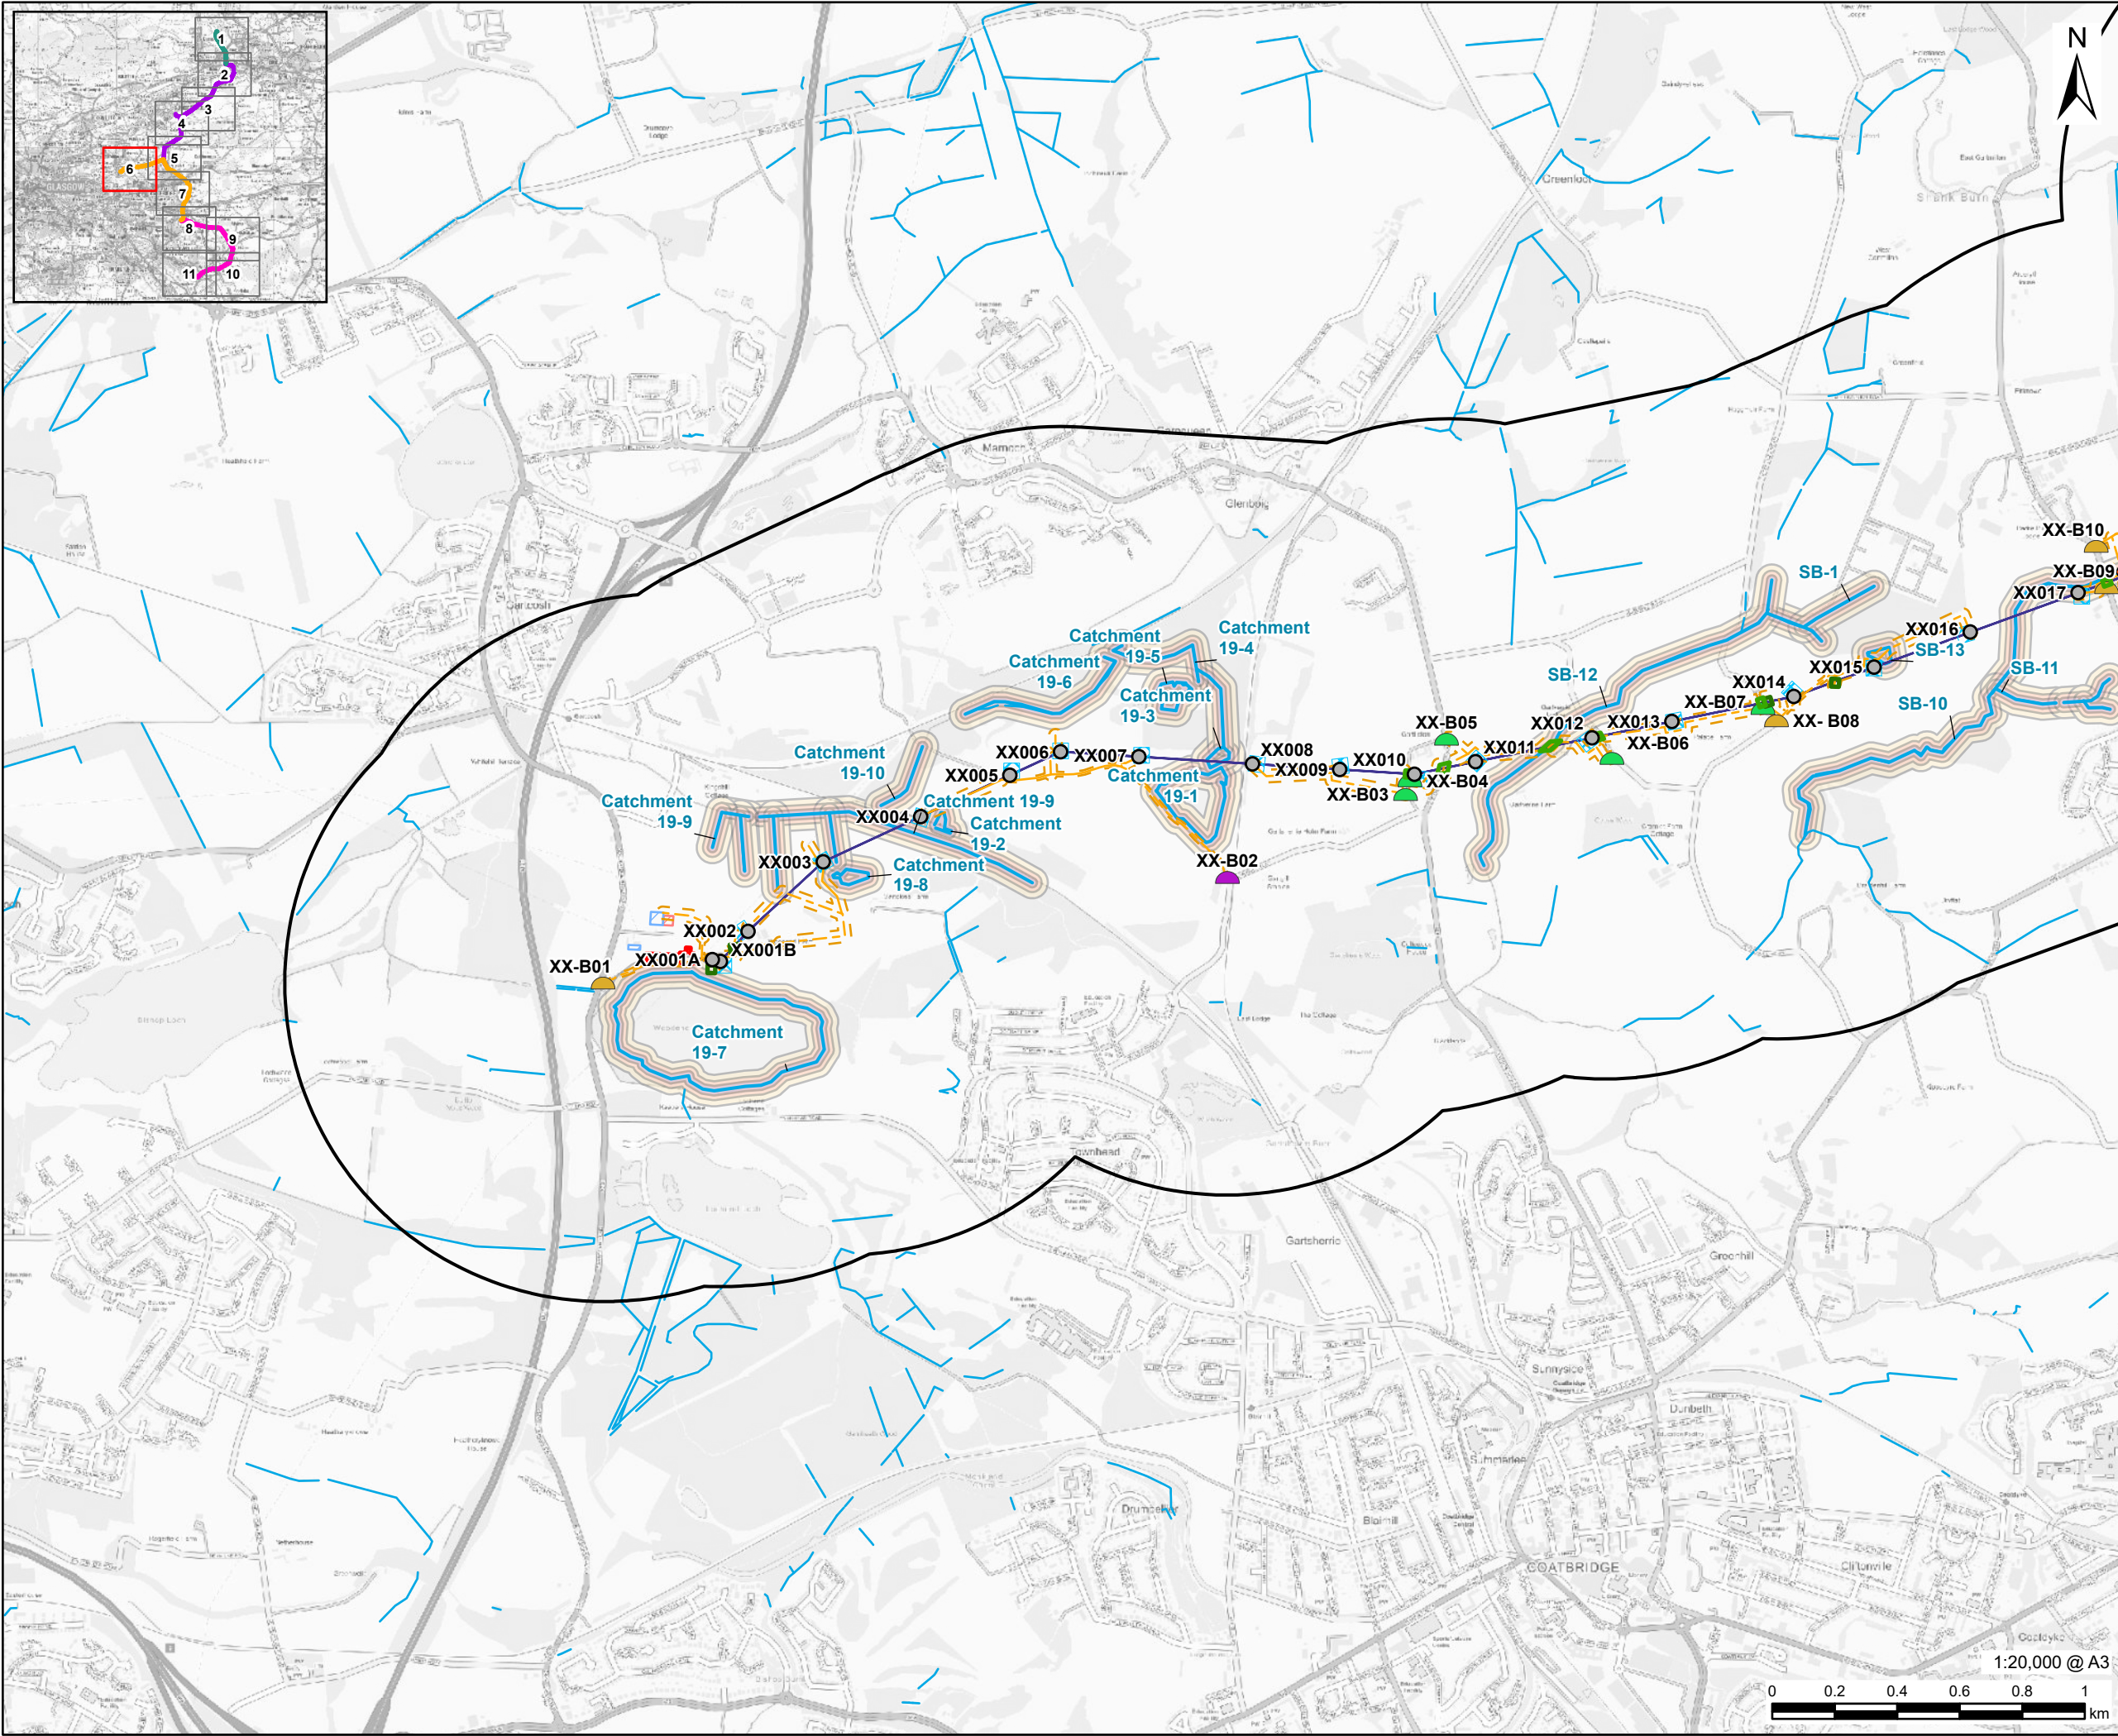

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- Easterhouse Substation Site Boundary
- XX Tower Compound
- XX Upgraded Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Substation Laydown Area
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Watercourse Crossing
- New temporary
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30 m)
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Water Course Crossings

FIGURE NUMBER

Figure 9.4 (Sheet 6 of 11)

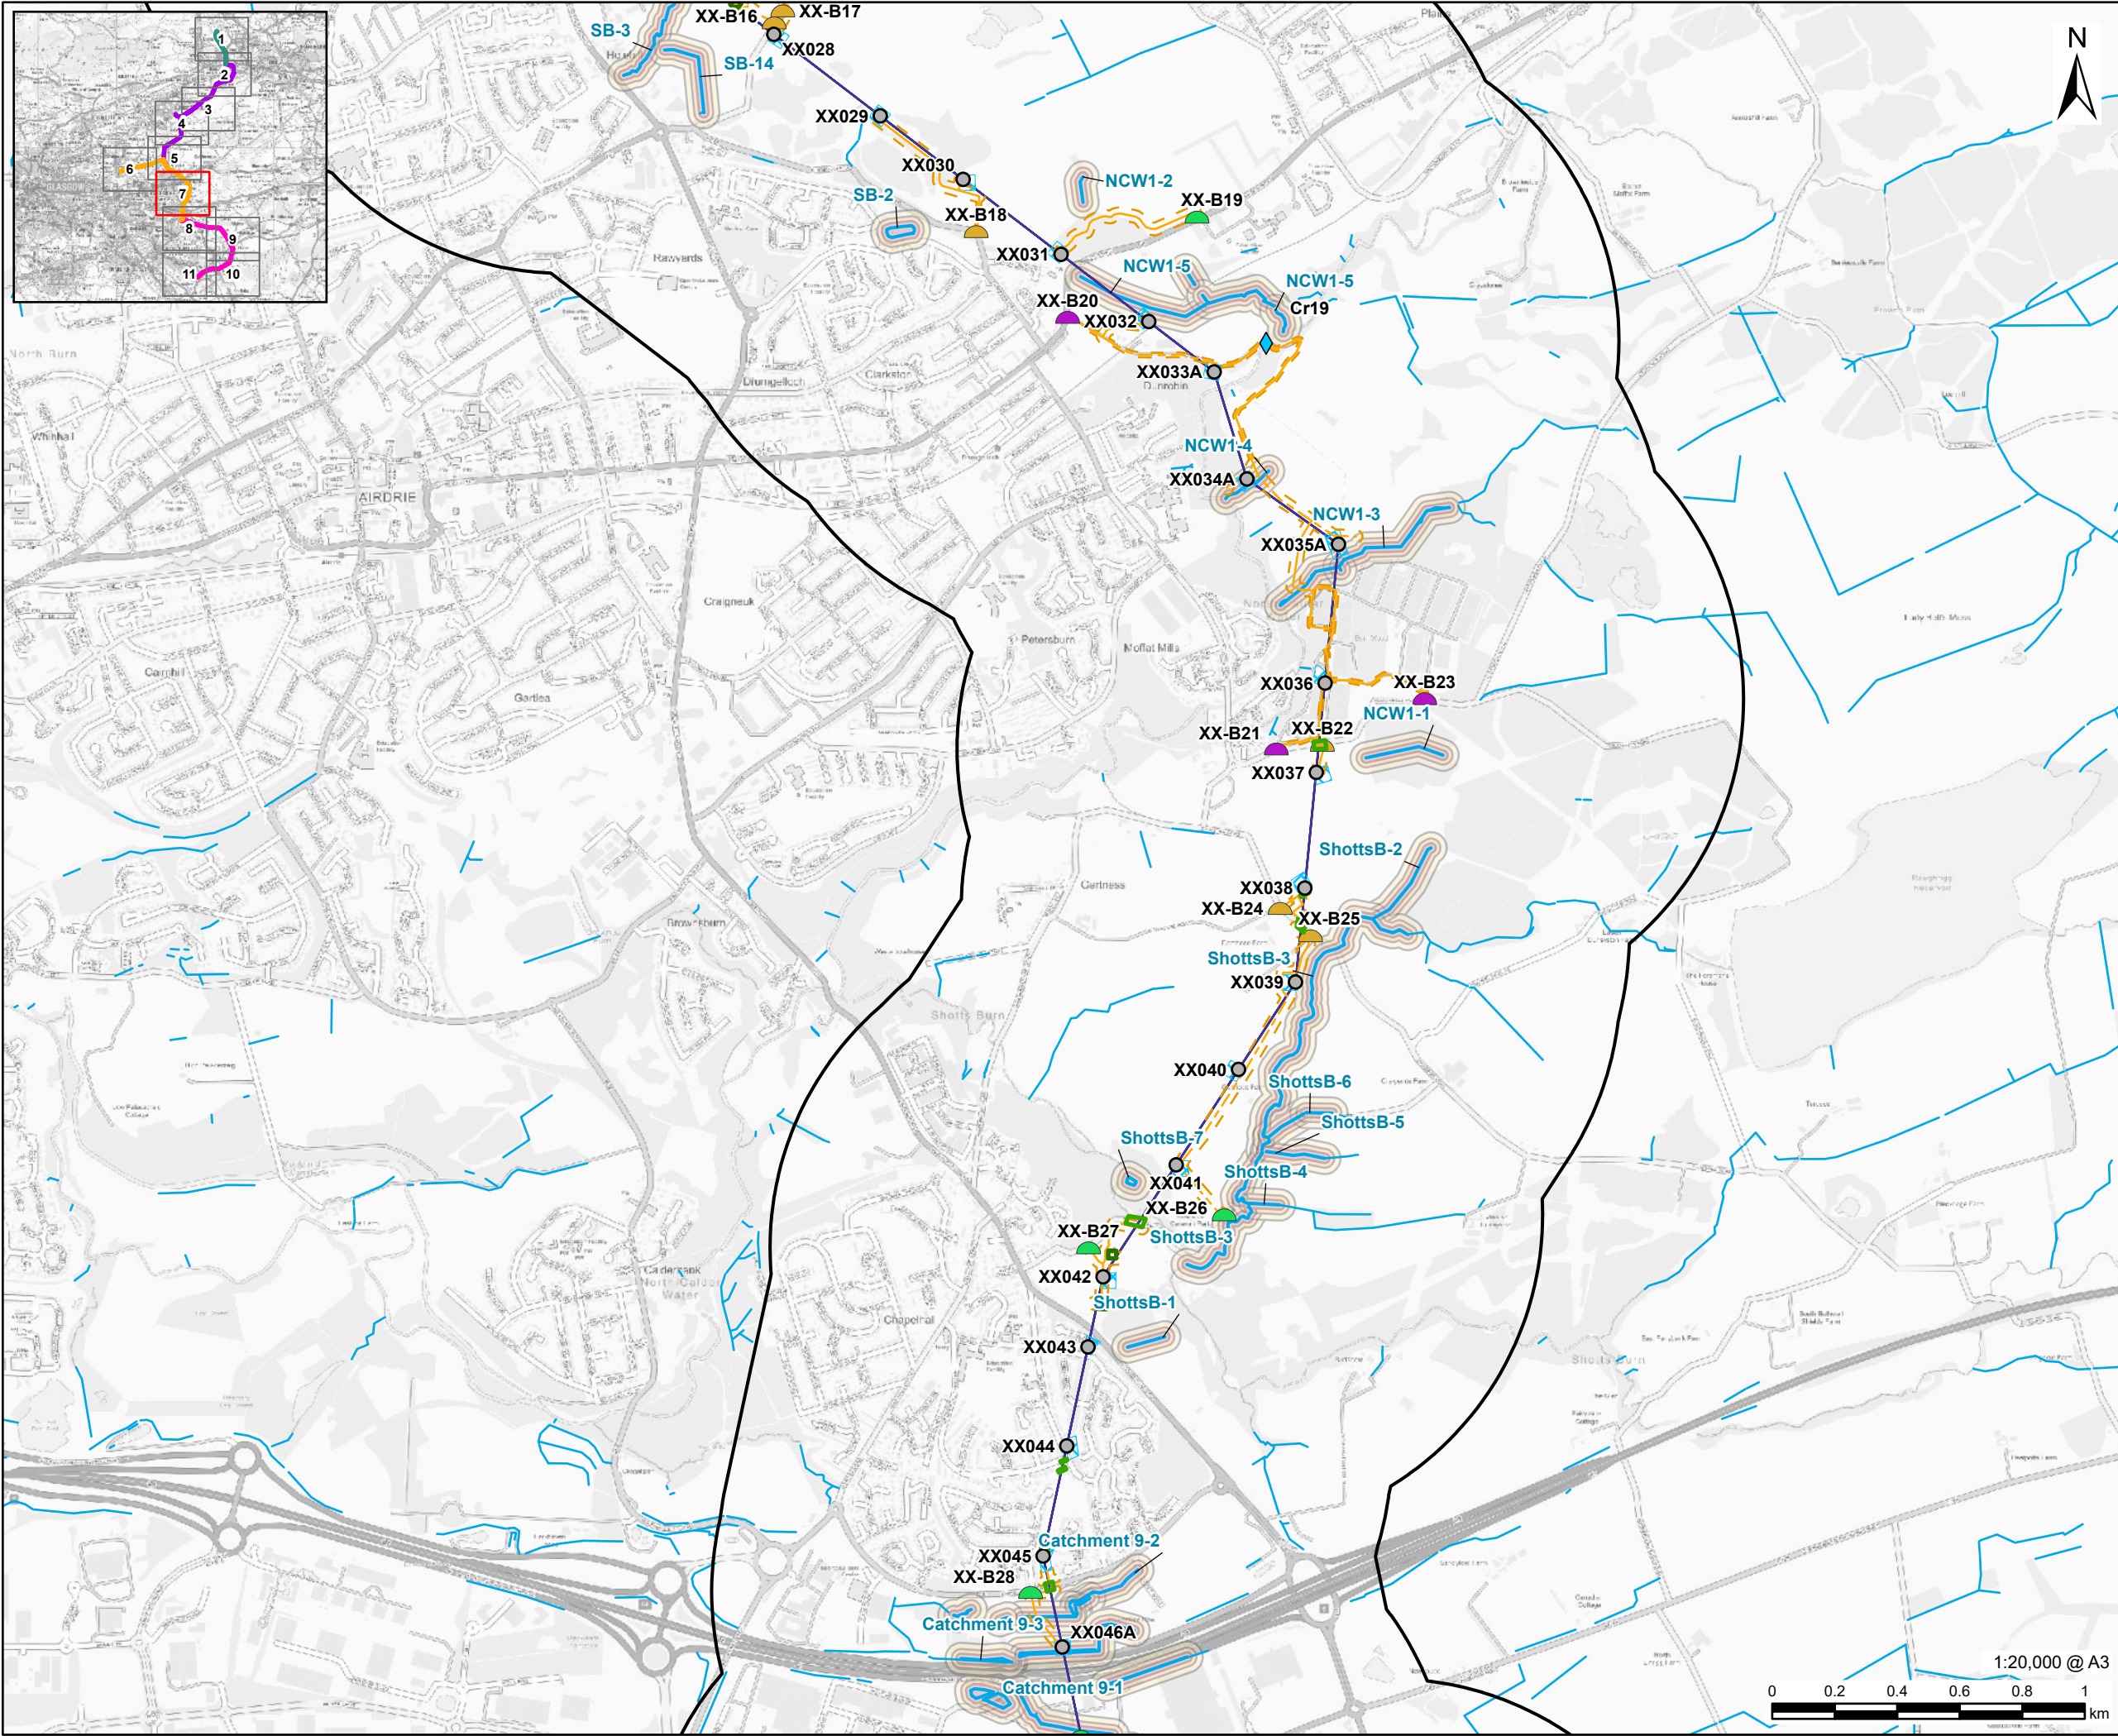

AECOM

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XX Tower Compound
- XX Upgraded Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Watercourse Crossing
- Existing
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30 m)
- Buffer Zone (50 m)

NOTES
Contains OS data © Crown copyright 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788


FIGURE TITLE
Water Course Crossings

FIGURE NUMBER
Figure 9.4 (Sheet 7 of 11)

0 0.2 0.4 0.6 0.8 1 km

1:20,000 @ A3

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

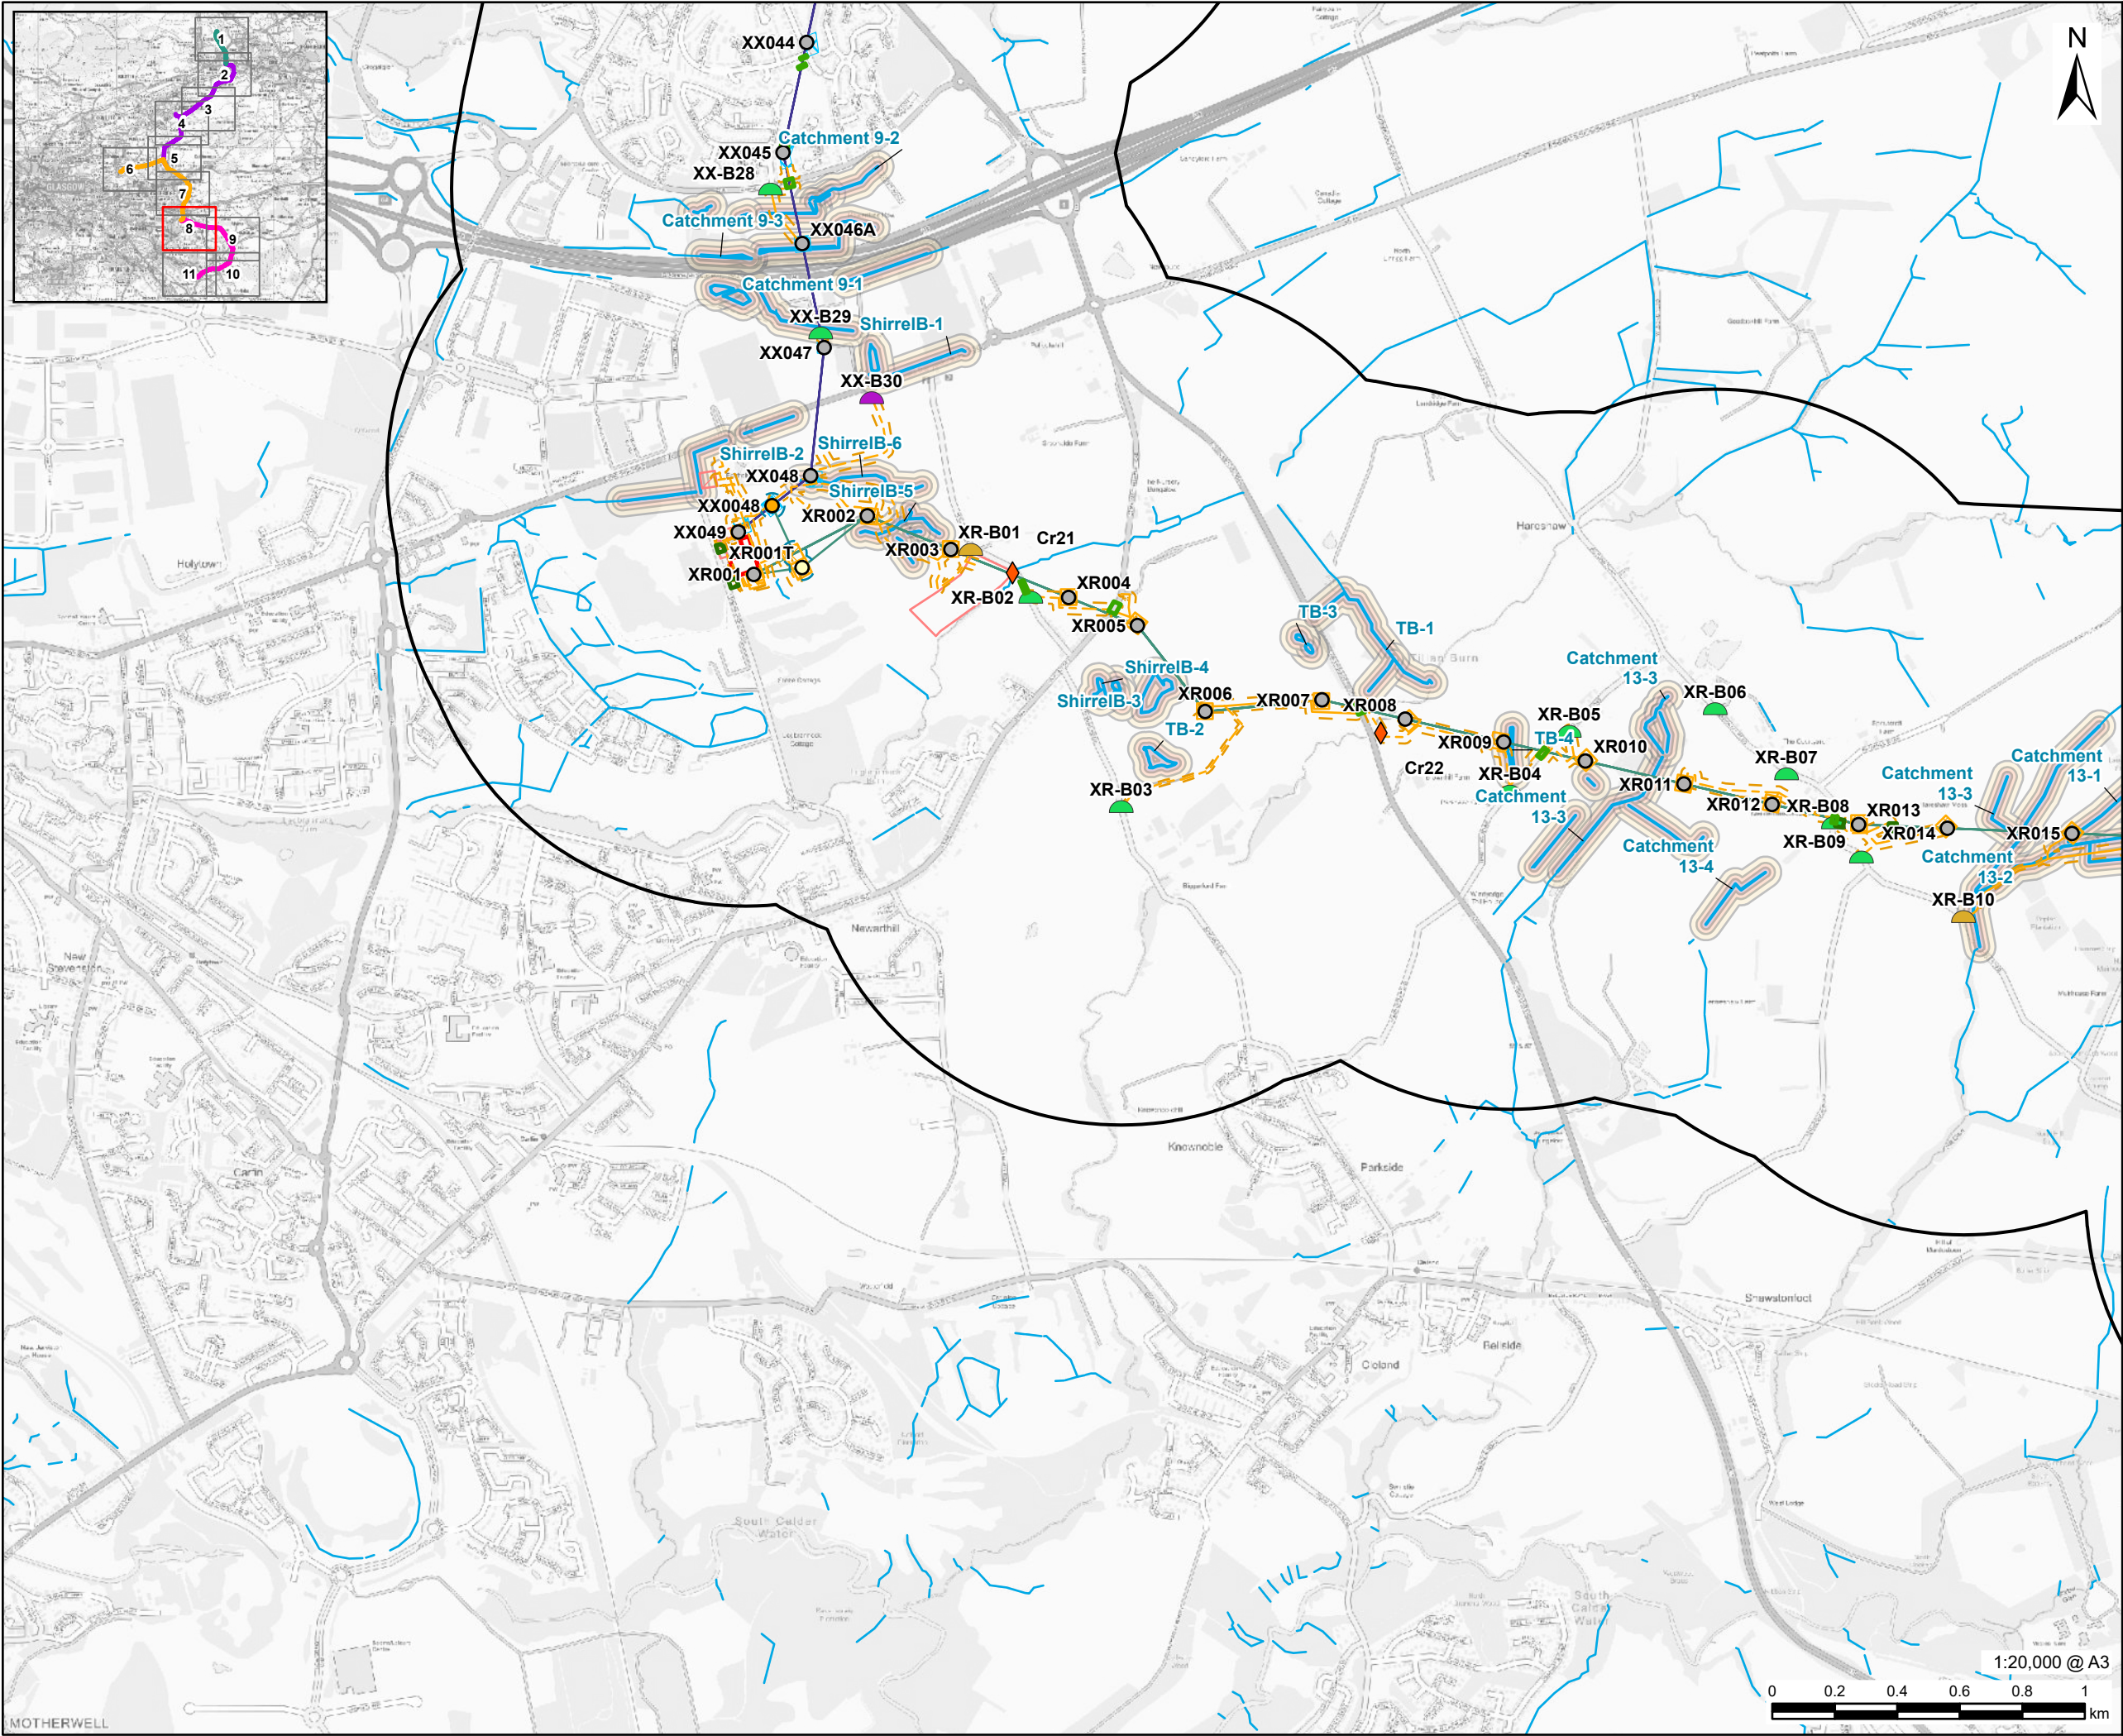

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- New Tower
- Temporary Tower
- Newarthill Substation Site Boundary
- XR Tower Compound
- XX Tower Compound
- XR Upgraded Overhead Line
- XX Upgraded Overhead Line
- New Tower Limit of Deviation
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Overhead Line Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Watercourse Crossing
- New temporary
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30 m)
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Water Course Crossings

FIGURE NUMBER

Figure 9.4 (Sheet 8 of 11)

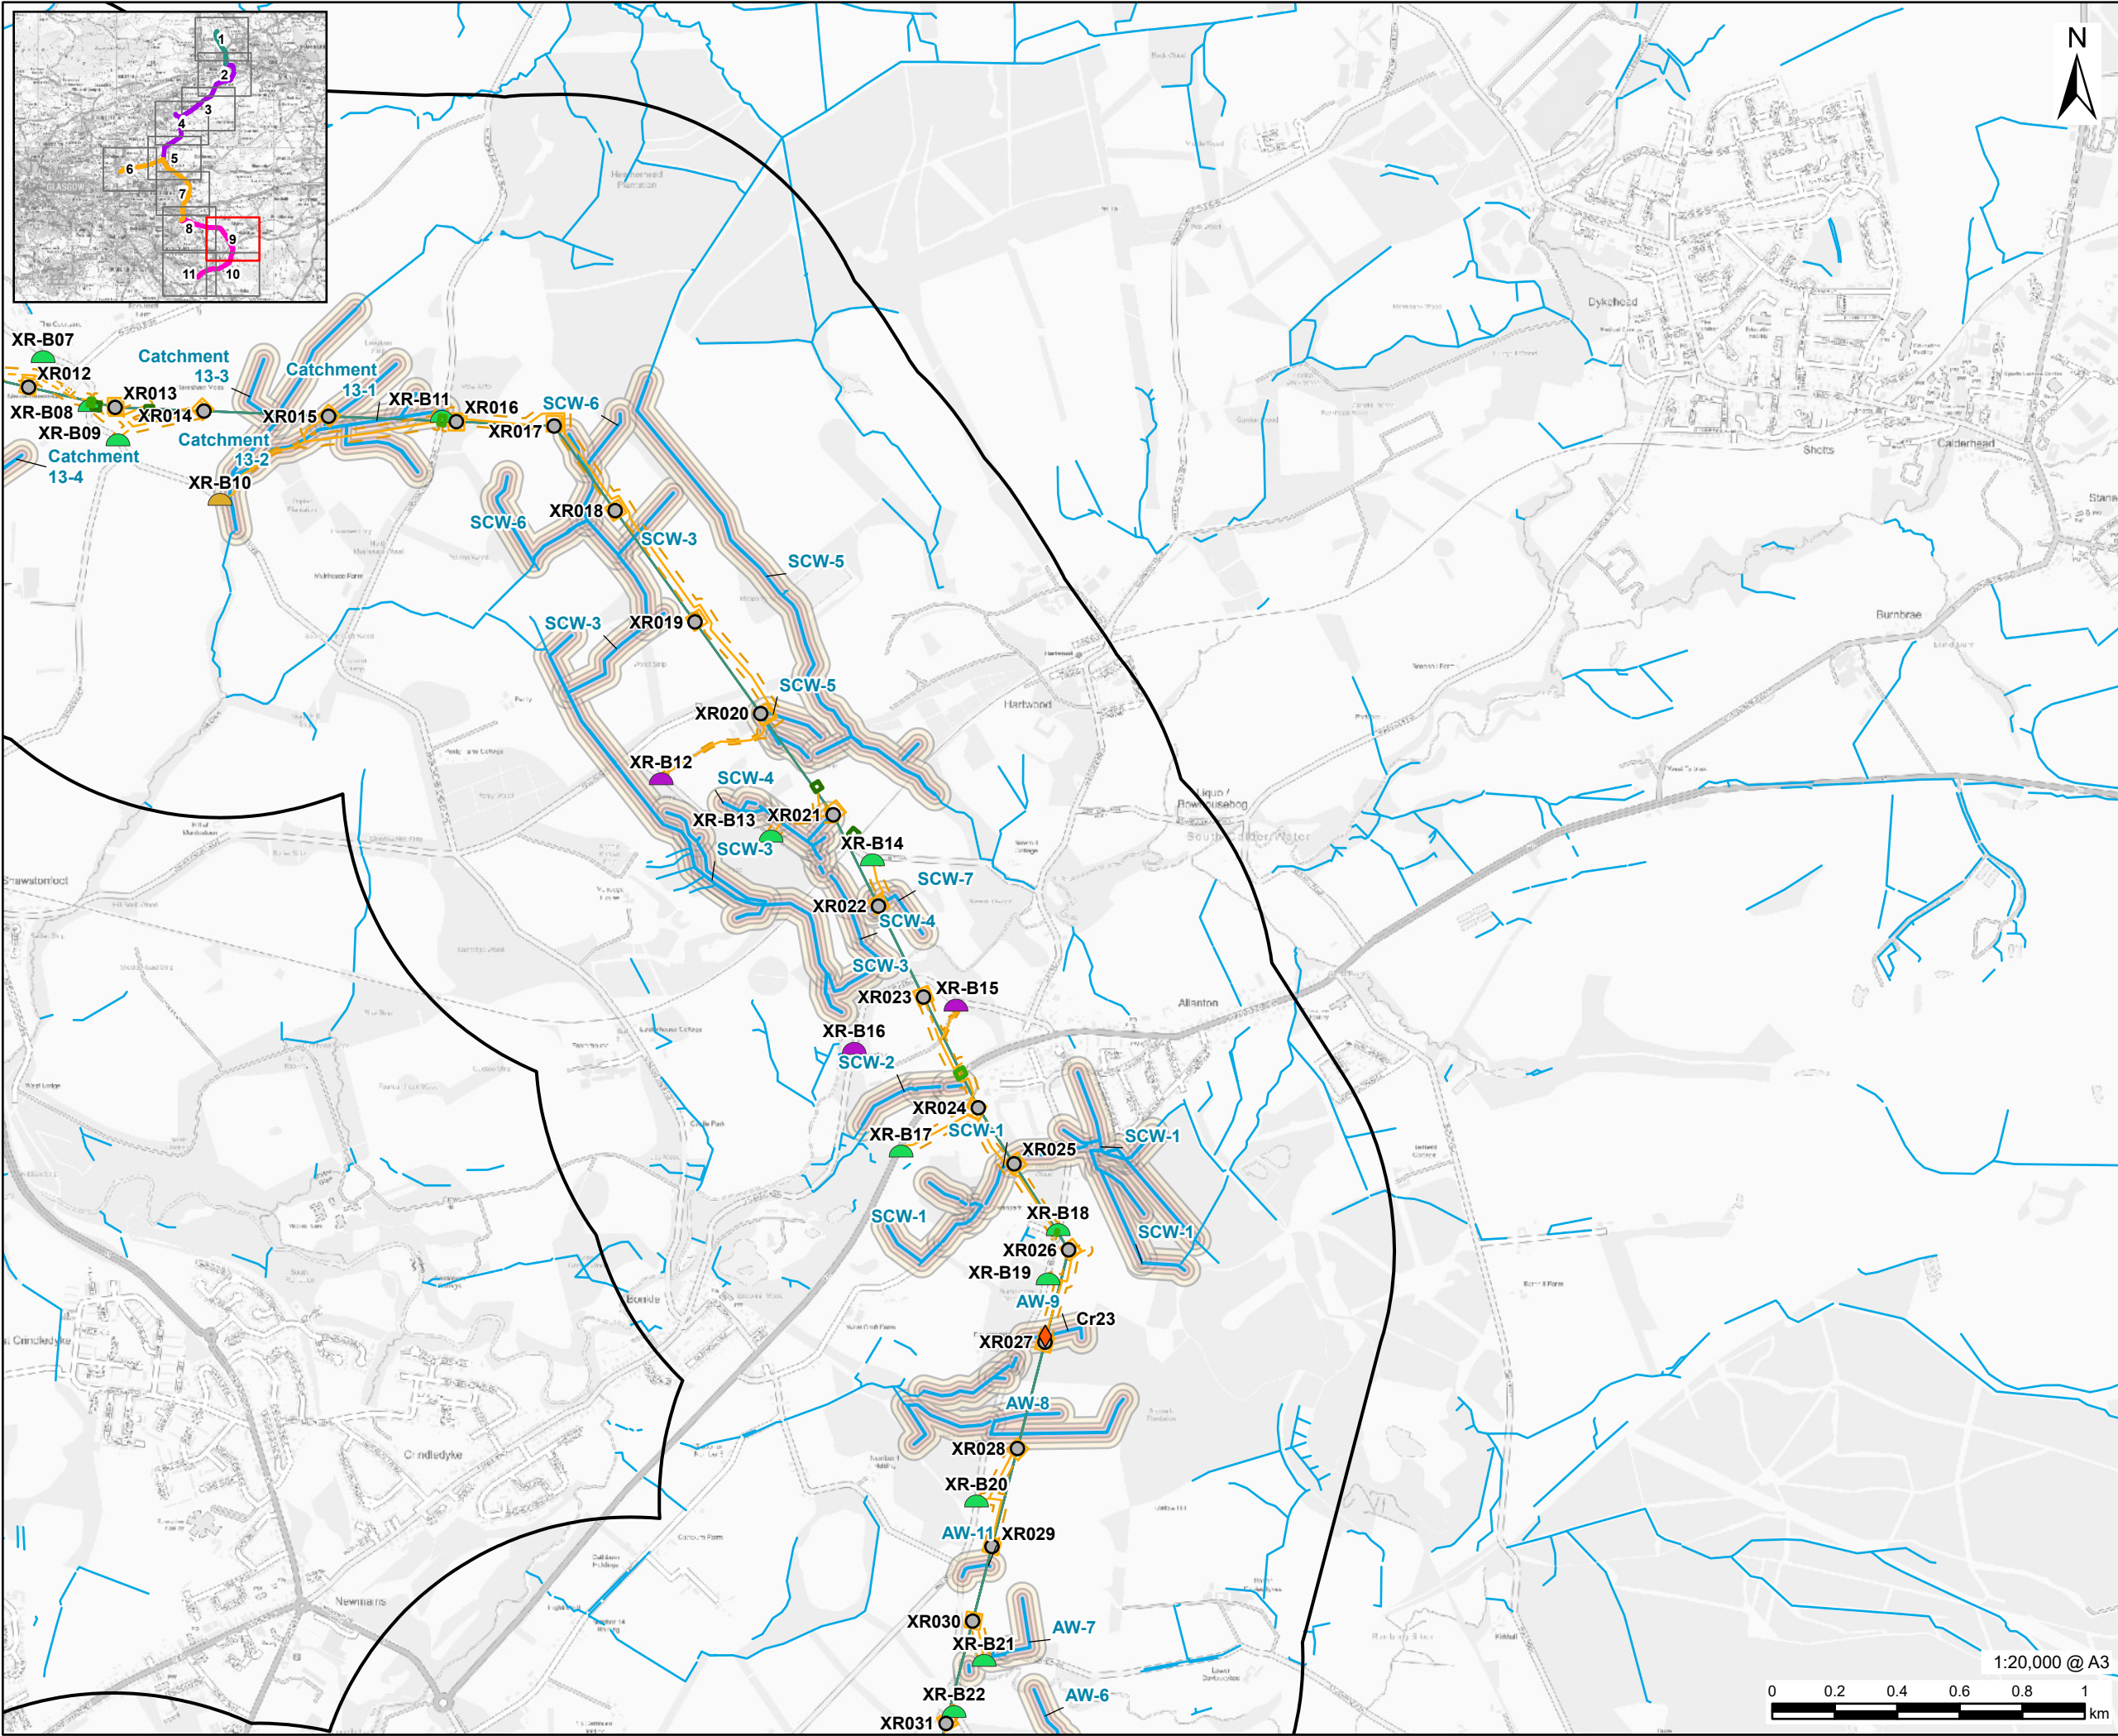

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- XR Tower Compound
- XR Uprated Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Watercourse Crossing
- New temporary
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30 m)
- Buffer Zone (50 m)

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER


60602788

FIGURE TITLE

Water Course Crossings

FIGURE NUMBER

Figure 9.4 (Sheet 9 of 11)

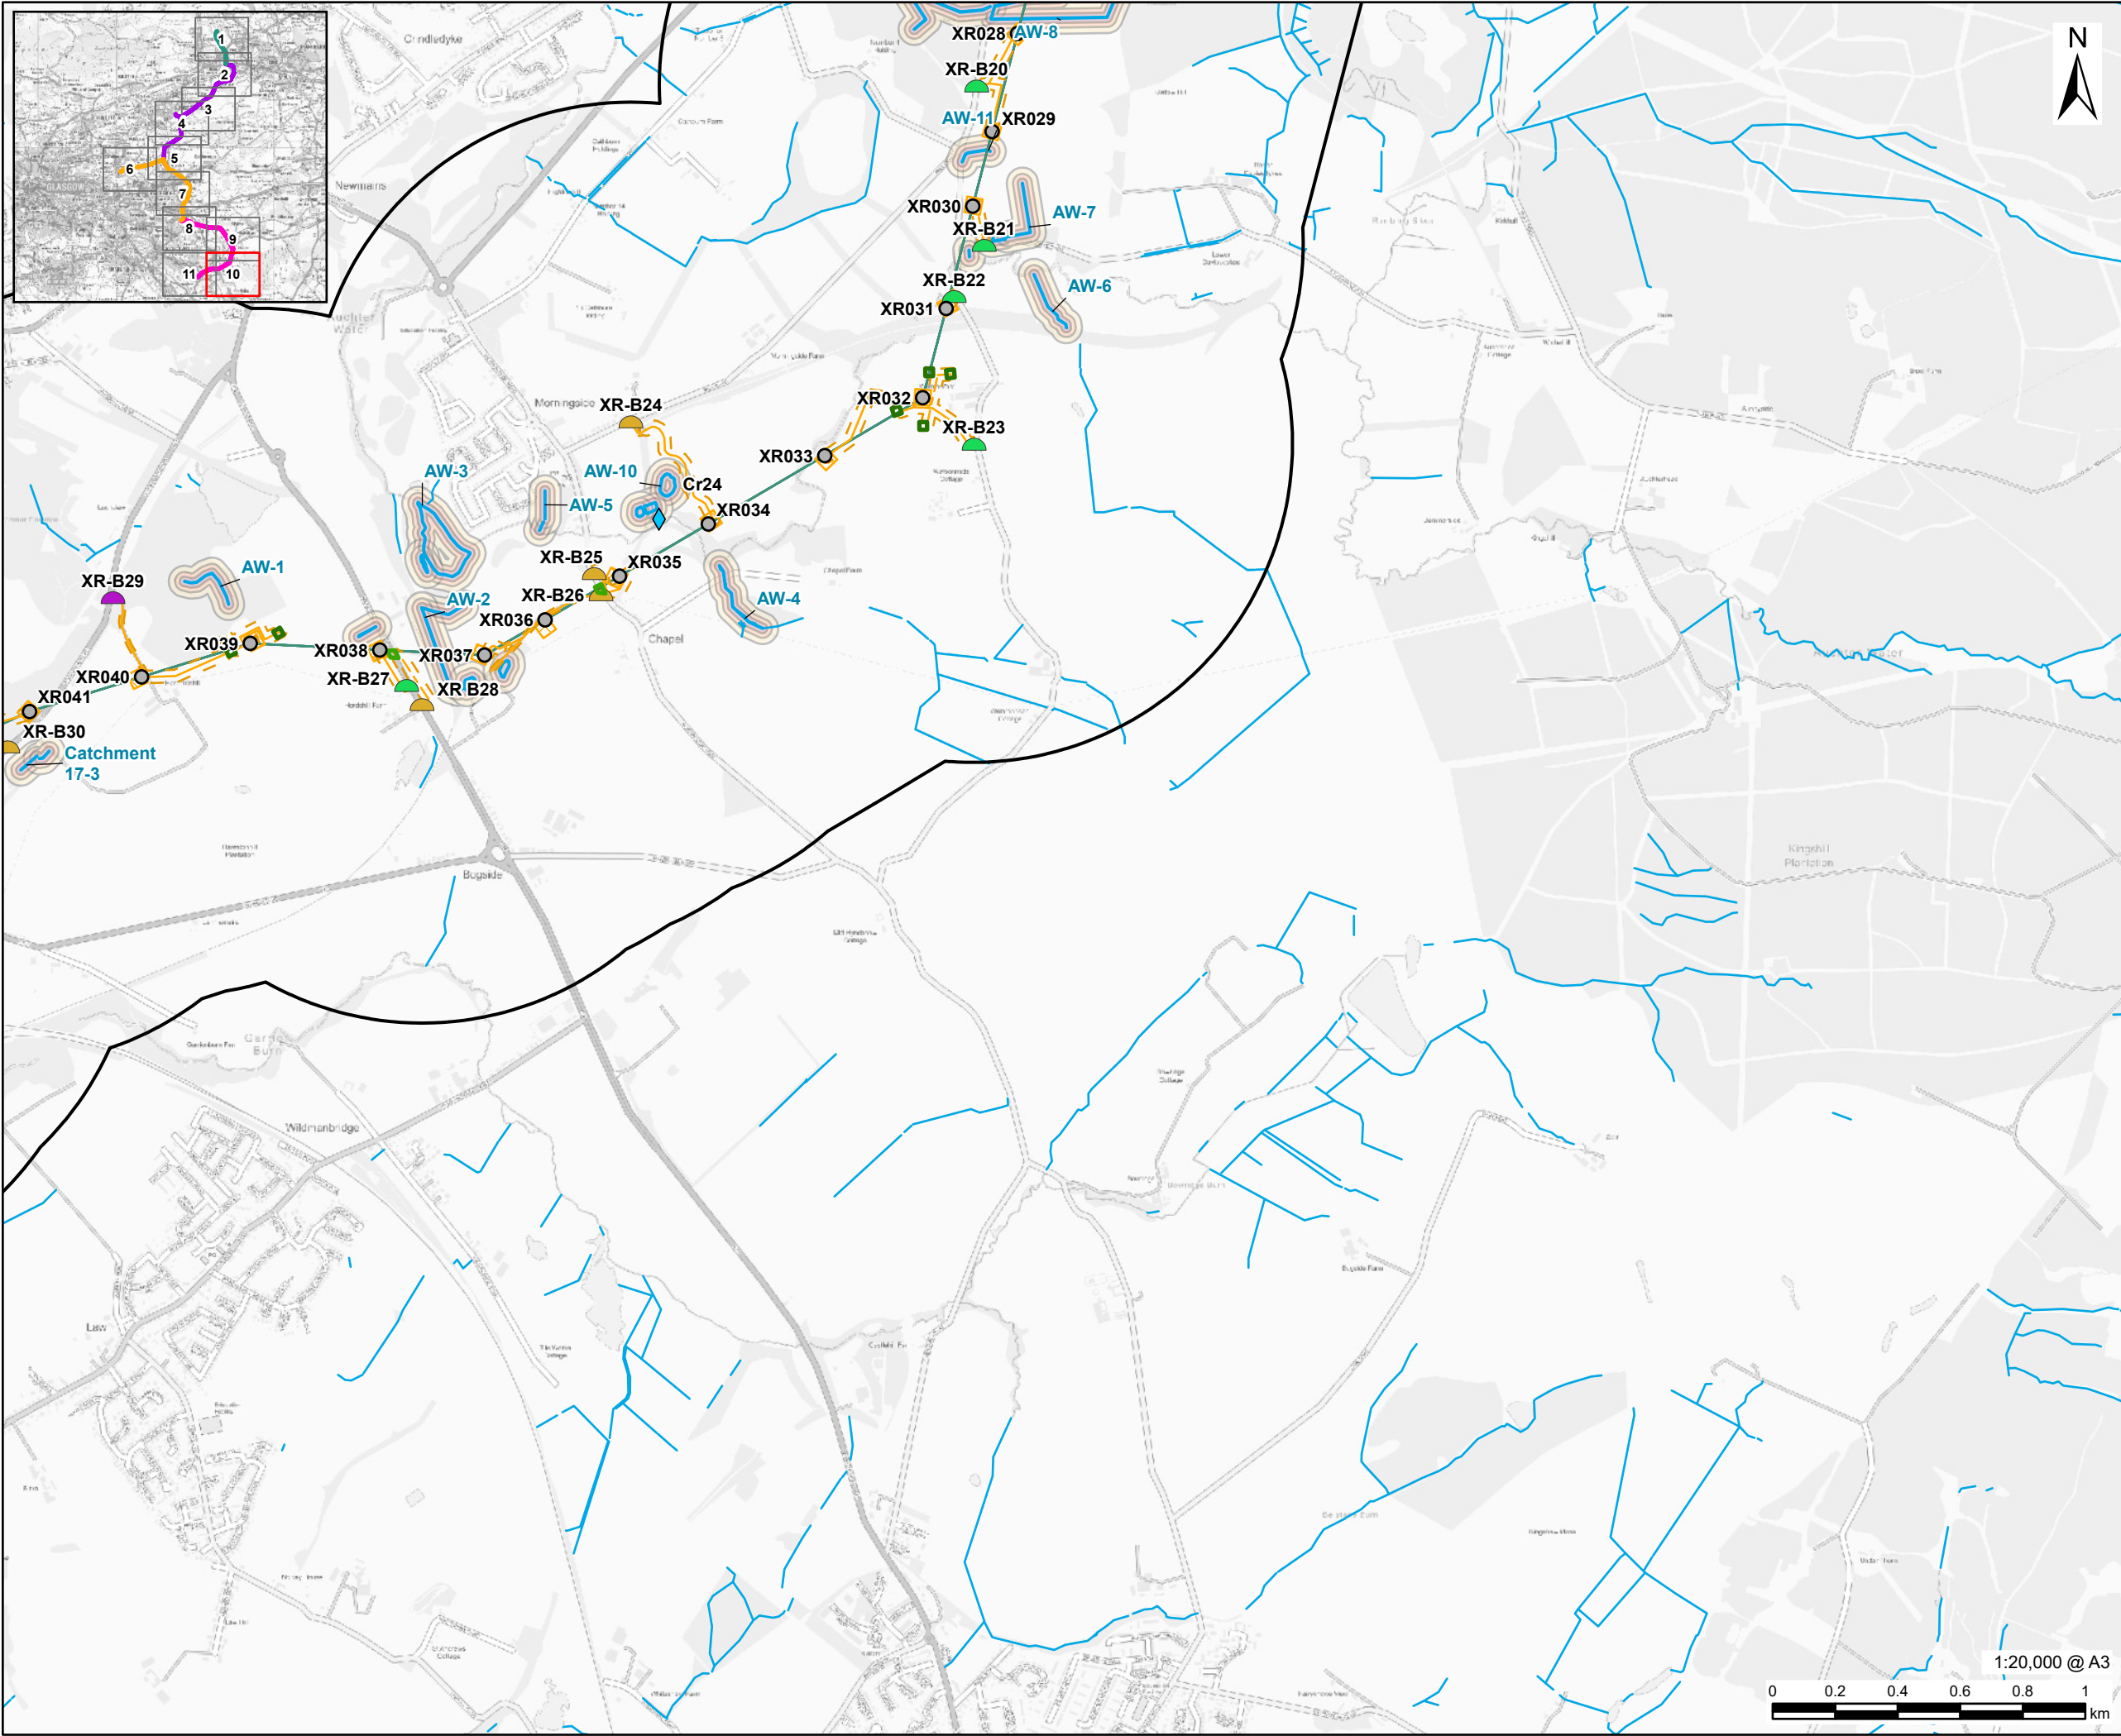

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - XR Tower Compound
 - XR Uprated Overhead Line
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Scaffolding
 - Pulling Position
 - Existing Bellmouth
 - New Bellmouth
 - Upgrade Bellmouth
 - 1km Study Area
 - Watercourse Crossing
 - Existing
 - Surface Water Feature
 - Buffer Zone (15m)
 - Buffer Zone (30 m)
 - Buffer Zone (50 m)


NOTES
Contains OS data © Crown copyright 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Water Course Crossings

FIGURE NUMBER
Figure 9.4 (Sheet 10 of 11)

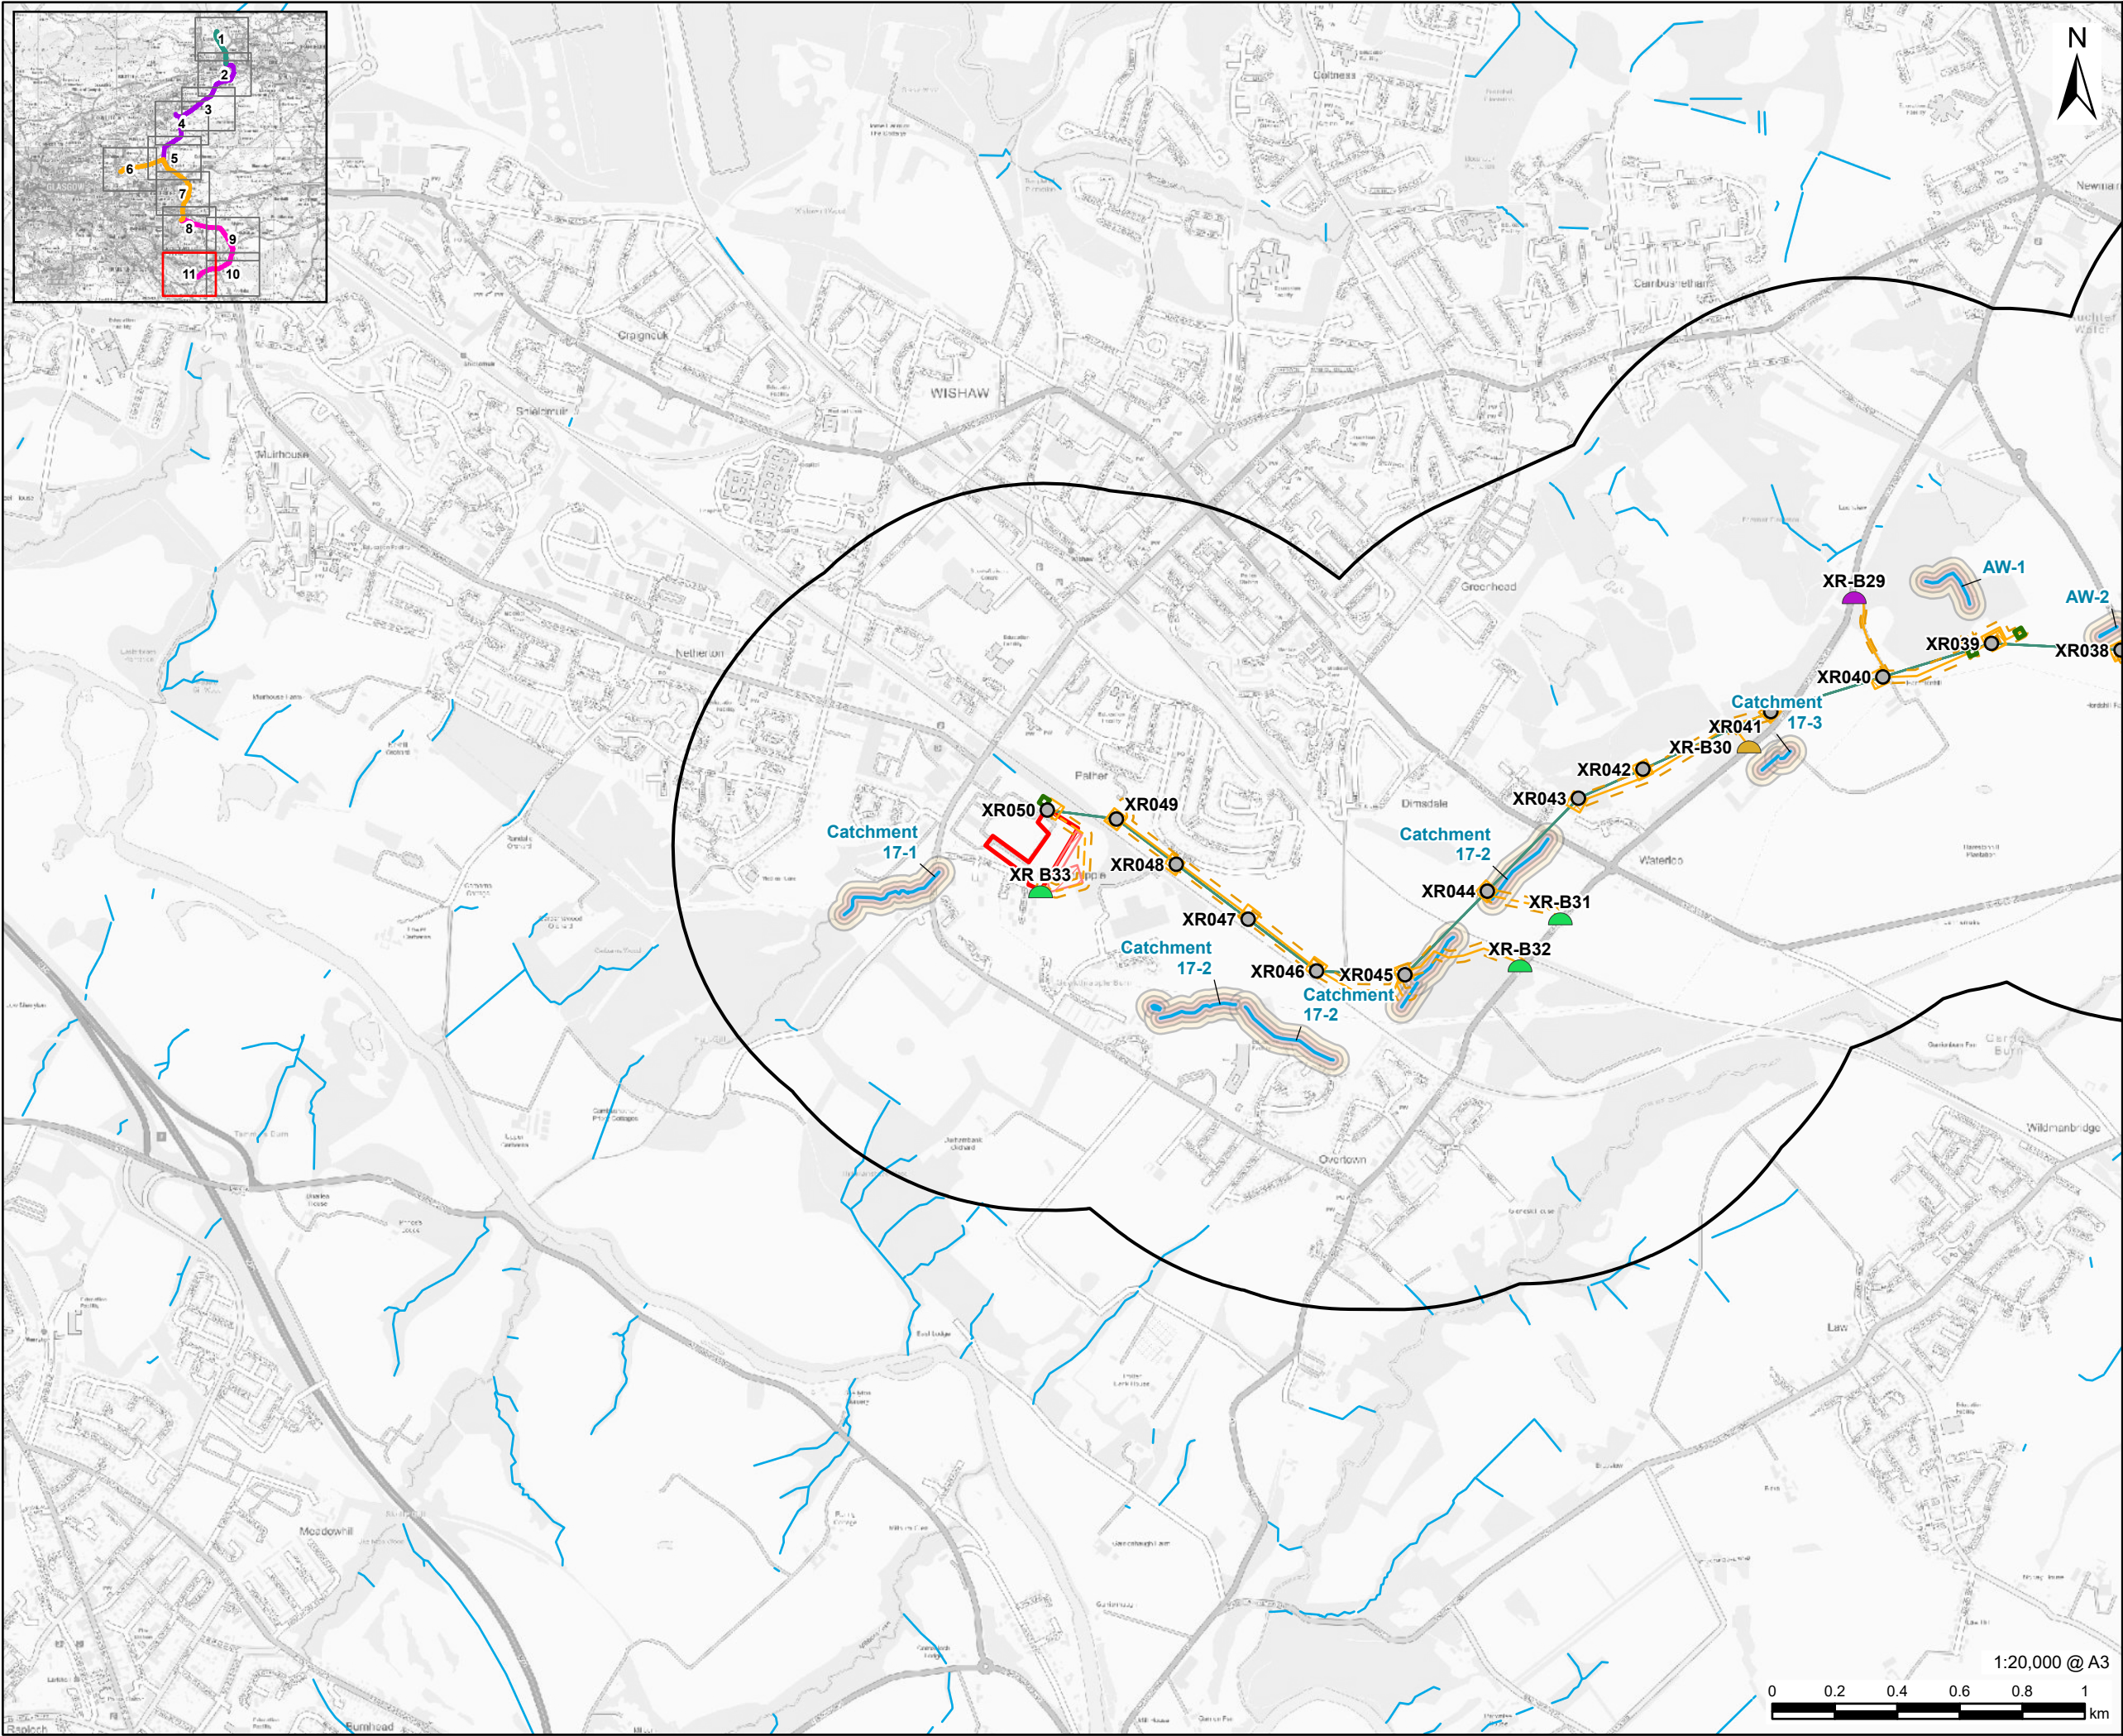

PROJECT

Denny Wishaw Network Upgrade

CLIENT

SP Energy Networks

CONSULTANT

AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

LEGEND

- Existing Tower
- Wishaw Substation Site Boundary
- XR Tower Compound
- XR Upgraded Overhead Line
- Temporary Trackway
- Temporary Stone Track
- Temporary Trackway and Temporary Stone Track Access Limit of Deviation
- Substation Site Compound
- Scaffolding
- Pulling Position
- Existing Bellmouth
- New Bellmouth
- Upgrade Bellmouth
- 1km Study Area
- Surface Water Feature
- Buffer Zone (15m)
- Buffer Zone (30m)
- Buffer Zone (50m)

NOTES

Contains OS data © Crown copyright 2025

ISSUE PURPOSE

Environmental Impact Assessment Report

PROJECT NUMBER

60602788

FIGURE TITLE

Water Course Crossings

FIGURE NUMBER

Figure 9.4 (Sheet 11 of 11)