


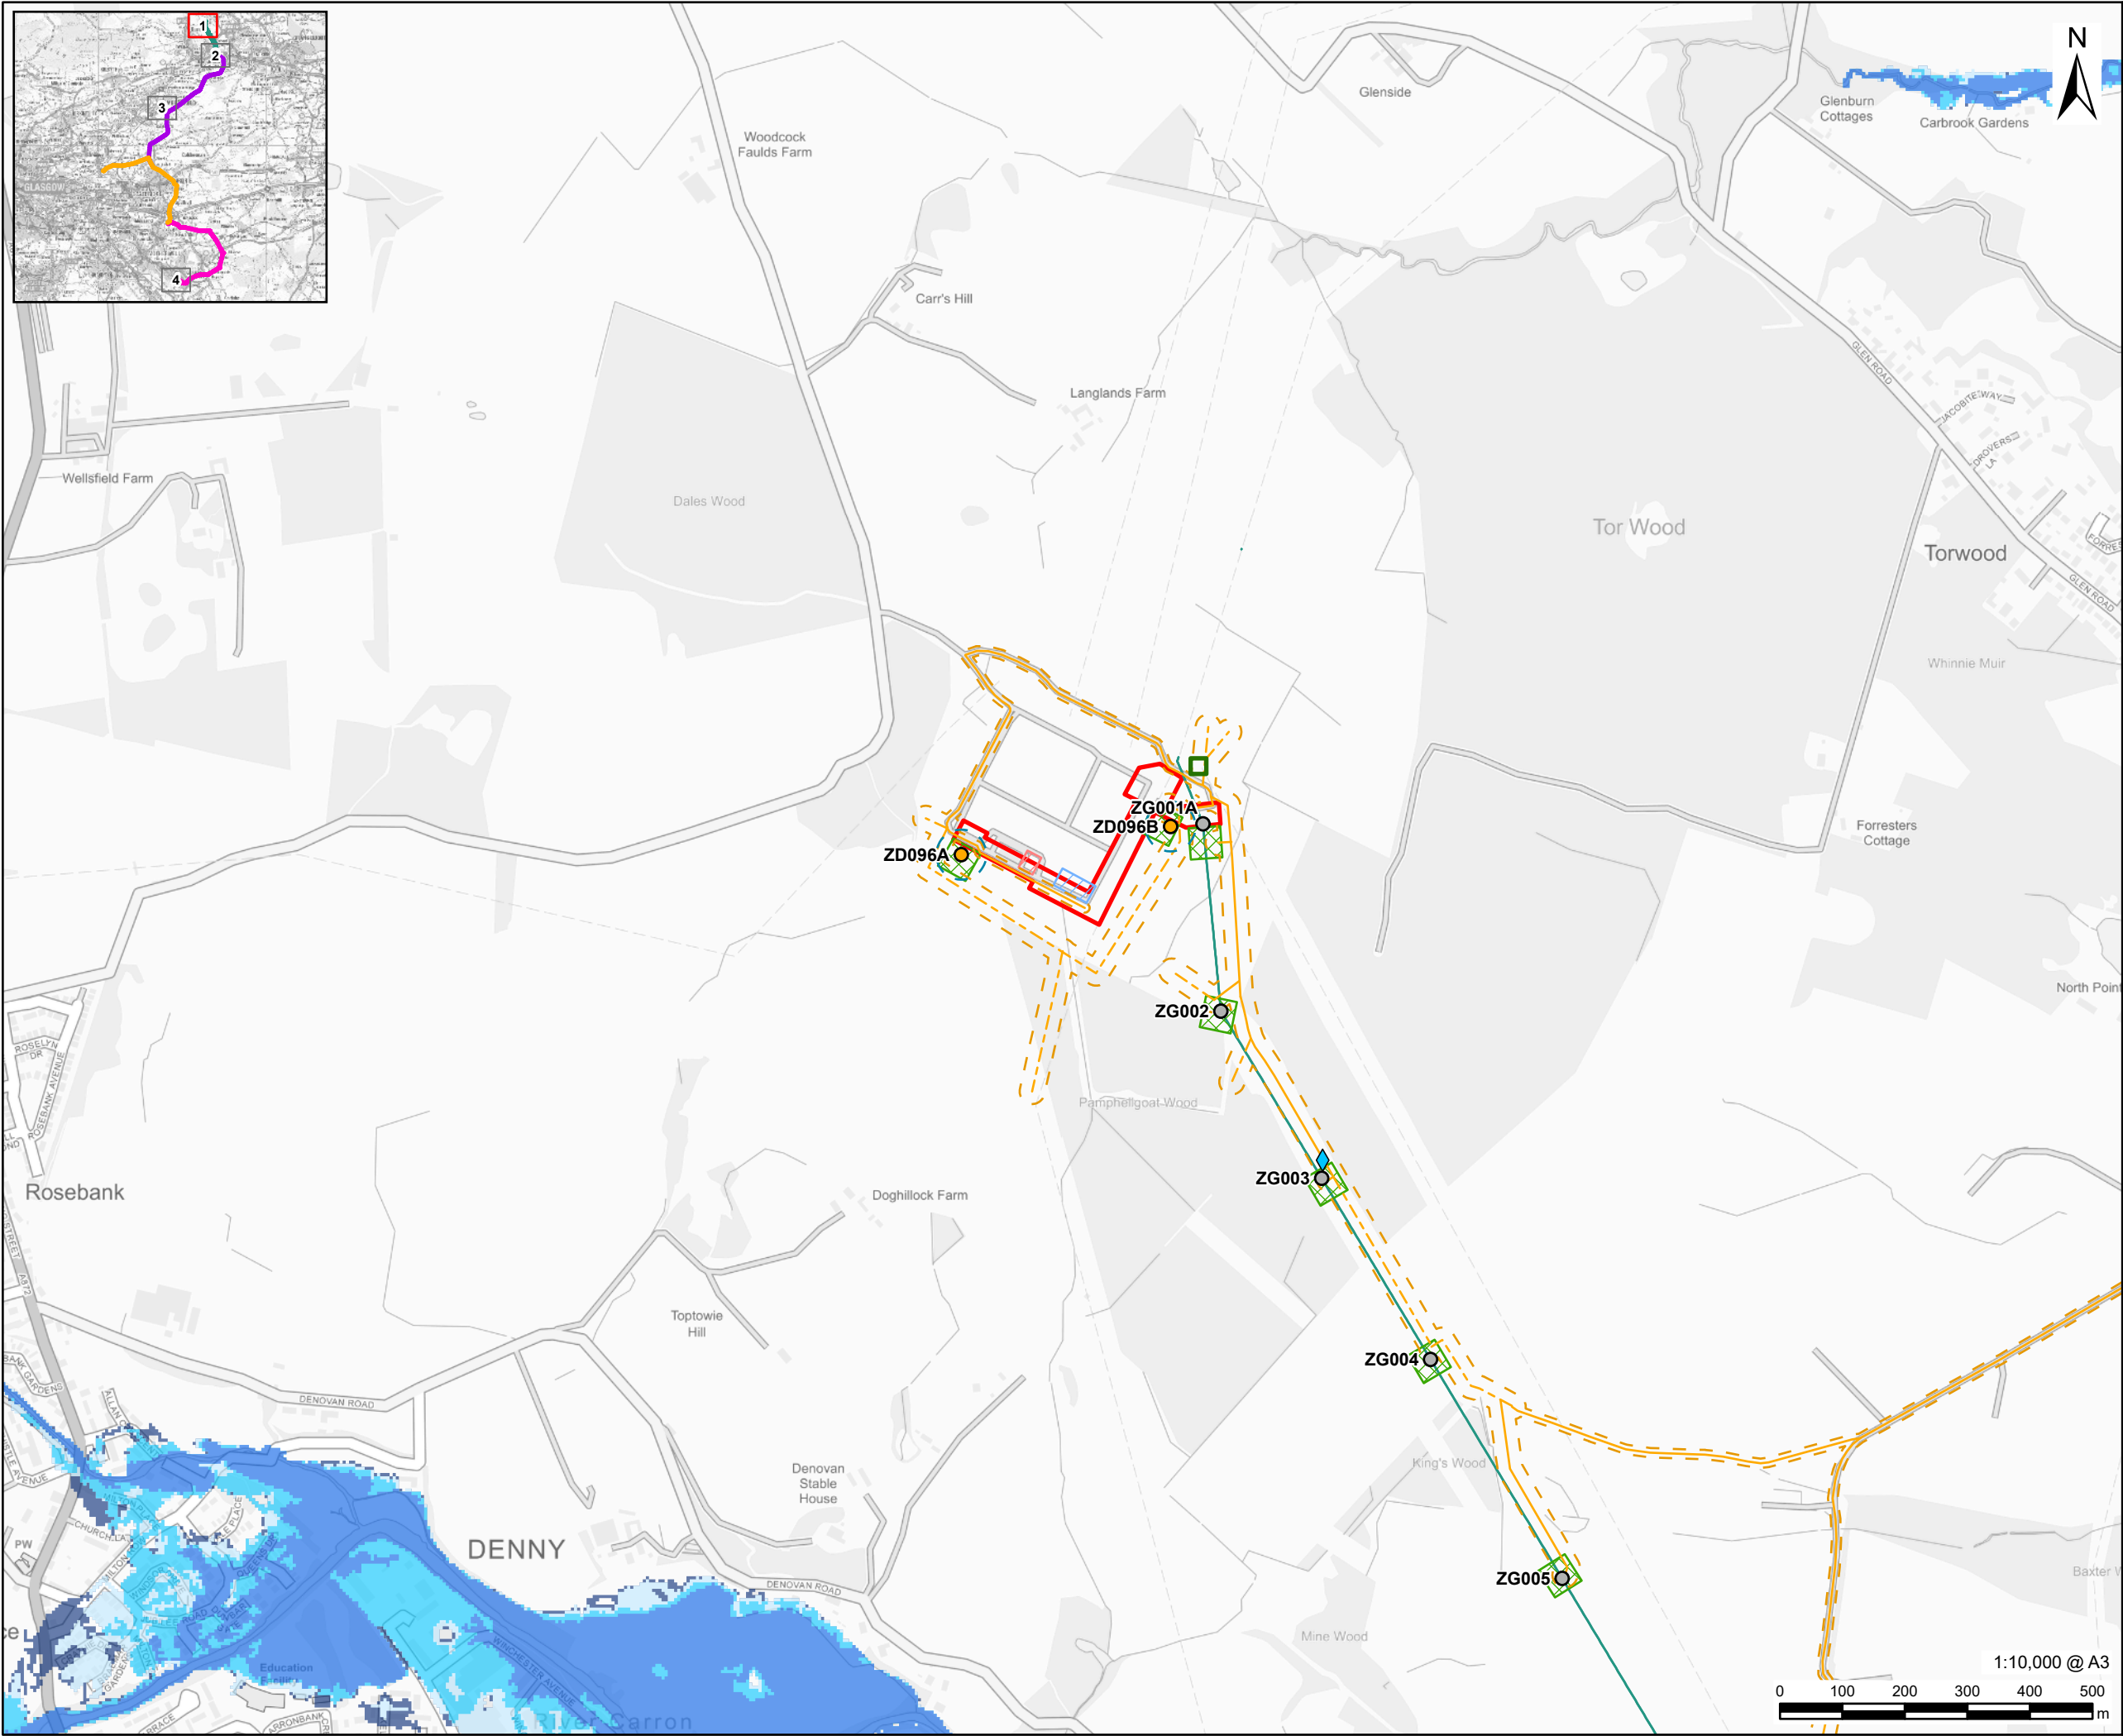

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - New Tower
 - Denny North Substation Site Boundary
 - ZG Tower Compound
 - ZG Alignment
 - New Tower Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Substation Site Compound
 - Substation Laydown Area
 - Pulling Position
 - Water Crossing
 - Pluvial Flood Risk Zone
 - High
 - Medium
 - Low
 - Climate Change


NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Pluvial Flood Risk -
Denny North Substation

FIGURE NUMBER
Figure 9.6 (Sheet 1 of 4)

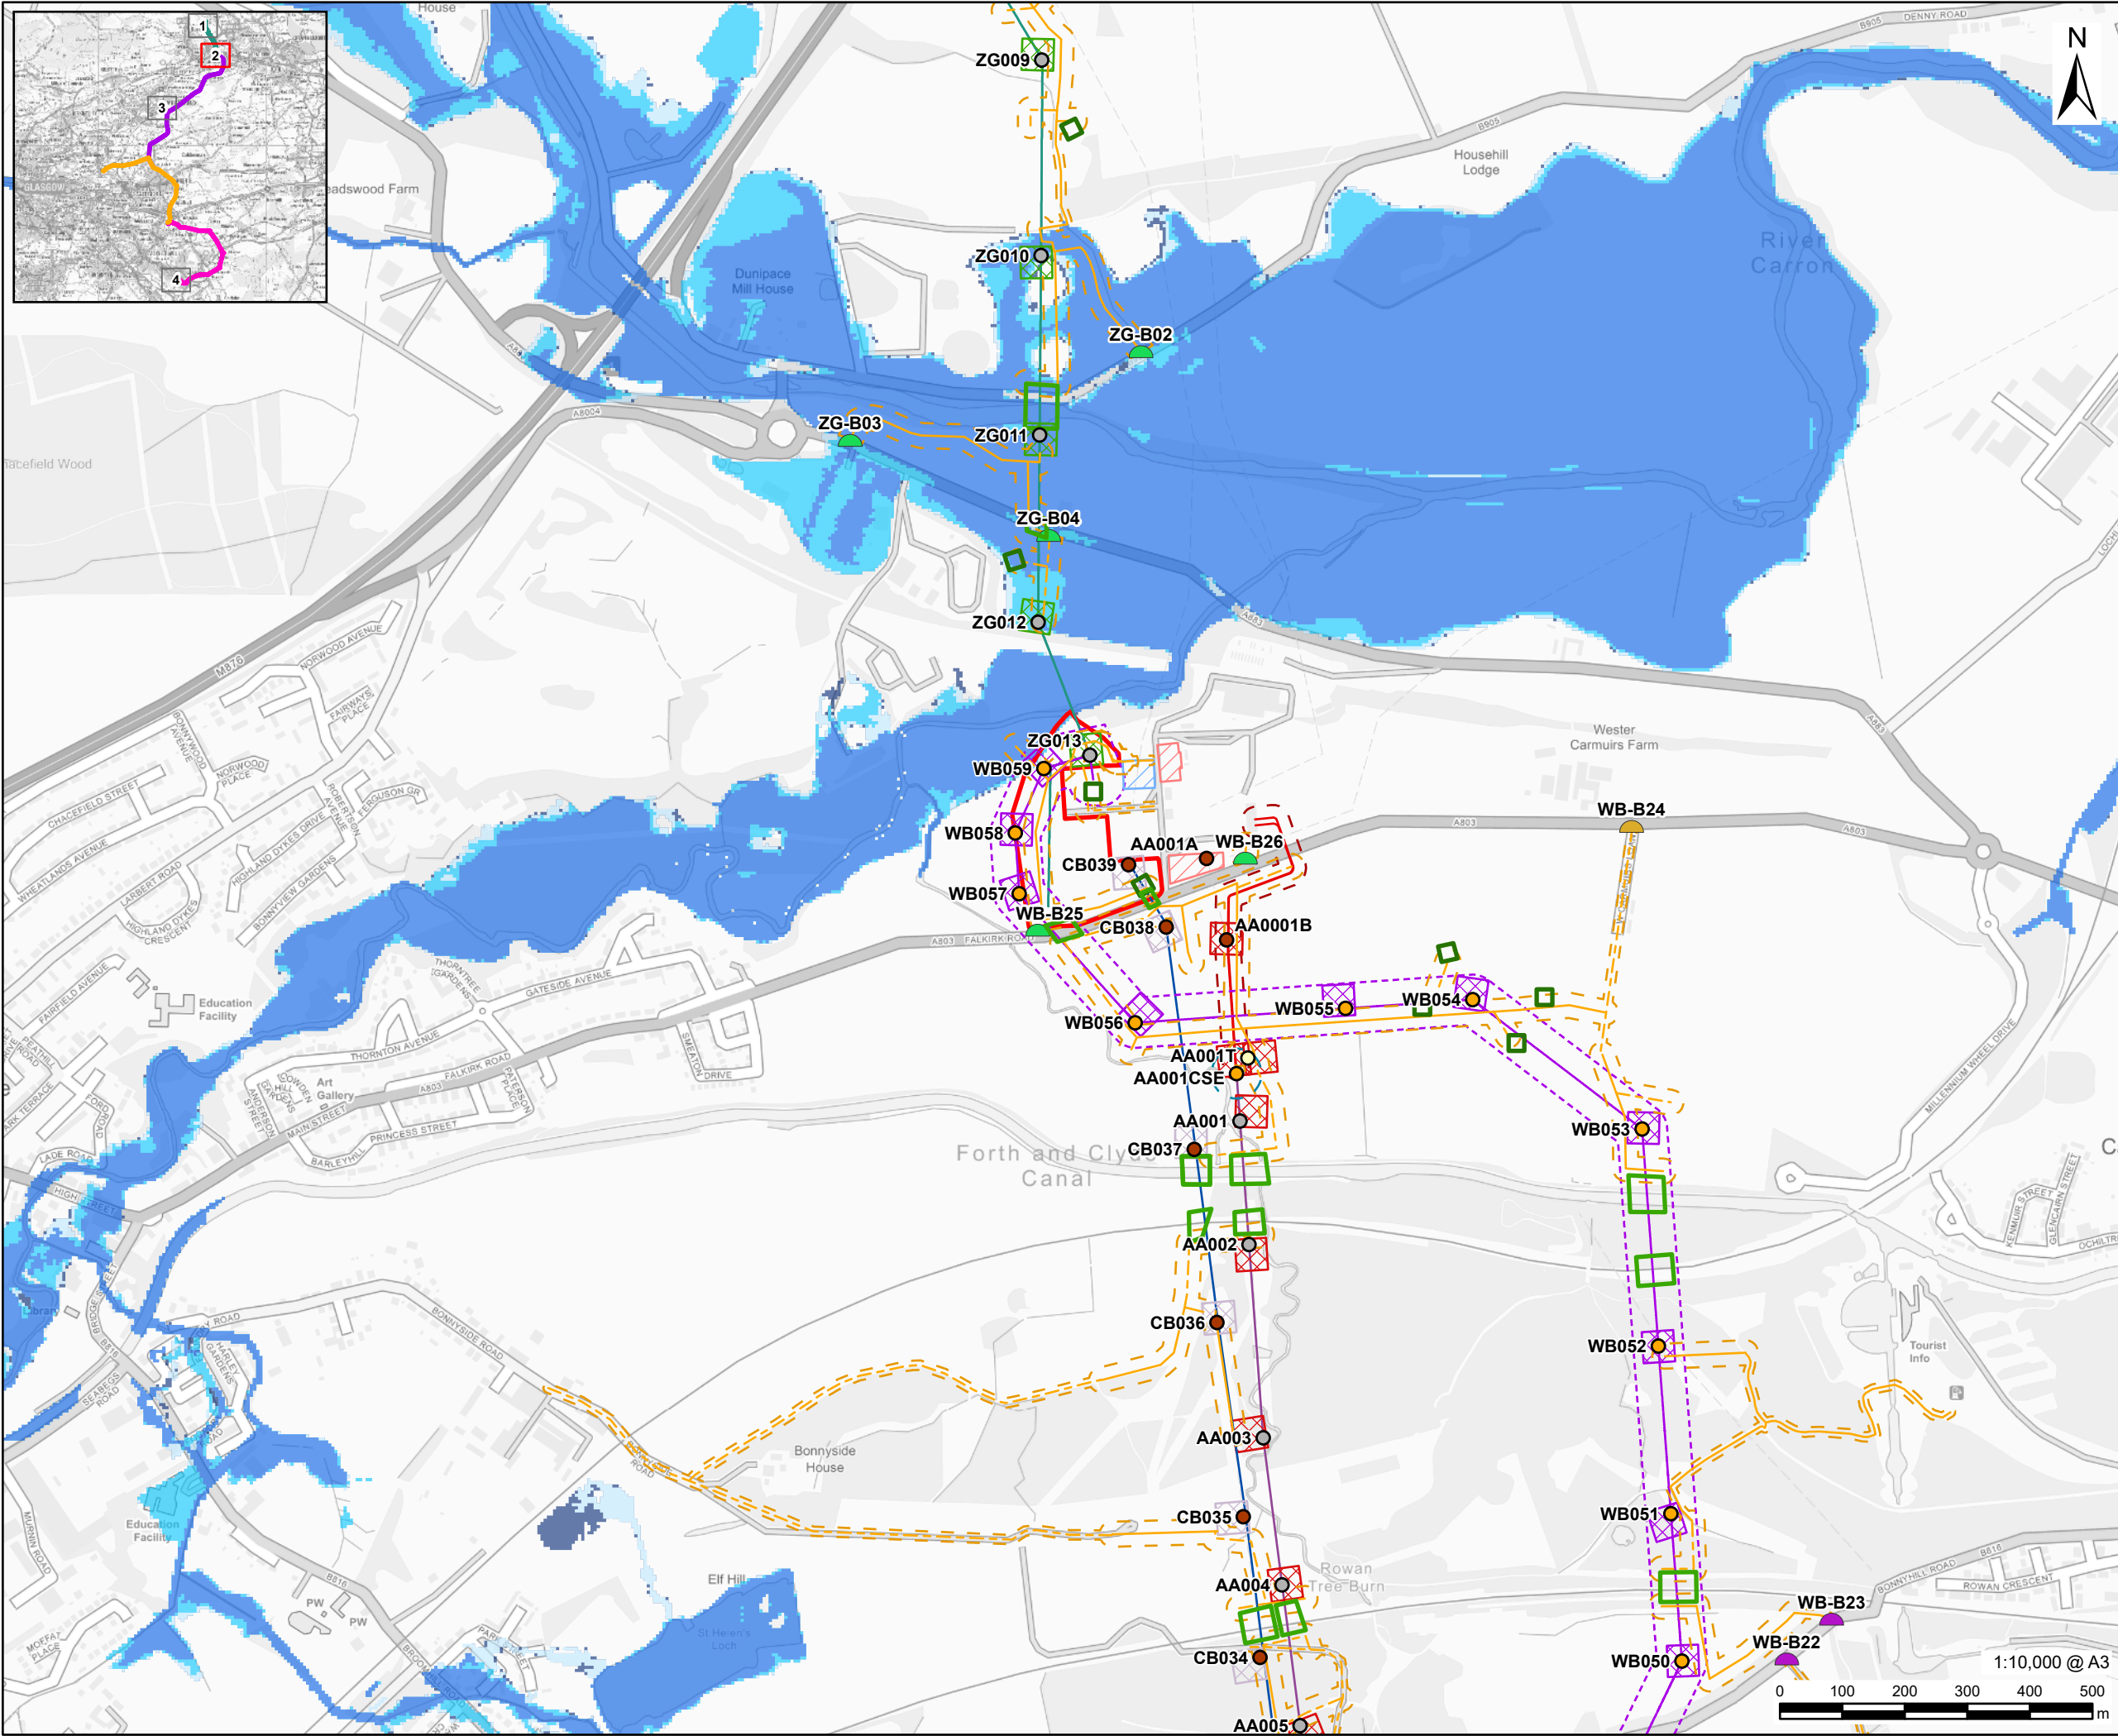

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - New Tower
 - Temporary Tower
 - Tower to be Removed
 - Bonnybridge Substation Site Boundary
 - New Build Tower Compound
 - ZG Tower Compound
 - CB Tower Compound
 - AA Tower Compound
 - New Build Overhead Line
 - ZG Alignment
 - CB Route Removal
 - AA Alignment
 - AA Route Undergrounding
 - New Build Overhead Line Limit of Deviation
 - AA Route Undergrounding Limit of Deviation
 - New Tower Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Substation Site Compound
 - Substation Laydown Area
 - Scaffolding
 - Pulling Position
 - Existing Bellmouth
 - New Bellmouth
 - Upgrade Bellmouth
 - Pluvial Flood Risk Zone
 - High
 - Medium
 - Low
 - Climate Change

NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025


ISSUE PURPOSE
Environmental Impact Assessment Report


PROJECT NUMBER
60602788

FIGURE TITLE
Pluvial Flood Risk - Bonnybridge Substation

FIGURE NUMBER
Figure 9.6 (Sheet 2 of 4)

1:10,000 @ A3



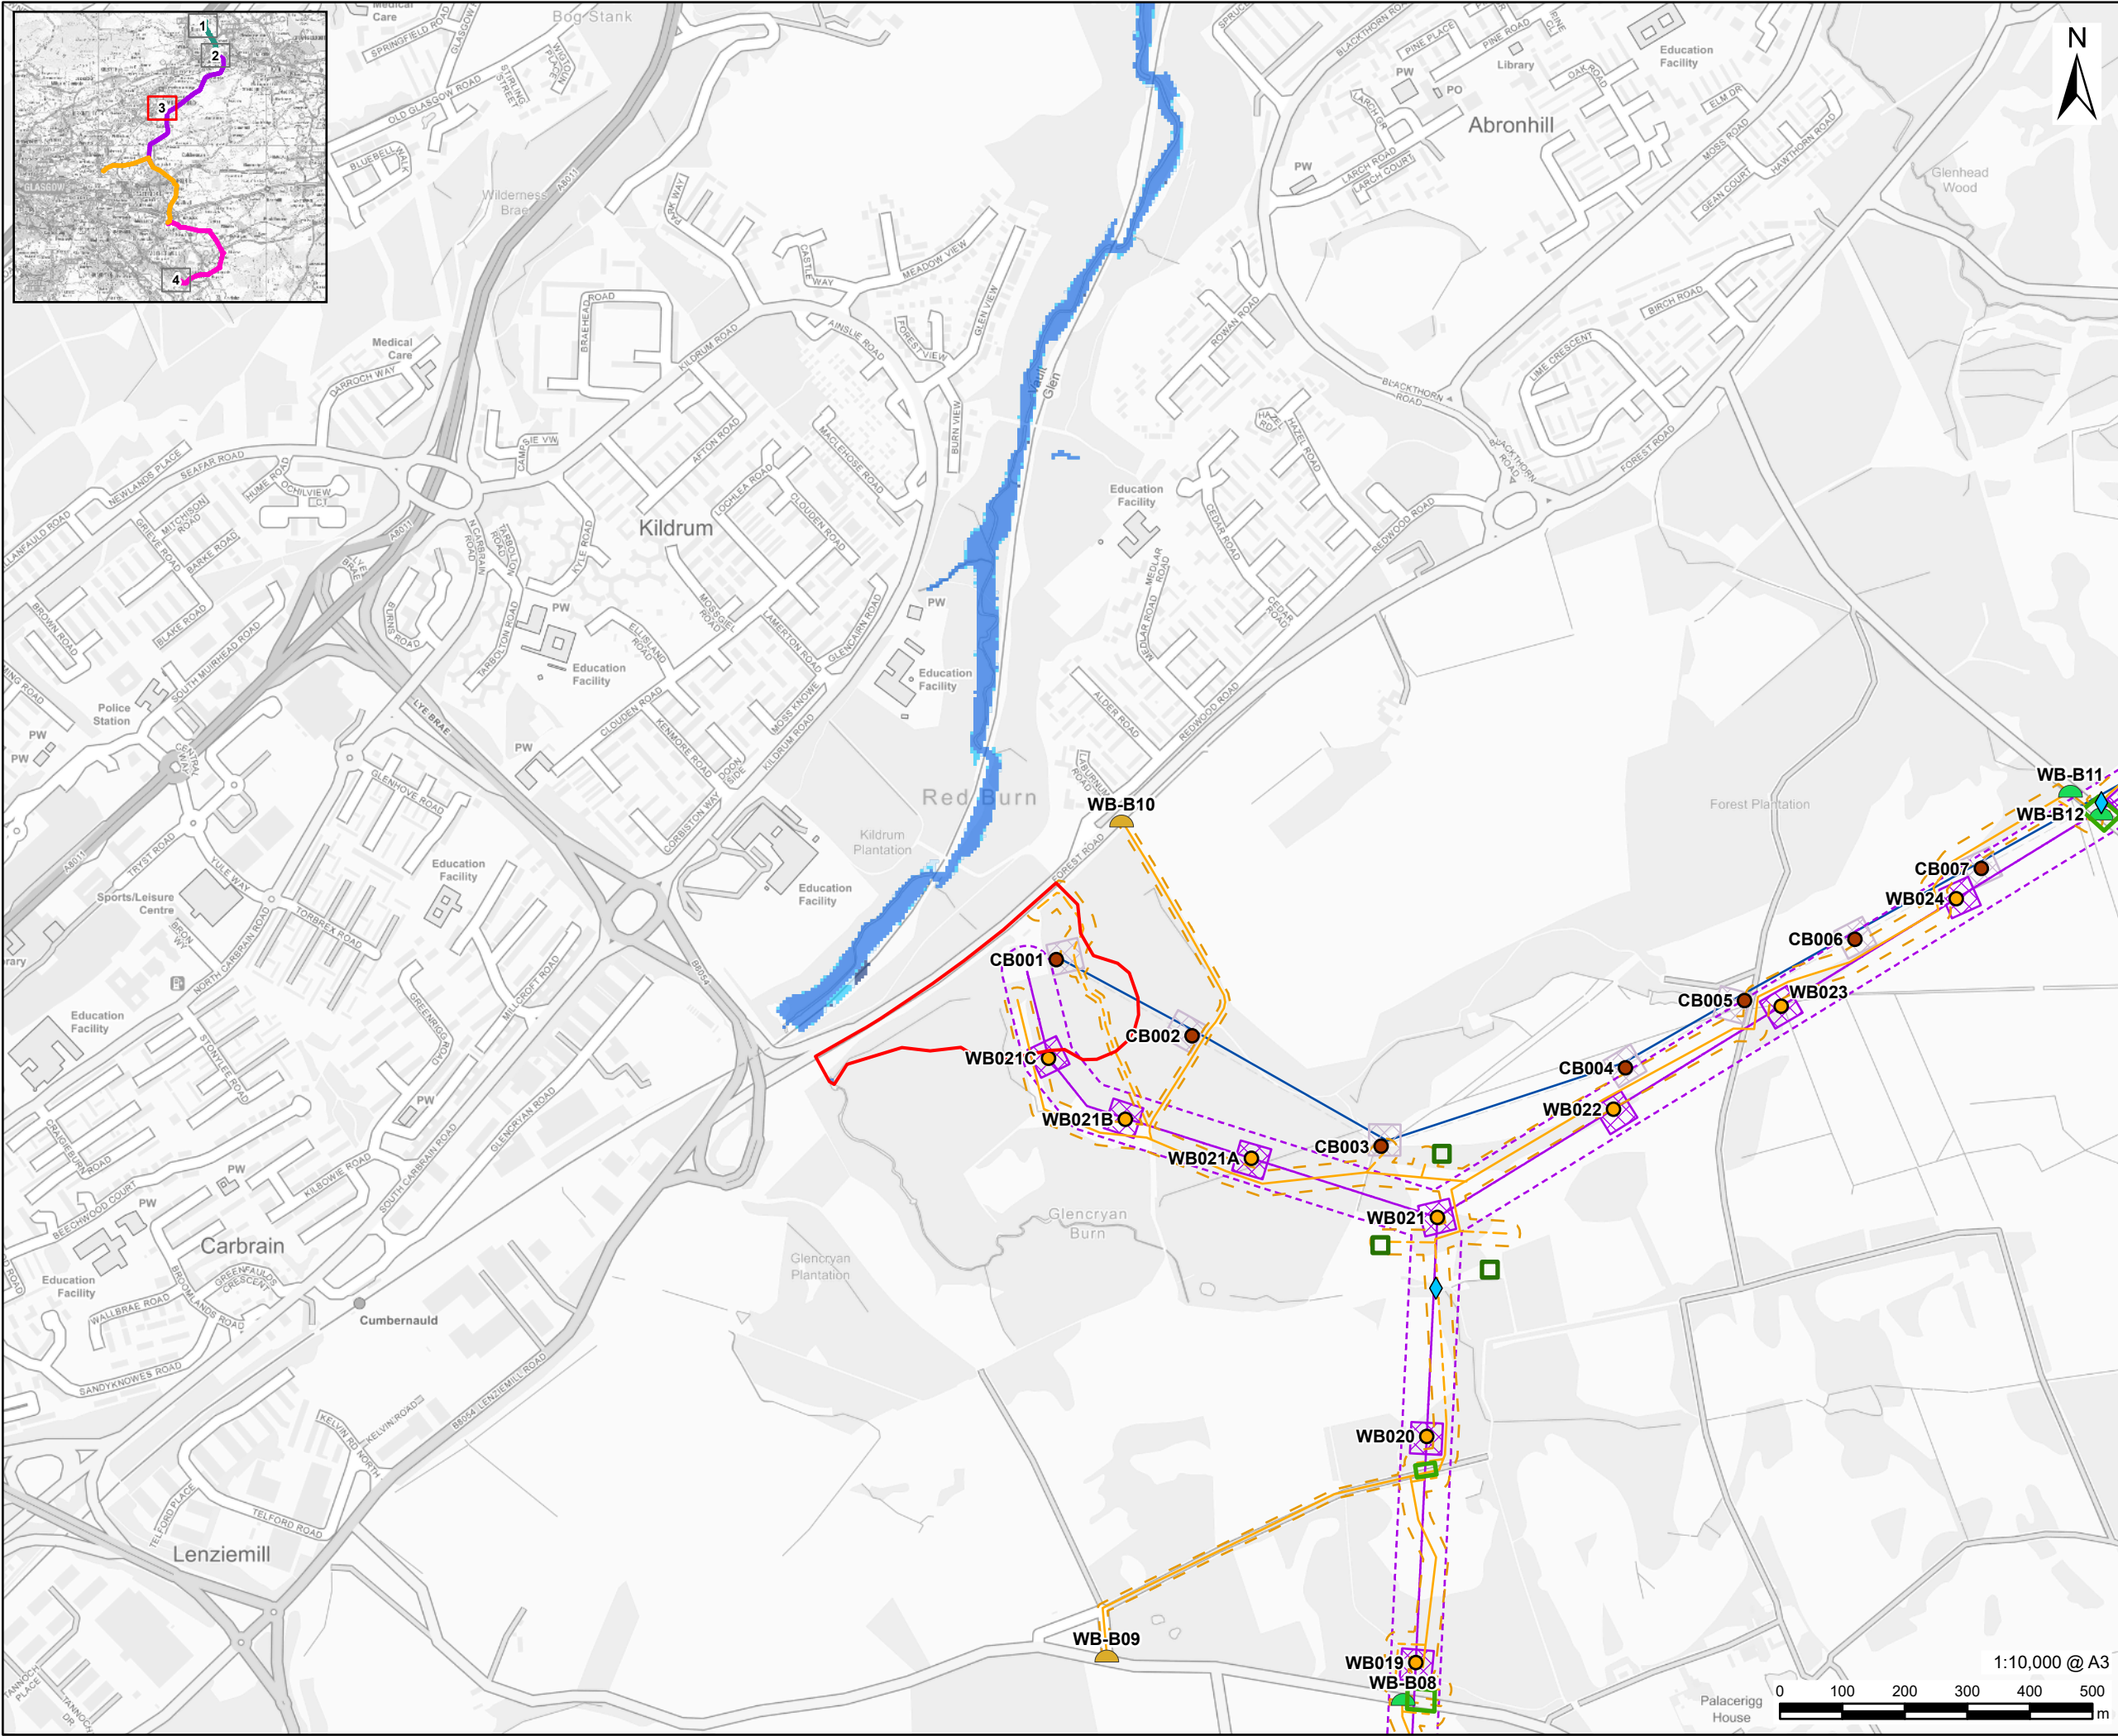

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- New Tower
 - Tower to be Removed
 - Cumbernauld Substation Site Boundary
 - New Build Tower Compound
 - CB Tower Compound
 - New Build Overhead Line
 - CB Route Removal
 - New Build Overhead Line Limit of Deviation
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Scaffolding
 - Pulling Position
 - Water Crossing
 - New Bellmouth
 - Upgrade Bellmouth
 - Pluvial Flood Risk Zone
 - High
 - Medium
 - Low
 - Climate Change


NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Pluvial Flood Risk - Cumbernauld Substation

FIGURE NUMBER
Figure 9.6 (Sheet 3 of 4)

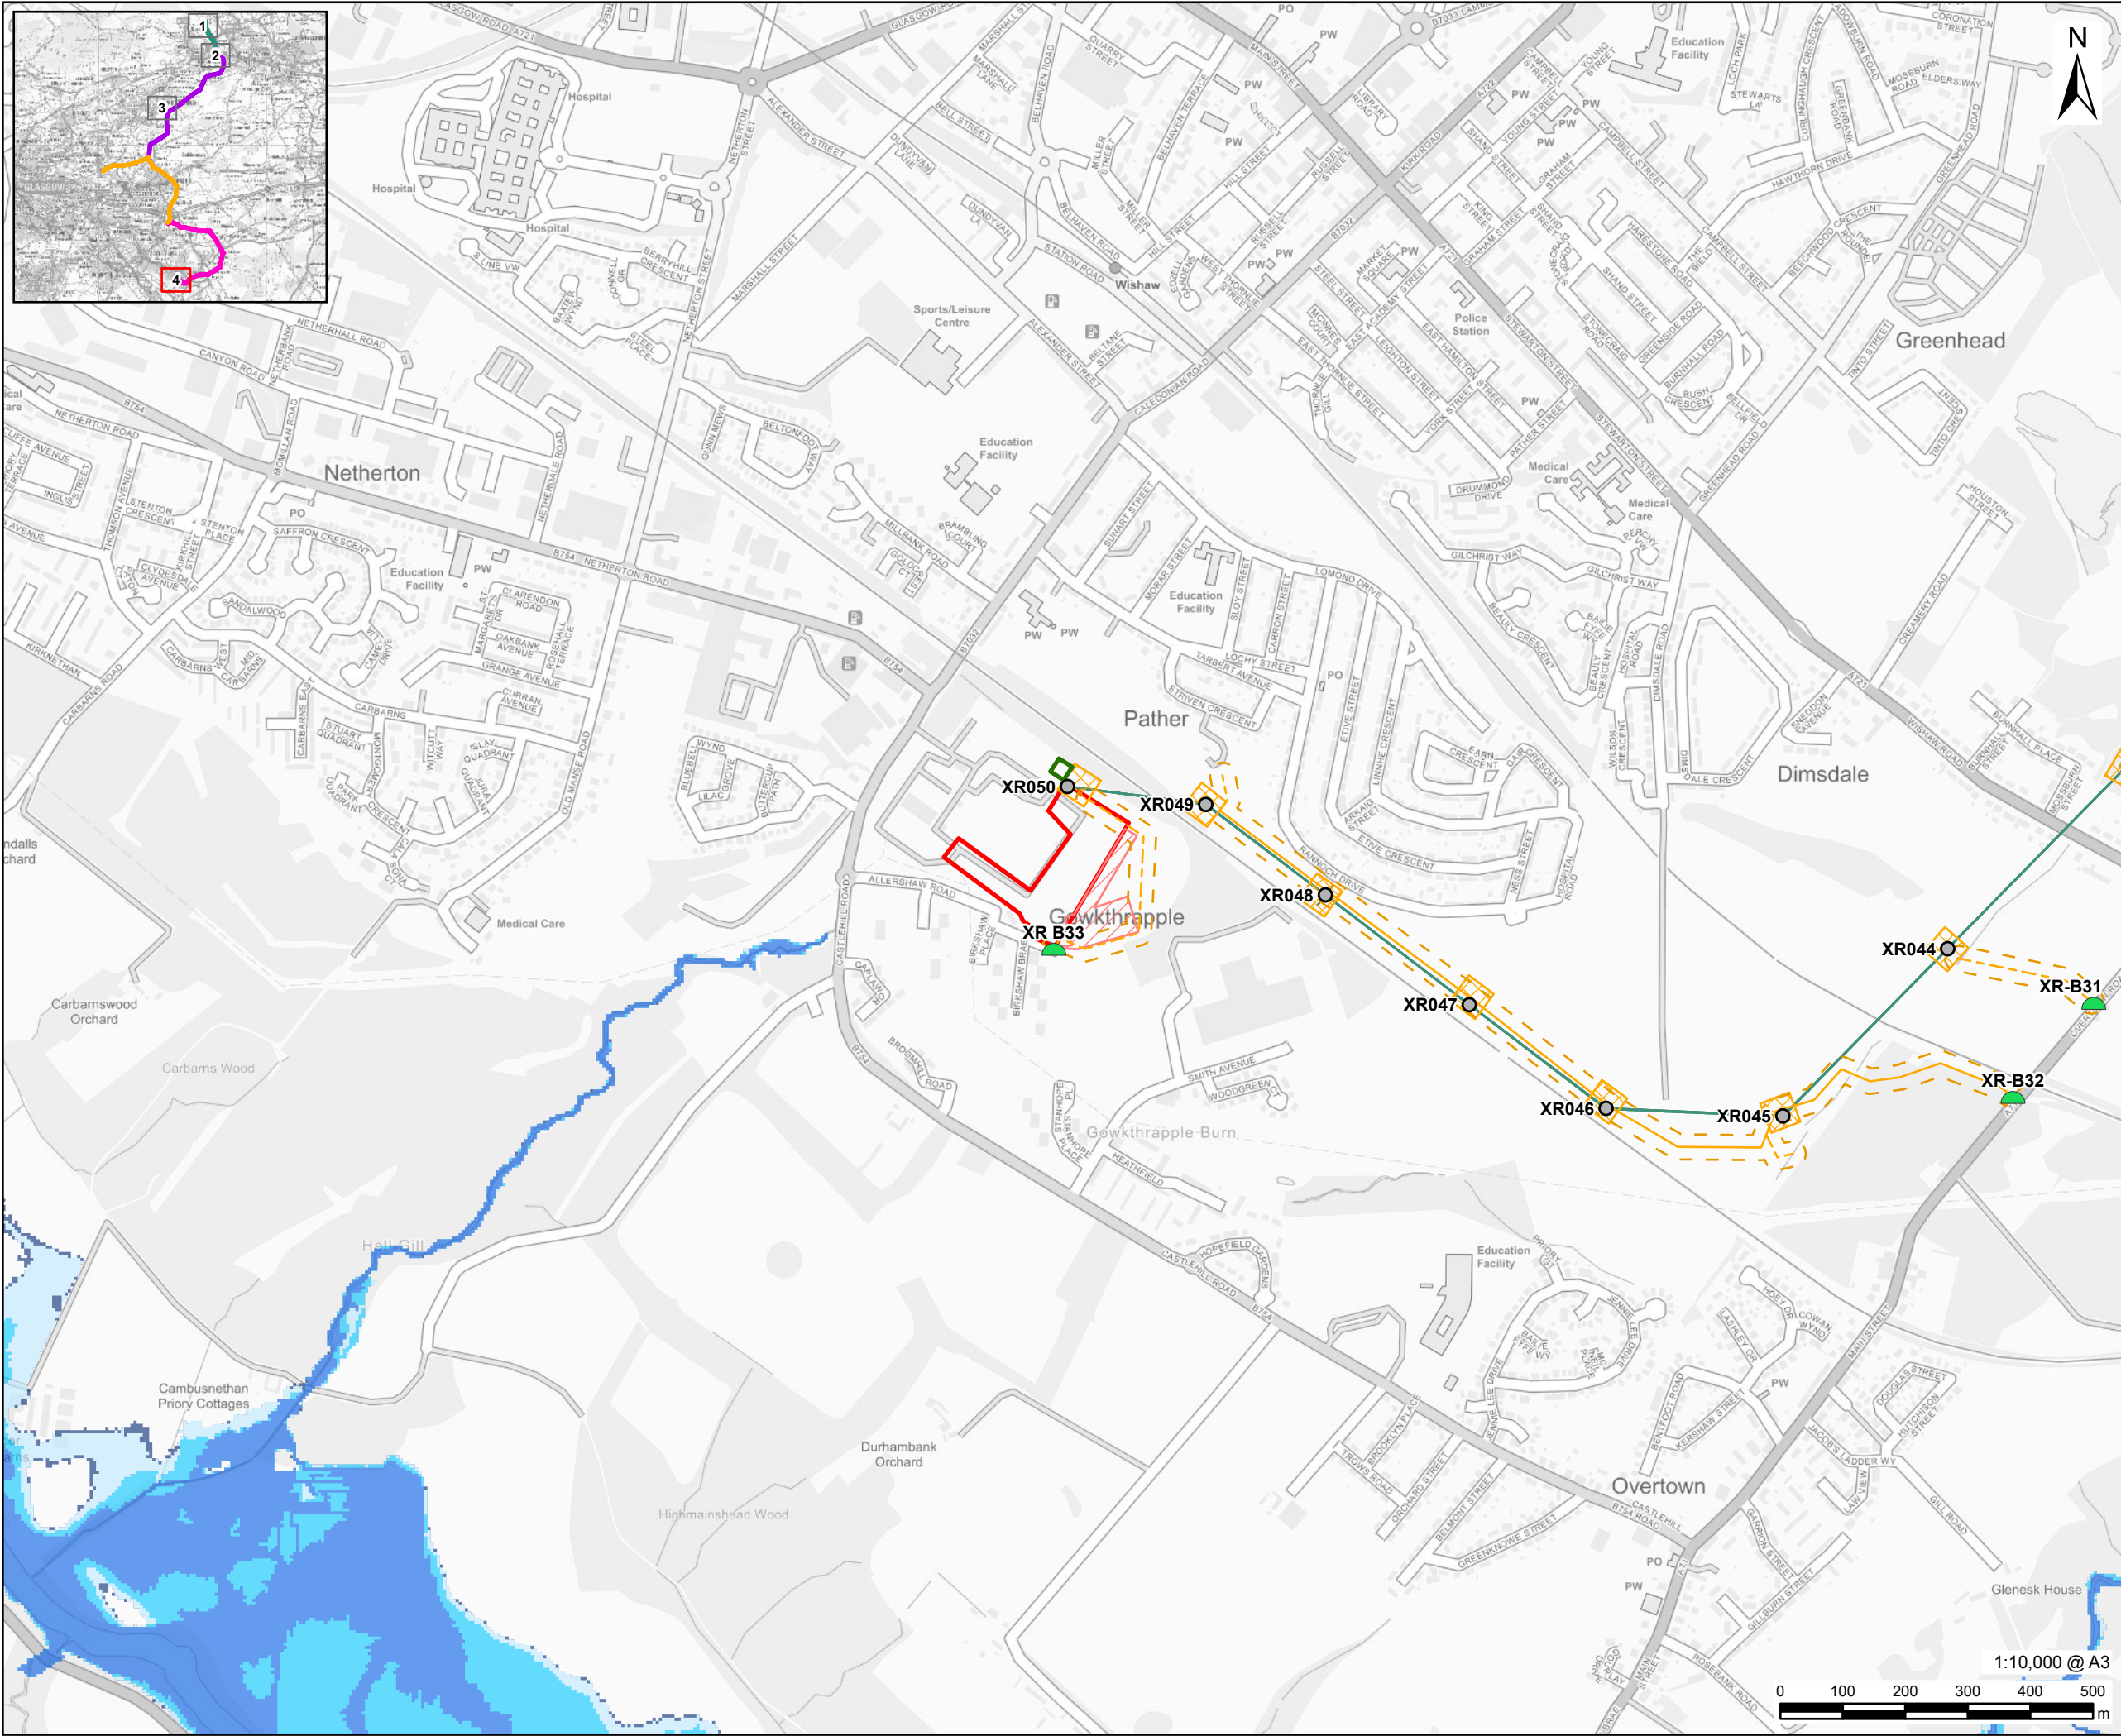

PROJECT
Denny Wishaw Network Upgrade

CLIENT
SP Energy Networks

CONSULTANT
AECOM Limited
One Trinity Gardens
Newcastle
NE1 2HF
www.aecom.com

- LEGEND**
- Existing Tower
 - Wishaw Substation Site Boundary
 - XR Tower Compound
 - XR Uprated Overhead Line
 - Temporary Trackway
 - Temporary Stone Track
 - Temporary Trackway and Temporary Stone Track Access Limit of Deviation
 - Substation Site Compound
 - Pulling Position
 - New Bellmouth
 - Pluvial Flood Risk Zone
 - High
 - Medium
 - Low
 - Climate Change

NOTES
Contains OS data © Crown copyright 2025
© SEPA 2025; this SEPA product is licensed under the Open Government Licence 3.0.
Contains OS data © Crown copyright and database right 2025

ISSUE PURPOSE
Environmental Impact Assessment Report

PROJECT NUMBER
60602788

FIGURE TITLE
Pluvial Flood Risk - Wishaw Substation

FIGURE NUMBER
Figure 9.6 (Sheet 4 of 4)