Appendix 12.8: Operational Noise Impact Assessment for Cumbernauld Substation

1. Figures 2

1. Figures

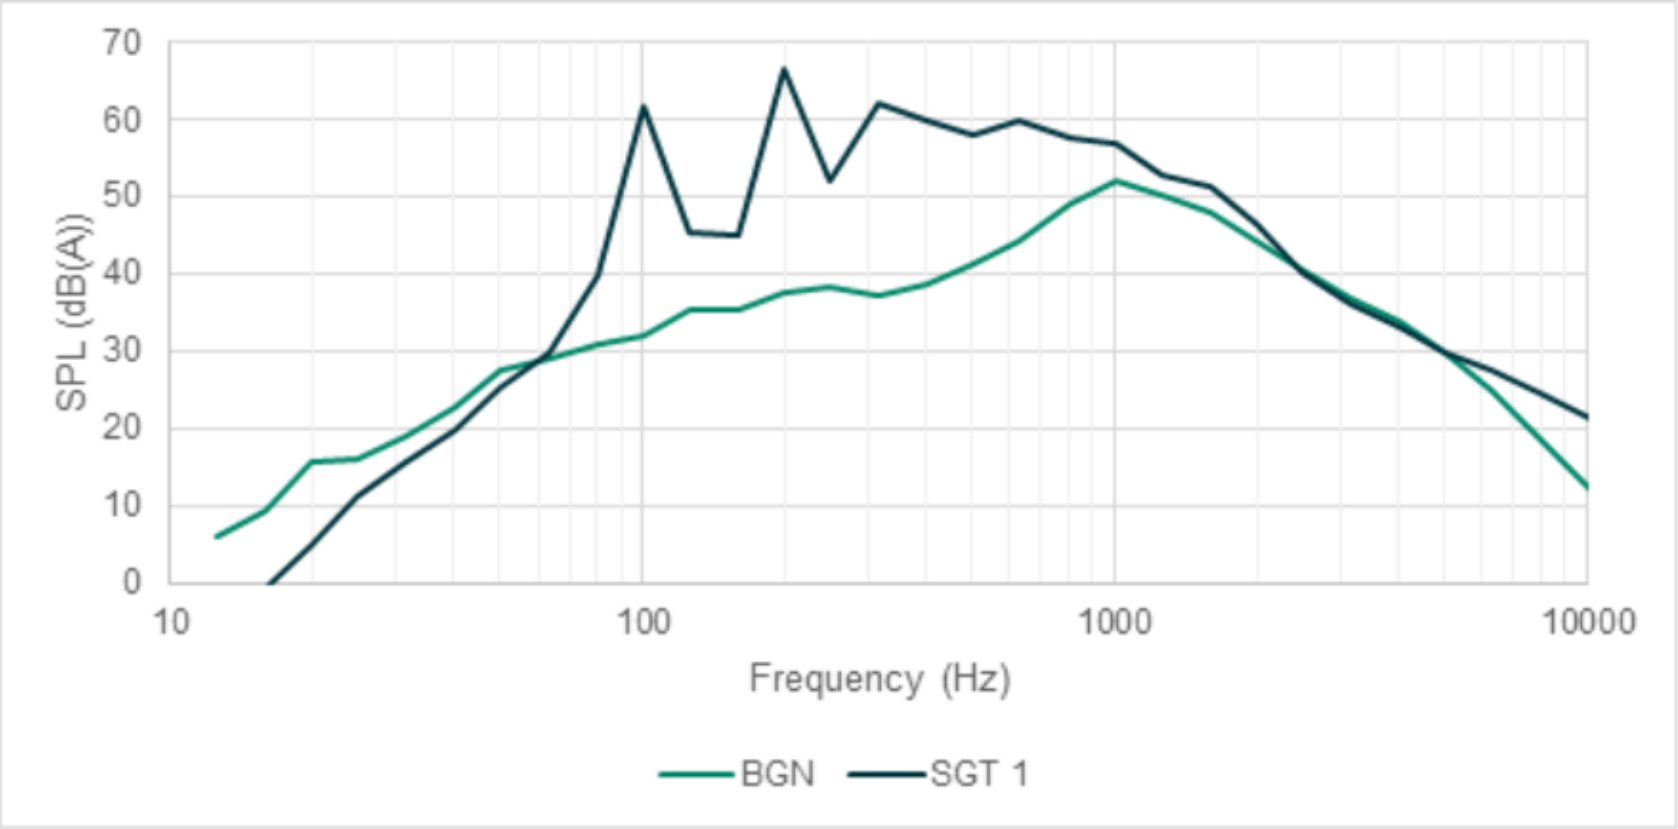

Figure 1.1:Equipment SPL Frequency Spectra

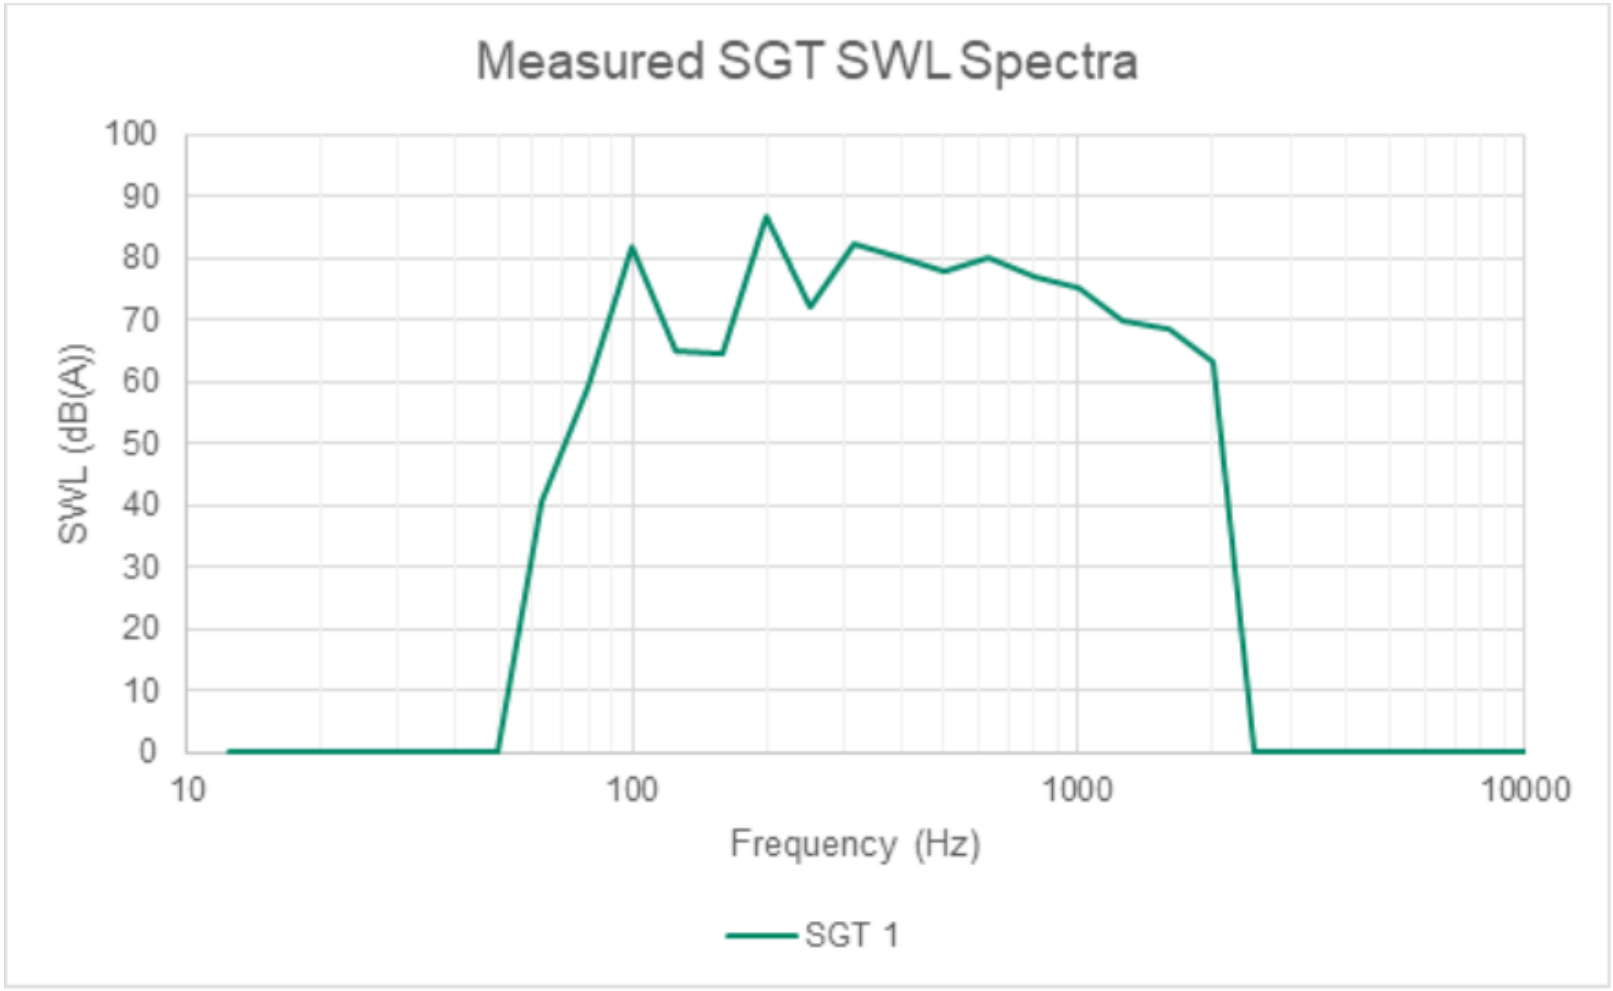

Figure 1.2: Equipment SWL Frequency Spectra

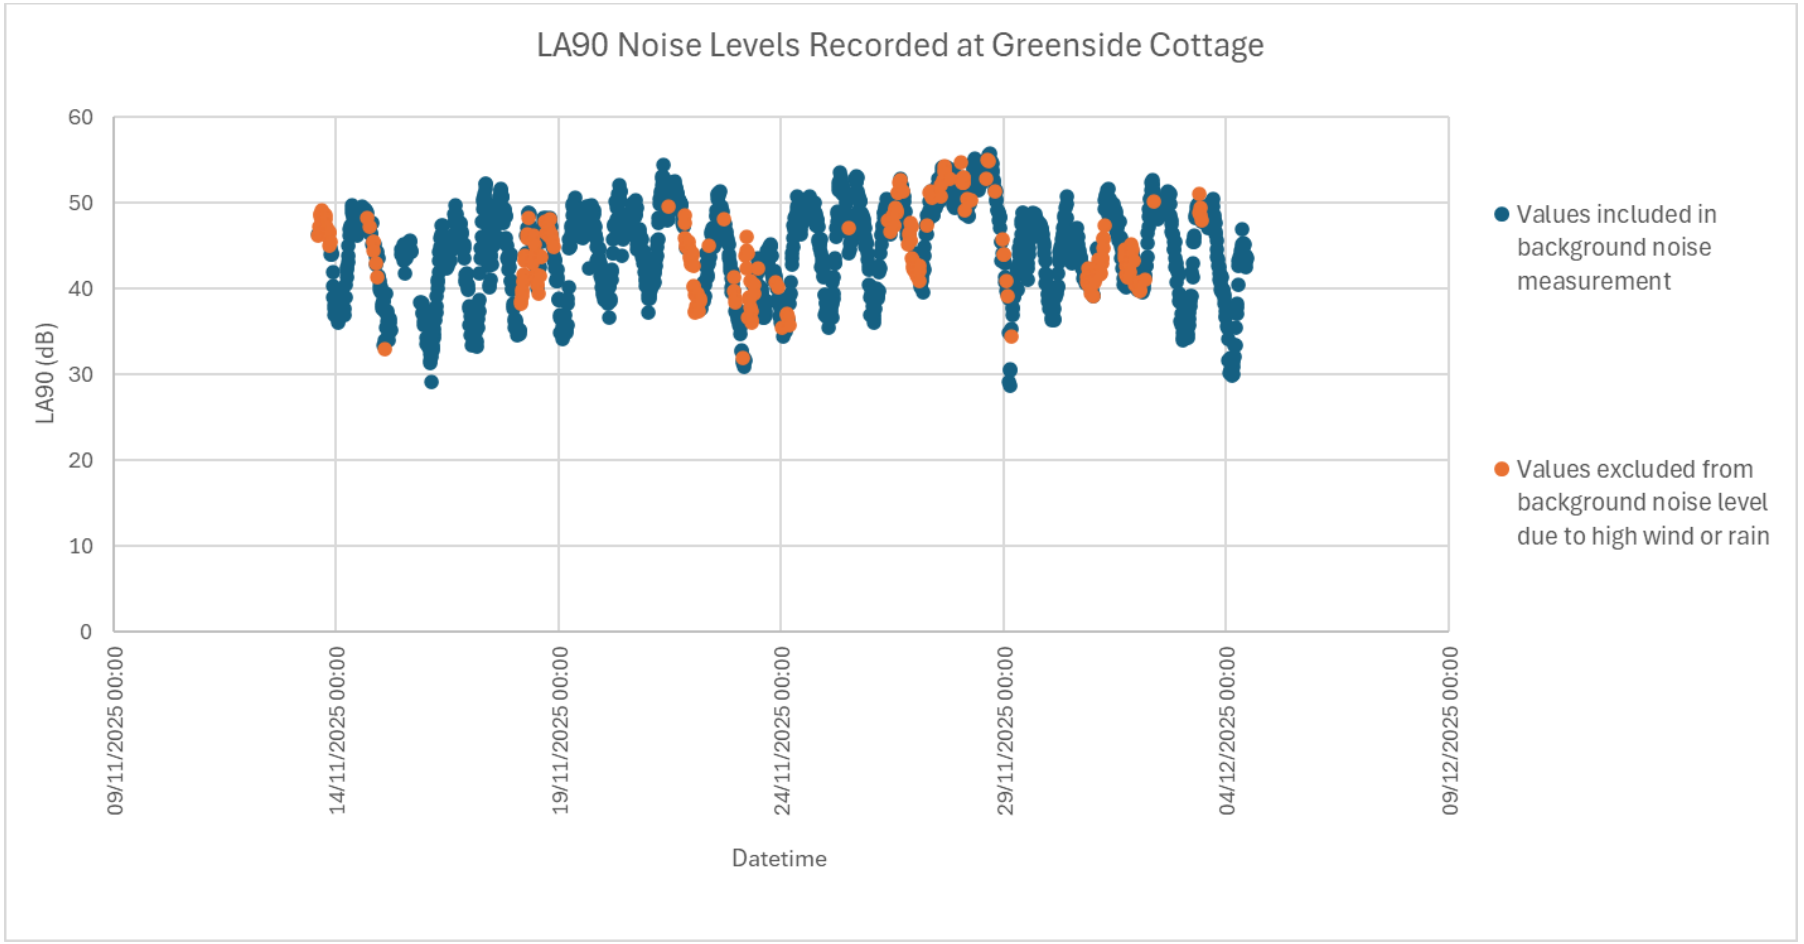

Figure 1.3: Unattended Noise Survey Result