

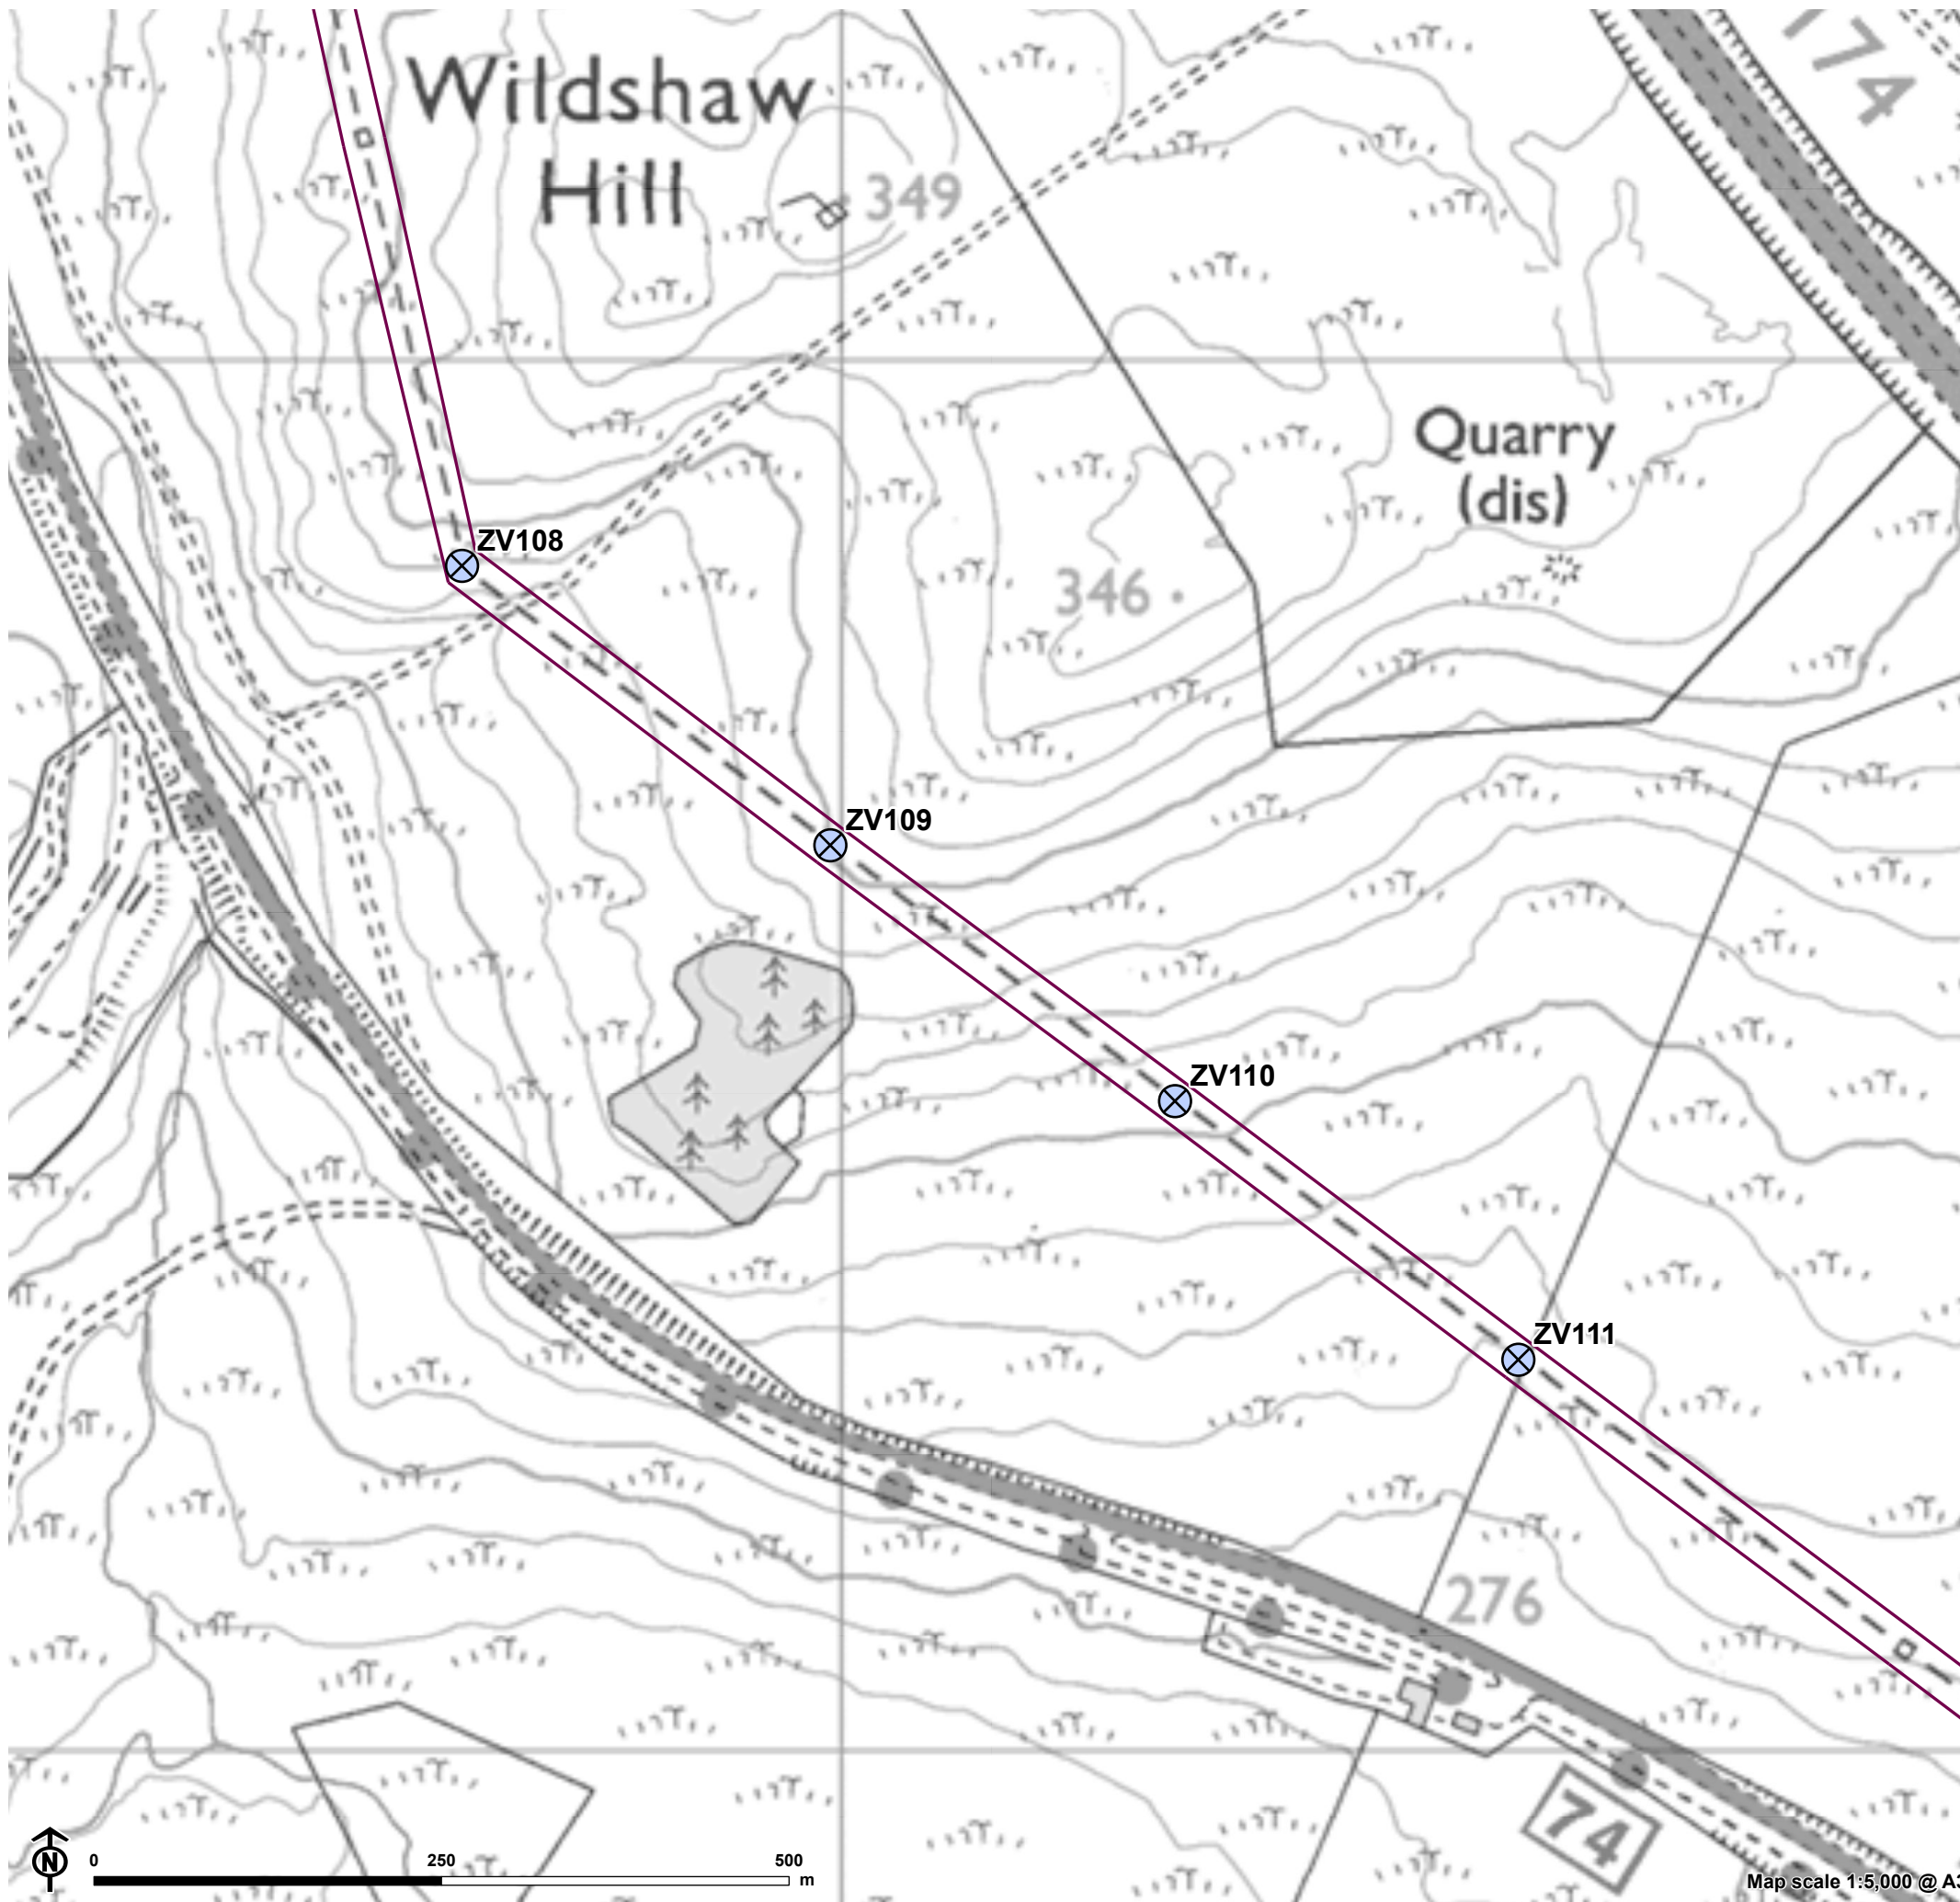


Figure 1.2: Site Plan - Existing Layout

-  Existing tower
-  Existing 400kV Overhead Line (OHL)