


Figure 1.5: Cumulative Developments

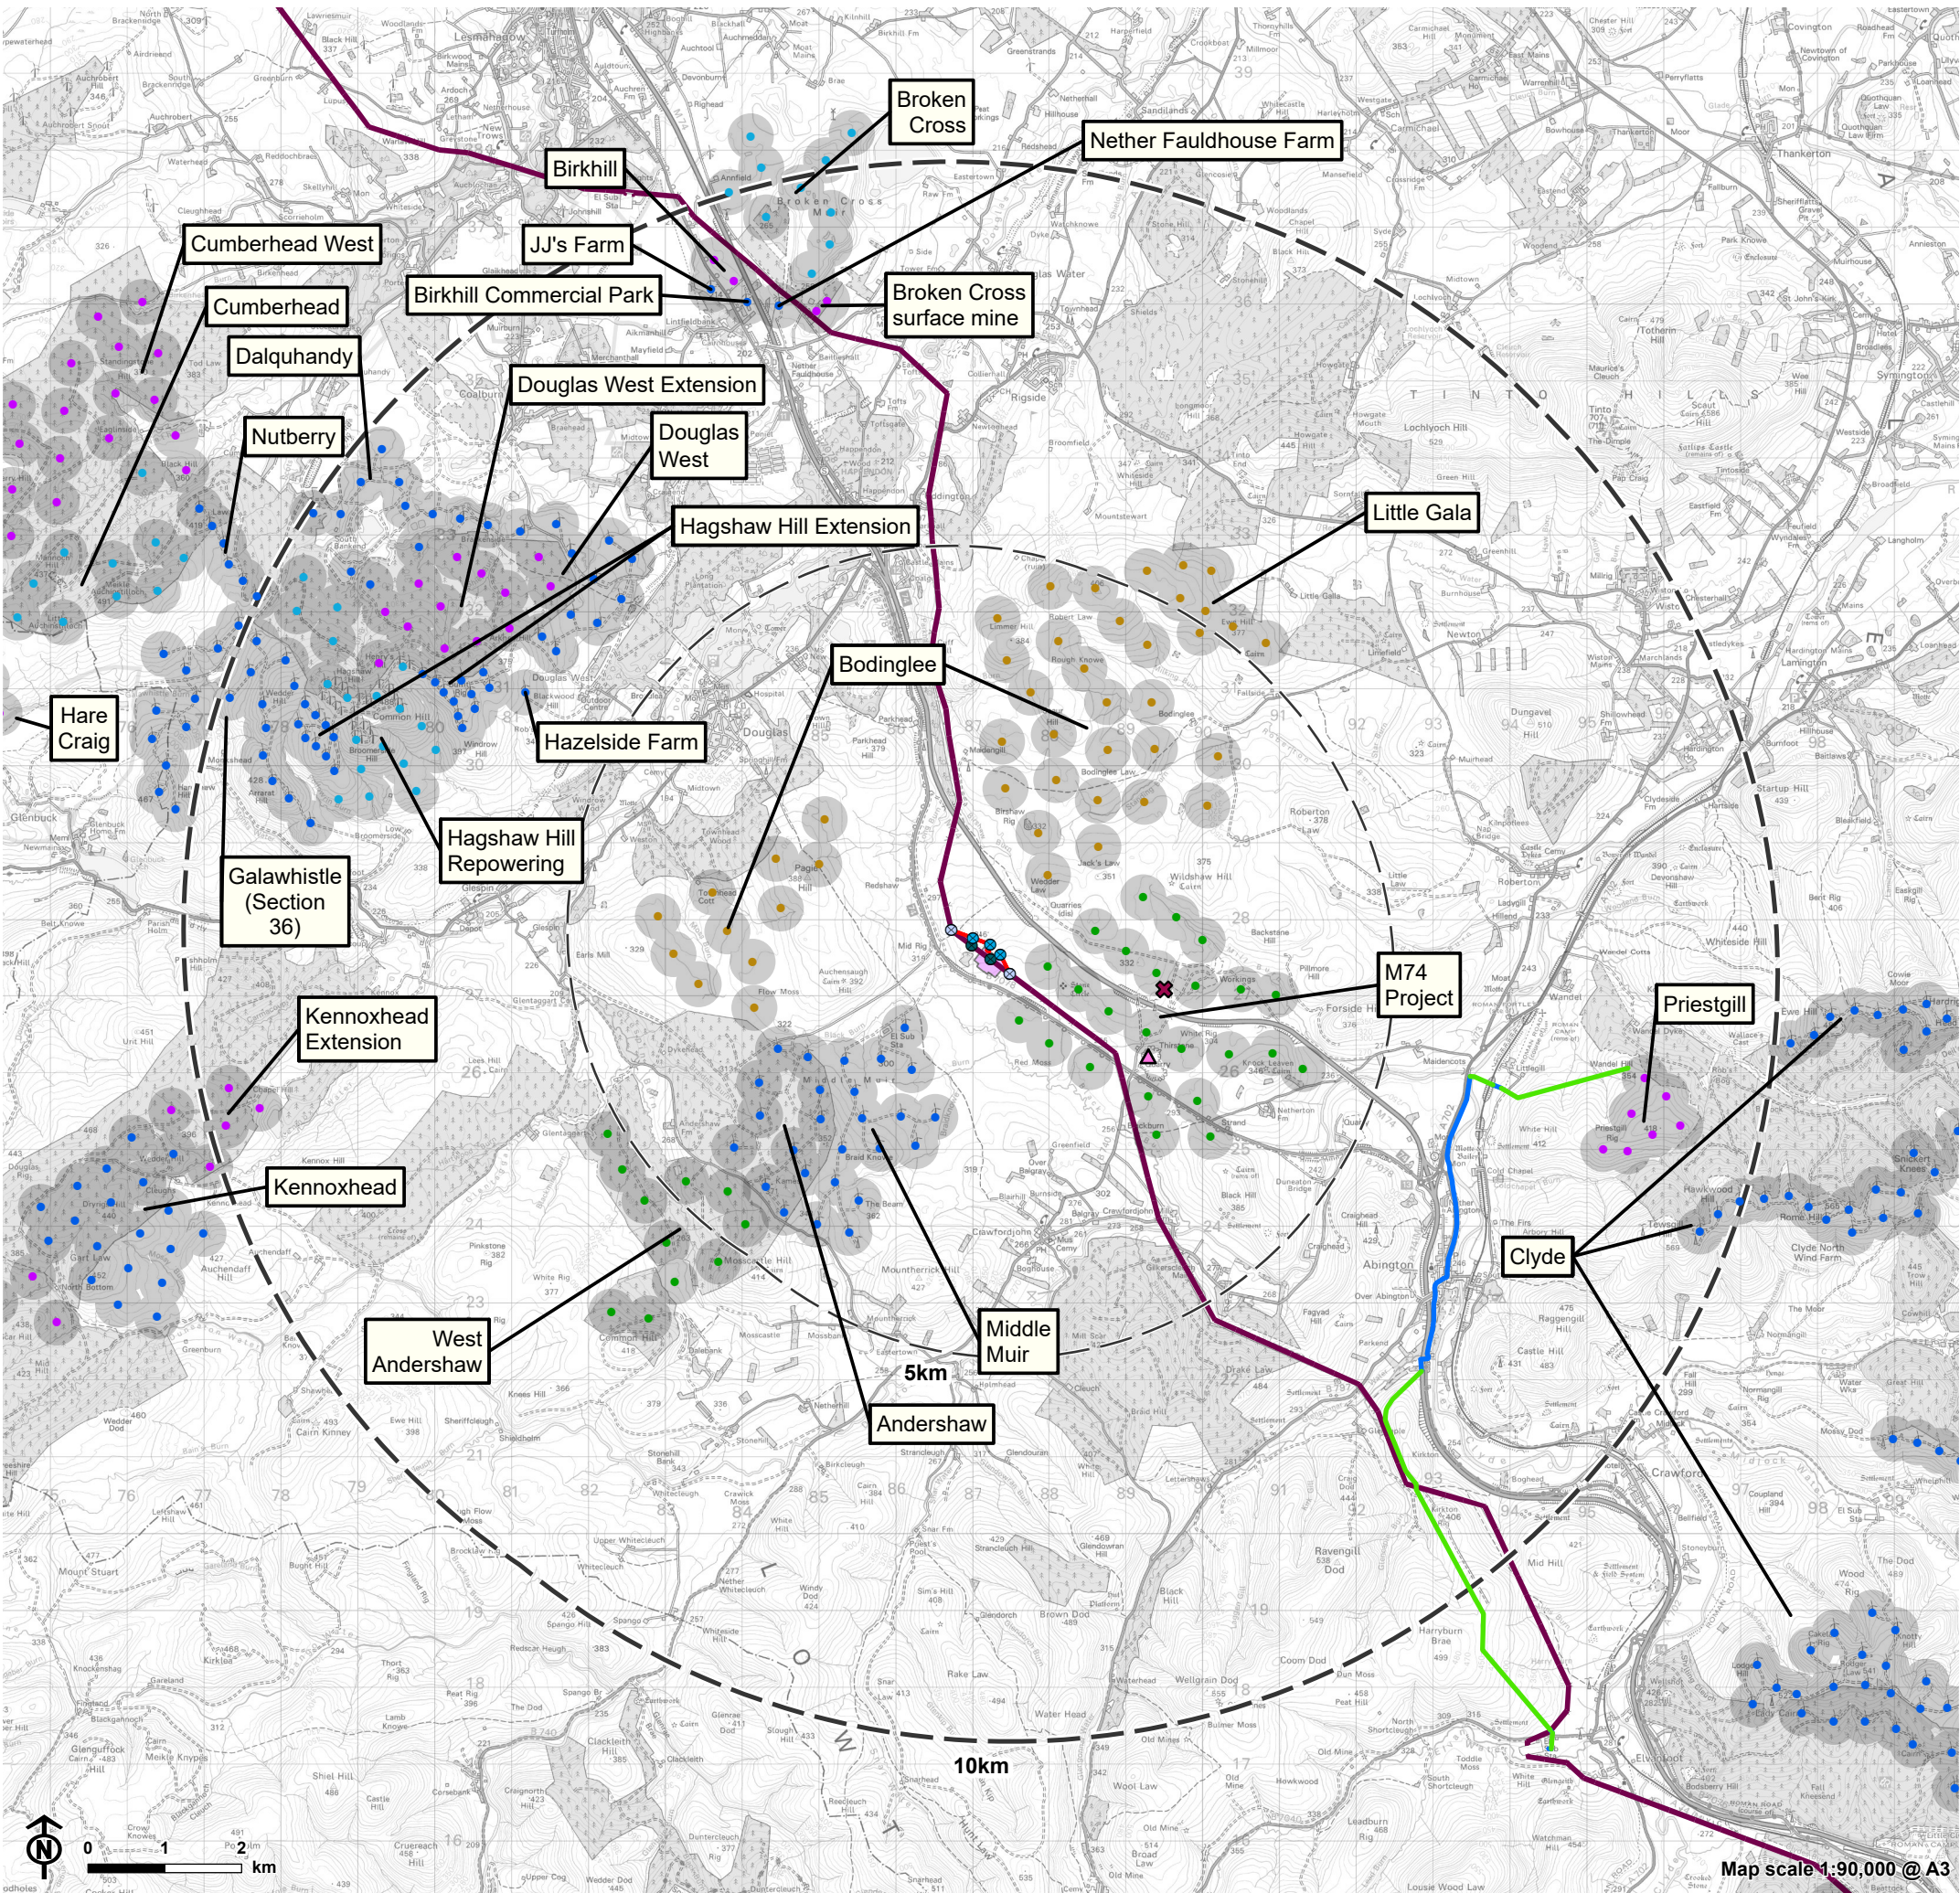

- Proposed tower
 - Proposed 400kV Overhead Line (OHL) ZV diversion
 - Existing tower
 - Existing tower to be removed
 - Existing 400kV Overhead Line (OHL)
 - 10km from from proposed 400kV Overhead Line (OHL) ZV diversion
 - 5km from from proposed 400kV Overhead Line (OHL) ZV diversion
- Other Developments**
- Duneaton Quarry (application for variation - previously consented)
 - MET Mast Centre (approved)
 - Priestgill Overhead Line (OHL) (consented)
 - Priestgill Underground Cable (UGC) (consented)
 - Redshaw Substation (proposed)
- Wind Farm Status**
- Application Submitted
 - Consented
 - Design/Scoping
 - Operational
 - Under Construction