400kV OHL ZV Diversion Project
Environmental Appraisal Report
for SP Energy Networks

LUC

Figure 5.1: Breeding Bird Survey Area and Breeding Bird Records

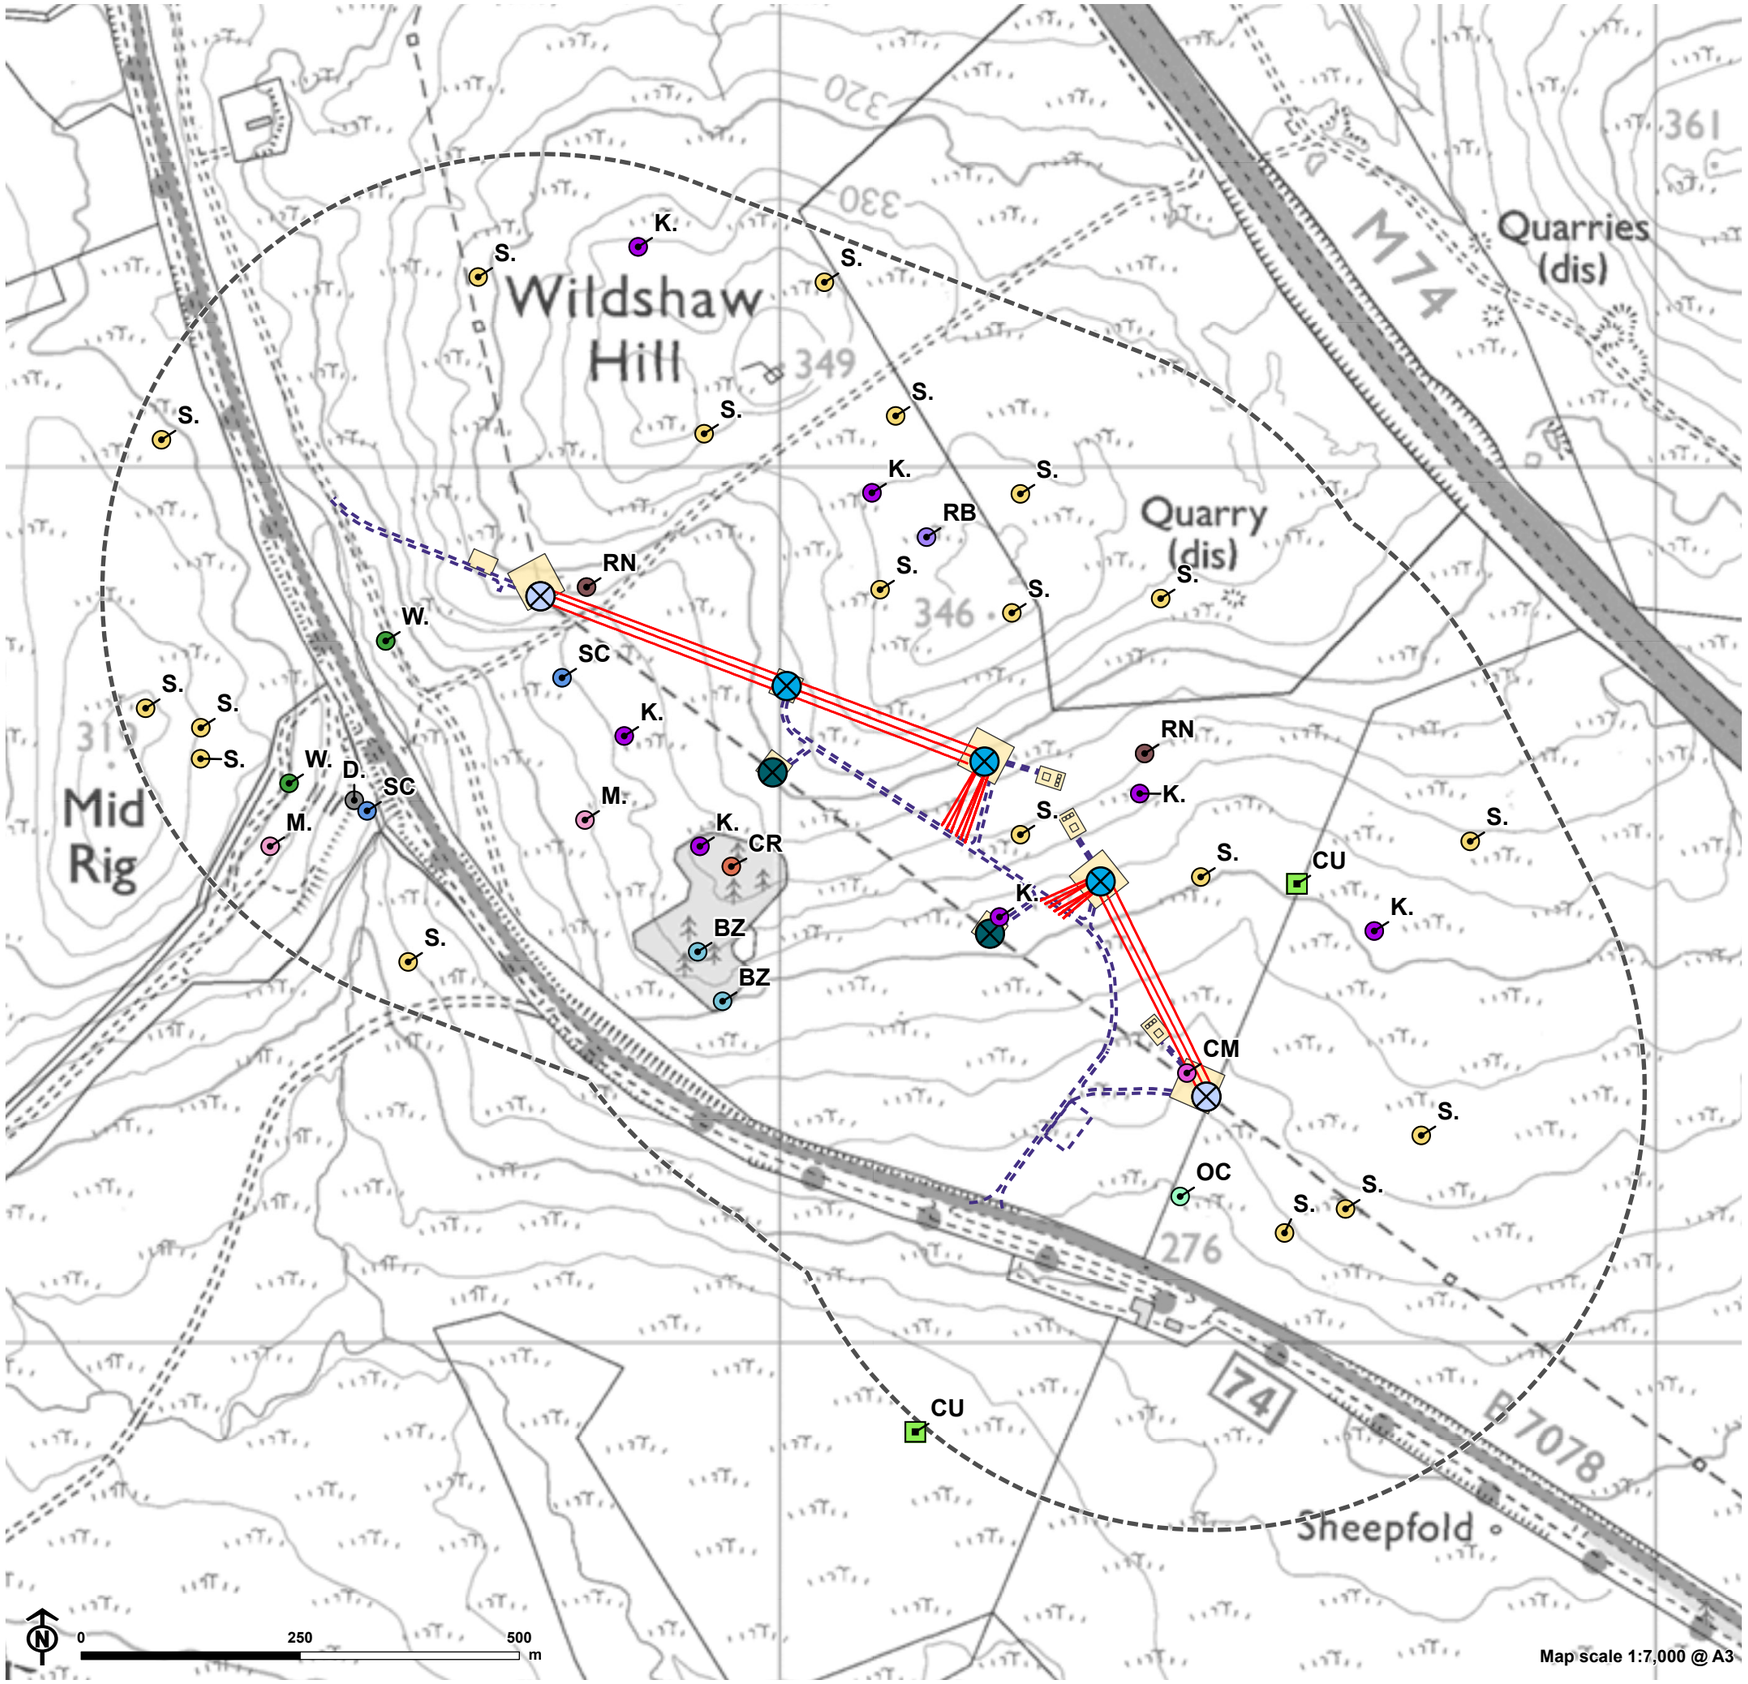

- Proposed tower
- Proposed 400kV Overhead Line (OHL) ZV diversion
- 500 m from proposed 400kV Overhead Line (OHL) ZV diversion
- Existing tower
- Existing tower to be removed

Breeding bird record (all visits combined)

- BZ - Buzzard
- CM - Common gull
- CR - Crossbill (common)
- D. - Dunnock
- K. - Kestrel
- M. - Mistle thrush
- OC - Oyster catcher
- RB - Reed bunting
- RN - Raven
- S. - Skylark
- SC - Stonechat
- W. - Wheatear

Estimated territory centres

- CU - Curlew

SP Energy Networks

© Crown copyright and database rights Ordnance Survey 0100031673

EB:cooper_h LUC 12775_OHL_ZV_Div_EIA 09/05/2024
Source: SPEN