

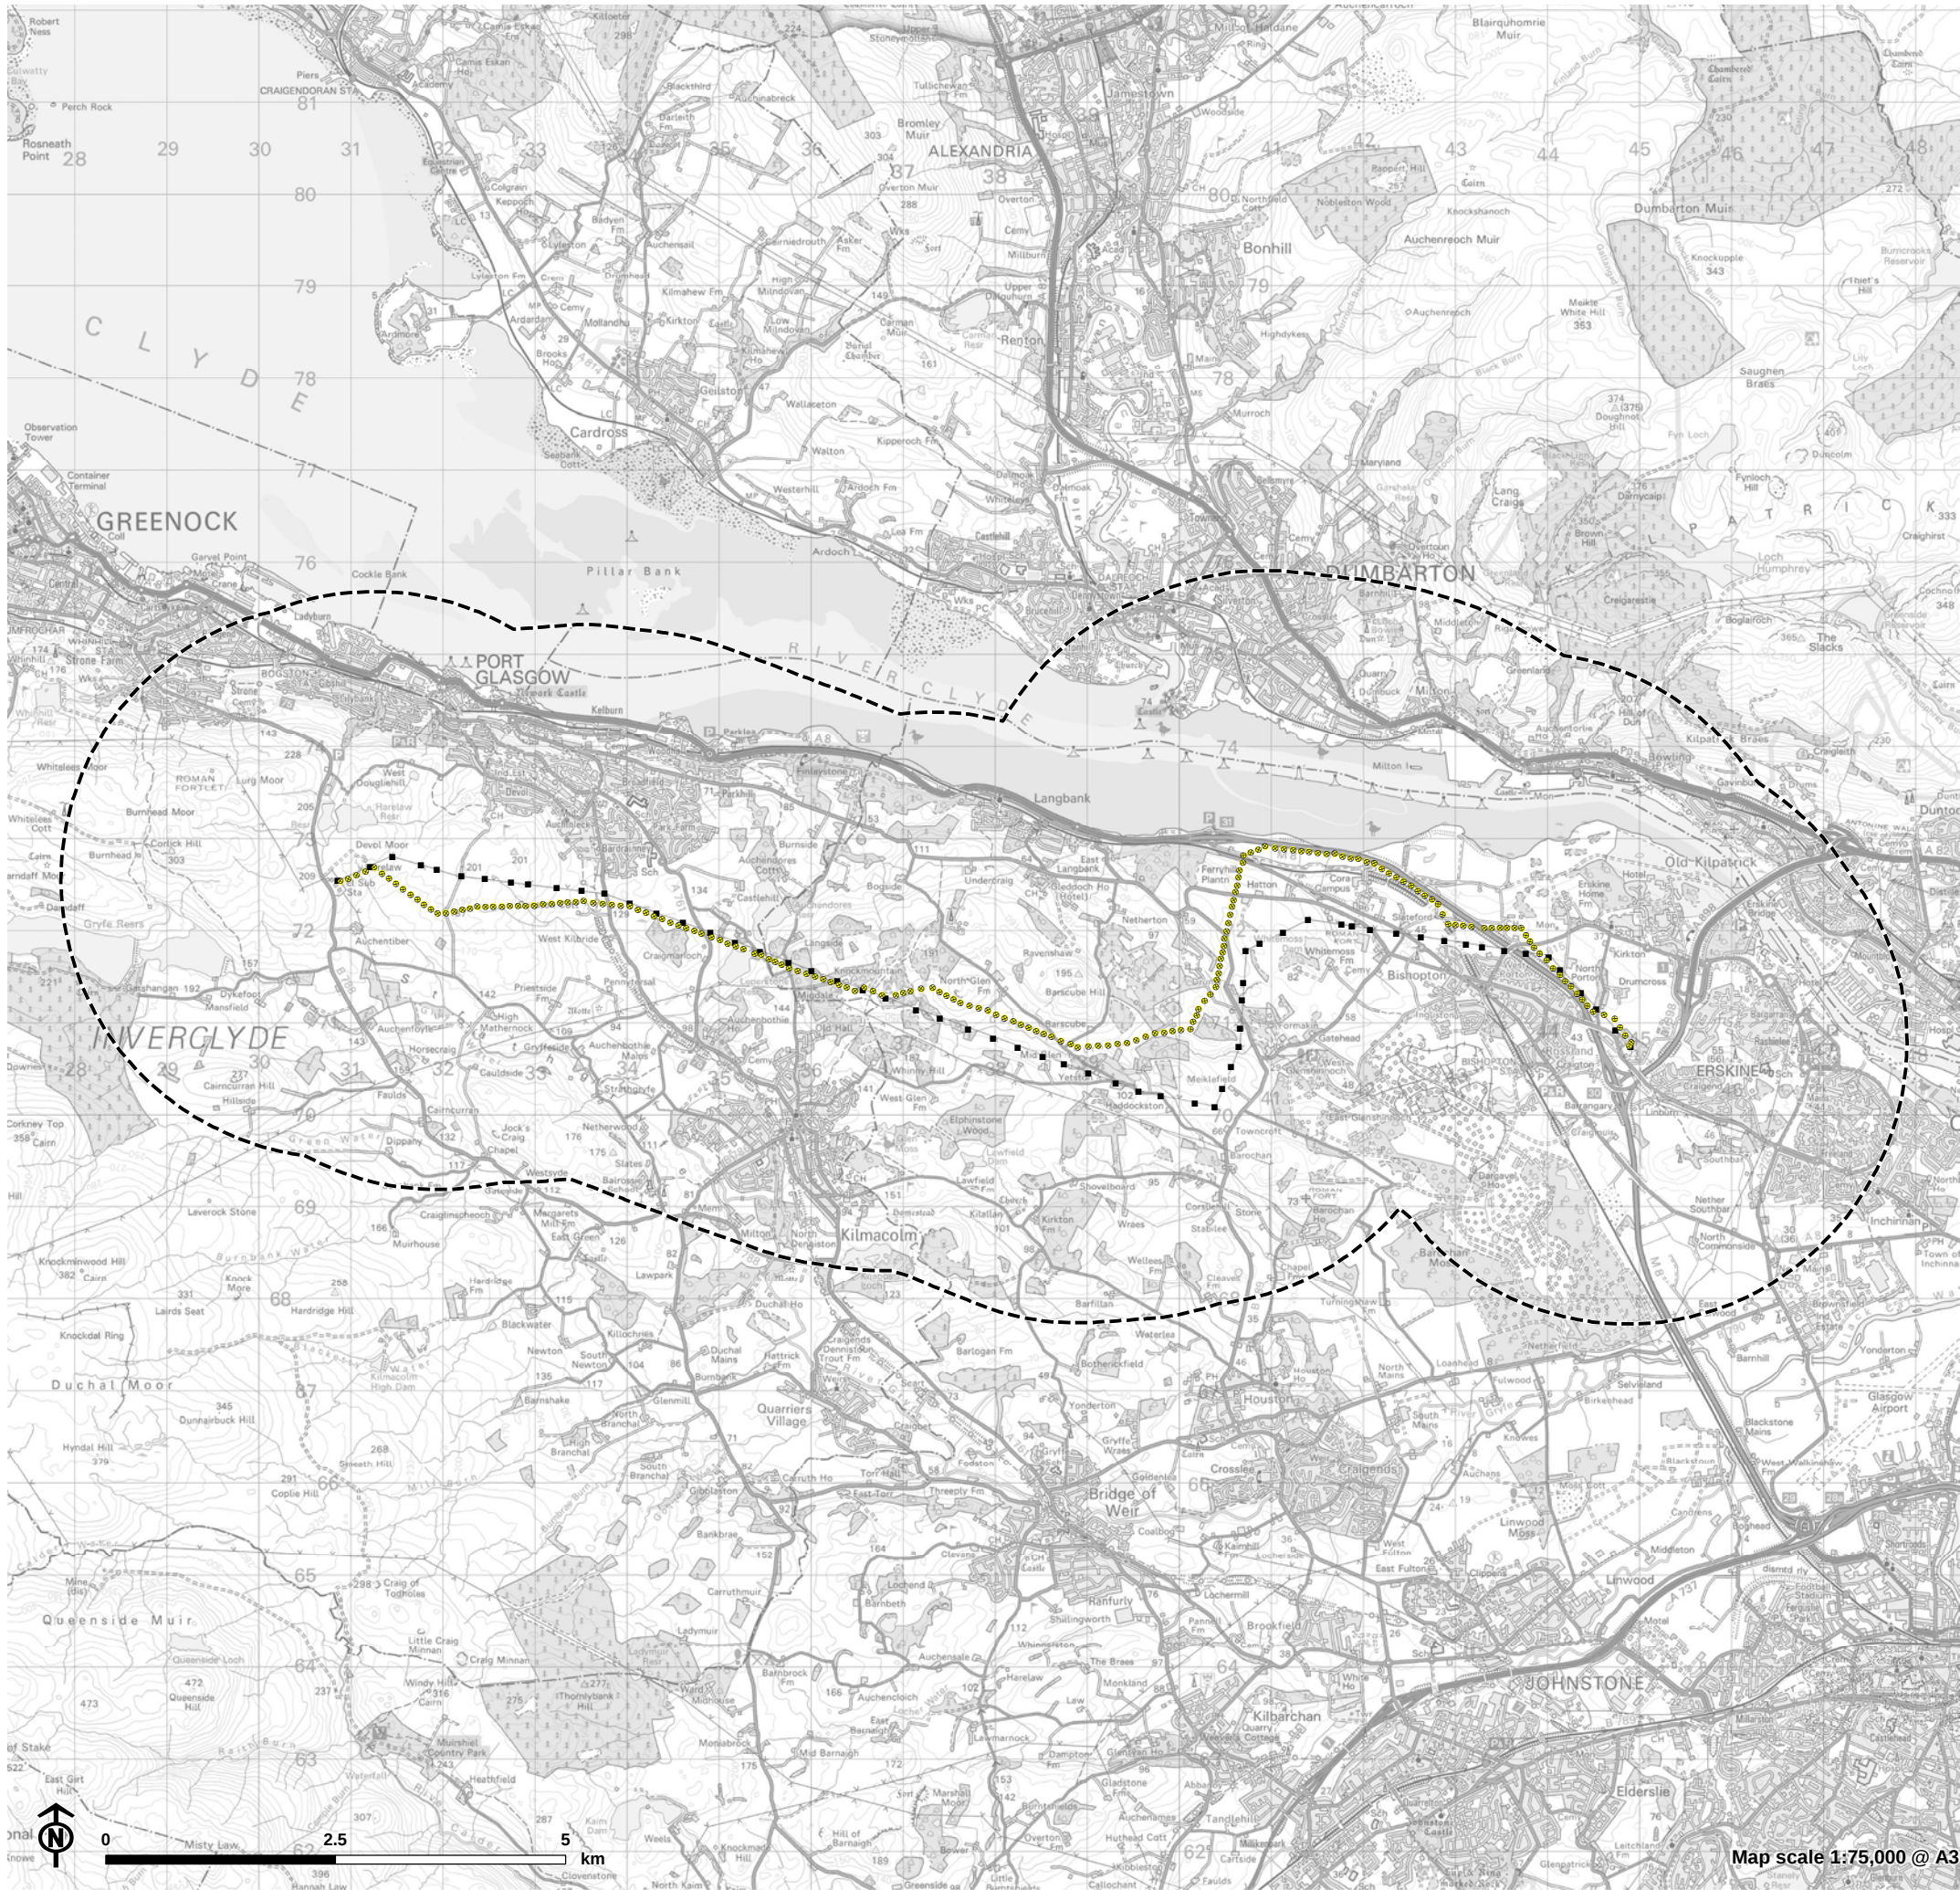


Figure 6.1.1: Landscape and Visual Impact Assessment Study Area

- Study Area
- New 132kV OHL (wood pole)
- Existing 132kV OHL (towers to be removed)