


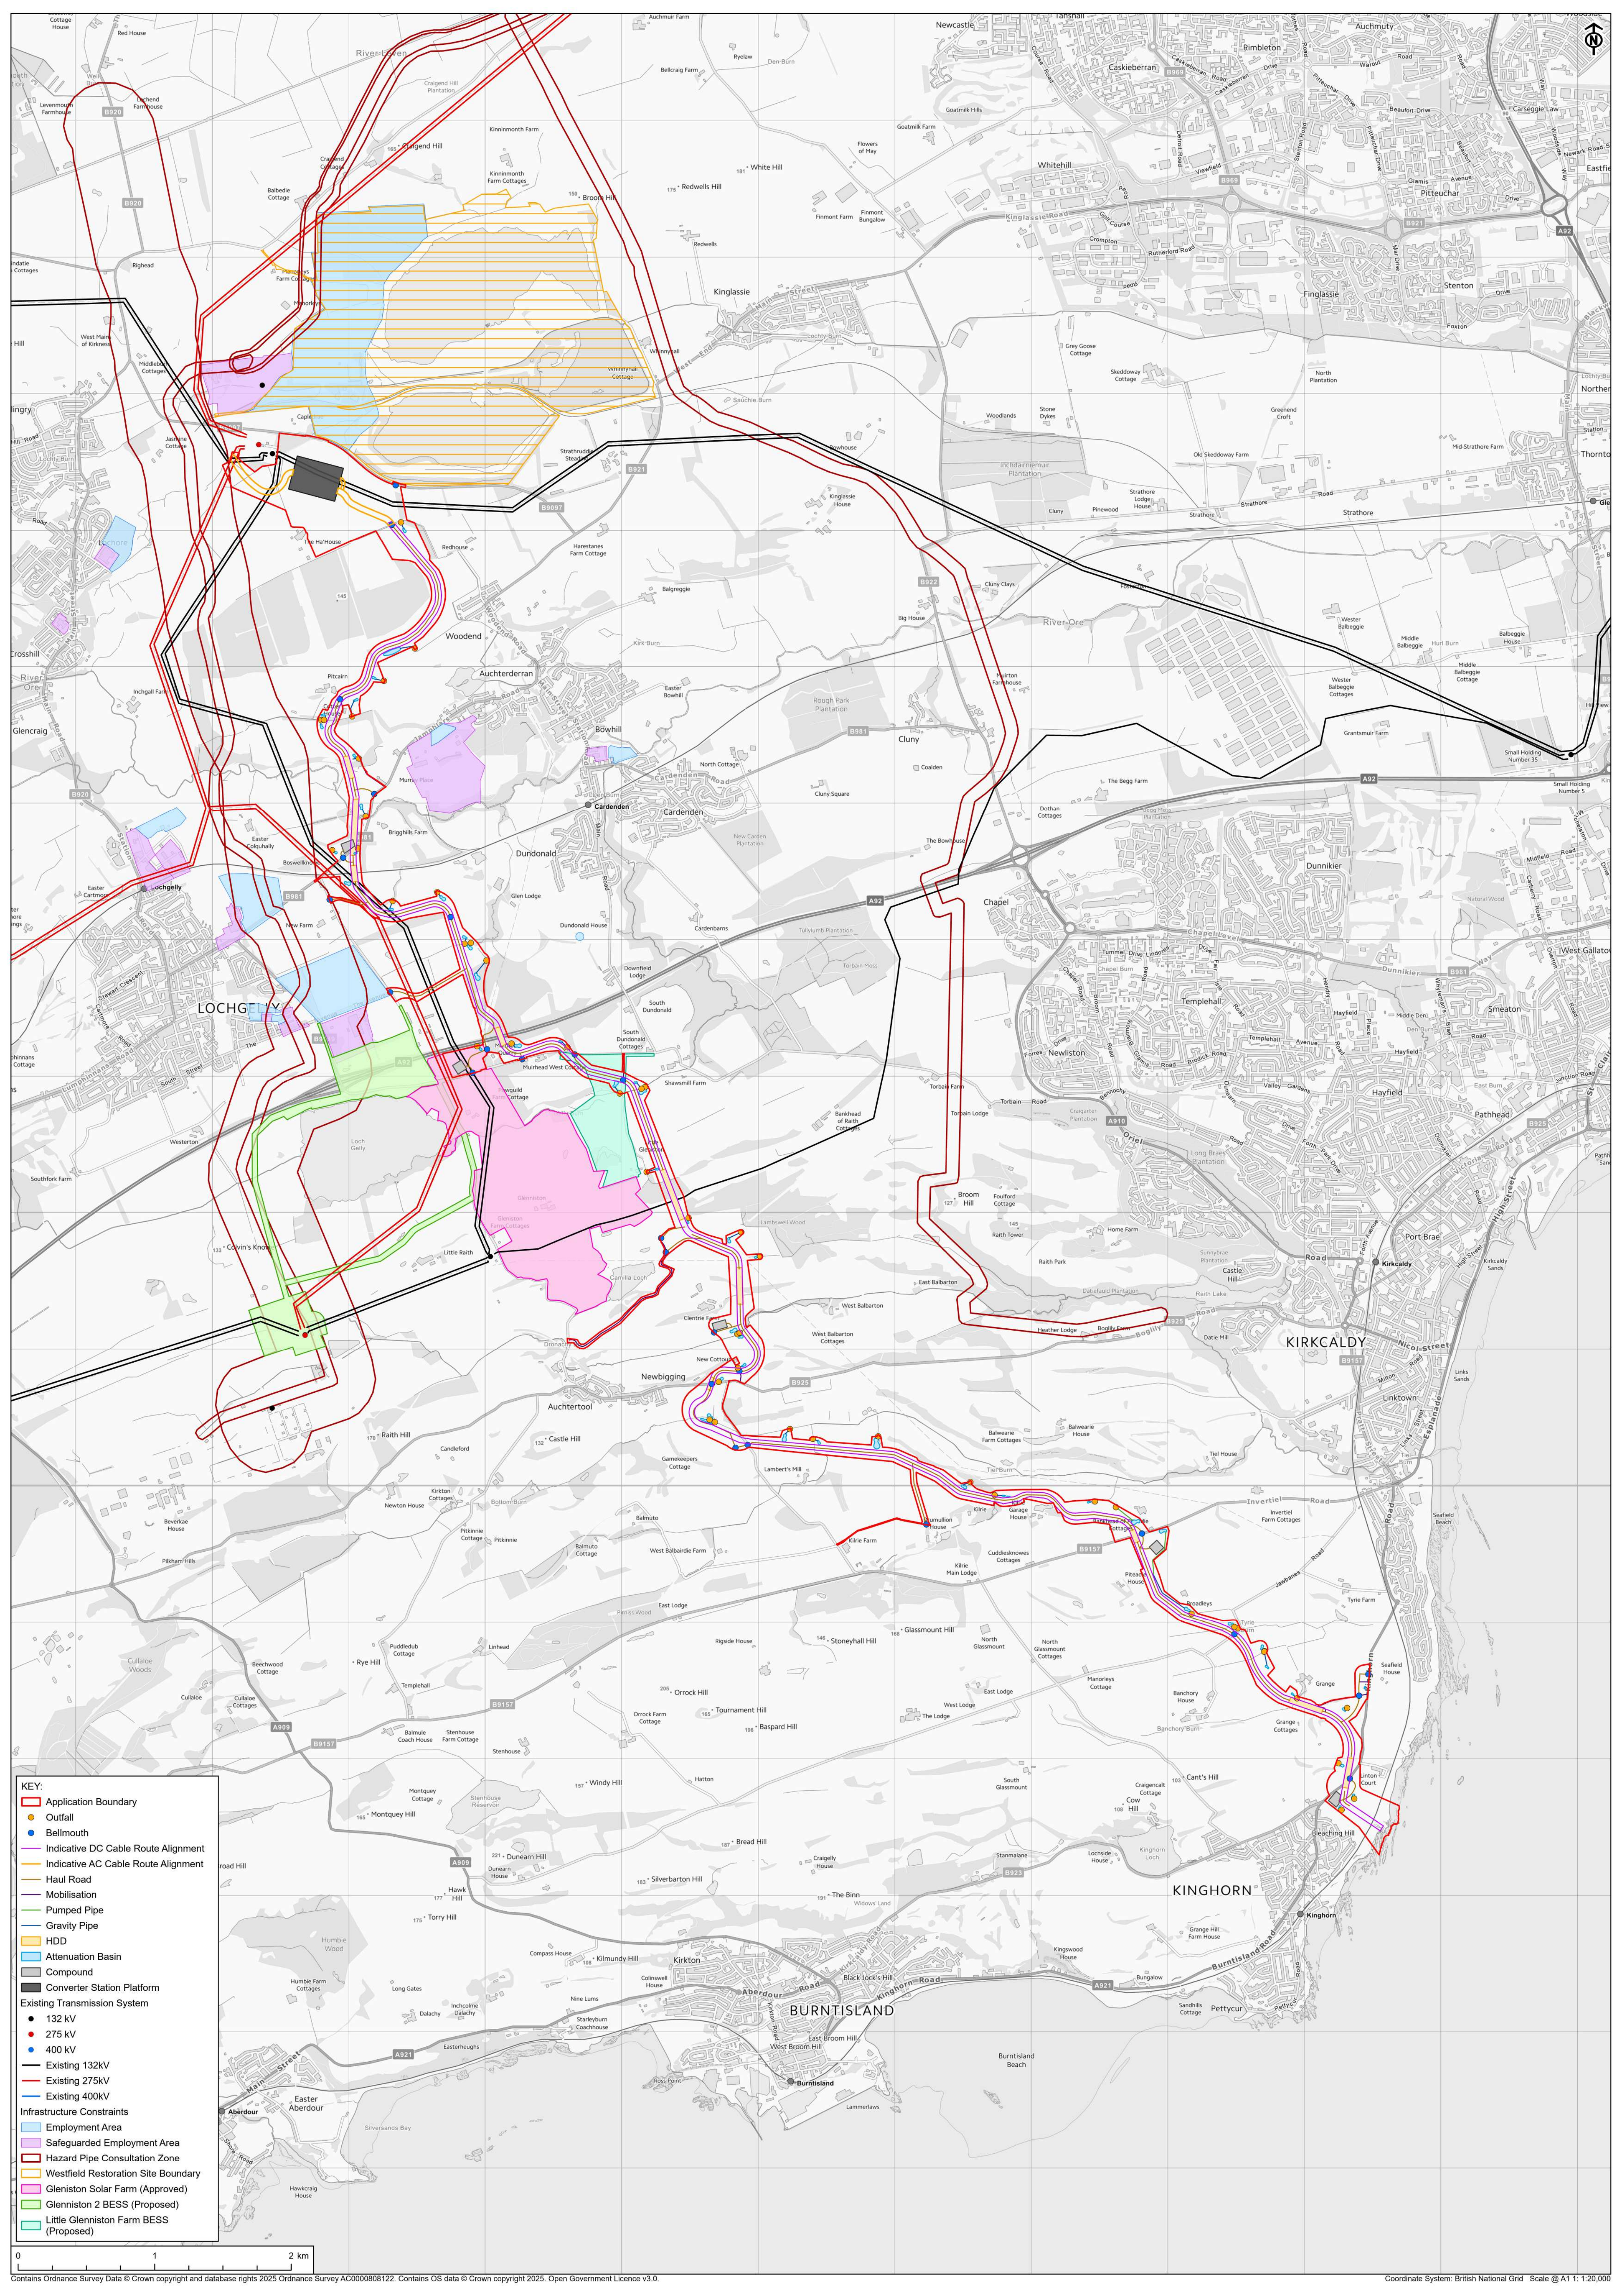

Application Boundary

Outfall

Bellmouth

Indicative DC Cable Route Alignment

Indicative AC Cable Route Alignment

Haul Road

Mobilisation

Pumped Pipe

Gravity Pipe

HDD

Attenuation Basin

Compound

Converter Station Platform

Existing Transmission System

132 kV

275 kV

400 kV

Existing 132kV

Existing 275kV

Existing 400kV

Infrastructure Constraints

Employment Area

Safeguarded Employment Area

Hazard Pipe Consultation Zone

Westfield Restoration Site Boundary

Gleniston Solar Farm (Approved)

Glenniston 2 BESS (Proposed)

Little Glenniston Farm BESS (Proposed)