




Option 1: extension of the existing substation site

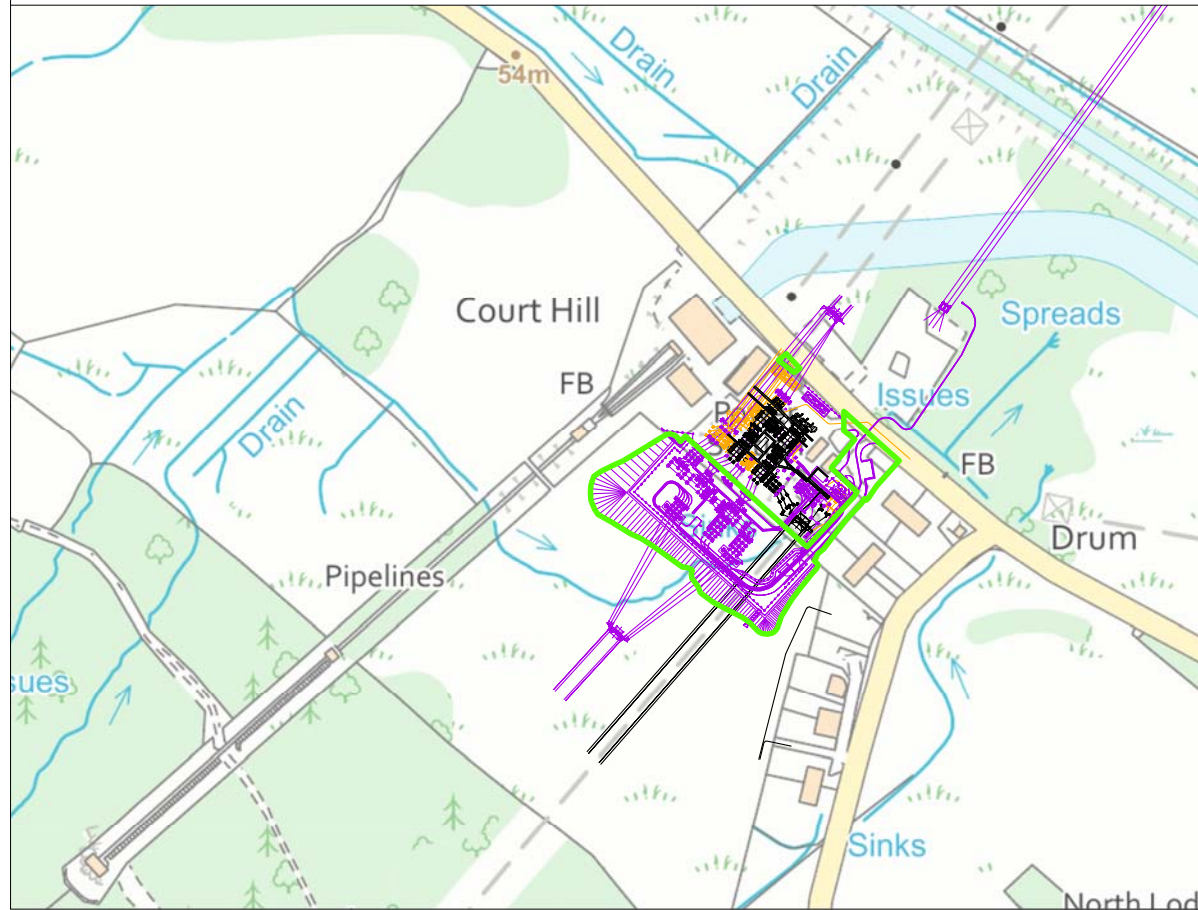


Option 2: retain the existing substation and relocate the proposed extension to the opposite side of Glenlee Power Station

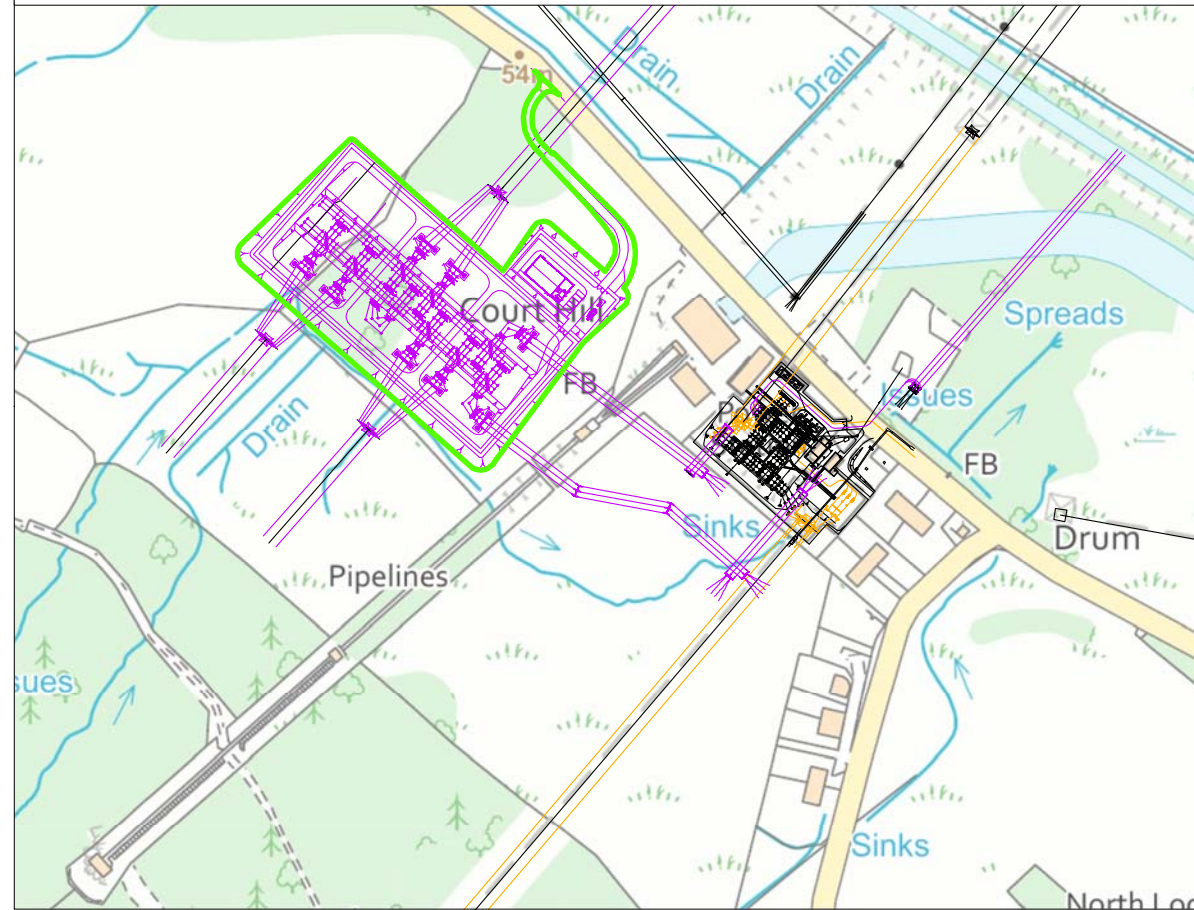

Option 3: move entire substation (proposed and existing) to the opposite side of Glenlee Power Station as an air insulated substation

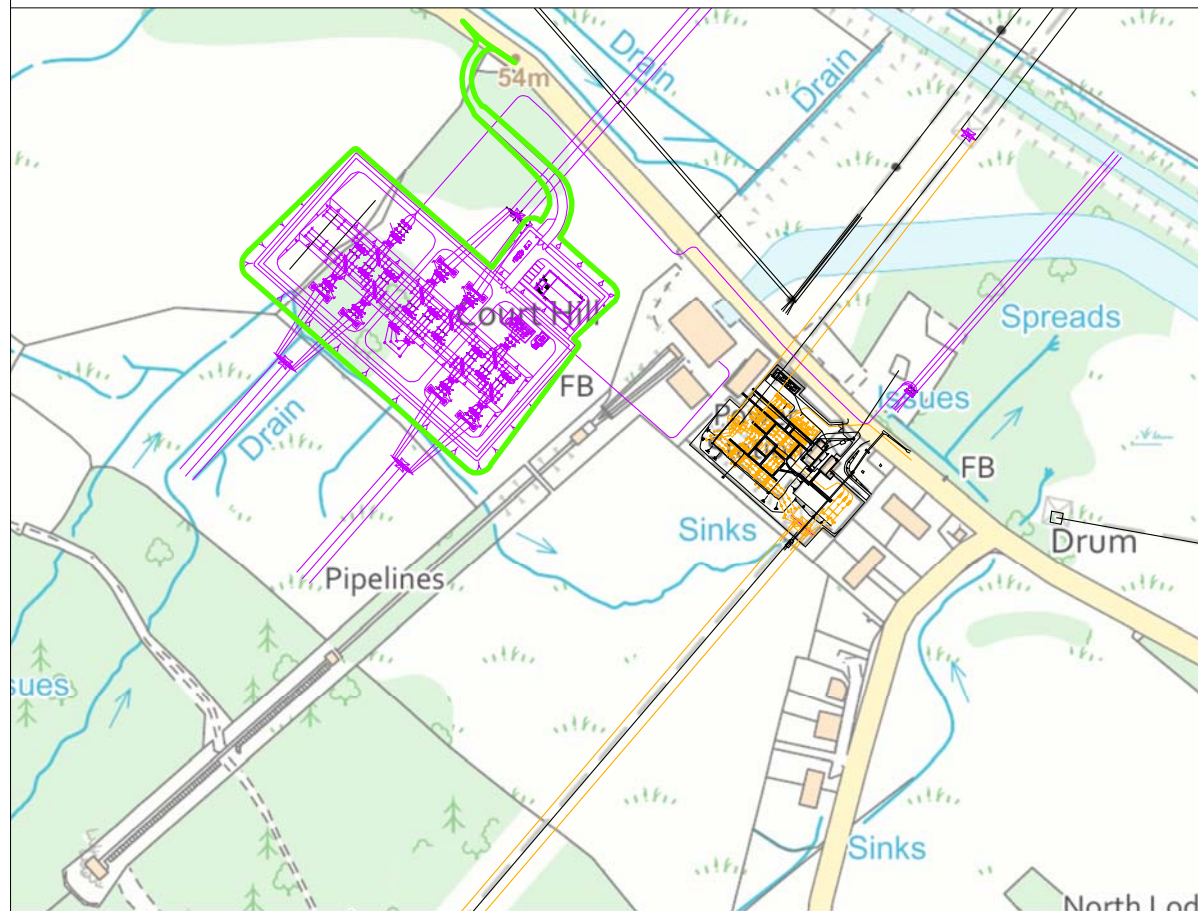

Option 4: move entire substation (proposed and existing) to the opposite side of Glenlee Power Station as a gas insulated substation

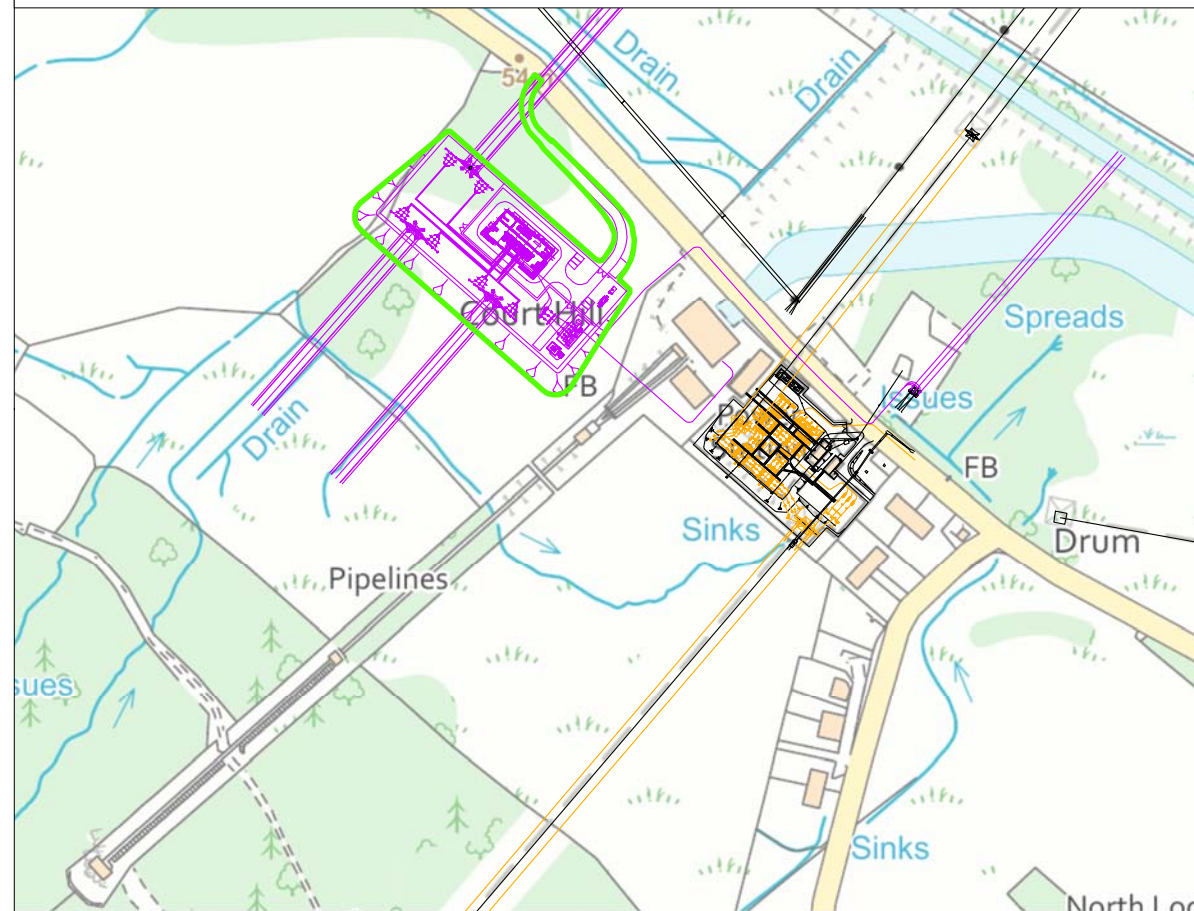

**Glenlee Substation Extension
EIA Report**

**Figure 3.1: Glenlee Substation Extension
Design Options**

- ▭ Land take
- Existing infrastructure
- New infrastructure
- Infrastructure to be removed

0 100 200
m

Map Scale @ A3: 4,000

