


Figure 2.1a: Proposed Routes

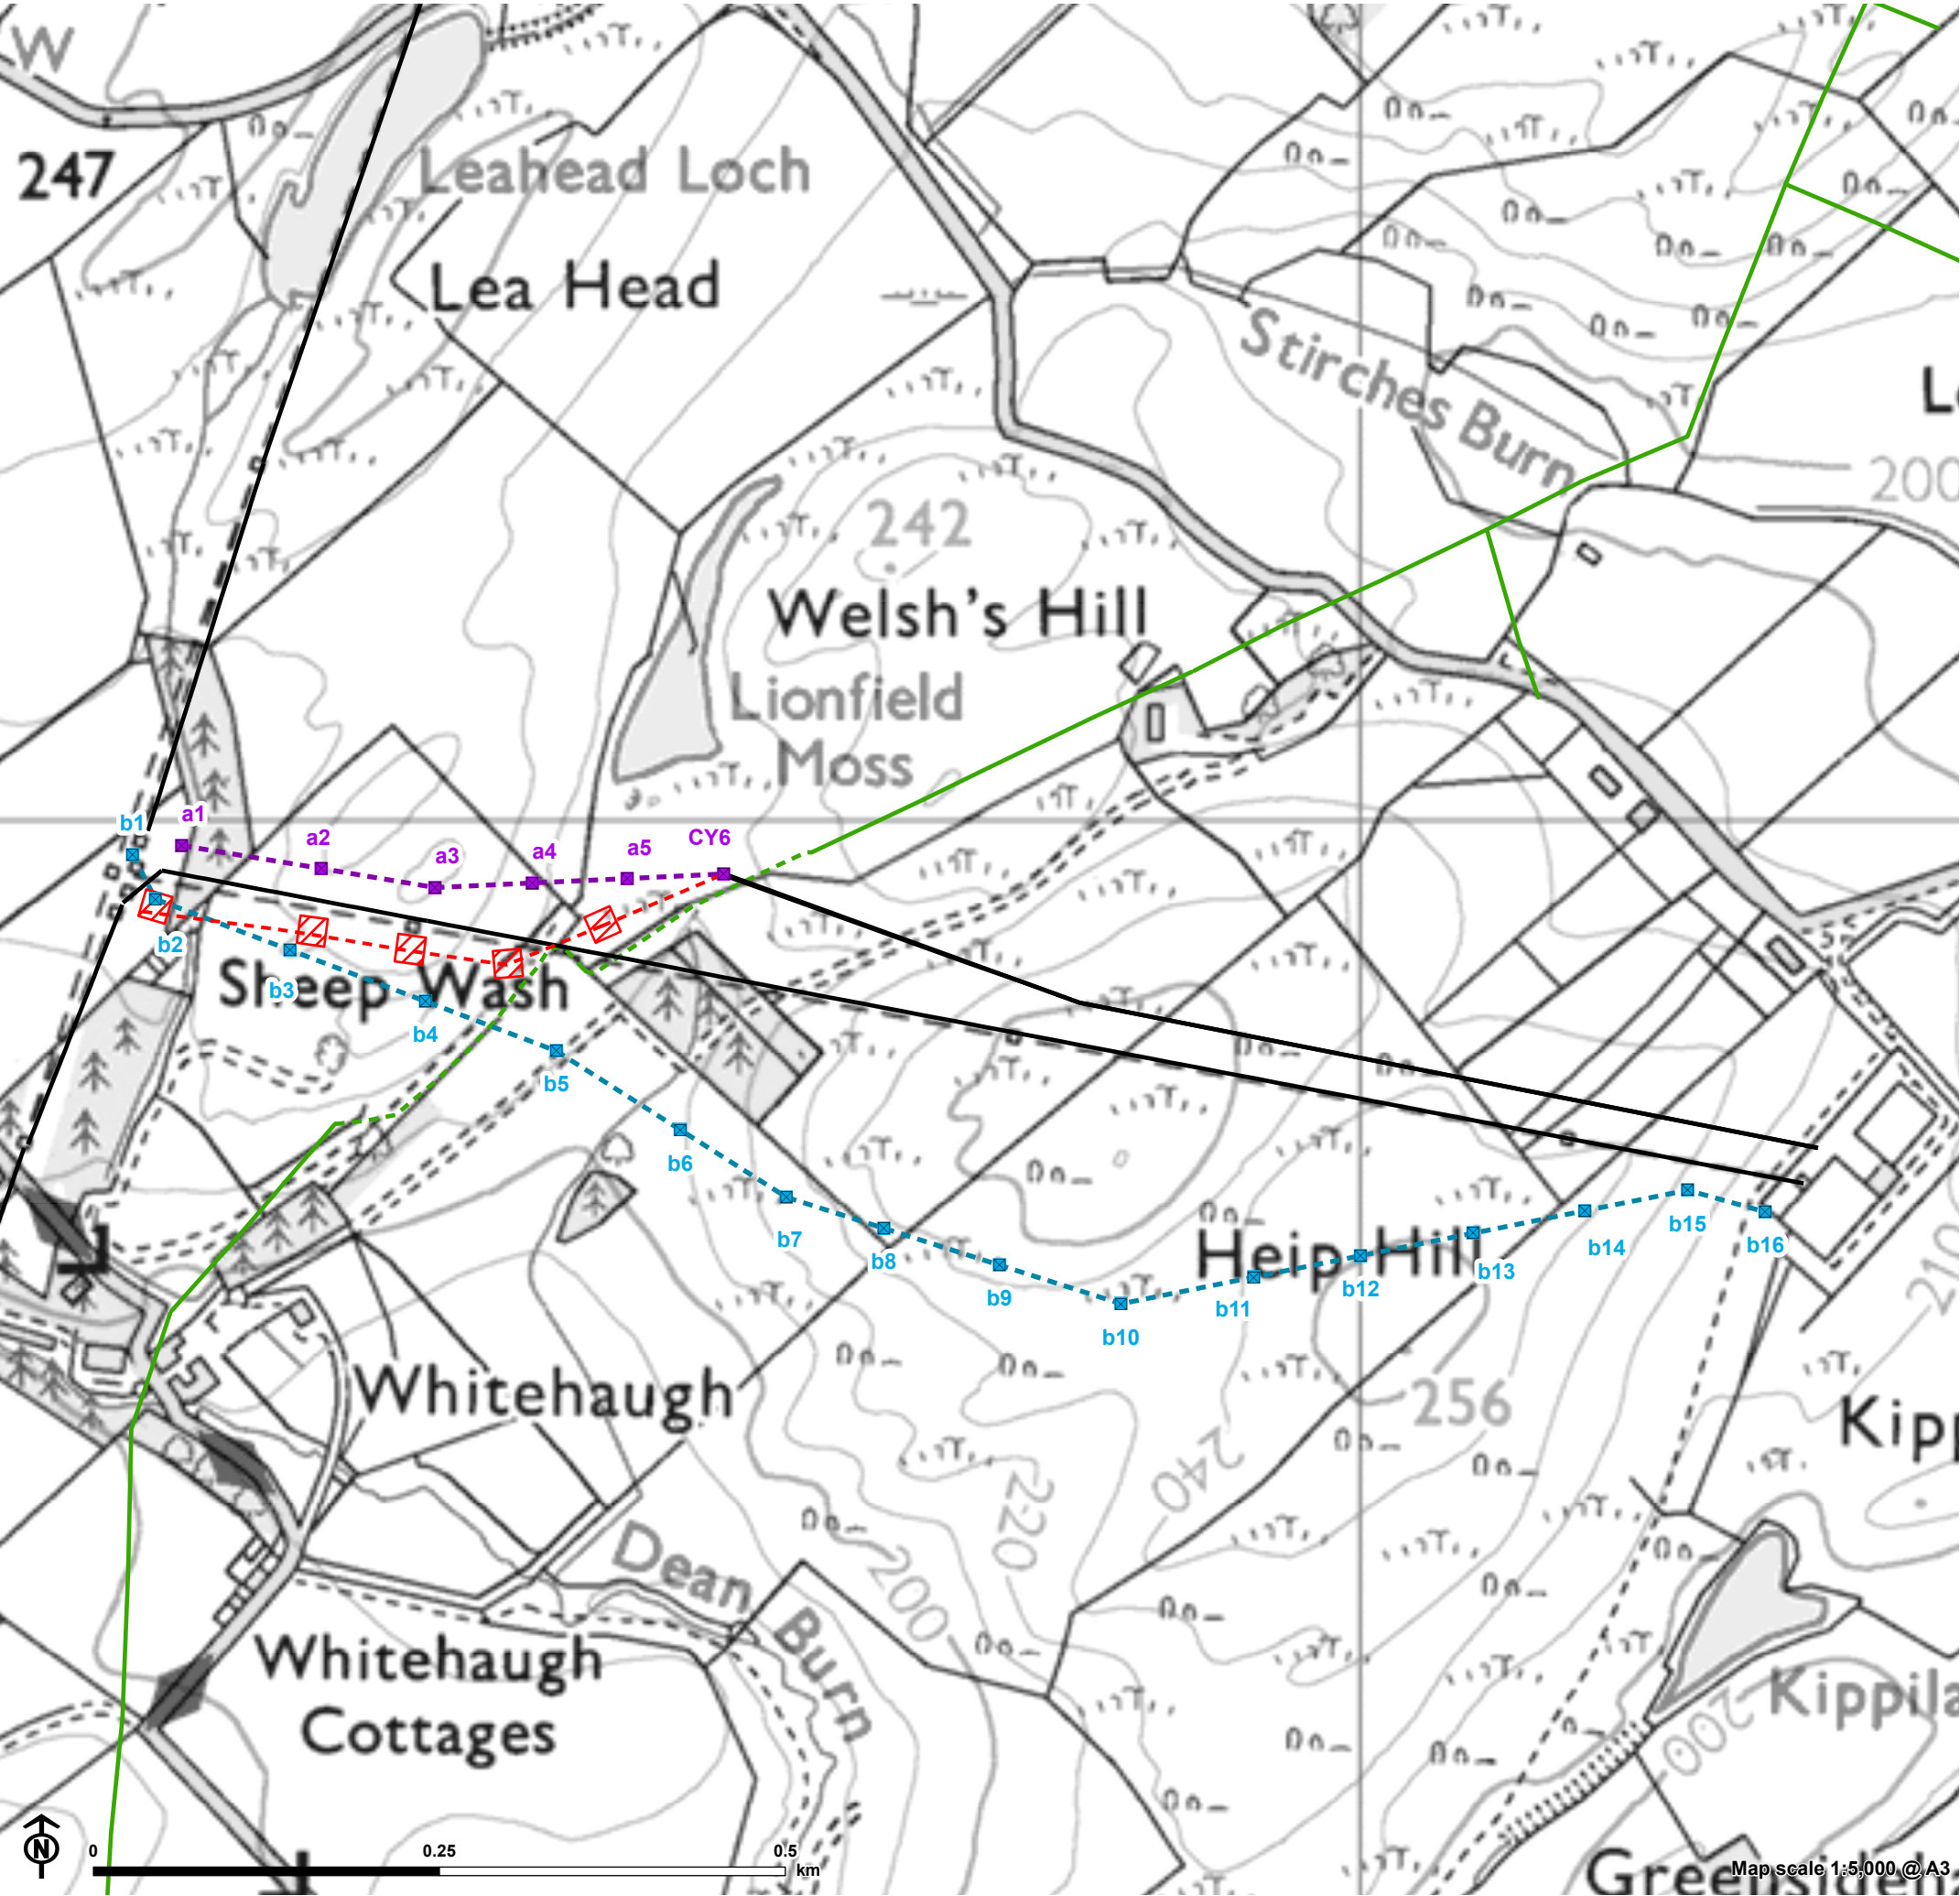

Proposed overhead line routes

- Route 'a' (wood pole a1-a5 and CY6)
- Route 'b' (wood pole b1-b16)
- Route 'a' proposed OHL
- Route 'b' proposed OHL

CY route to be removed

- CY route
- ▨ CY temporary working area

Existing network

- 132kV overhead line (OHL)
- 11kV overhead line (OHL)
- - - 11kV underground cable (UGC)