


What is Proposed

SP Transmission is planning a new overhead line of approximately 7.5 km to connect the proposed Glenburnie Wind Farm Substation (formerly called Longcroft Wind Farm) to a proposed cable sealing end (CSE) compound west of Oxton, which is planned as part of a separate project to replace the existing overhead line between the Dun Law Extension Substation and the proposed Galashiels Substation. The new line will mainly use double Trident wood poles (H-poles), typically 11-16 m high and spaced at 80-110 m.

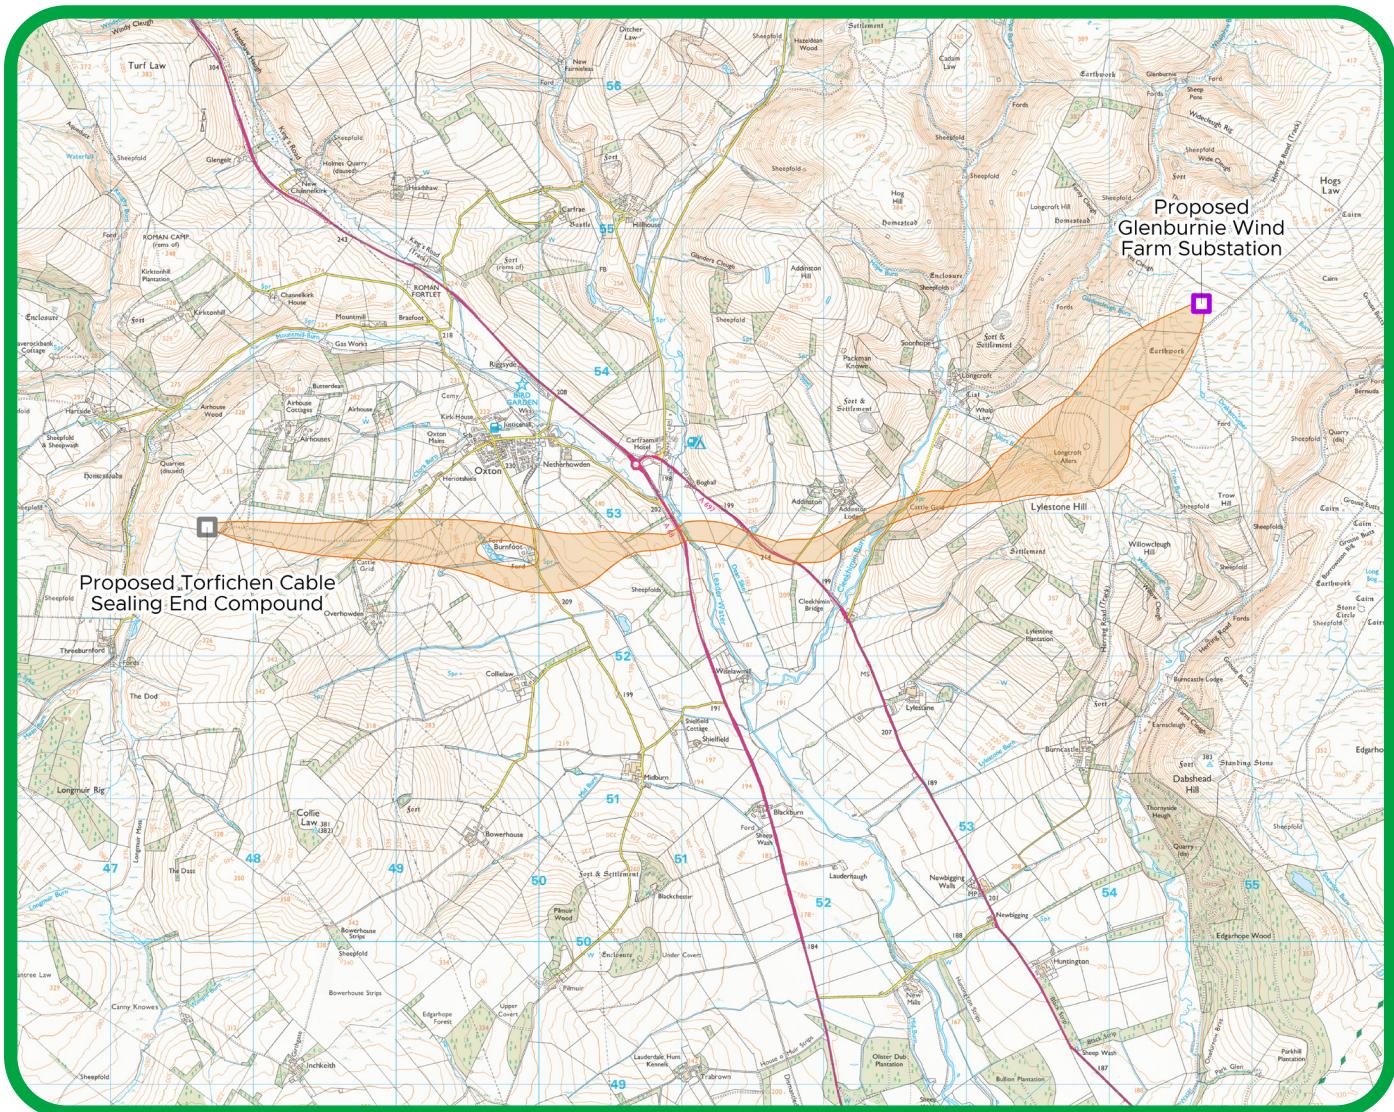

Proposed Overhead Line Design

Following careful environmental planning, the route shown above has been selected as the preferred route option as it minimises potential effects on both people and the environment. We are now seeking your views. Involving local communities is very important to us, as it helps identify any issues and address concerns at an early stage. More information on the project and the preferred route is available on the project website, which also explains how you can provide your feedback.



Trident
Wood Pole




H-Pole

Have Your Say

A copy of this information leaflet is being sent to all land owners impacted by the preferred route and addresses within 2 km of the preferred route. The PAC Event 1 is also being advertised in local newspapers, and a printed poster explaining the project and consultation will be displayed on public notice boards.

We invite you to visit the project website (address below) for more information, including the Routeing and Consultation Document, which outlines the initial stages of work to identify a preferred route for the new overhead line. The Routeing and Consultation Document includes a review of key environmental features, identification of alternative routes, and analysis of route options.

For more information on the project please scan the QR code



All responses received during the consultation period will be considered alongside the findings of the Routeing and Consultation document to help SP Transmission decide on the proposed route to be taken forward to the environmental assessment and consulted on as necessary. A further opportunity to comment formally will be provided once the application is submitted to the Scottish Government's Energy Consents Unit. Please note that providing feedback now does not affect your right to comment on the final application.

Consultation responses should be received by 24th of March 2026.



How do I get in touch?

The consultation will run between February 23rd - March 24th although information relating to the project will remain on the project website and be available for download before and after these dates.

You can get in touch by:

Emailing us directly at:
longcroftgc@spenergynetworks.co.uk

By post, allowing 7 days for receipt and sending your comments to this address:

Longcroft Wind Farm Connection Project
Land and Planning
SP Energy Networks
55 Fullarton Drive
Cambuslang
G32 8FA