


Figure 2.2 Proposed ZV diversion

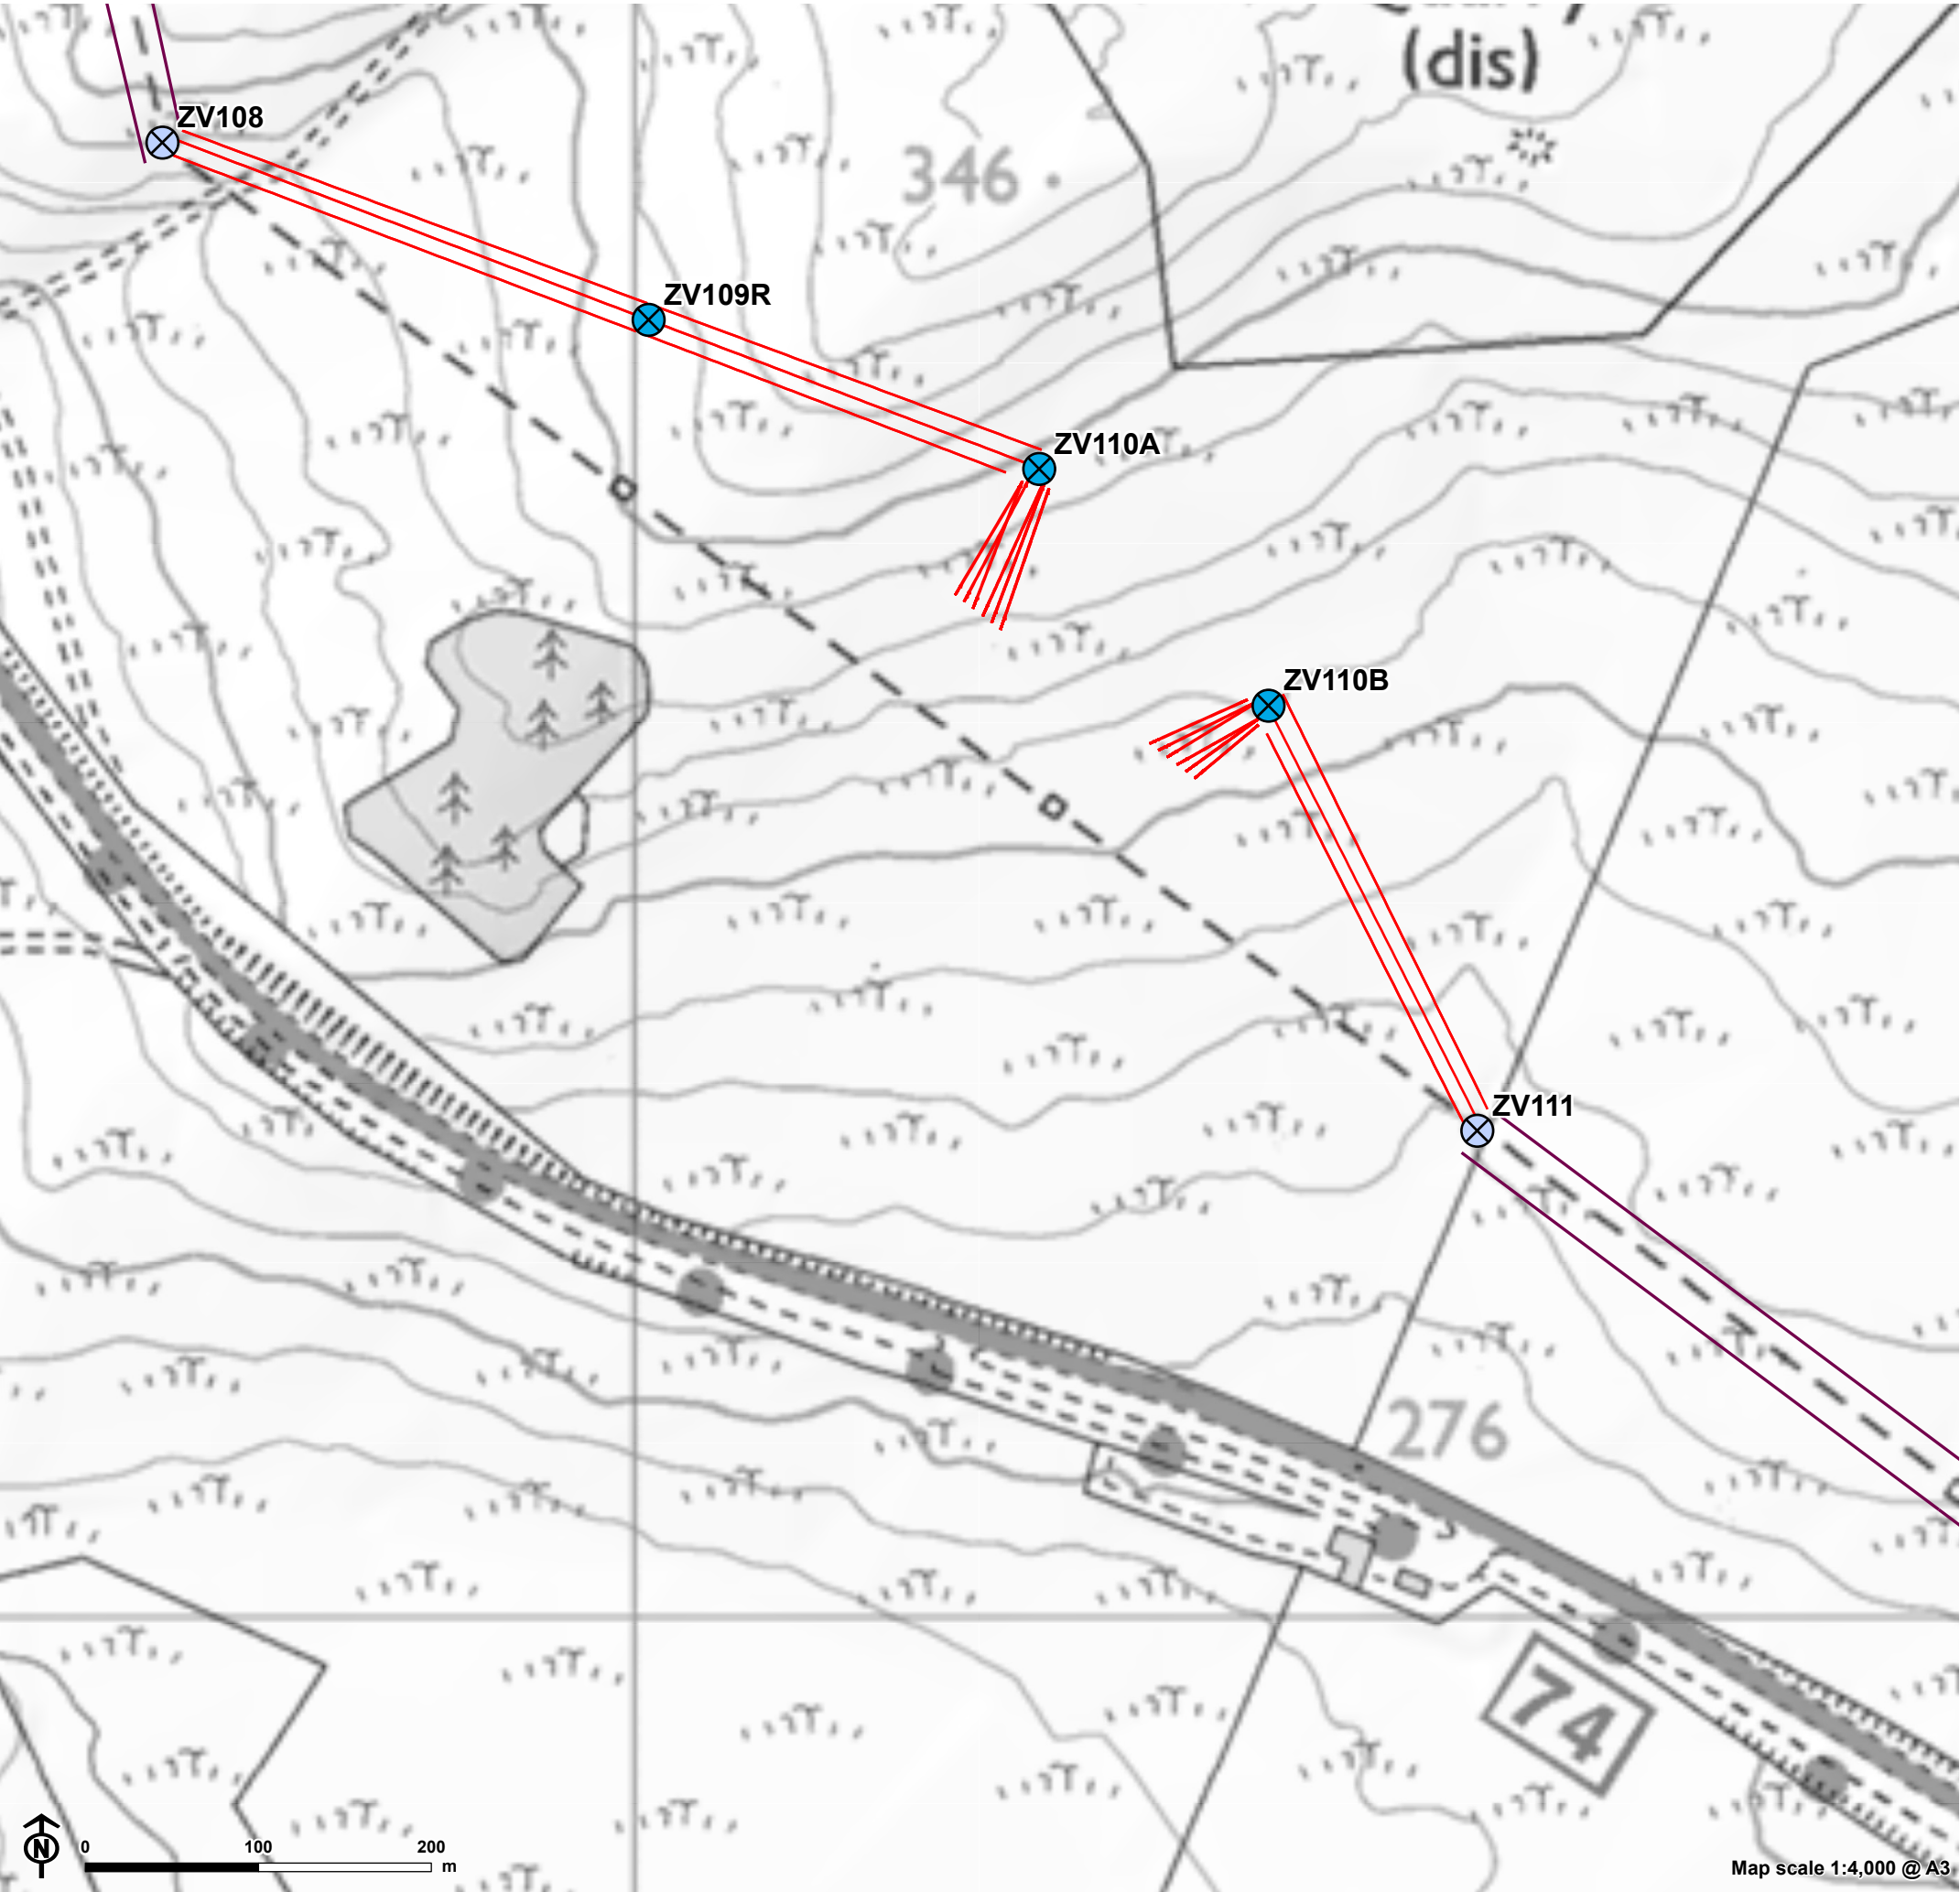

- Proposed tower (pending determination)
- Proposed 400kV Overhead Line (OHL) ZV diversion (pending determination)
- Existing tower
- Existing 400kV Overhead Line (OHL) - ZV route

Note:
ZV diversion is subject to a separate consenting process.