LUC

Figure 3.1: Proposed site plan

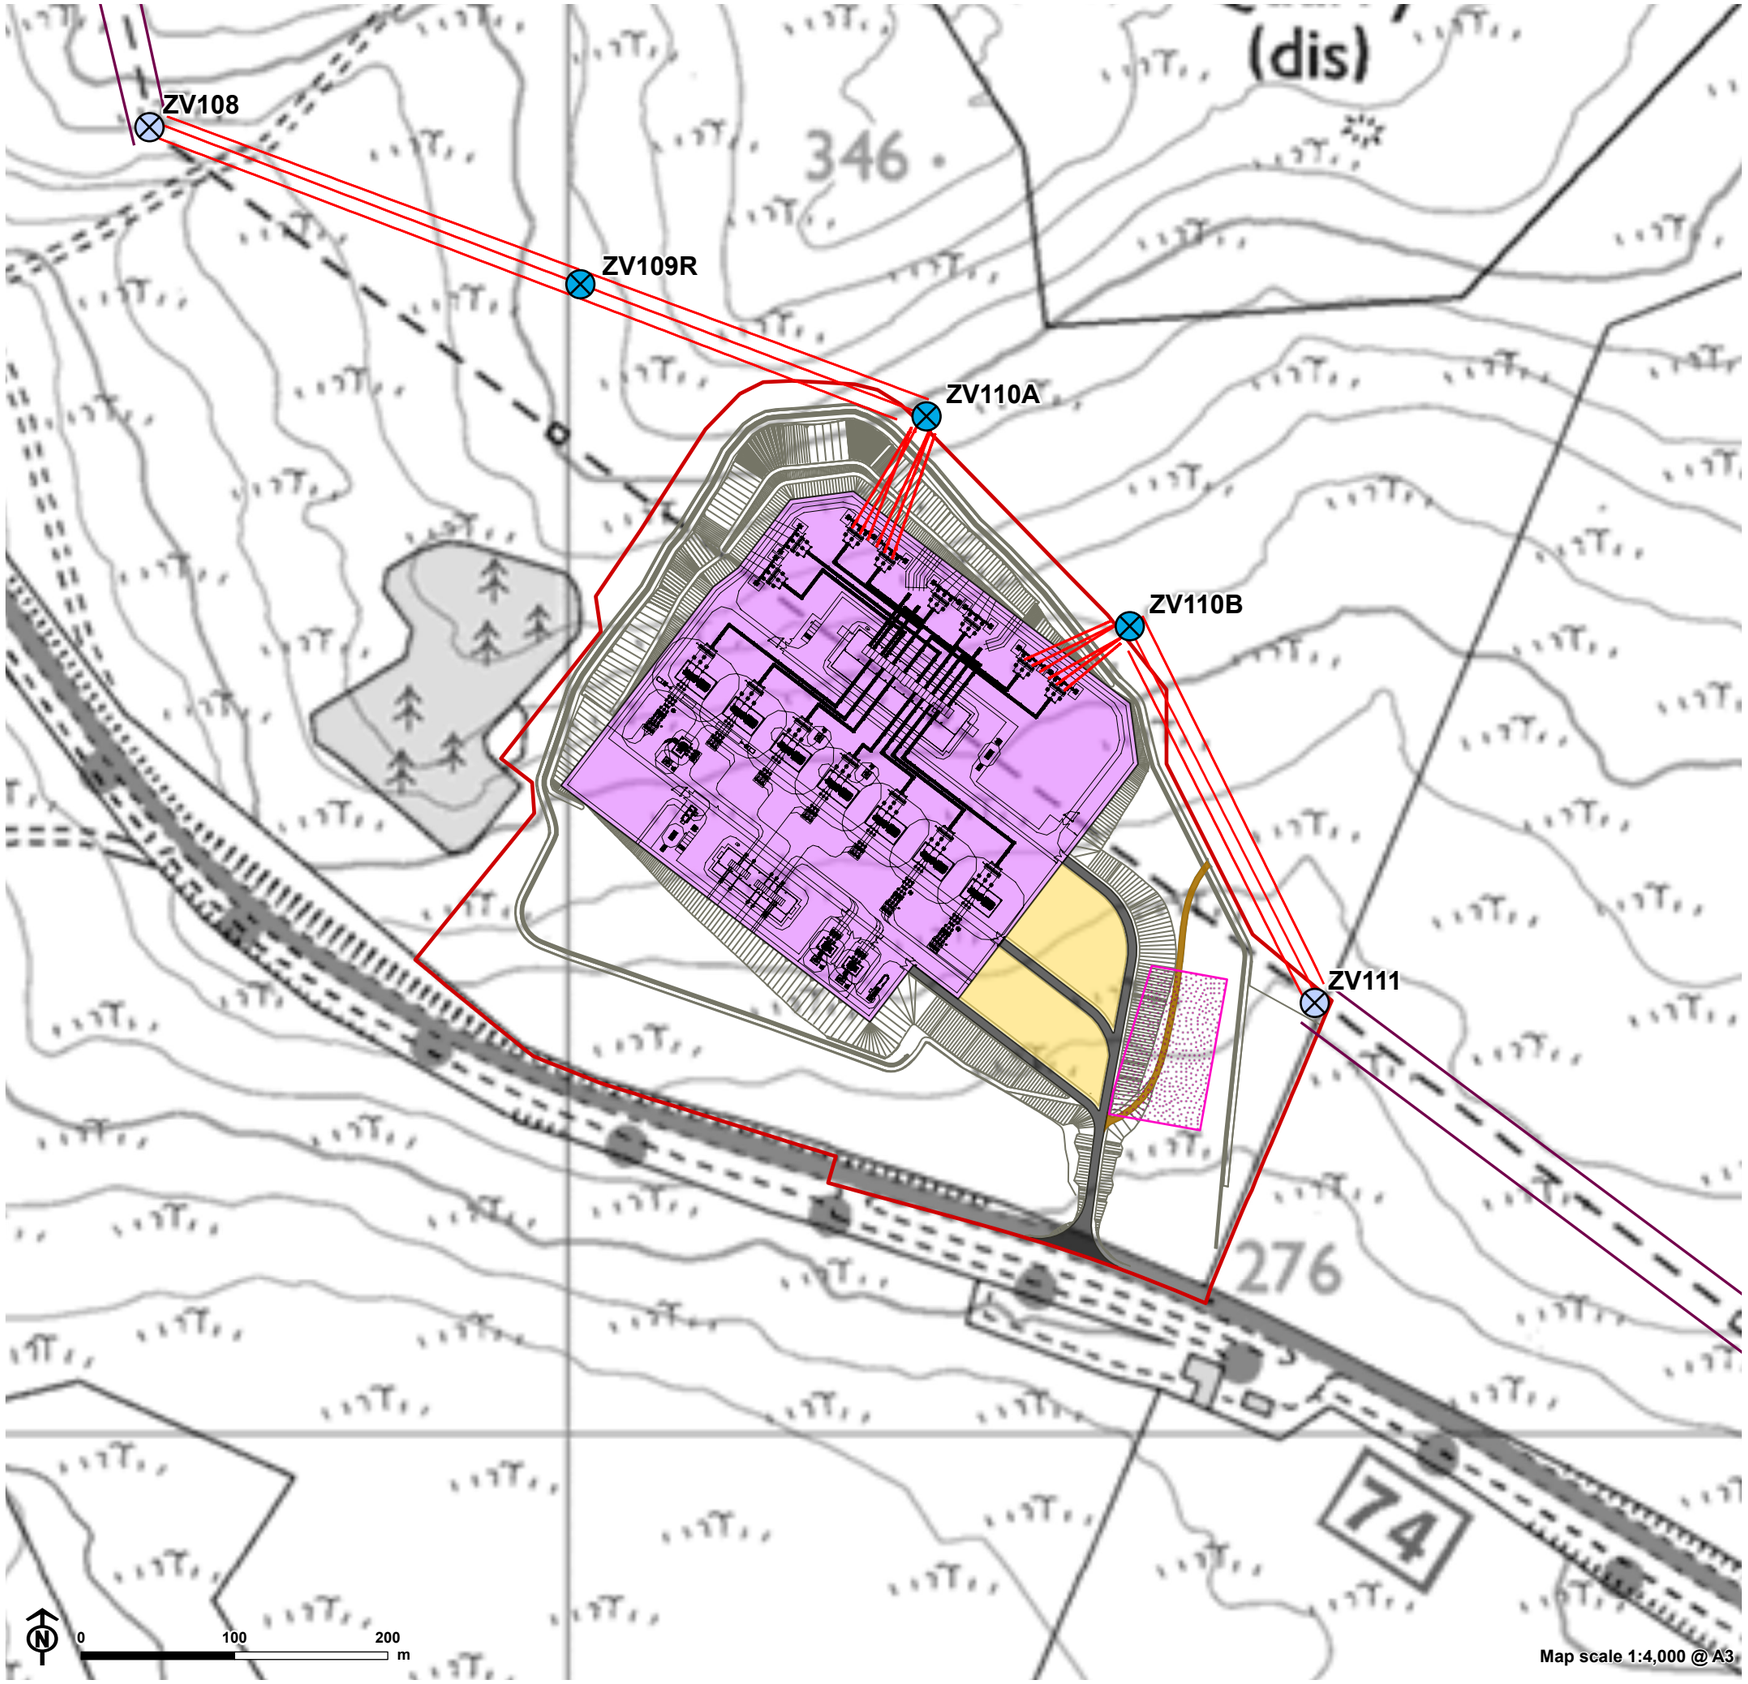

- Site boundary
- Proposed Redshaw Substation
- Proposed temporary compound
- Proposed access road
- Proposed farmer's access track
- Proposed laydown space
- Proposed platform earth works
- Proposed electrical layout
- Proposed ZV diversion tower (pending determination)
- Proposed 400kV Overhead Line (OHL) ZV diversion (pending determination)
- Existing tower
- Existing 400kV Overhead Line (OHL) - ZV route

Note:
ZV diversion subject to a separate consenting process.

SP Energy Networks

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122