


Figure 4.1: LVIA study area

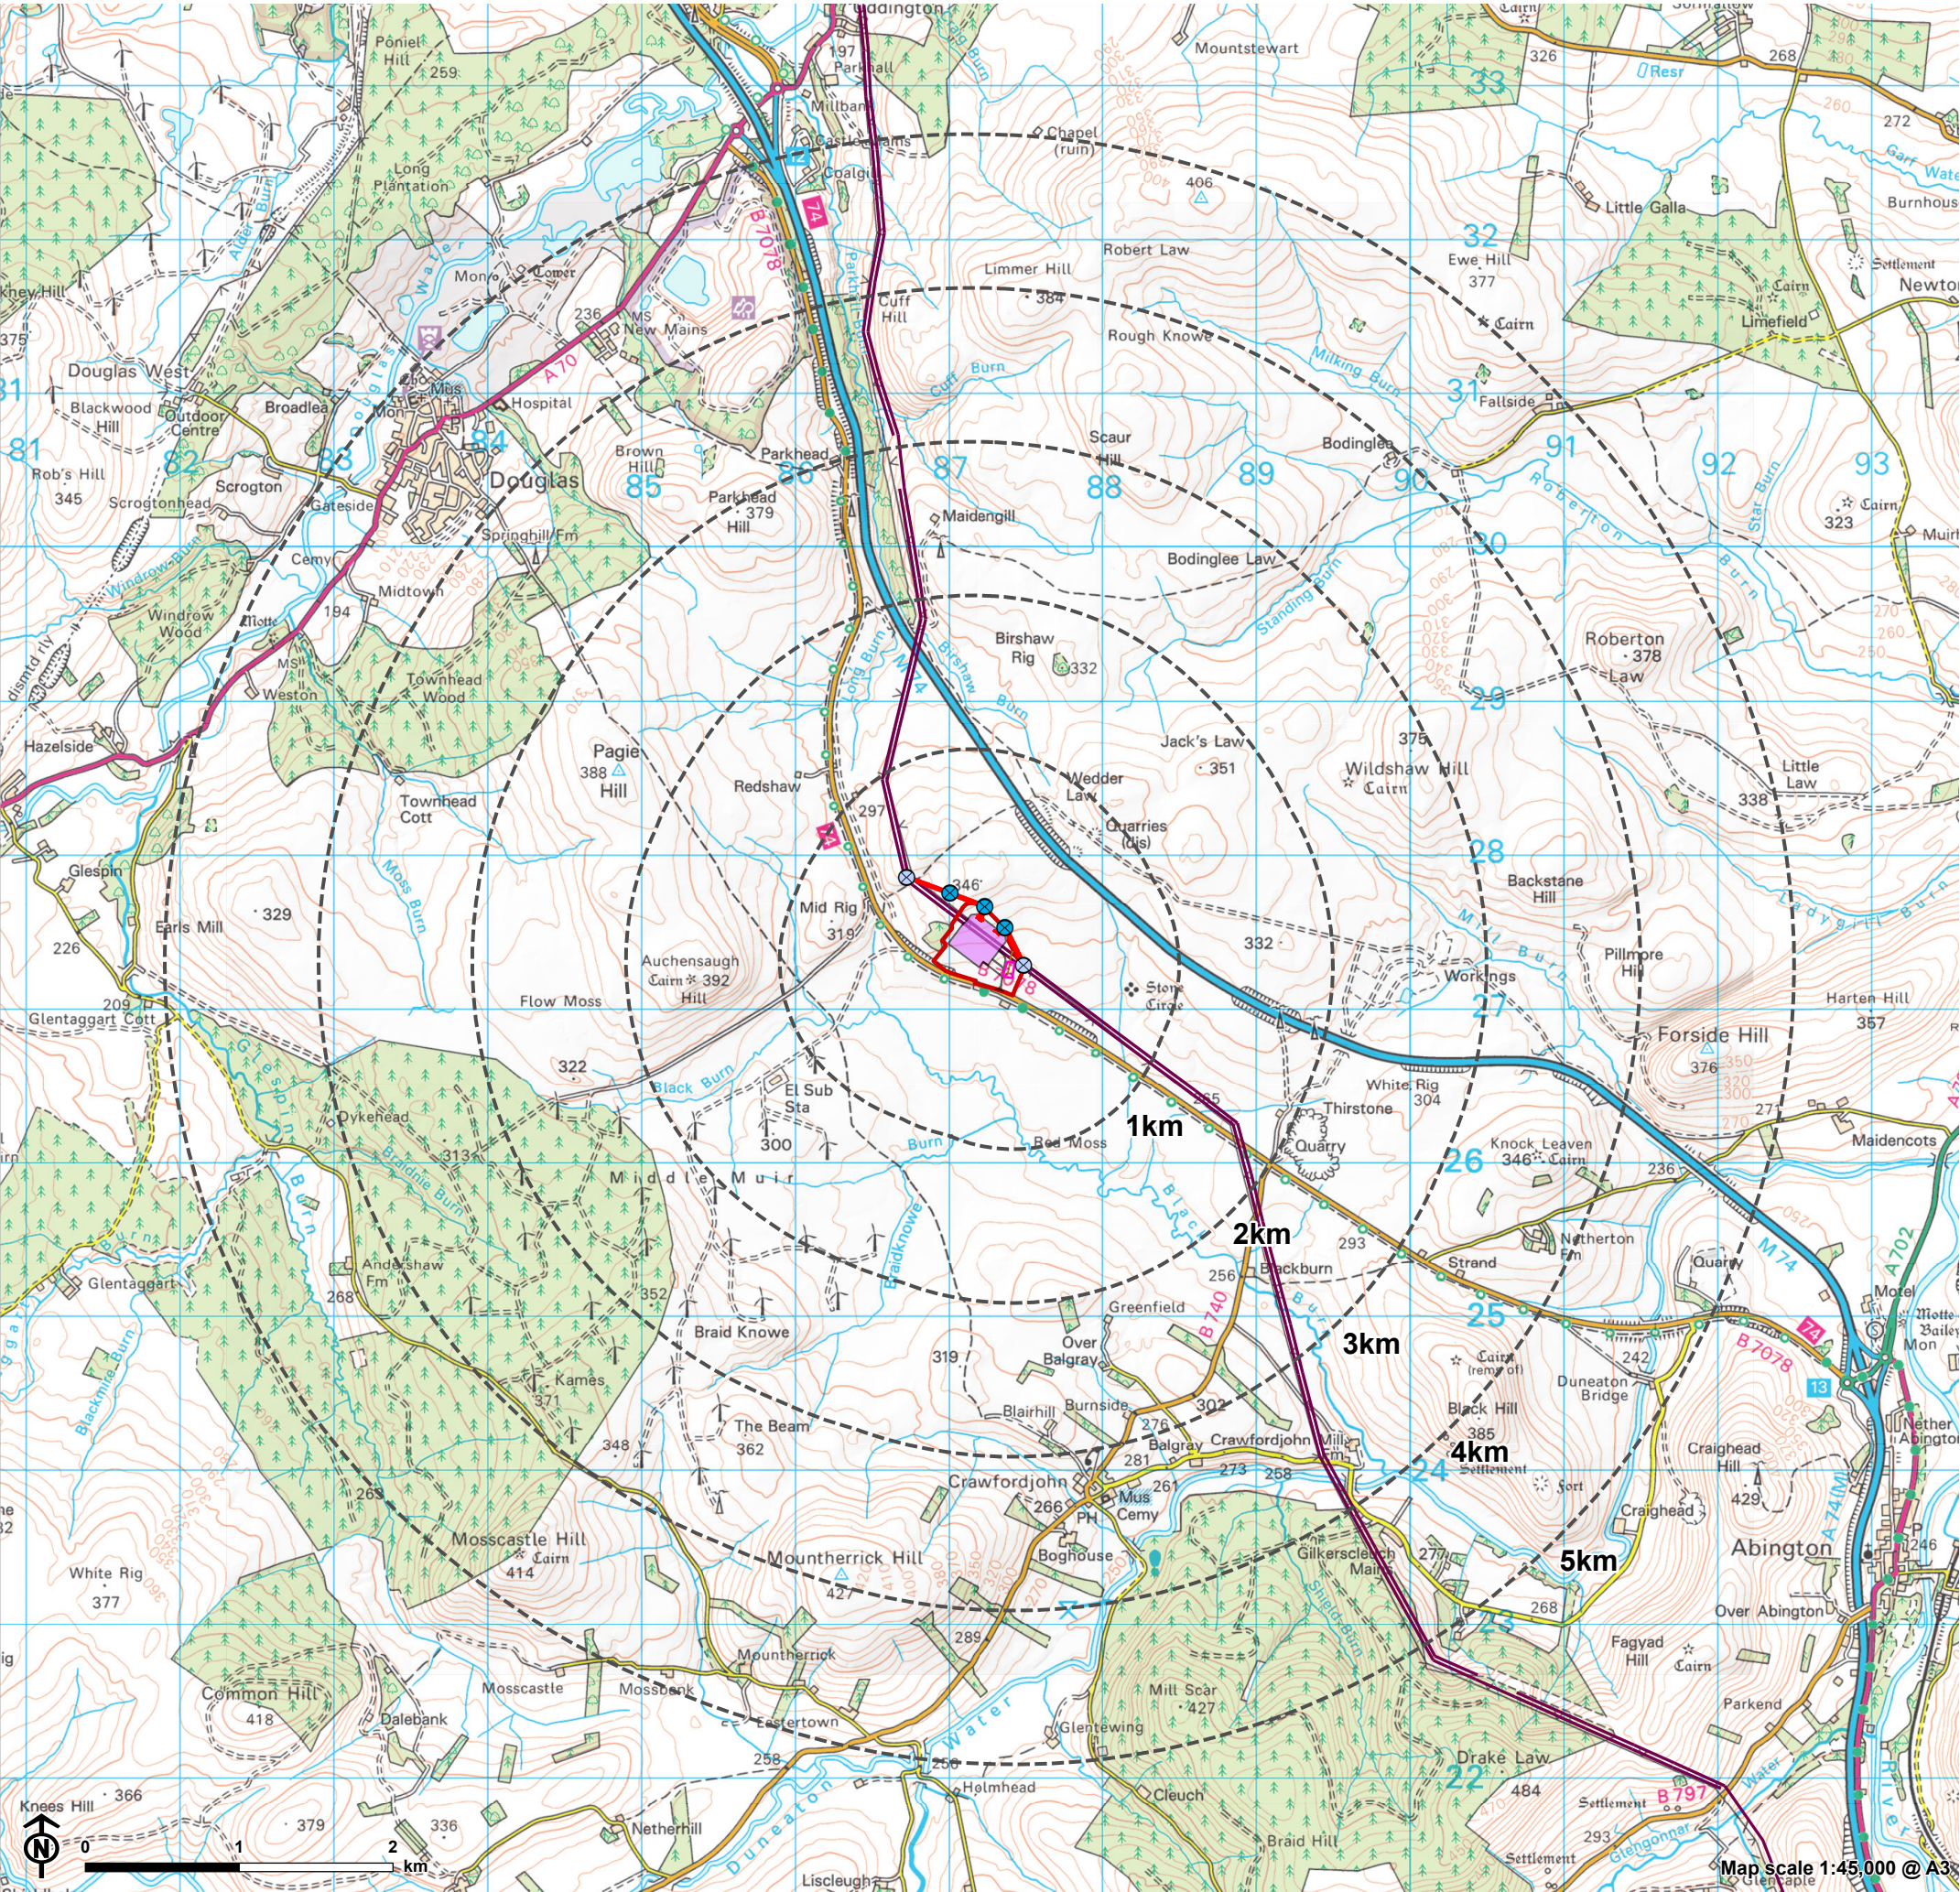

- Site boundary
- 1km interval from site boundary
- Proposed Redshaw Substation
- Proposed temporary compound
- Proposed access road
- Proposed farmer's access track
- Proposed ZV diversion tower (pending determination)
- Proposed 400kV Overhead Line (OHL) ZV diversion (pending determination)
- Existing tower
- Existing 400kV Overhead Line (OHL) - ZV route

**Note:**  
ZV diversion subject to a separate consenting process.