

## KTR Project Section 37

### KTR Section 37 Polquhanity to Glenlee (via Kendoon) and Removal of N and R Route (North) - Location Plan


- Polquhanity sealing end and terminal tower
- Substation and hydro electricity generating station
- Polquhanity to Glenlee via Kendoon (steel lattice tower)
- Existing tower for removal - Routes 'N' and 'R' (North)

**Note:** For the purposes of the EIA and S37 application R route has been divided into North and South at the Glenlee substation

Tower DE102R grid reference: NX591894  
Tower 35 grid reference: NX607806





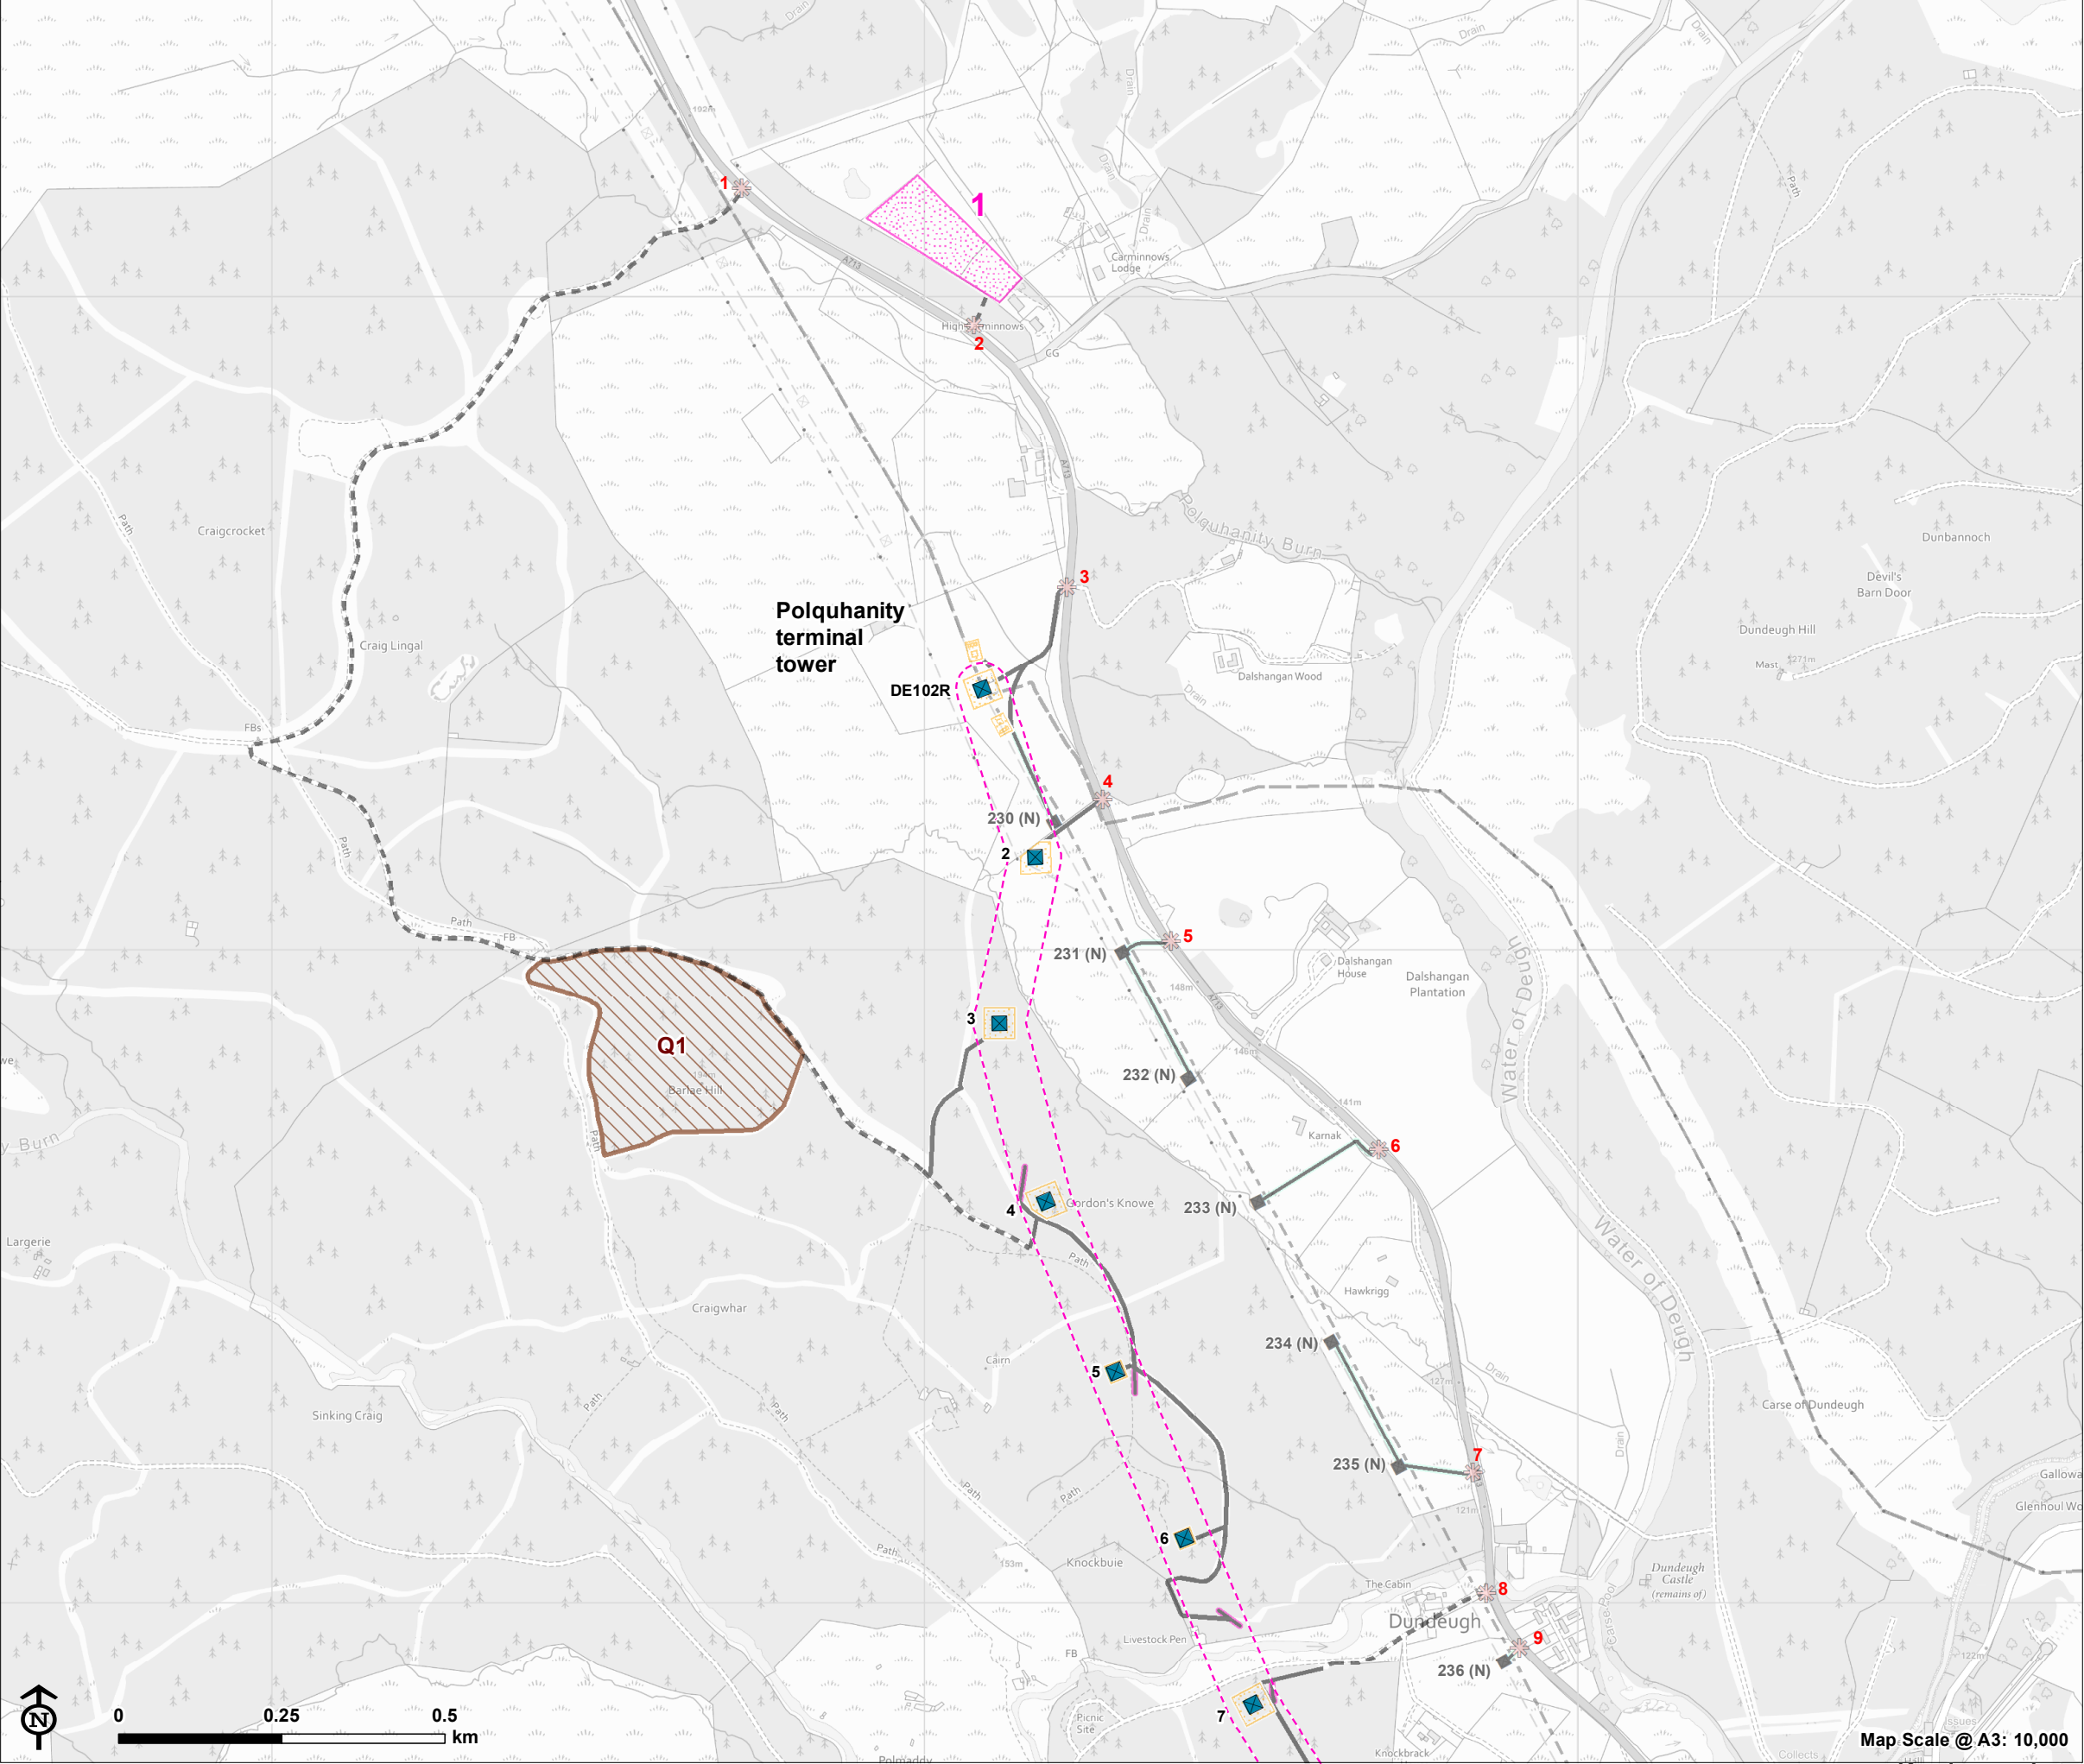

# KTR Project Section 37


## KTR Section 37 Polquhanity to Glenlee - Site Plan

- Overhead line infrastructure**
- Polquhanity to Glenlee via Kendoon (steel lattice tower)
  - Existing tower for removal
  - Existing 132kV overhead line to be removed (following construction of the KTR Project)
  - Existing network
- Access to proposed towers**
- Existing access
  - New access
  - Timber extraction spur
- Access to towers for removal**
- New access
  - Access point
  - Construction compound
  - Working area
  - Potential quarry working area
  - 80m Wayleave

**Note:**  
Tower DE102R grid reference: NX591894  
Tower 35 grid reference: NX607806





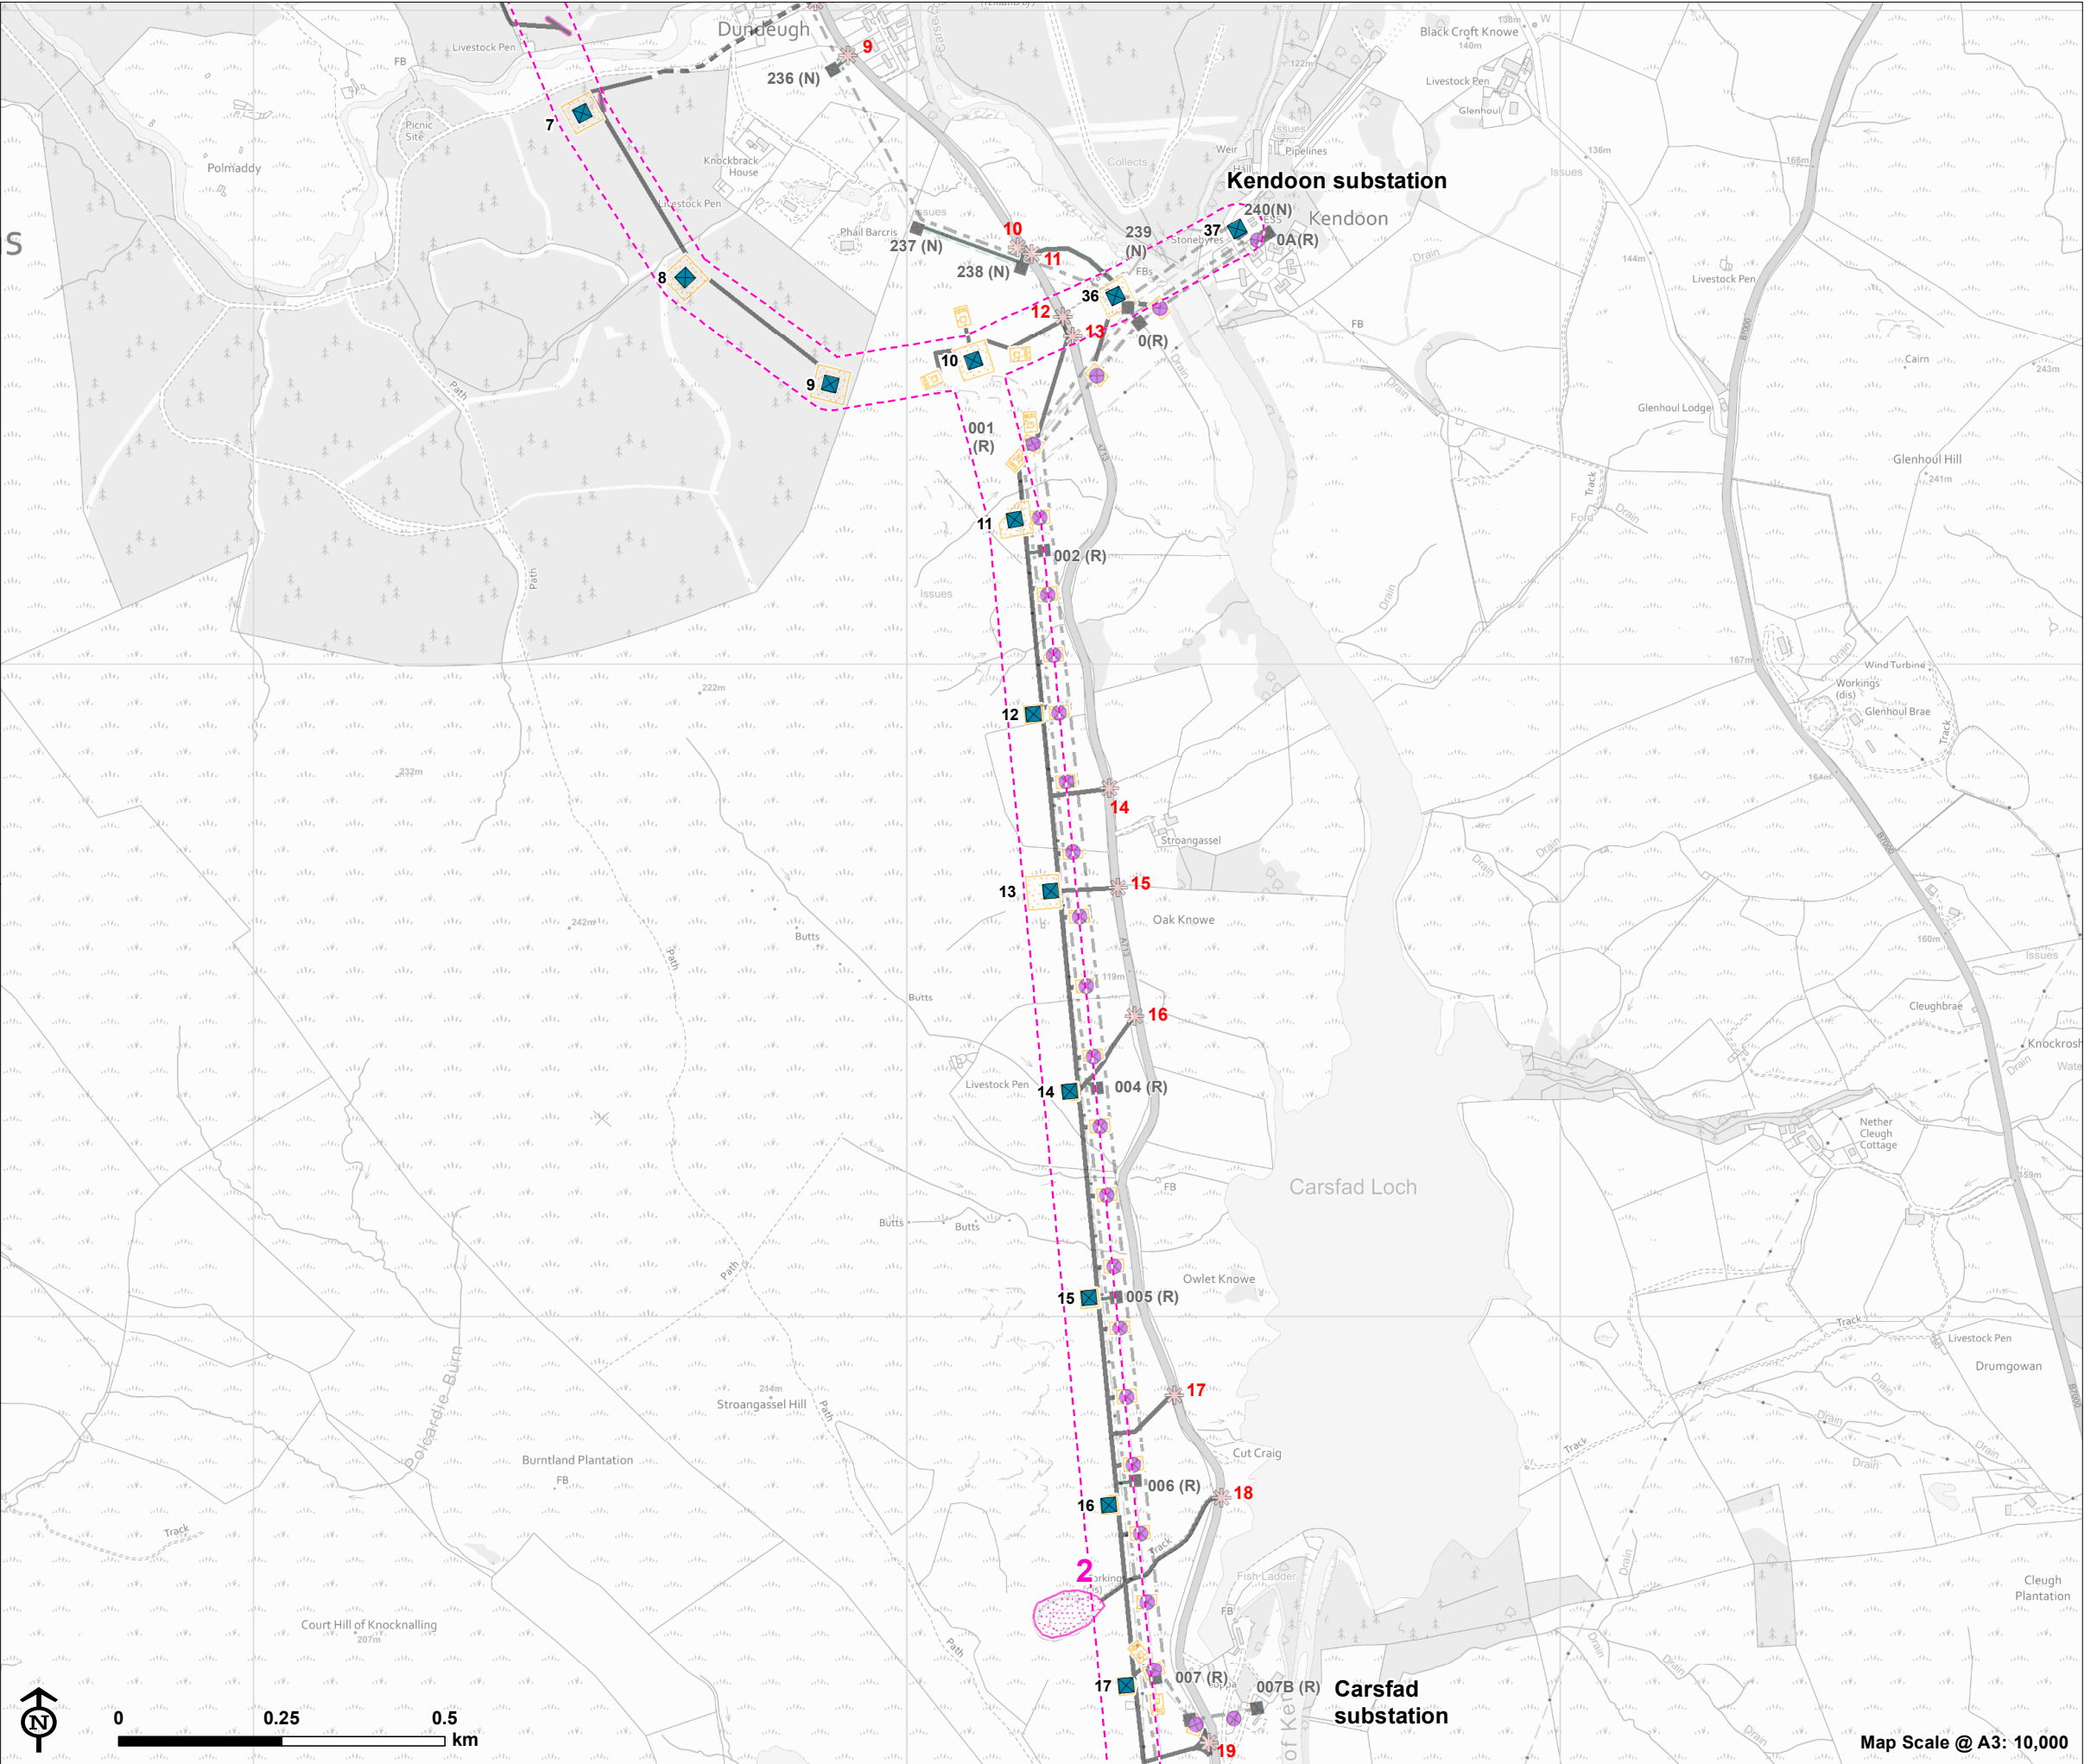

## KTR Project Section 37

### KTR Section 37 Polquharity to Glenlee - Site Plan

#### Overhead line infrastructure

- Polquharity to Glenlee via Kendoon (steel lattice tower)
- Carsfad to Kendoon (wood pole)
- Existing tower for removal
- Existing 132kV overhead line to be removed (following construction of the KTR Project)


#### Access to proposed towers

- Existing access
- New access
- Timber extraction spur

#### Access to towers for removal

- New access
- Access point
- Construction compound
- Working area
- 80m Wayleave

**Note:**  
Tower DE102R grid reference: NX591894  
Tower 35 grid reference: NX607806

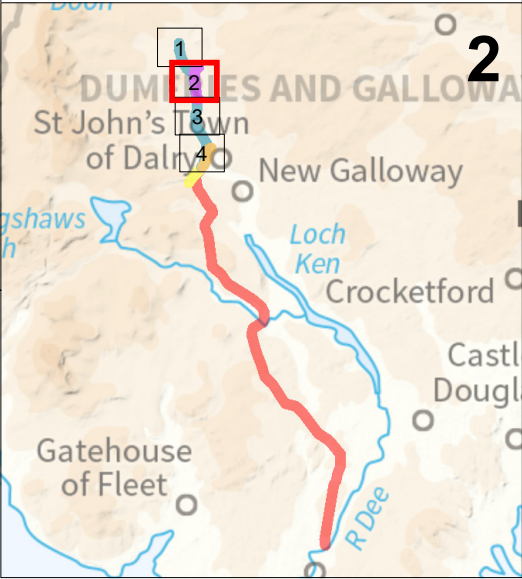





## KTR Project Section 37

### KTR Section 37 Polquhanty to Glenlee - Site Plan

**Overhead line infrastructure**

- Polquhanty to Glenlee via Kendoon (steel lattice tower)
- Carsfad to Kendoon (wood pole)
- Existing tower for removal
- Existing 132kV overhead line to be removed (following construction of the KTR Project)

**Access to proposed towers**

- Existing access
- New access
- Timber extraction spur

**Access to towers for removal**

- Existing access
- New access
- Access point
- Construction compound
- Working area
- 80m Wayleave

**Note:**  
Tower DE102R grid reference: NX591894  
Tower 35 grid reference: NX607806



