


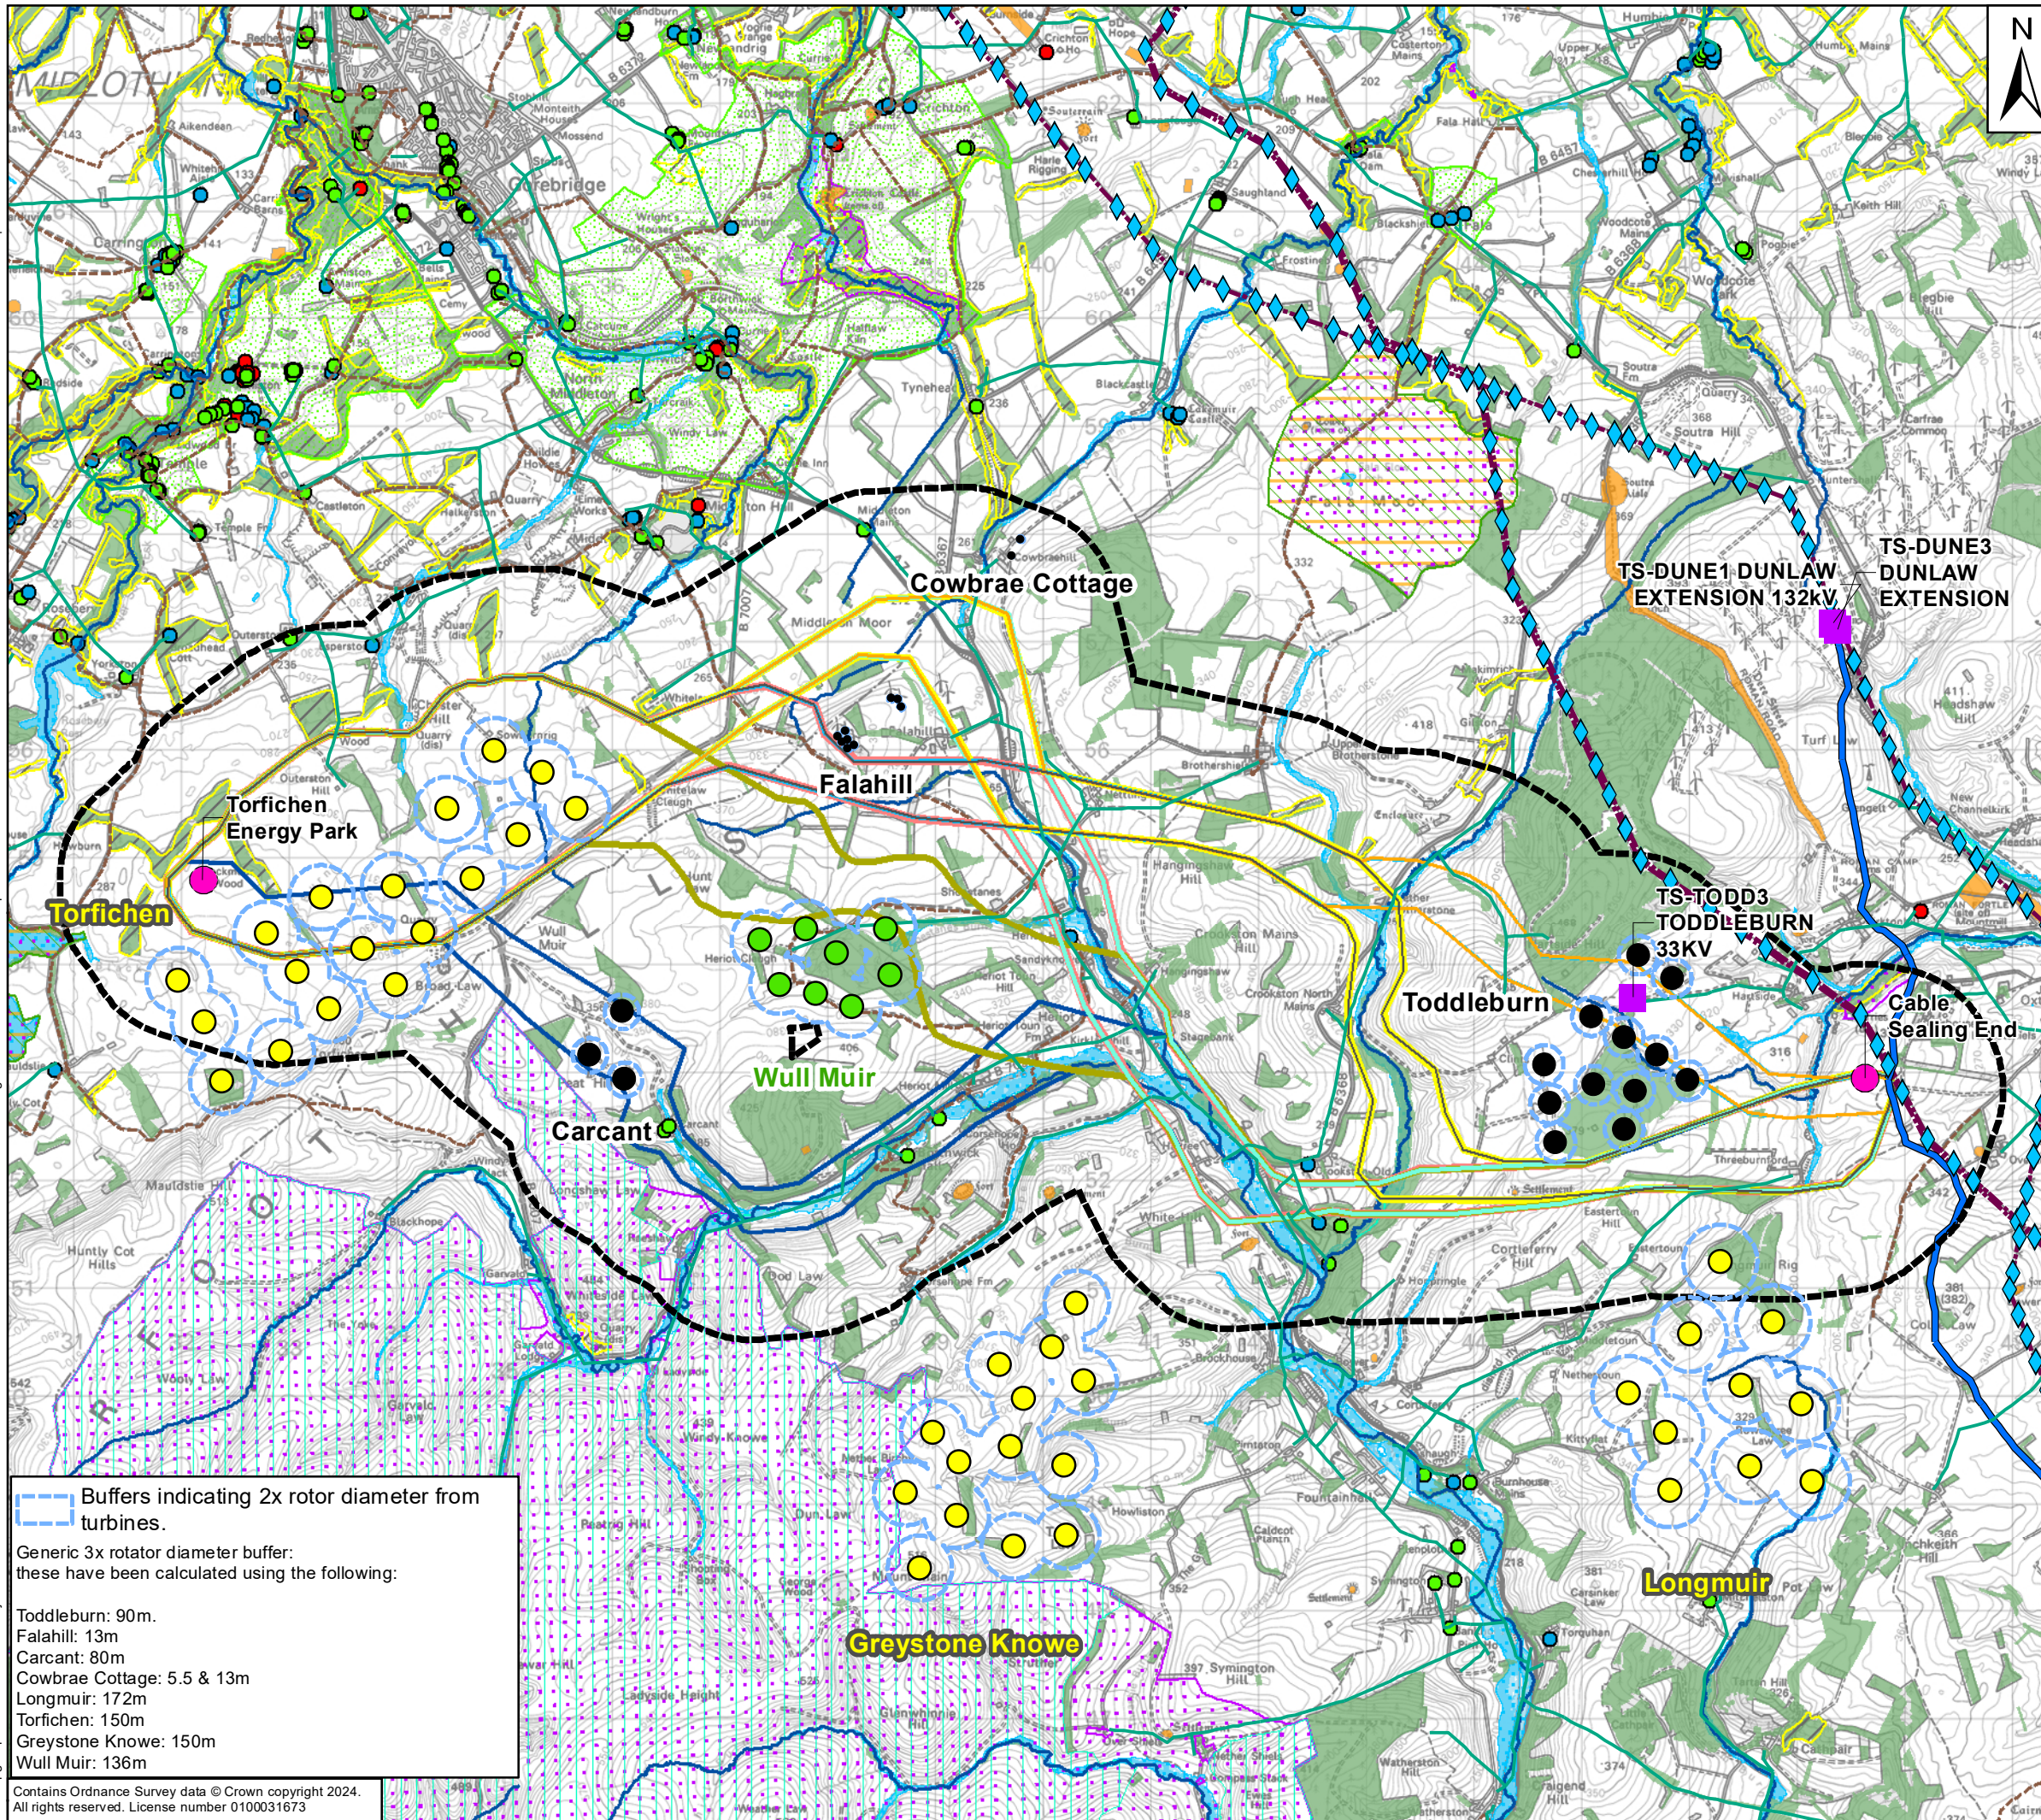

Legend:

- Route 1
- Route 2
- Route 3
- Route 4
- Route 5
- Route 6
- Route 7
- Route 8
- 2x rotor exclusion zone
- 1km Study Area
- SPT Transmission Substation
- SPT Transmission Towers
- Substation
- Existing
- In-planning
- Consented
- 11kV OHL Line
- 33kV OHL Line
- SPT Transmission OHL
- Core Paths
- River
- Grade A Listed Building
- Grade B Listed Building
- Grade C Listed Building
- Conservation Areas
- Scheduled Monuments
- Special Protection Areas
- Special Areas of Conservation
- Sites of Special Scientific Interest
- Ancient Woodland Inventory
- National Forest Inventory
- Ramsar Sites
- Flood Zone - Low Risk
- Flood Zone - Medium Risk
- Flood Zone - High Risk

Edinburgh

0 2 4 Km

WSP 8 First Street
Manchester,
M15 4RP,
UK
T+ 44 161 200 5000

Client:

SP Energy Networks

Project

Torfichen 132kV OHL Connection

Title:

Cumulative Developments

Drawing No: Figure 10

Date: 12/09/2025

Scale: 60,000 @ A3

Drawn: PB

Checked: RT

Approved: RT

Buffers indicating 2x rotor diameter from turbines.

Generic 3x rotor diameter buffer:
these have been calculated using the following:

Toddleburn: 90m.
Falahill: 13m
Carcant: 80m
Cowbrae Cottage: 5.5 & 13m
Longmuir: 172m
Torfichen: 150m
Greystone Knowe: 150m
Wull Muir: 136m