
Appendix 4.3


Wayleave Treatment Indicative Planting




Appendix 4.3
Wayleave Treatment Indicative Planting (Structure - L7c)

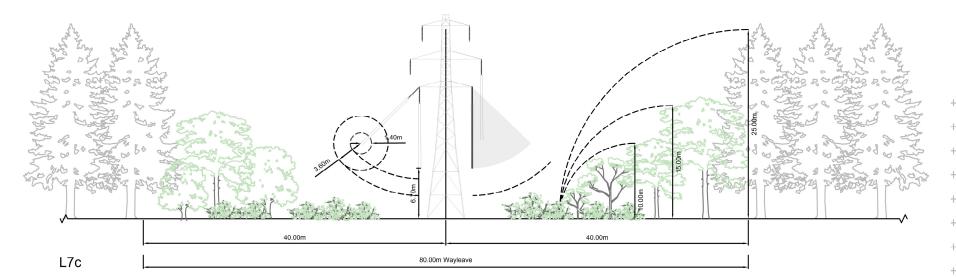

Section B : At Tower

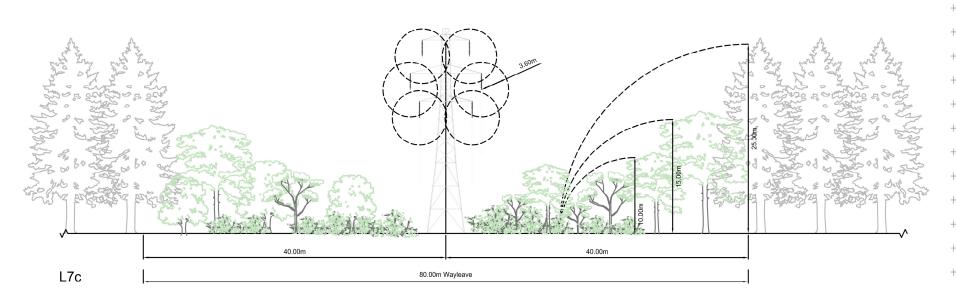

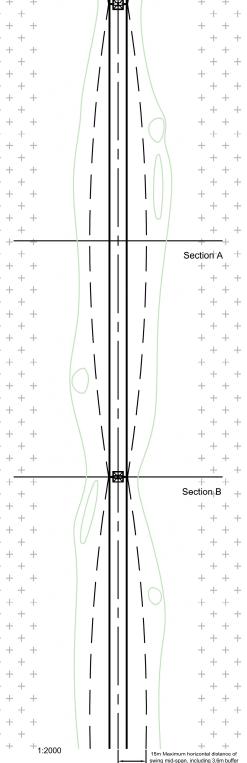

Boundary of wayleave to be softened with an irregular, scalloped edge, graduated vegetation height and "islands' of planting

Diagrammatic plan view of typical wayleave treatment Vegetation outwith wayleave Overhead Line Tower position Extent of outward swing of conductor Mixed scrub/woodland - Maximum vegetation height to comply with ENA43-8 and GS6 Ground cover - Maximum vegetation height to comply with ENA43-8 and GS6 Notes All works outwith the OHL to comply with ENA43-8 and GS6 Maximum conductor swing under blowout is 45° Do not scale from this drawing. All dimensions are drawn in millimetres. Drawing & design copyright LUC. Reproduction of this drawing in whole or in part is prohibited without prior permission.

